

AUG 19 1952

# Fire Tests of Steel Columns Protected With Siliceous Aggregate Concrete



United States Department of Commerce  
National Bureau of Standards  
Building Materials and Structures Report 124

## BUILDING MATERIALS AND STRUCTURES REPORTS

On request, the Superintendent of Documents, U. S. Government Printing Office, Washington 25, D. C., will place your name on a special mailing list to receive notices of new reports in this series as soon as they are issued. There will be no charge for receiving such notices.

An alternative method is to deposit with the Superintendent of Documents the sum of \$5, with the request that the reports be sent to you as soon as issued, and that the cost thereof be charged against your deposit. This will provide for the mailing of the publications without delay. You will be notified when the amount of your deposit has become exhausted.

If 100 copies or more of any report are ordered at one time, a discount of 25 percent is allowed. Send all orders and remittances to the *Superintendent of Documents, U. S. Government Printing Office, Washington 25, D. C.*

The following publications in this series are available by purchase from the Superintendent of Documents at the prices indicated:

BMS1	Research on Building Materials and Structures for Use in Low-Cost Housing .....	*
BMS2	Methods of Determining the Structural Properties of Low-Cost House Constructions ..	10¢
BMS3	Suitability of Fiber Insulating Lath as a Plaster Base .....	15¢
BMS4	Accelerated Aging of Fiber Building Boards .....	10¢
BMS5	Structural Properties of Six Masonry Wall Constructions .....	15¢
BMS6	Survey of Roofing Materials in the Southeastern States .....	15¢
BMS7	Water Permeability of Masonry Walls .....	*
BMS8	Methods of Investigation of Surface Treatment for Corrosion Protection of Steel .....	15¢
BMS9	Structural Properties of the Insulated Steel Construction Co.'s "Frameless-Steel" Constructions for Walls, Partitions, Floors, and Roofs .....	10¢
BMS10	Structural Properties of One of the "Keystone Beam Steel Floor" Constructions Sponsored by the H. H. Robertson Co. ....	10¢
BMS11	Structural Properties of the Curren Fabrihome Corporation's "Fabrihome" Constructions for Walls and Partitions .....	10¢
BMS12	Structural Properties of "Steelox" Constructions for Walls, Partitions, Floors, and Roofs Sponsored by Steel Buildings, Inc. ....	15¢
BMS13	Properties of Some Fiber Building Boards of Current Manufacture .....	10¢
BMS14	Indentation and Recovery of Low-Cost Floor Coverings .....	10¢
BMS15	Structural Properties of "Wheeling Long-Span Steel Floor" Construction Sponsored by the Wheeling Corrugating Co. ....	10¢
BMS16	Structural Properties of a "Tilecrete" Floor Construction Sponsored by Tilecrete Floors, Inc. ....	10¢
BMS17	Sound Insulation of Wall and Floor Constructions .....	20¢
Supplement to BMS17	Sound Insulation of Wall and Floor Constructions .....	5¢
Supplement No. 2 to BMS17	Sound Insulation of Wall and Floor Constructions .....	15¢
BMS18	Structural Properties of "Pre-fab" Constructions for Walls, Partitions, and Floors Sponsored by the Harnischfeger Corporation .....	10¢
BMS19	Preparation and Revision of Building Codes .....	†
BMS20	Structural Properties of "Twachtman" Constructions for Walls and Floors Sponsored by Connecticut Pre-Cast Buildings Corporation .....	10¢
BMS21	Structural Properties of a Concrete-Block Cavity-Wall Construction Sponsored by the National Concrete Masonry Association .....	10¢
BMS22	Structural Properties of "Dun-Ti-Stone" Wall Construction Sponsored by the W. E. Dunn Manufacturing Co. ....	10¢
BMS23	Structural Properties of a Brick Cavity-Wall Construction Sponsored by the Brick Manufacturers Association of New York, Inc. ....	10¢
BMS24	Structural Properties of a Reinforced-Brick Wall Construction and a Brick-Tile Cavity-Wall Construction Sponsored by the Structural Clay Products Institute .....	15¢
BMS25	Structural Properties of Conventional Wood-Frame Constructions for Walls, Partitions, Floors, and Roofs .....	20¢
BMS26	Structural Properties of "Nelson Pre-Cast Concrete Foundation" Wall Construction Sponsored by the Nelson Cement Stone Co., Inc. ....	10¢
BMS27	Structural Properties of "Bender Steel Home" Wall Construction Sponsored by the Bender Body Co. ....	10¢
BMS28	Backflow Prevention in Over-Rim Water Supplies .....	15¢
BMS29	Survey of Roofing Materials in the Northeastern States .....	20¢
BMS30	Structural Properties of a Wood-Frame Wall Construction Sponsored by the Douglas Fir Plywood Association .....	15¢
BMS31	Structural Properties of "Insulite" Wall and "Insulite" Partition Constructions Sponsored by The Insulite Co. ....	25¢

\*Out of print.

†Superseded by BMS116.

[List continued on cover page III]

# Fire Tests of Steel Columns Protected With Siliceous Aggregate Concrete

Nolan D. Mitchell



Building Materials and Structures Report 124

Issued May 25, 1951



## Foreword

This report, one of a series issued by the National Bureau of Standards on building materials and structures, presents the results of fire tests of four steel building columns protected by concrete made with certain highly siliceous aggregates. The results of the column tests were further confirmed by tests on concrete walls made with the same aggregates. Such materials are available in widely distributed areas, and are common constituents of much of the commercially available concretes.

The fire-endurance limits of protected columns described in this report may serve as a guide for the selection of constructions to meet building code requirements, and as a measure of the extent of compliance of building practice with existing codes.

E. U. CONDON, *Director.*

## CONTENTS

	Page
Foreword .....	III
I. Introduction .....	1
II. Materials .....	2
1. Steel columns .....	2
2. Concrete .....	2
III. Construction of columns .....	4
1. Placement of concrete .....	4
2. Workmanship .....	4
3. Seasoning of concrete .....	4
IV. Equipment and method of testing .....	5
1. Equipment .....	5
2. Method of testing .....	5
(a) Bearing of columns .....	5
(b) Restraint of columns .....	5
(c) Loads on columns .....	5
(d) Measurement of deformations .....	5
(e) Test specification .....	5
V. Results of tests .....	6
1. Columns 1 and 2—Potomac River gravel aggregate concrete protections ..	6
2. Columns 3 and 4—Milky and clear quartz aggregate concrete protections ..	6
VI. Summary and discussion .....	6



# Fire Tests of Steel Columns Protected With Siliceous Aggregate Concrete

Nolan D. Mitchell

Results of fire-endurance tests of four 6-in. steel H-columns protected with concrete made with highly siliceous aggregates are presented.<sup>1</sup> The concrete was of 2-in. thickness around the column shaft and filled the reentrant spaces. The aggregates investigated were river gravel and crushed quartz.

The columns were subjected to load throughout the tests. The loads on three columns of magnitude as computed by a standard formula for allowable load were constant. One column sustained a double load throughout the earlier part of the test.

The fire-endurance limits ranged from 2 hr 50 min for a column with crushed quartz aggregate concrete to 3 hr 34 min for one with gravel aggregate concrete. The results were consistent for columns protected with gravel aggregate concrete, and within reasonable limits for columns covered with quartz aggregate concrete.

The results of the column tests with respect to lack of spalling of the concrete were confirmed by tests on concrete wall slabs made with the same or like aggregates.

## I. Introduction

Fire-endurance tests were conducted at the National Bureau of Standards on four 6-in. 20-lb H-columns having protective coverings of siliceous aggregate concrete. The aggregate for the concrete on two columns was Potomac River sand and gravel, on the third crushed milky quartz, and on the fourth clear crushed quartz. These aggregates are widespread both in distribution and use and are available in the vicinity of Washington, D. C.

The information developed by these tests supplements that derived from the tests of columns with concrete coverings included in the series of tests conducted jointly by the Associated Factory Mutual Fire Insurance Companies, the National Board of Fire Underwriters, and the National Bureau of Standards, at Underwriters' Laboratories, Chicago, in 1917-18.<sup>2</sup> Related through use of siliceous aggregates are the fire tests of concrete columns conducted at the former Pittsburgh testing station of the National Bureau of Standards.<sup>3</sup>

In the early tests, it was observed that column protections of concrete made with highly siliceous gravel aggregates cracked and spalled so as to expose the steel shaft or reinforcing of the column before its temperature had reached the critical range for failure under load. Further, siliceous aggregate concrete monolithic floors and walls showed varying and contradictory behavior in fire tests. To illustrate, a 6-in.-thick concrete

floor slab made with Potomac River gravel concrete began spalling within 35 min after the start of the fire-endurance test. At 1 hr 45 min the fire had penetrated through a large hole formed in the spalled area. However, another floor specimen and three wall specimens made of concrete having aggregate from the same source showed no tendency to spall. The best surmise possible from the meager data was that the spalling could be due to the disruptive effect caused by superheating of water entrapped in the dense concrete.

The tests of columns at the National Bureau of Standards were for the purpose of again investigating the reaction of siliceous aggregate concretes to fire exposure, especially under the conditions of high stress peculiar to column encasements. To supplement the tests on the columns encased with siliceous aggregate concrete, results are given for four walls constructed of similar concretes. Three of these were made with Potomac River gravel and one with the crushed quartz that served as both the fine and coarse aggregates for the coverings of two of the four columns.

The columns, which were alike in size, were tested under an allowable load computed from a formula recommended by the American Institute of Steel Construction. However, as no tendency of the concrete to spall was evident in the first test, the second of the columns with gravel aggregate concrete protection was subjected to twice the load of the other columns until a specified temperature of the steel was attained to determine whether excessive strain would induce spalling of the encasement, after which the load was re-

<sup>1</sup> The term "siliceous" as used herein conforms to the usage in building codes in which it is construed to embrace the minerals composed wholly or largely of quartz, chert, flint, etc.

<sup>2</sup> Fire tests of building columns, Underwriters' Laboratories, 1920; also published as B. S. Tech. Pap. T184 (1921).

<sup>3</sup> Fire resistance of concrete columns by W. A. Hull and S. H. Ingberg, B. S. Tech. Pap. T272 (1925).

duced to that of the formula and maintained until failure had occurred.

The failure of silica gravel concrete protection observed early in the test at the Underwriters' Laboratories was not duplicated in the present tests. The fire-endurance limits for the columns of this series ranged from 2 hr 50 min to 3 hr 34 min.

It should be noted that, although both groups of tests used concrete made with siliceous aggregates, there was dissimilarity in composition of the aggregates of the two groups. The aggregates of the concrete that failed earliest in the tests at the Underwriters' Laboratories contained 98

percent of chert, whereas the aggregate for the concrete used for the present tests consisted of either a mixture containing principally quartz, sandstone, and quartzite, with only a minor quantity of chert or a relatively pure crushed quartz. Also, despite the general assumption of poor performance of siliceous aggregate concretes, columns protected with this material have shown a reasonable resistance to fire. This is indicated by tests made at the Underwriters' Laboratories where an 8 in. column protected with 2 in. of sandstone concrete showed a fire-endurance limit exceeding 4 hr, even though considerable cracking and spalling of the concrete had occurred early in the test.

## II. Materials

### 1. Steel Columns

The column shafts were fabricated from 6-in. 20-lb stanchion sections 5.97 in.<sup>2</sup> in area. The heads of the columns were restrained for 32 to 33 in. by ½-in. plates of two types, leaving an effective column length of 124 in. End fittings were so applied as to allow the milled ends of the column shafts to rest directly on the 1½-in.-thick planed steel bearing plates. The column fitting assemblies were made with hot rivets. The least radius of gyration of the columns was 1.5 in. and the  $l/r$  ratio was 82.67. Figure 1 shows a column in place after a fire test. The details of the column shafts are shown in figure 2.

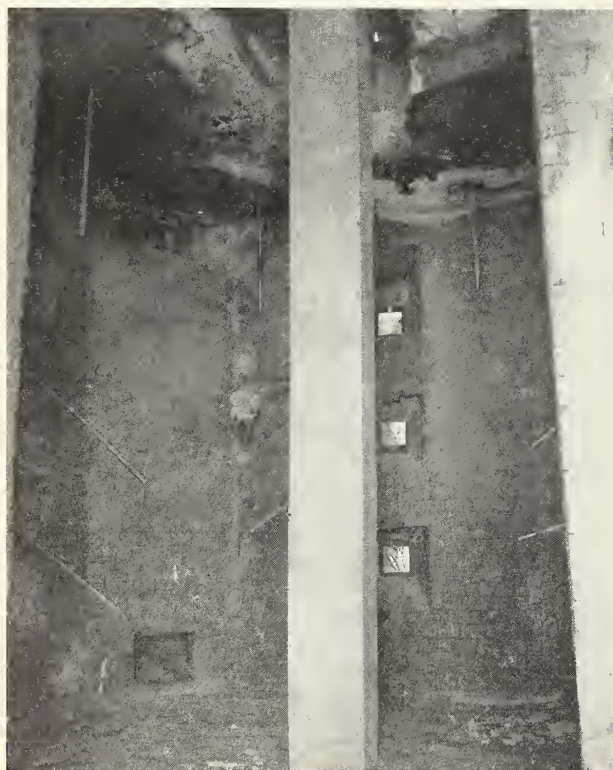


FIGURE 1. A test column in furnace after fire exposure.

### 2. Concrete

The concrete for encasing the first two columns of the tests was made of 1 part of portland cement, 2½ parts of Potomac River concrete sand, and 3½ parts of Potomac River gravel. Equal parts of two sizes of screened gravel were mixed to produce the coarse aggregate. The densities of the sand and screened gravel were determined, and the batches were proportioned by weight of materials. A typical batch consisted of 94 lb (1 bag) of cement, 300 lb of damp sand, 197 lb of fine gravel, 181 lb of coarse gravel and 6½ gal water.

The sieve and petrographic analyses of the aggregates used in the concretes are shown in table 1.

TABLE 1. Sieve and petrographic analyses of concrete aggregates

Sieve designation	Sieve analysis of concrete aggregates—percentage retained					
	Potomac River gravel	Potomac River sand	Clear crushed quartz	Milky crushed quartz	Clear crushed quartz sand	Milky crushed quartz sand
¾ in.	0.0	0.0	0.0	0.0	0.0	0.0
⅝ in.	50.0	.0	1.7	1.2	.0	.0
No. 4	50.0	4.9	40.3	42.6	.0	.0
No. 8	0.0	19.5	53.7	53.5	.0	.1
No. 16	.0	13.7	3.4	2.1	.2	.1
No. 30	.0	13.2	0.2	0.1	5.7	2.2
No. 50	.0	22.5	.1	.1	42.1	61.7
No. 100	.0	18.8	.2	.1	38.5	29.5
Pan	.0	7.4	.4	.3	13.5	6.4
Minerals	Petrographic analyses of concrete aggregates: Mineral content—percent					
	21	90	100	100	100	100
Vein quartz	38					
Quartzite	23					
Sandstone	12					
Chert		4				
Mica		6				
Other <sup>b</sup>						

<sup>a</sup> Potomac River gravel screened to size.

<sup>b</sup> One or more of the following: chlorite, magnetite, schist, gneiss.

In the tests, the third and fourth columns were covered with concrete made with fine and coarse aggregates of relatively high purity; that for one was of milky quartz, the other of a clear variety. Photomicrographs of these materials, figure 3,



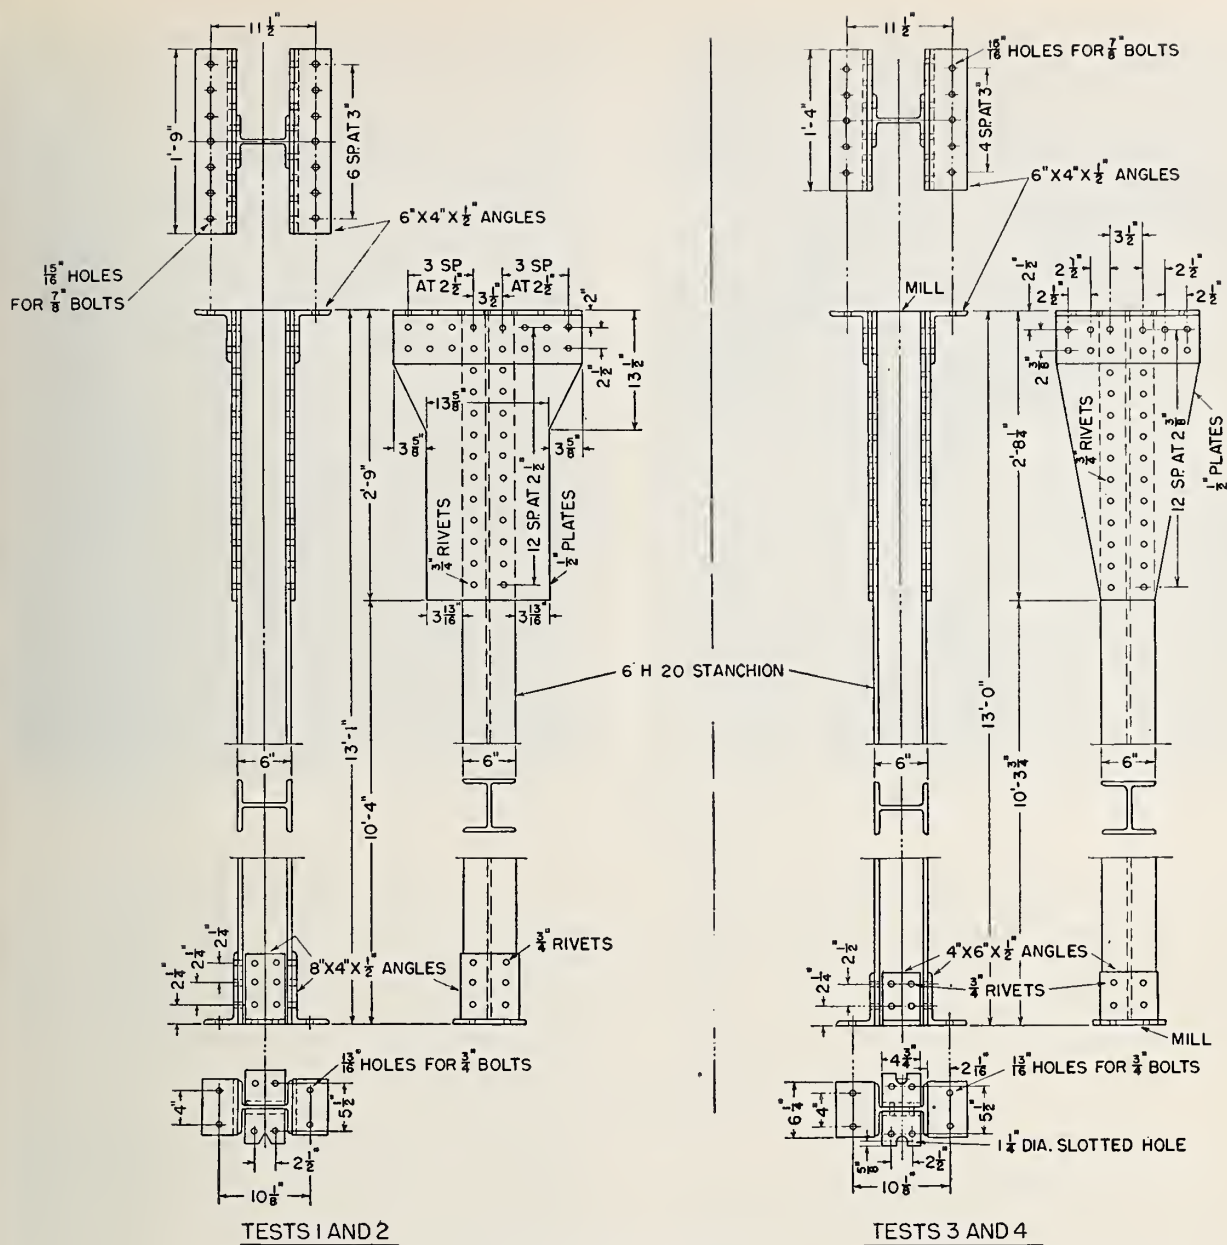


FIGURE 2. Details of columns.

show small inclusions. Because of the unusual grading of the coarse quartz aggregate, a workable mix was found to have the proportions approximately 1 part of cement, 3 parts of sand, and 2 parts of coarse aggregate. The batches were proportioned by weight and consisted of 94 lb (1 bag) of cement, 293 lb of quartz sand, and 195 lb of crushed quartz.

Each batch was mixed for not less than 1 1/2 min dry and 2 min wet. Three test cylinders were cast from each of four batches of Potomac River aggregate concrete and three each from the single full batches of the milky and of the clear-quartz aggregate concretes. The water was

controlled to give slumps of concrete in the range of 6 to 8 in.

The average compressive strength of the cylinders of Potomac River gravel aggregate concrete was 2,580 lb/in.<sup>2</sup>. The average batch strengths ranged from 2,240 to 2,800 lb/in.<sup>2</sup>. The initial tangent modulus of elasticity of six cylinders was  $2.97 \times 10^6$  lb/in.<sup>2</sup>. The modulus determined from stress-strain relations at a working load of 1,600 lb/in.<sup>2</sup> was  $2.03 \times 10^6$  lb/in.<sup>2</sup>.

For the concrete made with milky quartz aggregate, the average compressive strength of three cylinders was 1,930 lb/in.<sup>2</sup>. The initial

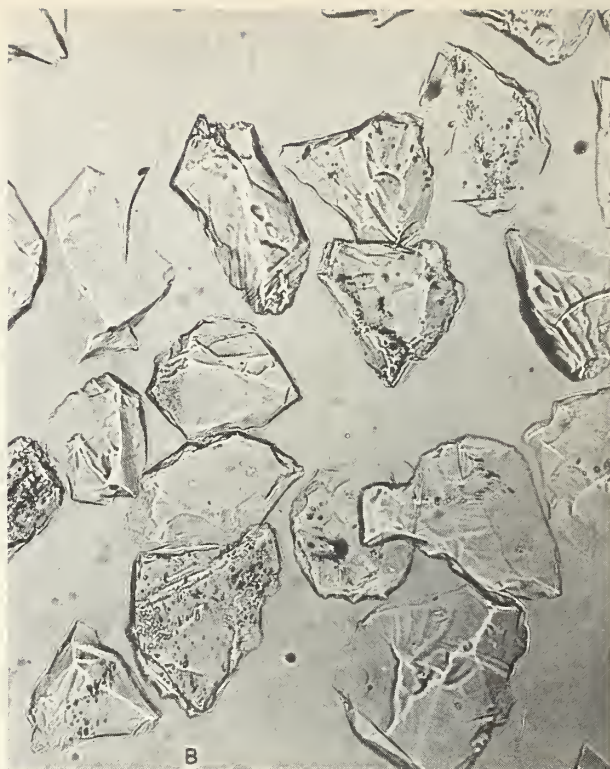
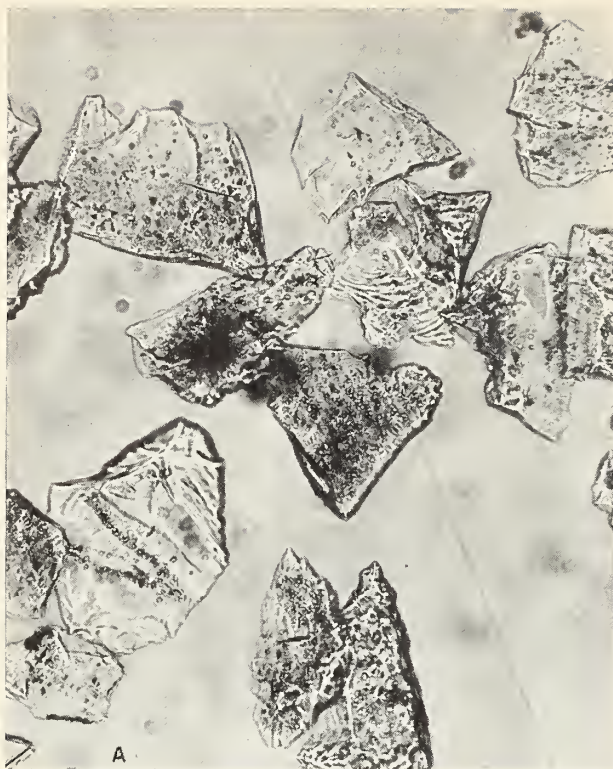


FIGURE 3. Photomicrographs of crushed quartz aggregates showing inclusions or voids (X96): A, milky; B, clear.

tangent elastic modulus as determined on one cylinder was  $2.8 \times 10^6$  lb/in<sup>2</sup>. The three cylinders made with clear quartz aggregate concrete had an average compressive strength of 2,600 lb/in<sup>2</sup>. The modulus of elasticity for one of these cylinders determined from the initial tangent was  $2.6 \times 10^6$  lb/in<sup>2</sup>.

In all of the tests, a No. 8 SWG wire (0.16 in.

in diameter) wound spirally around the column on an 8-in. pitch provided anchorage for the concrete covering. The wire spiral had 1-in. clearance at the midwidths of the column flanges, leaving a distance of 1 in. from the wire to the outside surface of the concrete. Thus the wire was covered with 1 in. of concrete at the midwidth of each of the four sides of the column.

### III. Construction of Columns

#### 1. Placement of Concrete

Plywood forms were spaced 2 in. on all sides from the vertically placed column shafts. Concrete poured into the tops of the forms was compacted around the columns by vibrating the sides of the forms with an air hammer. The few small voids, visible after the forms were removed, were filled with a cement and sand mortar.

A 4- by 8-ft. by 4-in.-thick wall slab was poured from the same batches of the clear and of the milky quartz aggregate concretes that were used for the column coverings. The slab was divided into quarters with the sections of like aggregate concrete diagonally opposite each other.

#### 2. Workmanship

The steel columns were of good commercial quality of fabrication. The concrete was of ordinary good workmanship with a mixing time exceeding that of the prescribed minimum, and was well placed with the exception that the form

around the enlarged portion of the top of one column was through inadvertence laterally displaced about 1 in. As this imperfection occurred in the upper restrained portion of the column, well above the section under test, it was thought incapable of adversely affecting the results.

#### 3. Seasoning of Concrete

The forms were stripped from the columns encased with Potomac River gravel concrete on the fifth day after pouring. The columns were kept moist for 8 days. Beginning the ninth day after removal of forms, the weights of the columns were checked until such time as drying was essentially complete. In 30 days, concrete that weighed approximately 2,900 lb had lost 37 lb, after which its weight remained constant.

The column protections of crushed quartz aggregate concrete were allowed to remain in the forms 15 days, after which the concrete was kept moist 5 days. The concrete was further seasoned under atmospheric conditions for 2½ months prior to test.



## IV. Equipment and Method of Testing

### 1. Equipment

The tests were made in gas-fired furnaces equipped with hydraulic jacks for applying load. The furnace, loading equipment, and the column under test are shown in figure 4. The furnace, while not originally designed for columns, was modified by an increase in height to accommodate a column having an effective length of 124 in.

The jack piston was raised by an electrically driven oil pump equipped for automatic control of pressures. The movable floor of the furnace rested on a spherical bearing block raised and lowered by the hydraulic jack.

Temperatures at 12 locations in the furnace were measured with chromel-alumel thermocouples protected by iron tubes. The temperatures at 16 or more points on each column were also measured with similar thermocouples made of No. 18 AWG wires. The thermocouple junctions were formed by inserting carefully cleaned ends of the respective wires into 1.1-mm diameter paired holes spaced at  $\frac{1}{4}$  in. drilled into the column shaft. Steel was swaged around the holes to secure metal-to-metal contact with the wires. The thermocouples were disposed at each of four levels of the column shafts as indicated by the positions B, N, M, and T in figure 4.

### 2. Method of Testing

#### (a) Bearing of Columns

Steel bearing plates were bolted at either end of a test column. The plate at the bottom was 20 in. sq and  $1\frac{1}{8}$  in. thick. The top plate, 25 by 27 by  $1\frac{1}{8}$  in. was fixed to the column with fourteen  $\frac{7}{8}$ -in. bolts  $2\frac{1}{2}$  in. long, and in turn was bolted to the overhead bearing of the loading frame of the furnace in such a position as to center the bottom plate over the loading jack. The furnace floor was then raised to within  $\frac{3}{4}$  in. of the bottom plate and the space between filled with portland cement grout. As the floor rested on a well-lubricated ball-and-socket joint coincident with the vertical center line of the column shaft, the column was considered to have a spherical end bearing at its lower extremity.

#### (b) Restraint of Columns

The plates attached to the head of a column were designed to give effective restraint against bending of the upper 33 in., thus offering substantially full continuity from the top of the fire-exposed test portion of the column shaft to the overhead bearing.

#### (c) Loads on Columns

The load imposed during the test on three of the columns was computed from a formula for allowable load recommended by the American Institute of Steel Construction

$$P = \left( 17,000 - 0.485 \frac{l^2}{r^2} \right) A,$$

in which  $P$  = 81,700 lb, total load on a column, equivalent to a stress of 13,700 lb/in.<sup>2</sup> on the cross-sectional area  $A$  of the column (5.97 in.<sup>2</sup>);  $l$  = 124 in., the effective length of the column;  $r$  = 1.50 in., the least radius of gyration of the steel column.

The load was applied before starting the test fire and was maintained until rapid yielding of the column occurred, the load being removed when the yield of a column from its maximum expansion amounted to approximately 0.6 in., or three-fourths of the amount of its expansion.

The second of the columns protected with Potomac River gravel aggregate concrete was loaded to 163,000 lb before the test, and this load was maintained until the average of the temperatures at 16 points in the steel reached 445° C (833° F), the maximum at any of the 16 points being 490° C (914° F). These temperatures were attained in 1 hr 51 min after the start of the test, at which time the load was reduced to that of the other tests.

#### (d) Measurement of Deformations

Movement of the piston of the hydraulic jack as observed on a dial indicator was taken as a measure of the longitudinal deformation of a column. Measurements made during previous tests indicated that the thermal expansion of the vertical framework was closely compensated by the expansion of the unexposed section of the column and the thermal deflections of the overhead beams supporting the upper bearing plate. No measurements of the lateral deflections of a column were made during or after a test.

#### (e) Test Specification

The tests were conducted in accordance with the American Society for Testing Materials Standard Methods of Fire Tests of Building Construction and Materials, E119-41 (ASA No. 2.1-1942) as applicable to loaded columns. The loading schedule for one column, as previously described, deviated from that of the specification.

The limit of fire endurance was selected as the time from the start required to attain a yield of about 0.6 in. from the point of maximum expansion of a column.

## V. Results of Tests

### 1. Columns 1 and 2—Potomac River Gravel Aggregate Concrete Protections

The results of fire tests of columns protected with concrete made with Potomac River gravel aggregate are shown in figures 5 and 6.

Figure 5 shows the temperatures within the furnace and the standard furnace reference curve. Also shown are the maximum observed temperatures at any thermocouple, the temperatures at the level having the highest average most consistently, and the minimum level temperatures in a column. The average of temperatures for the several levels are arithmetical. They were not weighted in proportion to the areas involved as were those reported in previous tests.<sup>4</sup> It was considered that the greater temperature effects on the column strength at the edges of the flanges, as compared to the effects at the midpoint of the flange or web, compensated for the smaller cross-sectional area contributory to each thermocouple near the edges.

The failure of both columns involved deformation throughout the fire-exposed lengths. The lateral deformation of column 1 was somewhat greater than that of column 2 and was centered somewhat lower in the shaft. Although the lateral deflections were unequal, the total shortening of both columns, as determined by measurements before and after the tests, was the same, 0.4 in.

The expansion of the columns with increases in the average temperatures of the steel shafts are shown in figure 6. Column 2 was subjected to double the load applied to column 1 until the average temperature in the shaft reached 445° C (833° F), after which the load was reduced to that of column 1.

Yielding of the steel under constant load with increasing temperature began in column 1 after the average temperature of the steel shaft had exceeded 570° C (1,058° F) and in column 2 after it had exceeded 610° C (1,130° F). End-point temperatures for column 1 were 730° C (1,346° F) as the average of all thermocouples and 775° C (1,427° F) maximum at one location; for column 2, 725° C (1,337° F) was the average end-point temperature and 760° C (1,400° F), the maximum at one location. The fire-endurance limit for column 1 was 3 hr 34 min and for column 2, 3 hr 32 min.

The condition of the gravel aggregate concrete column protections after the fire test are shown in figures 1 and 7. Figure 8 shows the two columns after removal of the concrete encasement.

The Potomac River gravel concrete of three monolithic walls did not spall or develop serious cracks throughout the fire- and load-test periods. Two reinforced concrete walls 4 and 6 in. thick were exposed for 1 hr 27 min and 4 hr, respectively. Figure 9 shows the fire-exposed face of an 8-in.

unreinforced wall after 5½ hr test. These walls suffered only minor cracking and in no case was there evidence of spalling.

### 2. Columns 3 and 4—Milky and Clear Quartz Aggregate Concrete Protections

Figures 10 and 11 show the results of fire tests on steel columns protected with crushed quartz aggregate concrete. Temperatures within the furnace and the standard reference curve are shown in figure 10, as well as the observed temperature at any thermocouple in a column, the temperature at the level having the highest average most consistently, and the minimum average temperature at one level. As was true for the first two columns, the averages are arithmetical and not weighted.

Both columns suffered lateral deformations in their fire-exposed portions. The concrete with milky quartz aggregate of column 3 showed only minor cracking at the end of the test, as is seen in figure 12. Failure to cease application of the load at the end of the test when the contraction had reached the predetermined value of ⅝ in. caused severe bending of the shaft of column 4. The clear quartz aggregate concrete showed little cracking and no evidence of spalling prior to the excessive deformation.

The expansion of the columns with increase in average temperature of the shafts is shown in figure 11. Yielding under constant load and increasing temperature began in column 3 at an average temperature of the steel of 525° C (977° F) and in column 4 at 535° C (995° F). End-point temperatures for column 3 at the fire-endurance limit of 3 hr 10 min were 625° C (1,157° F) as the average of all thermocouples and 730° C (1,346° F) maximum at any one thermocouple. For column 4, the average end-point temperature was 620° C (1,148° F) and the single point maximum was 755° C (1,391° F). The fire-endurance limit was 2 hr 50 min. A correction of 4 min may be added to the fire-endurance time of column 3 because of the excess of the furnace exposure over the standard.

The quartz aggregate concrete of a 4- by 8-ft wall slab 4 in. thick showed only a fine crack in the line of a pouring joint after a fire exposure of 1½ hr. The slab was poured in quarters from the same milky and clear quartz concrete batches used for columns 3 and 4, the sections with like aggregate being diagonally opposite. Figure 13 shows the fire-exposed face of the wall after removal from the furnace.

## VI. Summary and Discussion

The steel columns of these tests were of a type commonly used as structural members. The concrete protections were made with siliceous aggregates of widespread occurrence. The concrete used on columns 1 and 2, made with a gravel

<sup>4</sup> Fire tests of building columns, Underwriters' Laboratories 1920; also published as B. S. Tech. Pap. T184 (1921).



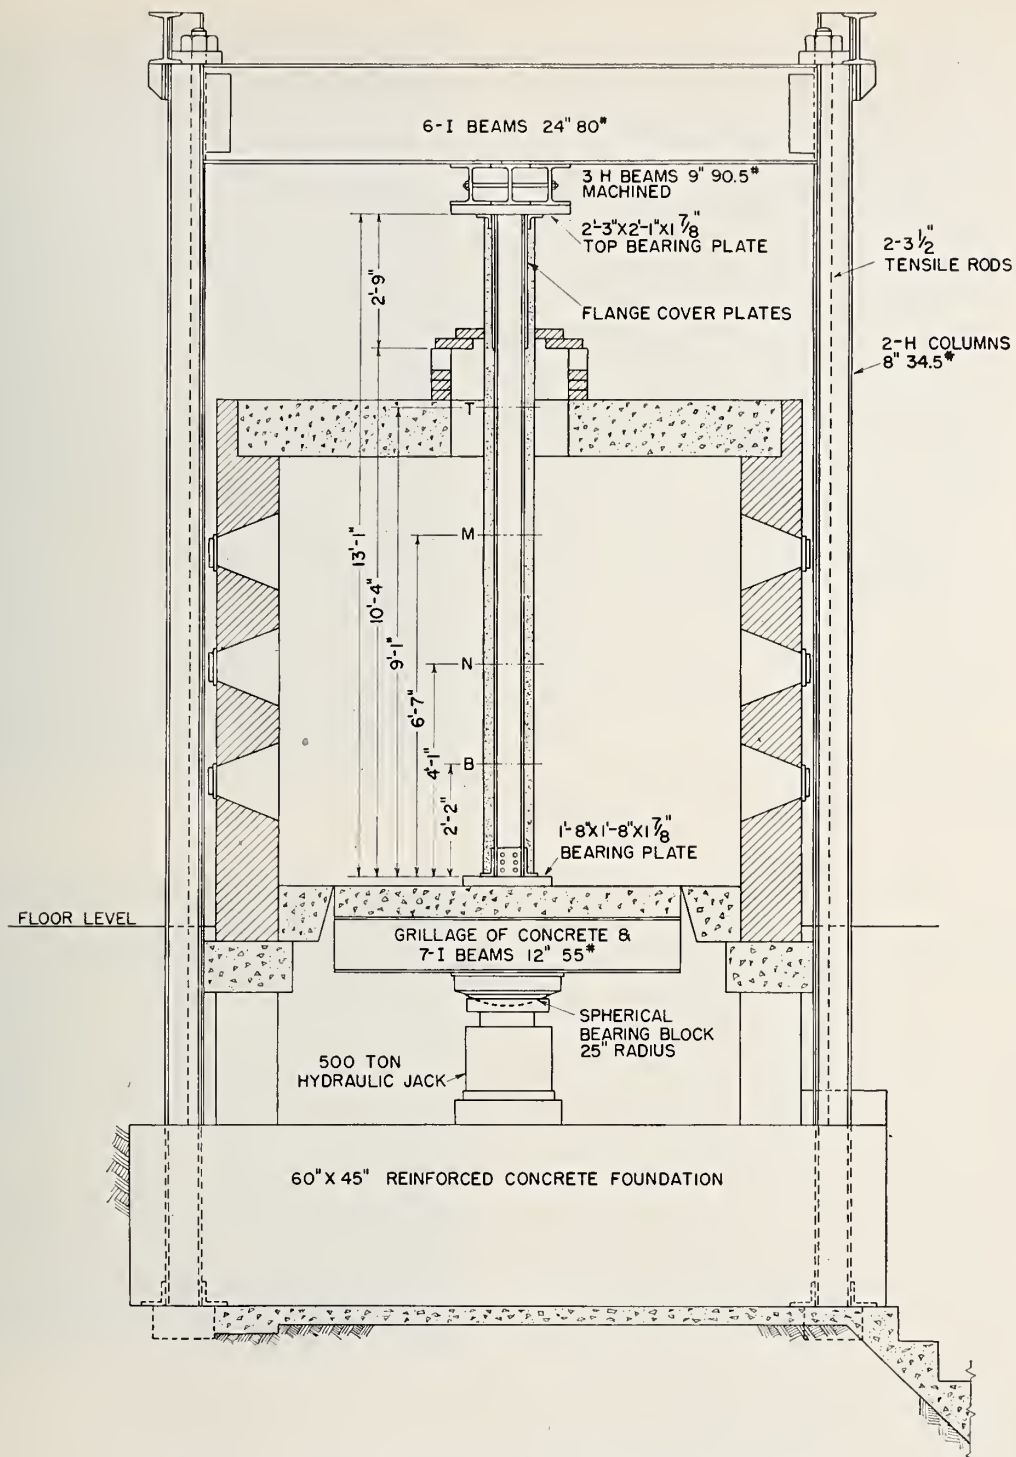


FIGURE 4. Furnace and loading equipment with typical column in place.

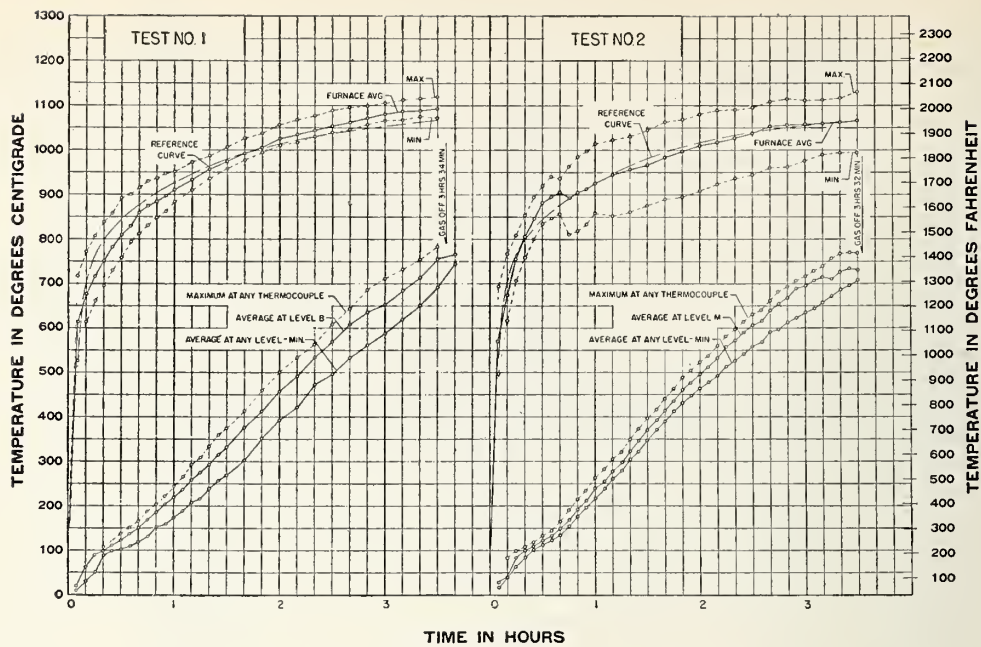


FIGURE 5. Furnace and column temperatures for columns with Potomac River gravel concrete—Tests 1 and 2.

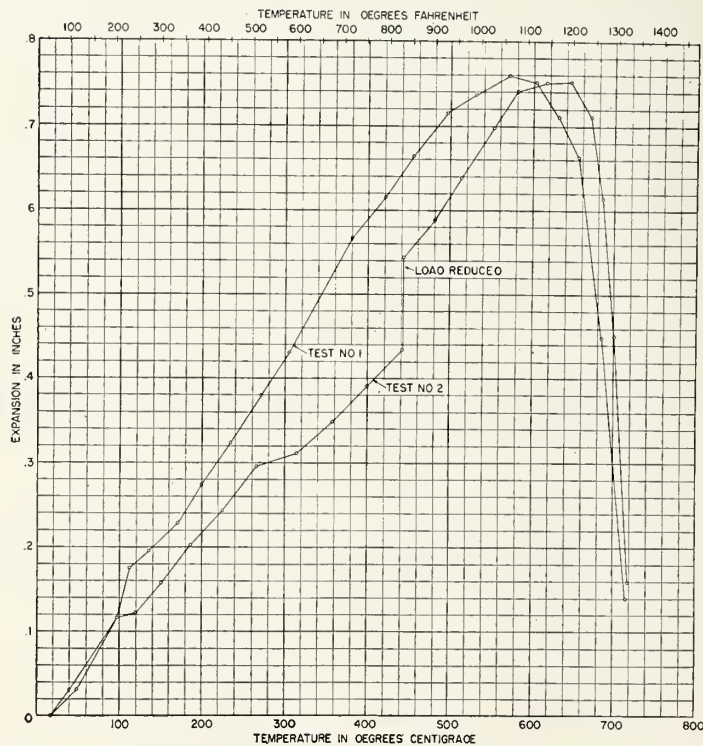


FIGURE 6. Expansion curves for columns with Potomac River gravel concrete—Tests 1 and 2.

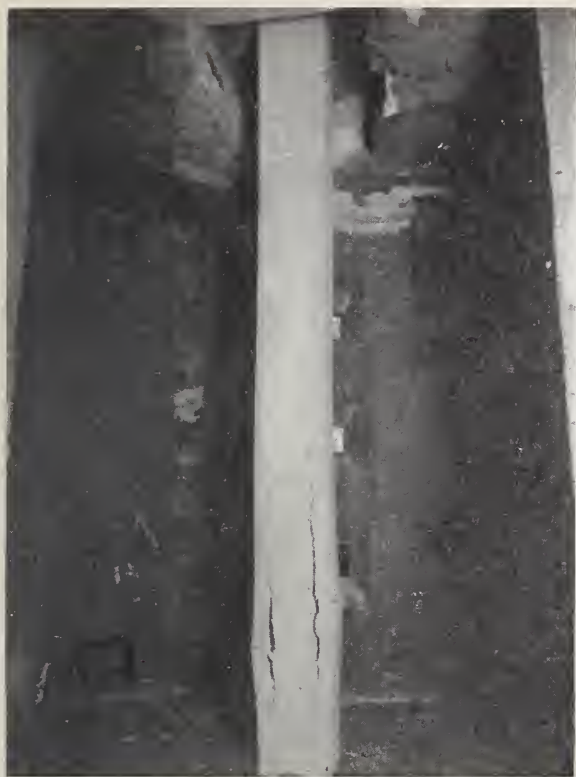


FIGURE 7. Condition of gravel aggregate concrete column protection after 3½-hr fire exposure.

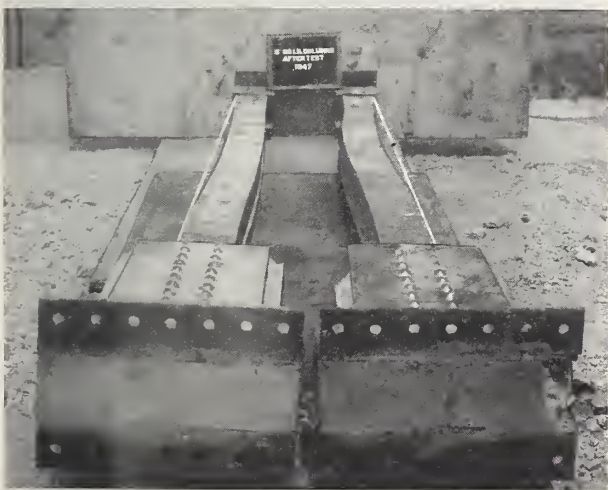


FIGURE 8. Condition of columns after tests 1 and 2—Concrete removed.

aggregate, was of conventional mix. The concrete with crushed quartz aggregate, however, had a disproportionate amount of sand, necessitated by the difficulty of working and the unusual fineness, sharpness, and gradation of the crushed sand and stone.

The columns were subjected to the loads computed by a formula for allowable loads recommended by the American Institute of Steel Construction. One column with Potomac River

gravel aggregate concrete was subjected to a load twice that of the other columns until an average column temperature of 445° C (833° F) was attained, after which the load was reduced to that under which the other columns were tested. The delay in yield of this column can possibly be attributed to set caused by the greater load imposed on the column during the early part of the test. However, the double load did not reach the compressive yield strength of structural steel at the attained temperature of 445° C.<sup>5</sup>

The fire-endurance limits of columns with Potomac River aggregate concrete was somewhat greater than that of columns made with crushed quartz aggregate. The comparative times were 3 hr 34 min and 3 hr 32 min with the gravel aggregate concrete, and 3 hr 10 min and 2 hr 50 min with the quartz. The maximum measured expansions of the columns ranged from 0.59 to 0.76 in. The end-point temperatures as averages of the thermocouple readings at four levels for columns 1 through 4, respectively, were 730° C (1,346° F), 725° C (1,337° F), 625° C (1,157° F), and 620° C (1,148° F). The corresponding single-point maximums were 775° C (1,427° F), 760° C (1,400° F), 730° C (1,346° F), and 755° C (1,391° F).

The fire resistance of structural-steel columns with solid concrete protections and all reentrant spaces filled with concrete, can be estimated from the formula <sup>6</sup>

$$R = c \left( D - 0.4 \frac{d^2}{D} \right)^{1.7},$$

where

$R$  = the fire resistance of the column

$D$  = the dimension of the outside column section

$d$  = the dimension of the inside section or core

$c$  = a constant depending on the composition of the concrete.

Substituting the fire-endurance limits which are the results of the present tests, and the column dimensions, coefficient  $c$  becomes 5.5 for columns with Potomac River gravel aggregate concrete, 4.9 for milky quartz aggregate, and 4.4 for clear quartz aggregate.

The fire resistance of columns with 8-, 10-, and 12-in. steel shafts protected by 2-in. coverings of concrete, as determined from the formula, are shown in table 2.

The results obtained from the tests reported herein indicate that the conclusions reached in the fire tests of siliceous aggregate concrete for column protection as reported in National Bureau of Standards Technologic Papers 184 (1920) and 272 (1925) need to be reexamined. In the present tests there was no spalling of concrete such as had been reported in the previous tests and the cracking was not sufficient to expose the shaft before the critical-temperature range of the steel was attained.

<sup>5</sup> P. D. Sale, Compression tests of structural steel at elevated temperature, J. Research NBS 13, 713 (1934) RP741.

<sup>6</sup> Fire-resistance classifications of building constructions, NBS Building Materials and Structures Report BMS92, p. 70 (1942).



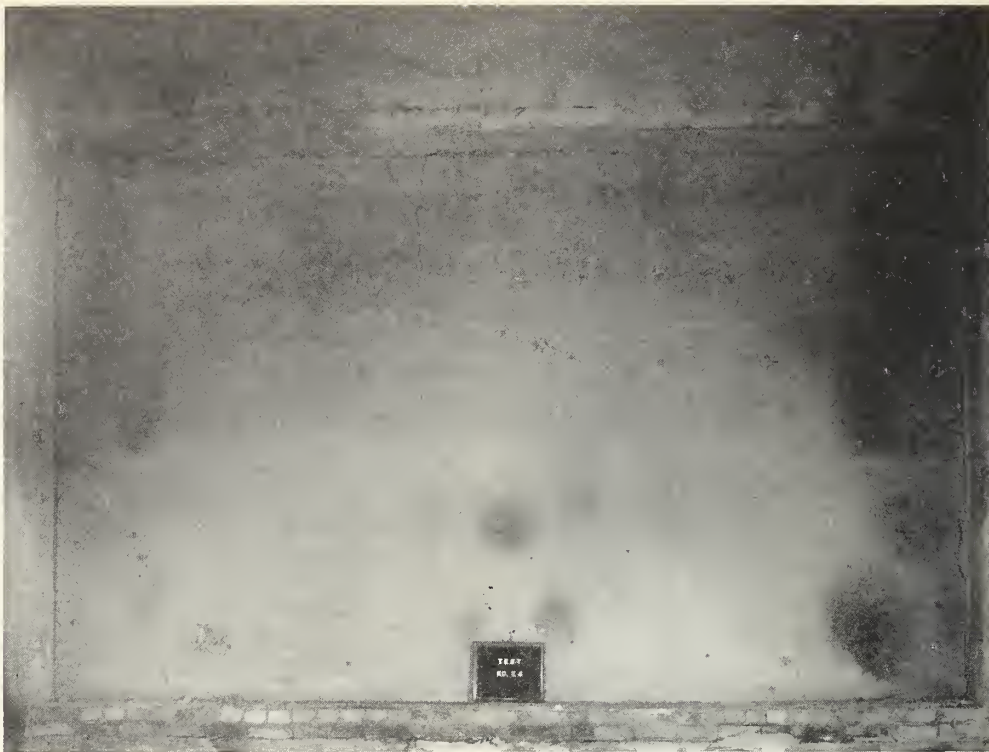


FIGURE 9. Fire-exposed face of an 8-in. unreinforced wall of Potomac River gravel concrete after 5½-hr test.

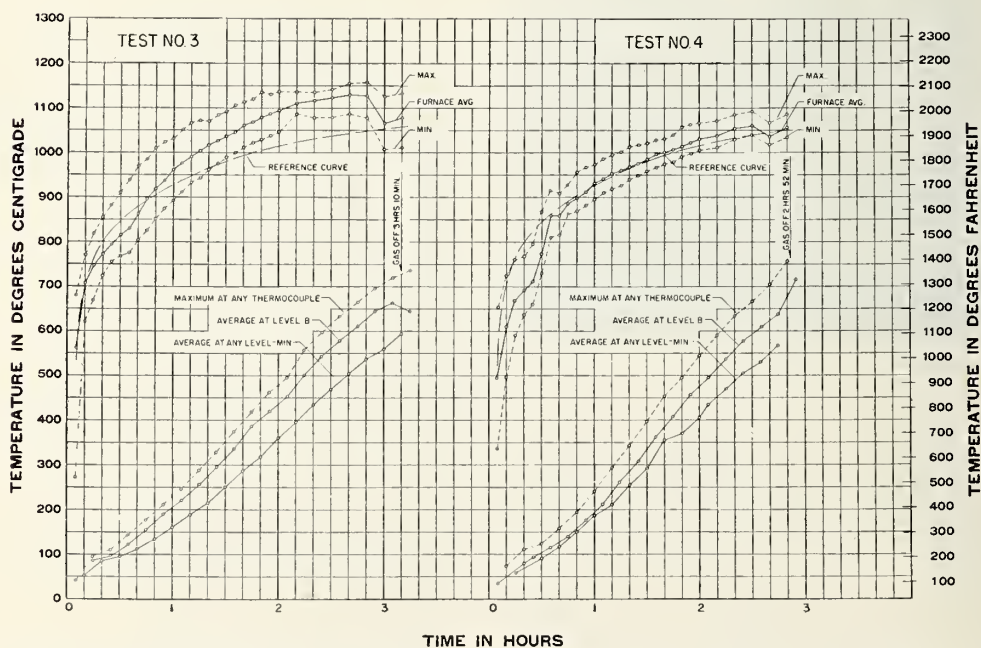


FIGURE 10. Furnace and column temperatures for columns with crushed quartz concrete—Tests 3 and 4.



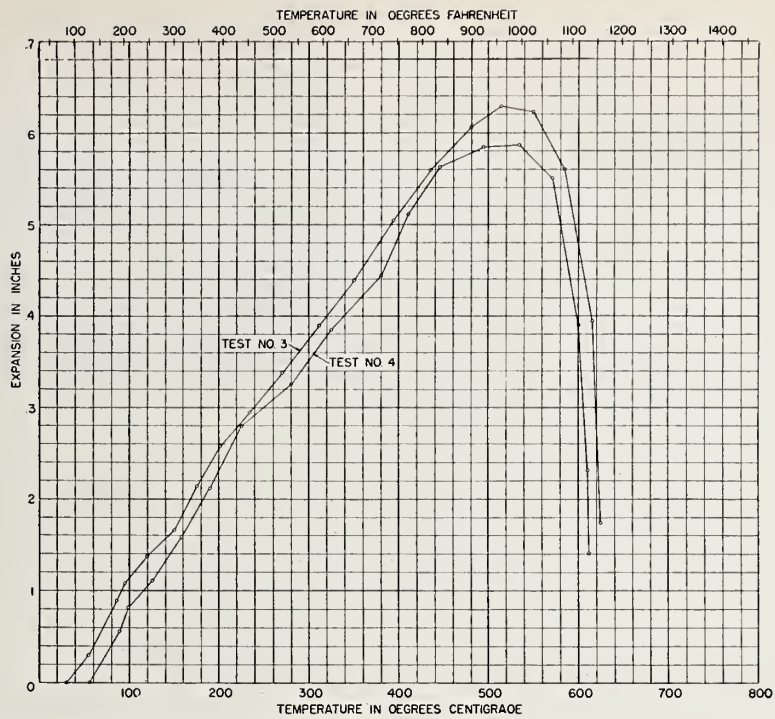


FIGURE 11. *Expansion curves for columns with crushed quartz aggregate concrete—Tests 3 and 4.*

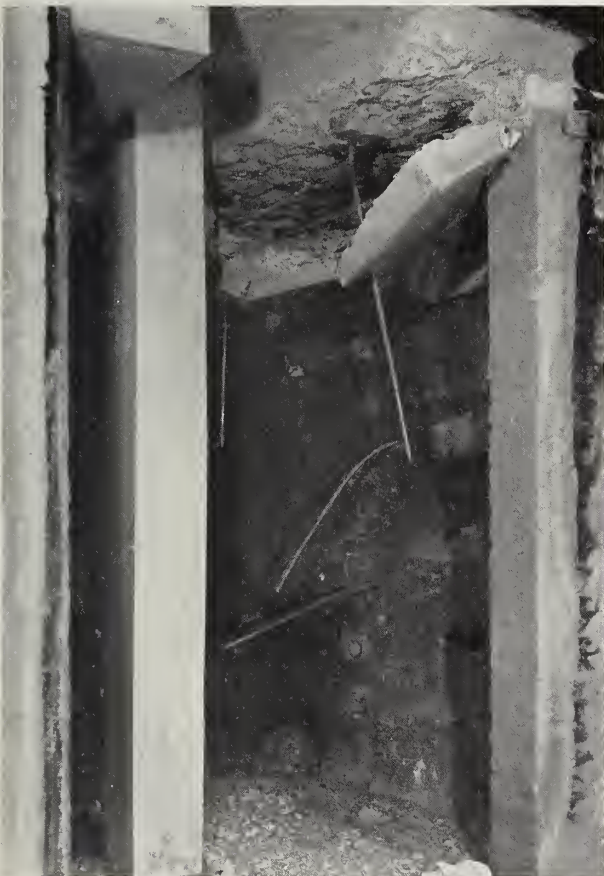


FIGURE 12. *Column protected with milky quartz aggregate concrete after 3-hr 10-min fire exposure—Test 3.*



FIGURE 13. *Fire-exposed face of a crushed quartz concrete wall slab after 1½-hr test.*

TABLE 2. *Derived fire-resistance ratings of steel shaft H-columns with 2 inches of concrete protection*

Concrete aggregate	Size of column shaft		Fire-resistance rating
	in.	hr	
Potomac River gravel.....	8	4½	
	10	5½	
	12	6½	
Milky quartz.....	8	4	
	10	5	
	12	6	
Clear quartz.....	8	3½	
	10	4½	
	12	5¼	

The resistance of a concrete to high temperatures is probably influenced by its density. The spalling caused by the explosion resulting from superheated water in a dense concrete was previously mentioned in connection with the failure of a floor slab made with siliceous aggregate concrete. Further evidence of this effect can be seen in figure 12, which shows failure of the concrete top of the furnace after the first fire-endurance test to which the concrete was subjected. The failure occurred with explosive force 34 min after a 3-hr 10-min fire exposure, at which time the furnace still retained considerable heat. Examination of the debris showed the concrete, made with carefully graded firebrick aggregate, to be extremely compact. The structure of the spalled material can be seen in the photograph of the sample in figure 14.

The aggregates used in both series of tests, while siliceous in character, differed in mineralogical composition. Those composed largely of chert

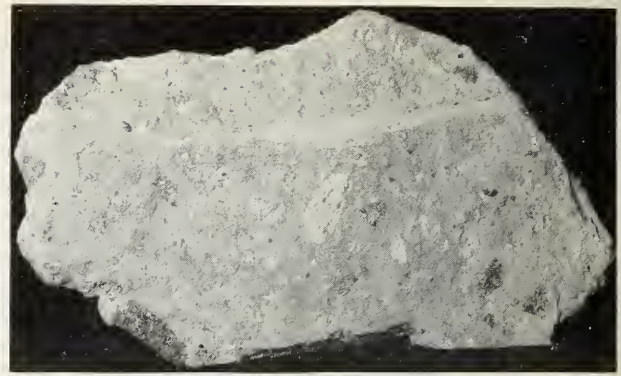


FIGURE 14. *Sample of firebrick aggregate concrete spalled from top of furnace.*

gave the poorest results in the tests at Underwriters' Laboratories. It is possible that an impurity or vaporizing water in the chert caused a disruptive force upon the application of heat. The characteristically rapid volume change of the siliceous minerals at critically high temperatures had no apparent effect upon the concrete used in the present tests.

The results of the tests indicate that concrete made with siliceous aggregates, as herein described, provides an acceptable material for the protection of structural steel against fire. The consistency of the results allowed definite conclusions as to the reliability of the protections for the demonstrated fire-endurance limits.

WASHINGTON, September 12, 1950.



# BUILDING MATERIALS AND STRUCTURES REPORTS

[Continued from cover page ii]

BMS32	Structural Properties of Two Brick-Concrete-Block Wall Constructions and a Concrete-Block Wall Construction Sponsored by the National Concrete Masonry Association.....	15¢
BMS33	Plastic Calking Materials.....	15¢
BMS34	Performance Test of Floor Coverings for Use in Low-Cost Housing: Part 1.....	15¢
BMS35	Stability of Sheathing Papers as Determined by Accelerated Aging.....	*
BMS36	Structural Properties of Wood-Frame Wall, Partition, Floor, and Roof Constructions With "Red Stripe" Lath Sponsored by The Weston Paper and Manufacturing Co.....	10¢
BMS37	Structural Properties of "Palisade Homes" Constructions for Walls, Partitions, and Floors, Sponsored by Palisade Homes.....	*
BMS38	Structural Properties of Two "Dunstone" Wall Constructions Sponsored by the W. E. Dunn Manufacturing Co.....	10¢
BMS39	Structural Properties of a Wall Construction of "Pfeifer Units" Sponsored by the Wisconsin Units Co.....	10¢
BMS40	Structural Properties of a Wall Construction of "Knap Concrete Wall Units" Sponsored by Knap America, Inc.....	15¢
BMS41	Effect of Heating and Cooling on the Permeability of Masonry Walls.....	*
BMS42	Structural Properties of Wood-Frame Wall and Partition Construction with "Celotex" Insulating Boards Sponsored by The Celotex Corporation.....	15¢
BMS43	Performance Test of Floor Coverings for Use in Low-Cost Housing: Part 2.....	15¢
BMS44	Surface Treatment of Steel Prior to Painting.....	10¢
BMS45	Air Infiltration Through Windows.....	15¢
BMS46	Structural Properties of "Scot-Bilt" Prefabricated Sheet-Steel Constructions for Walls, Floors, and Roofs Sponsored by The Globe-Wernicke Co.....	*
BMS47	Structural Properties of Prefabricated Wood-Frame Constructions for Walls, Partitions, and Floors Sponsored by American Houses, Inc.....	20¢
BMS48	Structural Properties of "Precision-Built" Frame Wall and Partition Constructions Sponsored by the Homasote Co.....	15¢
BMS49	Metallic Roofing for Low-Cost House Construction.....	20¢
BMS50	Stability of Fiber Building Boards as Determined by Accelerated Aging.....	10¢
BMS51	Structural Properties of "Tilecrete Type A" Floor Construction Sponsored by the Tilecrete Co.....	10¢
BMS52	Effect of Ceiling Insulation Upon Summer Comfort.....	15¢
BMS53	Structural Properties of a Masonry Wall Construction of "Munlock Dry Wall Brick" Sponsored by the Munlock Engineering Co.....	10¢
BMS54	Effect of Soot on the Rating of an Oil-Fired Heating Boiler.....	10¢
BMS55	Effects of Wetting and Drying on the Permeability of Masonry Walls.....	10¢
BMS56	A Survey of Humidities in Residences.....	10¢
BMS57	Roofing in the United States—Results of a Questionnaire.....	*
BMS58	Strength of Soft-Soldered Joints in Copper Tubing.....	10¢
BMS59	Properties of Adhesives for Floor Coverings.....	15¢
BMS60	Strength, Absorption, and Resistance to Laboratory Freezing and Thawing of Building Bricks Produced in the United States.....	30¢
BMS61	Structural Properties of Two Nonreinforced Monolithic Concrete Wall Constructions.....	10¢
BMS62	Structural Properties of a Precast Joist Concrete Floor Construction Sponsored by the Portland Cement Association.....	15¢
BMS63	Moisture Condensation in Building Walls.....	15¢
BMS64	Solar Heating of Various Surfaces.....	10¢
BMS65	Methods of Estimating Loads in Plumbing Systems.....	15¢
BMS66	Plumbing Manual.....	35¢
BMS67	Structural Properties of "Mu-Steel" Prefabricated Sheet-Steel Constructions for Walls, Partitions, Floors, and Roofs, Sponsored by Herman A. Mugler.....	15¢
BMS68	Performance Test for Floor Coverings for Use in Low-Cost Housing: Part 3.....	20¢
BMS69	Stability of Fiber Sheathing Boards as Determined by Accelerated Aging.....	10¢
BMS70	Asphalt-Prepared Roll Roofings and Shingles.....	20¢
BMS71	Fire Tests of Wood- and Metal-Framed Partitions.....	20¢
BMS72	Structural Properties of "Precision-Built, Jr." Prefabricated Wood-Frame Wall Construction Sponsored by the Homasote Co.....	10¢
BMS73	Indentation Characteristics of Floor Coverings.....	10¢
BMS74	Structural and Heat-Transfer Properties of "U. S. S. Panelbilt" Prefabricated Sheet-Steel Constructions for Walls, Partitions, and Roofs Sponsored by the Tennessee Coal, Iron & Railroad Co.....	20¢
BMS75	Survey of Roofing Materials in the North Central States.....	15¢
BMS76	Effect of Outdoor Exposure on the Water Permeability of Masonry Walls.....	15¢
BMS77	Properties and Performance of Fiber Tile Boards.....	10¢
BMS78	Structural, Heat-Transfer, and Water-Permeability Properties of Five Earth-Wall Constructions.....	25¢
BMS79	Water-Distributing Systems for Buildings.....	20¢
BMS80	Performance Test of Floor Coverings for Use in Low-Cost Housing: Part 4.....	15¢
BMS81	Field Inspectors' Check List for Building Constructions (cloth cover, 5 x 7½ inches).....	30¢

\*Out of print.

[List continued on cover page iv]

# BUILDING MATERIALS AND STRUCTURES REPORTS

[Continued from cover page III]

BMS82	Water Permeability of Walls Built of Masonry Units.....	25¢
BMS83	Strength of Sleeve Joints in Copper Tubing Made With Various Lead-Base Solders....	15¢
BMS84	Survey of Roofing Materials in the South Central States.....	15¢
BMS85	Dimensional Changes of Floor Coverings With Changes in Relative Humidity and Temperature.....	10¢
BMS86	Structural, Heat-Transfer, and Water-Permeability Properties of "Speedbrik" Wall Construction Sponsored by the General Shale Products Corporation.....	15¢
BMS87	A Method for Developing Specifications for Building Construction—Report of Subcommittee on Specifications of the Central Housing Committee on Research, Design, and Construction.....	20¢
BMS88	Recommended Building Code Requirements for New Dwelling Construction With Special Reference to War Housing.....	*
BMS89	Structural Properties of "Precision-Built, Jr." (Second Construction) Prefabricated Wood-Frame Wall Construction Sponsored by the Homasote Co.....	15¢
BMS90	Structural Properties of "PHC" Prefabricated Wood-Frame Constructions for Walls, Floors, and Roofs Sponsored by the PHC Housing Corporation.....	15¢
BMS91	A Glossary of Housing Terms.....	15¢
BMS92	Fire-Resistance Classifications of Building Constructions.....	30¢
BMS93	Accumulation of Moisture in Walls of Frame Construction During Winter Exposure....	10¢
BMS94	Water Permeability and Weathering Resistance of Stucco-Faced, Gunite-Faced, and "Knap Concrete-Unit" Walls.....	15¢
BMS95	Tests of Cement-Water Paints and Other Waterproofings for Unit-Masonry Walls....	25¢
BMS96	Properties of a Porous Concrete of Cement and Uniform-Sized Gravel.....	10¢
BMS97	Experimental Dry-Wall Construction With Fiber Insulating Board.....	10¢
BMS98	Physical Properties of Terrazzo Aggregates.....	15¢
BMS99	Structural and Heat-Transfer Properties of "Multiple Box-Girder Plywood Panels" for Walls, Floors, and Roofs.....	15¢
BMS100	Relative Slipperiness of Floor and Deck Surfaces.....	10¢
BMS101	Strength and Resistance to Corrosion of Ties for Cavity Walls.....	10¢
BMS102	Painting Steel.....	10¢
BMS103	Measurements of Heat Losses From Slab Floors.....	15¢
BMS104	Structural Properties of Prefabricated Plywood Lightweight Constructions for Walls, Partitions, Floors, and Roofs Sponsored by the Douglas Fir Plywood Association....	30¢
BMS105	Paint Manual with particular reference to Federal Specifications.....	\$1. 25
BMS106	Laboratory Observations of Condensation in Wall Specimens.....	15¢
BMS107	Building Code Requirements for New Dwelling Construction.....	*
BMS108	Temperature Distribution in a Test Bungalow With Various Heating Devices.....	15¢
BMS109	Strength of Houses: Application of Engineering Principles to Structural Design....	\$1. 50
BMS110	Paints for Exterior Masonry Walls.....	15¢
BMS111	Performance of a Coal-Fired Boiler Converted to Oil.....	15¢
BMS112	Properties of Some Lightweight-Aggregate Concretes With and Without an Air-entraining Admixture.....	10¢
BMS113	Fire Resistance of Structural Clay Tile Partitions.....	15¢
BMS114	Temperature in a Test Bungalow With Some Radiant and Jacketed Space Heaters....	25¢
BMS115	A Study of a Baseboard Convectector Heating System in a Test Bungalow.....	15¢
BMS116	Preparation and Revision of Building Codes.....	15¢
BMS117	Fire Resistance of Walls of Lightweight Aggregate Concrete Masonry Units.....	20¢
BMS118	Stack Venting of Plumbing Fixtures.....	15¢
BMS119	Wet Venting of Plumbing Fixtures.....	20¢
BMS120	Fire Resistance of Walls of Gravel-Aggregate Concrete Masonry Units.....	15¢
BMS121	Investigation of Failures of White-Coat Plasters.....	25¢
BMS122	Physical Properties of Some Samples of Asbestos-Cement Siding.....	**
BMS123	Fire Tests of Wood-Framed Walls and Partitions With Asbestos-Cement Facings....	15¢
BMS124	Fire Tests of Steel Columns Protected With Siliceous Aggregate Concrete.....	15¢

\*Out of print.

\*\*In Press.