
VIII00 885883




NBS BUILDING SCIENCE SERIES 53

U.S. DEPARTMENT OF COMMERCE / National Bureau of Standards

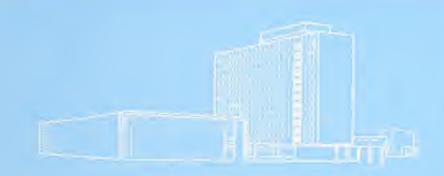

Study of the Local Resistance of Conventional Plywood Subflooring to Concentrated Load



The Building Science Series

The Building Science Series disseminates technical information developed at the National Bureau of Standards on building materials, components, systems, and whole structures. The Series presents research results, test methods, and performance criteria related to the structural and environmental functions and the durability and safety characteristics of building elements and systems.

These publications, similar in style and content to the NBS Building Materials and Structures Reports (1938-59), are directed toward the manufacturing, design, construction, and research segments of the building industry, standards organizations, and officials responsible for building codes.

The material for this Series originates principally in the Center for Building Technology of the NBS Institute for Applied Technology. The publications are divided into three general groups: Building Systems and Processes; Health, Safety and Comfort; and Structures and Materials. For further information regarding these publications please contact the Scientific and Professional Liaison Section, Center for Building Technology, Institute for Applied Technology, National Bureau of Standards, Washington, D.C. 20234. IUL 16 1974 nctace TA435 Study o . USE NO.53 of Conv 1974 c.2

6.6.5

Study of the Local Resistance of Conventional Plywood Subflooring to Concentrated Load

Felix Y. Yokel

Center for Building Technology Institute for Applied Technology National Bureau of Standards Washington, D.C. 20234

NBS Building science series no 53

Prepared for the Office of Research and Technology Office of Housing and Urban Development Washington, D.C. 20410



U.S. DEPARTMENT OF COMMERCE, Frederick B. Dent, Secretary NATIONAL BUREAU OF STANDARDS, Richard W. Roberts, Director

Issued May 1974

Library of Congress Catalog Number: 74-600075

National Bureau of Standards Building Science Series 53

Nat. Bur. Stand. (U.S.), Bldg. Sci. Ser. 53, 43 pages (May 1974) CODEN: BSSNBV

Supersedes NBSIR 73-116 (PB 220-432/9)

U.S. GOVERNMENT PRINTING OFFICE WASHINGTON: 1974

For sale by the Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402 (Order by SD Catalog No. C13.29:2/53). Price 85 cents.

TABLE OF CONTENTS

		Page
SI	Conversion Units	iv
1.	Introduction	1
	1.1 Purpose of Study	1
	1.2 Background Information	1
2.	Scope of Testing Program	4
3.	Test Specimens	6
	3.1 Materials	6
	3.2 Description of Specimens	6
4.	Testing Procedure	10
5.	Test Results	12
6.	Interpretation of Test Results	21
	6.1 Compliance with the Criterion	21
	6.2 Failure Modes	28
	6.3 Effect of Test Location on Load Capacity and Stiffness	32
	6.4 Relative Stiffness of Floor Systems	34
7.	Conclusions	34
8.	Acknowledgement	34
9.	References	36

In view of the present accepted practice in this country for building technology, common US units of measurement have been used throughout this paper. In recognition of the position of the United States as a signatory to the General Conference on Weights and Measures, which gave official status to the metric SI system of units in 1960, assistance is given to the reader interested in making use of the coherent system of SI units by giving conversion factors applicable to US units used in this paper.

Length

1 in = 0.0254 meter (exactly)

Force

1 1b (1bf) - 4.448 Newton (N)

Pressure

 $1 \text{ psi} - 6895 \text{ N/m}^2$

Temperature

5/9 (Temperature °F - 32) = Temperature °C

Study of the Local Resistance of Conventional Plywood Subflooring to Concentrated Load*

F. Y. Yokel

Representative specimens, simulating the performance of five conventional plywood floor systems, were tested under concentrated load in order to compare their performance with that stipulated by performance criteria developed on the basis of anticipated occupancy loads.

In 24 out of 26 tests the performance of the specimens exceeded that required by the criteria. Data on failure loads, load-deflection characteristics and failure modes are presented and discussed.

<u>Key Words</u>: Evaluation criteria; floors; hardboard; load capacity; performance criteria; plywood; plywood subflooring; subflooring; underlayment; wood-frame construction.

1. Introduction

1.1 Purpose of Study

This study was conducted as part of an effort to develop and improve evaluation criteria for industrialized housing. The criteria were used to guide the development and evaluation of prototype housing for the Department of Housing and Urban Development's Operation Breakthrough.

The subject of this study are requirements for the resistance of floors to concentrated loads. The objective of the study is to determine the level of performance of conventional floor systems and compare their performance with that required in the evaluation criteria for Operation Breakthrough $[1]^{\frac{1}{2}}$, which were based on anticipated occupancy loads.

1.2 Background Information

1.2.1 The need for Evaluate the Structural Performance of Floors Under Concentrated Load

Present U.S. building codes and design standards for residential construction provide for floor capacity under distributed load. One of the few U.S. recommendations related to concentrated loads acting on floors is contained in a performance standard by HHFA [2] which is advisory and not enforcable. The standard recommends deflection limitations under a 250-lb concentra-ted load, and an "extended-load capacity" of 450 lb with a residual deflection not to exceed 25 percent of the maximum deflection. The concentrated loads are to be applied over a 1-inch diameter area.

Research Sponsored by the Office of Research and Technology, Department of Housing and Urban Development, Washington, D. C. 20410

¹Figures in brackets indicate literature references at the end of this paper.

The lack of enforceable provisions for concentrated-load capacity is not attributable to a lack of need for such provisions. It is merely brought about by the fact that codes are based on conventional building systems, which by and large tend to perform in a manner acceptable to the user under conditions of normal use. On the other hand it is envisioned that some innovative systems may comply with code provisions for distributed loads, but exhibit unsatisfactory performance under other types of occupancy load. It is therefore necessary to evaluate these innovative systems under various types of loading generated by occupancy, including critical concentrated loads.

1.2.2 Occupancy-Generated Concentrated Loads acting on Floors

Concentrated loads on floors may be caused by heavy furniture or by human activity. Two critical conditions are identified:

- 1. A concentrated load of critical magnitude that may cause damage to the entire floor, or more likely to a section of the floor, by exerting excessive bending moments and/or excessive shear.
- 2. A load that is concentrated over a very small area, thereby causing failure by excessive compressive stress and/or excessive punching shear.

Typical heavy concentrated loads have been studied by Boyd [3] and are summarized below:

1.	A person carrying a heavy load)
2.	A crowded sofa (per front caster))
3.	An upright piano (1 caster)	,
4.	A grand piano (1 caster)	,
5.	Transportation of an upright piano (per wheel)	ł
б.	Transportation of a grand piano (per wheel)	,
	Boyd concluded that since the use of grand pianos is relatively rar	e,

the following design-loads should be used:

- (a) 400 1b for several seconds
- (b) 350 1b for 1/2 hour
- (c) 200 lb indefinitely.

In extreme cases some casters may spread these loads over an area as small as 0.5 in^2 .

Critical loading caused by load concentration over a small bearing area is also caused by stiletto heels. Even though these heels may no longer be fashionable, their future use cannot be ruled out. A study of typical stiletto-heel pressures [4] indicates a range of compressive stresses from 550 psi to 1390 psi, and one extreme value of 2,260 psi. Values of punching shear computed from these data range from 80 lb/in to 117 lb/in. The case that produced the 2260-psi compressive stress produced a punching shear of 156 lb/in.

1.2.3 Discussion of Evaluation Criteria for Concentrated Load on Floors

The following criterion has been adopted as a guide for Operation Breakthrough [1]:

"The structural floor should resist a 400-lb load, applied on a circular area of 5/8-in diameter and sustained for one hour, without causing a residual indentation of the structural surface in excess of 1/16-in, measured 1 hour after removal of the load, and a 280 lb long-term sustained load, applied on a circular area of 5/8-in diameter.

If the wearing surface is of non-durable material, or if there is a possibility that this surface may be removed during the useful life of the structure, the floor should satisfy (this) criterion with the wearing surface removed."

This criterion is intended to test the structural floor and not the wearing surface. However, permanent-type wearing surfaces which are left in place throughout the service-life of the building may have a beneficial effect on the load capacity of structural floors which could be relied upon.

The criterion requires reasonable deflection recovery under a 400-1b concentrated load sustained for one hour, and a 280-1b long-term sustained load capacity. The term "sustained-load" capacity is not defined in the criterion. In this investigation it is assumed that the intent of the criterion is that a 280-1b load applied over a 5/8-in diameter area continuously during the service life of the structure should not cause serious distress.

The 400-lb requirement would be in many cases associated with the capacity to support a higher short-term load; however, the relationship between the short-term capacity, the one-hour capacity, and the long-term capacity would depend on the material of the structural floor. As an example, this relationship is considered for the case of wood.

The following approximate capacities can be calculated using the information in Reference [5] and assuming that capacities are interpreted in terms of maximum residual deflection and that the residual deflections are related to flexural strength:

30-second capacity.	•	•	•	•	٠	•	•	•	٠	٠	•	•	٠	•	•	485	1b	
1-hour capacity	•	•	•	•	•	•	•	•					•	•		400	1b	
1-year capacity	•	•				•		•		•		•	•	•		290	1b	

On the other hand, for another material, instantaneous and long-term capacities may differ very little from the one-hour capacity.

The compressive stress caused by the 400-1b load required in the criterion is 1300 psi and the punching shear is 203 lb/in. If we compare the concentrated load, the compressive stress and the punching shear with the data in section 1.2.2, it is evident that the criterion represents reasonable minimum requirements with no substantial margin with respect to extreme occupancy loads. However, it should be noted that some of the ex-

treme loads, caused by the moving of heavy furniture, could be modified or avoided by simple precautions.

The loading requirements in the criterion differ from existing techniques, such as the ASTM E72 test [6] and the ASTM D 2394 test [7]. Both of these tests methods use a 1-in diameter disc to transmit the load, while the criterion requires a 5/8-in diameter loading area.

The E72 test is intended to measure the structural capacity of the system, and the D 2394 tests measure the strength of the finished flooring. These tests, with proper choice of load levels, could adequately evaluate most floor systems. A problem, however, arises with floor systems that consist of a thin structural skin supported by stiffening elements. In this case the system may perform satisfactorily under the D 2394 test, while under different support conditions the structural skin may fail by punching shear. On the other hand, in order to generate adequate stress under a 1-in diameter disc, the concentrated load would have to be increased to over 1000 lb, and in order to generate adequate punching shear the load would have the to be increased to at least 500 lb. These heavier concentrated loads would be higher than the extreme concentrated loads that actually act on the floor in service.

2. Scope of Testing Program

Seven different types of plywood subflooring²/ were tested. Most of the subflooring specimens were supported by wood joists of 2 x 4-in nominal size, spaced 16 in on center. In a small number of specimens joist spacings of 24 in, 20 in, 10 in and 6 in were used in order to investigate failure modes. The small 4-in joist depth was selected, since in all cases the joists were fully supported, and joist - deflection and hence, joist size, was not a variable considered in this investigation. Test loads were concentrated loads which were increased until failure occurred. For part of the specimens loads were applied in several cycles of unloading and reloading. Deflections were measured near the point of load application. The test loads were applied over circular areas of 1 in, 5/8 in, and in a limited number of tests, 1/2 in diameter. Table 2.1 shows the test variables and the scope of the testing program.

^{2/}The structural material or surface which supports floor loads and the finish flooring. If the subfloor material is sufficiently dense, smooth stiff, dimensionally stable and possesses adequate bonding properties, finish flooring may be applied directly without the use of underlayment.

Joist Spa	acing (in)		16		2	24	2	20	-	LO		5	
Diame Loaded at	ter of rea (in)	1	5/8	1/2	1	5/8	1	5/8	1	5/8	1	5/8	TOTAL
	А	12	,18			6	6	6	6	6	6	6	72
E.	В		18			12		6		11		6	53
Subflooring System	С	5	6	2									13
ng S	D	14	7										21
oori	Е	14	7										21
ubf1	F		6										6
	G		7										7
Total No.	. of Tests	ł				·				1			193

SUBFLOORING SYSTEMS:

- A: 15/32-in-thick underlyament grade Southern Pine interior-type,5-ply plywood.
- B: 1/2-in-thick standard grade Southern Pine interior-type with exterior glue, 5-ply plywood.
- C: 1/2-in-thick standard grade Douglas Fir interior-type, 3-ply plywood.
- D: 1/2-in-thick standard grade Douglas Fir interior-type, 3-ply a/ plywood.
- E: 1/2-in-thick plywood as in D under 1/4-in-thick plywood underlayment.
- F: 1/2-in-thick plywood as in C under 7/32-in-thick hardboard underlayment.
- G: 1/2-in-thick plywood as in C under 1/4-in-thick plywood underlayment.
- a/ The core of this plywood was laminated giving the interior ply double thickness.

3.1 Materials

All materials were purchased from local suppliers and were typical of those presently used in building construction. Plywoods met the requirements of Product Standard PSI-66 [8] for softwood plywood. Dimensions and physical properties of the different plywoods used are shown in table 3.1.

Hardboard underlayment $\frac{3}{}$ complied with Federal Standard LLB-810a, Type VI [9]. Dimensions and physical properties of the hardboard used are shown in table 3.2.

Wood joists were Construction Grade $\frac{4}{}$ Douglas Fir. Moisture content was 9.7 percent $\frac{5}{}$ and specific gravity was $0.41.\frac{6}{}$

3.2 Description of Specimens

Except as noted below, the standard specimens were constructed in accordance with the provisions in "FHA Minimum Property Standards" [15], Sections 817.3 and 817.4.

Standard Specimens were constructed in small widths compared to the size of plywood sheets actually used in construction. This conservatively simulated conditions representing the least strength and stiffness that the floors may be expected to develop in service.

3.2.1 Standard Specimens without Underlayment

Figure 3.1 shows a typical specimen. The 2 x 4 joists were 16 in long and were spaced 16-in on center. Plywood sheets, nominally 1/2 in thick, 14 in wide, and 48 in long, were nailed to the top and bottom faces of the joists. The plywood sheets were oriented with the grain of the outer plies perpendicular to the axis of the joists. The joists were 2 in longer than the width of the plywood sheet to give the specimens stability under concentrated loads applied at the long edge of the plywood. The plywood sheets were nailed to the joists with 8d common nails. Three nails, spaced 6 in on center, were used for the two outside joists. The inside joists were nailed with two nails, spaced 10 in on center.

^{3/}Hardboard is a dense panelboard manufactured of wood fibers with the natural lignin in the wood reactivated to serve as a binder for the wood fibers. Underlayment is a material installed over the subfloor to provide a suitable base for the finish flooring when the subfloor does not possess the necessary properties for direct application of the flooring.

 $[\]frac{4}{1}$ In accordance with WCLIB Rules No. 15 [10]

 $[\]frac{5}{Determined}$ in accordance with ASTM D2016 [13]

 $[\]frac{6}{D}$ Determined in accordance with ASTM D2395 [14]

Designation	Thickness in.	No. of plies	Species	Grade	Identification Index	Туре	Moisture ^{d/} Content %	Specific d/ Gravity
a <u>b</u> /	15/32	5	Southern Pine	Underlayment	Plugged and Touch Sanded	Interior with Exterior Glue	7.1	0.60
ь <u>b</u> /	1/2	5	Southern Pine	Standard	32/16	Interior with Exterior Glue	7.3	0.54
c <u>c</u> /	1/2	3	Douglas Fir	C-D	32/16	Interior with Exterior Glue	6.3	0.53
d <u>b</u> /	1/2	3 <u>e</u> /	Douglas Fir	Standard	32/16	Interior with Exterior Glue	9.5	0.47
Underlayment	<u>b</u> / 1/4	3	Douglas Fir	A-A		Interior	8.0	0.48

TABLE 3,1

Physical Properties of Plywoods 4/

a/ Properties are defined in conformance with Product Standard PS1-66.

b/ Properties identified in DFPA Grade-Trademark except for species, moisture content and specific gravity.

c/ Properties identified in TECO Gradestamps, except for species, moisture content and specific gravity.

d/ Properties determined in accordance with ASTM designation D-805 [11].

e/ The core of this plywood was laminated, giving the interior ply double thickness.

TABLE 3.2

Physical Properties of the Hardboard a/

Thickness	Modulus of	Water	Thickness	Specific	Average
	Rupture	Absorption	Swelling	Gravity	Moisture Content
0.215 in	4,500 psi	13.73%	7.08%	0.998	5%

 $\underline{a}/$ Tested by manufacturer in accordance with Commercial Standard CS 251-63 [12].

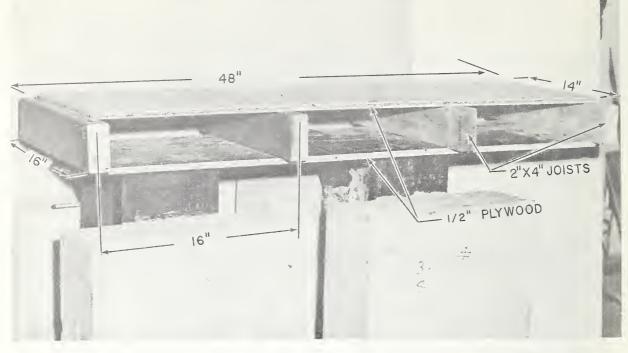


FIGURE 3.1 STANDARD SPECIMEN WITHOUT UNDERLAYMENT

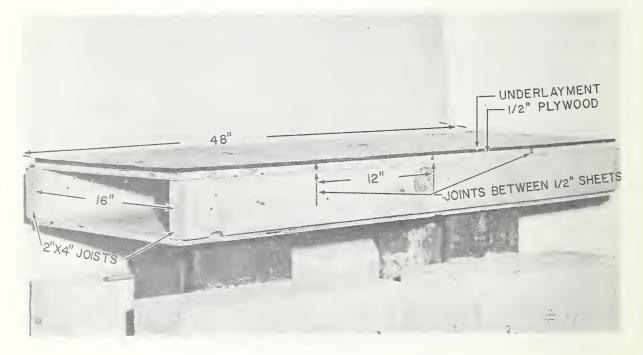


FIGURE 3.2 STANDARD SPECIMEN WITH UNDERLAYMENT

Standard specimens, as described in this section, were made for three different floor systems:

System A, using plywood a^{7/} System B, using plywood b System C, using plywood c

3.2.2 Standard Specimens with Underlayment

Figure 3.2 shows a typical standard specimen with underlayment. The two 48-in long 2 x 4 joists were spaced 16-in on center. Four 12-in long by 16-in wide sections of nominally 1/2-in thick plywood were nailed to the top and bottom faces of the joists. Each 12 x 16-in plywood section was nailed on each side by three 8d common nails, spaced 5-in on center. This spacing was less than the 6-in spacing required in "FHA Minimum Property Standards." The reduced nail spacing was chosen in an attempt to compensate for the fact that this specimen was only 16 inches wide, while in an actual building an 8 ft sheet would be used, and FHA Minimum Property Standards require, continiuty at least at one of the two joist supports ("over two or more spans"). The 1/2-in plywood sheets were oriented with the grain of the outer ply perpendicular to the axes of the joists. A continuous sheet of underlayment, 16 in wide by 48 in long, was nailed to the outer face of the 1/2 in plywood sheets. This underlayment consisted of either 7/32-in thick hardboard or 1/4-in thick plywood. The 1/4-in thick plywood underlayment was oriented with the grain of the outer plies parallel to the joists. The underlayment was nailed to the 1/2-in plywood sheets by 4d annular-thread nails spaced 6-in on center.

Standard specimens with underlayment were made for four different floor systems:

System D, using plywood d with 7/32-in hardboard underlayment; System E, using plywood c with 1/4-in plywood underlayment; System F, using plywood c with 7/32-in hardboard underlayment: System G, using plywood c with 1/4-in plywood underlayment.

3.2.3 Specimens With Other Than 16 in Joist Spacing

Several Specimens were made with other than 16 in joist spacing. These specimens were all without underlayment and were similar to the specimens described in Section 3.2.1 with the exception of the joist spacing.

 $\frac{7}{For}$ description of plywood refer to Section 3.1 and table 3.1.

3.2.4 Deviations from the provisions of "FHA Minimum Property Standards"

The test was performed on small specimens and a conservative simulation of the worst conditions was desired. Some aspects of the simulation may have adversely affected performance. Deviations from the provisions of MPS and their possible effects are listed below:

- 1. Subflooring System A used 15/32-in thick plywood, while MPS requires a minimum thickness of 1/2 in. The reduced thickness would cause a reduction in strength and stiffness.
- 2. The specimen in figure 3.1 is 14 in wide. In an actural floor 4-ft wide plywood sheet would be used. Any free edge of such a sheet would have to be blocked, and either blocking or Tongue-and-grove joints would have to be used where two sheets meet. Thus an actual floor may be somewhat stiffer than the test specimen.
- 3. In addition to the lack of continuity noted in Section 3.2.2, 12-in wide plywood subflooring strips were used in the specimens with underlayment shown in figure 3.2. Stiffness and possibly strength may have been reduced by engaging 12-in wide plywood strips, rather than the 4-ft wide sheets normally used in construction.

4. Testing Procedure

The specimens were fabricated and stored in the laboratory at approximately 73°F and 50 percent relative humidity. All the tests were performed in the same laboratory.

The load was transmitted from the head of a 60,000-1b capacity testing machine. The test setup is shown in figure 4.1. The specimen rested on the platten of the testing machine. Load was applied to the specimens through the end of a 6.5-in long steel rod. The end of this rod was sharp edged and machined to the required diameter. The steel rod was connected to a load cell which was inserted between the upper end of the rod and the head of the testing machine.

Deflection $\frac{8}{}$ was measured by a displacement transducer (LVDT). The transducer was connected to a base, made of a 2 x 4 wood member, 18-in long, that rested on three adjustable bolts. These bolts were so spaced that the base could be supported on the centerline of two joists on 16 in centers. Deflections were measured to the face of a bracket which was connected to the upper end of the load cell, thus measuring the downward movement of the

^{8/}The term "indentation" used in the criterion was interpreted as a deflection of localized nature which was measured relative to two points on the surface of the floor, spaced 16 in apart and which in some cases included a well defined indentation of the floor surface, as well as a localized deflection between two adjacent supporting joists. In the case of the standard specimens, the measured deflections at the critical locations were referenced to two points at the floor surface located above the centerlines of two adjacent supporting joists.

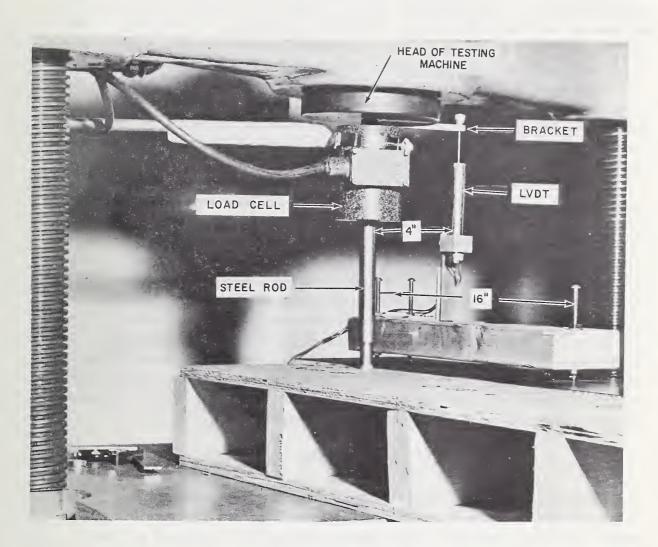


FIGURE 4.1 TEST SET UP

loading device relative to points, spaced 16 in apart and located at the surface of the specimen. The distance between the centerline of the displacement transducer and the centerline of the loading rod was 4 in.

Deflections thus measured also included shortening of the loading rod and the load cell. To determine the magnitude of this effect the shortening of the rod and the load cell was measured for loads up to 1000 lb. It was determined that the effect of this shortening on test results was of second order magnitude and corrections for this effect were therefore unnecessary.

Data were recorded electronically by transmitting the output from the displacement transducer and the load cell to an X-Y recorder. The X-Y recorder plotted loads on the Y axis to a scale of 100 lb per 1 in, and deflections on the X axis to a scale of 0.1 in per 1 in. This produced a graphical record of the data which had adequate resolution.

The load was applied at a rate of 1/2 lb/sec. Most specimens were loaded continuously to failure, but several specimens were subjected to cycles of unloading and reloading. After each load increment of 100 lb these specimens were completely unloaded and reloaded to a load 100 lb greater than the previous load or to failure, whichever came first. This procedure left a record of instantaneous deflection recovery for each specimen. On two specimens, a 400-lb load was maintained for one hour and the specimens were then unloaded and deflection recovery was measured after one hour. In some tests failure occured at loads higher than 1000 lb. In these cases the load cell which had a 1000-lb capacity was removed prior to the completion of the test and loads were measured by the testing machine. For these tests, only failure loads as defined in Section 5 were recorded since the deflections at failure were not measured.

5. Test Results

The test data which consist of a plotted load-deflection curve for each specimen tested are summarized in table 5.1. The first column in the table identifies the floor system, in accordance with the list of floor systems in table 2.1. The diameter of the loaded area is shown in the second column, the joists spacing in the third column, and the location of the test load in the fourth column. Test-load locations are identified as shown in figure 5.1. The other three columns identify failure load, load causing initial structural damage, and deflection at failure load, respectively.

The method by which these values were determined is illustrated in figure 5.2 which shows a typical load-deflection curve. In general, specimens could be loaded to a certain level without any sign of distress. First signs of distress, which were usually associated with some cracking sound, can be identified on the load-deflection curves as a drop in the applied

TADER D.T. TEST RESULT	TABLE	1.	TABLE	Test	Result:
------------------------	-------	----	-------	------	---------

Floor System	Diameter of Loaded Area in	Spacing of Joists in	Location of Test	Failure Load 1b	Load Causing Initial Structural Damage 1b	Deflection at Failure Load in
			1	540 700 620 400 565	480 670 570 400 530 Average	0.52 0.54 0.39 0.30
			2	450 600 525	450 460 455 Average	0.34 0.38
А	5/8	16	3	310 210 440 490 363	310 210 440 460 355 Average	0.67 0.51 0.68 0.84
15/32-in。 5 ply plywood			4	300 300 300	300 300 300 Average	0.61 0.36
			5	$\begin{array}{c} 1000 \ \underline{b} / \\ 1000 \ \underline{b} / \end{array}$	980 950 920 <u>c</u> / <u>c</u> /	0.12 <u>a</u> / 0.14 <u>a</u> / 0.13 <u>a</u> / 0.08 <u>a</u> / 0.07 <u>a</u> / 0.08 <u>a</u> /
	5/8	24	1	670 430 820 640	460 280 590 ³⁴³ Average	1.20 0.89 1.32
			2	1044 740 600 795	1044 300 600 648 Average	1.22 1.14 0.75

<u>a</u>/ Deflection readings were taken at 1000 lb.

b/ The test was discontinued at the load level indicated.

c/ No information is available.

13

Floor System	Diameter of Loaded Area in	Spacing of Joists in	Location of Test	Failure Load lb	Load Causing Initial Structural Damage 1b	Deflection at Failure Load in
			1	540 610 730 627	460 610 460 510 Average	0.63 0.64 0.88
		20	2	540 740 610 630	540 450 610 503 Average	0.50 0.80 0.61
			1	990 910 950	890 710 800 Average	0.39 0.41
A	5/8	10	2	1000 1138 960 1010 1027	1000 1138 940 950 1007 Average	0.37 0.30 <u>a</u> / 0.27 0.31 <u>a</u> /
		6	1	1082 1372 1227	1082 1372 1227 Average	0.25 <u>a</u> / 0.18 <u>a</u> /
			2	994 1290 1122 1172 1145	994 c/ c/ c/ Average	$\begin{array}{c} 0.28 \\ 0.22 \underline{a} \\ 0.22 \underline{a} \\ 0.22 \underline{a} \\ 0.22 \underline{a} \\ \end{array}$
	1	16	1	1040 1208 1482 670 1065 970 795 795 1003	640 1000 1000 670 740 860 700 795 801 Average	$\begin{array}{c} 0.58 \underline{a} \\ 0.46 \underline{a} \\ 0.49 \underline{a} \\ 0.36 \\ 0.56 \underline{a} \\ 0.54 \\ 0.43 \\ 0.42 \end{array}$
			2	1152 590 800 590 783	1000 590 710 590 723 Average	0.48 <u>a</u> / 0.31 0.62 0.32


				1		
Floor	Diameter	Spacing	Location	Failure	Load Causing	Deflection
System	of	of	of	Load	Initial Structural	at Failure
	Loaded Area	Joists	Test		Damage	Load
	in	in		1b	1b	in
			1	845	845	0.64
			T			
				860	860 370	0.74
		20		530	558 Average	0.51
		20		145	JJO AVETAGE	
				850	660	0.66
			2	1242	1000	0.87 <u>a</u> /
				1264	560	0.84 <u>a</u> /
А	1			1119	740 Average	
			1	1788	c/	c/
				1706	c/	<u>c</u> /
		10		1747	Average	
	-			1662	c/	c/
			2	1182	<u>c</u> /	$ \frac{-}{c}$
				1726	c/	<u>c</u> /
				1268	c/	
				1460	Average	
			1	1750	<u>c</u> /	<u>c</u> /
				1740	c/	<u>c</u> /
		6		1745	Average	—
				1546	<u>c</u> /	c/
			2	1564	c/	c/
	-			1508	<u>c</u> /	c/
				1584	c/	c/
				1551	Average	
l		<u> </u>		- <u>}</u>		1
				895	895	0.51
			1	860	660	0.61
				825	810	0.61
	0.5			600	600	0.40
				795	741 Average	
В	5/8	16	2	730	700	0.43
1/2-in.		1		790	790	0.51
5 ply				760	745 Average	
plywood				290	290	0.43
Prywood				480	470	0.68
			3	425	360	0.68
				590	590	0.79
	1			446	428 Average	
					· · · · · · · · · · · · · · · · · · ·	*****

Floor System	Diameter of Loaded Area in	Spacing of Joists in	Location of Test	Failure Load lb	Load Causing Initial Structural Damage 1b	Deflection at Failure Load in
		16	4	440 634 537	440 634 537 Average	0.57 0.68
			5	840 1000 <u>b</u> / 950 1000 <u>b</u> / 1000 <u>b</u> / 1000 <u>b</u> /	$ \begin{array}{c} 840 \\ \\ 950 \\ 630 \\ \\ \\ \\ -/ \end{array} $	0.14 0.12 <u>a</u> / 0.13 0.14 <u>a</u> / 0.11 <u>a</u> / 0.11 a/
В	5/8	24	1	890 945 730 910 652 640 600 920 748	780 790 640 910 360 600 600 500 640 Average	1.29 1.29 1.20 1.25 1.06 1.08 0.94 1.27
			2	680 670 795 770 729	660 670 795 770 724 Average	0.81 1.07 0.97 0.92
		20	1	785 634 800 740	785 634 630 683 Average	0.79 0.59 0.90
			2	990 810 810 870	890 660 810 787 Average	0.78 0.71 0.61
		10	1	940 650 830 1126 900 889	690 650 550 570 900 672 Average	0.39 0.24 0.31 0.44 <u>a</u> / 0.25

Floor System	Diameter of Loaded Area in	Spacing of Joists in	Location of Test	Failure Load 1b	Load Causing Initial Structural Damage 1b	Deflection at Failure Load in
в	5/8	10	2	660 960 660 840 800 990 81.8	620 820 660 830 800 670 733Average	0.36 0.38 0.23 0.31 0.27 0.35
		6	1	830 1012 921	680 1012 846Average	0.20 0.28 <u>a</u> /
		-	2	790 810 938 975 878	790 810 938 830 842Average	0.17 0.18 0.32 0.29
			1	580	540	0.31
			2	770	770	0.37
	5/8	16	3	250 380 315	250 380 315 Average	0.31 0.62
			5	1000 <u>b</u> / 1000 <u>b</u> /	520 470 495 Average	0.12 <u>a</u> / 0.13 <u>a</u> /
C 1/2-in.	1/2	16	5	1000 <u>b</u> / 1000 b/	280 700 490Average	0.21 <u>a</u> / 0.19 <u>a</u> /
3-ply plywood	1	16	1	710 710 710 710	620 630 625 Average	0.59 0.37
			3	420 660 540	350 460 405 Average	0.76 0.85
			4	400	350	0.45

Floor System	Diameter of Loaded Area in	Spacing of Joists in	Location of Test	Failure Load 1b	Load Causing Initial Structural Damage lb	Deflection at Failure Load in
	5/8	16	lu	780 675 695 680 708	570 620 660 480 583 Average	1.21 0.53 0.57 0.71
			2u	568	330	<u>c</u> /
			3u	1000 <u>b</u> / 1000 <u>b</u> /	<u>c</u> / <u>c</u> /	0.18 <u>a</u> / 0.18 <u>a</u> /
D 1/2-in. 3-ply	1	16	lu	1025 1006 1002 1008 1064 985 1015	910 730 1000 1008 1064 960 945 Average	0.74 <u>a</u> / 0.70 0.71 0.70 0.71 0.80
plywood			2u	800 640 700 660 700	570 440 570 500 520 Average	1.32 1.31 1.50 1.50
			3u	$ \begin{array}{c} 1000 \ \underline{b} \\ 1000 \ \underline{b} \\ 1000 \ \underline{b} \\ 1000 \ \underline{b} \\ \end{array} $	c/ c/ c/ c/	0.09 <u>a</u> / 0.09 <u>a</u> / 0.11 <u>a</u> / 0.11 <u>a</u> /
E	5/8	16	lu	410 542 540 497	360 542 540 481 Average	0.51 0.53 0.52
1/2-in. 3-ply plywood			2u	400 450 425	390 420 405 Average	0.73 0.96
+ 1/4-in. plywood			Зu	670 880 775	670 810 740 Average	0.22 0.18

Floor	Diameter	Spacing	Location	Failure	Load Causing	Deflection
Systems	of	of	of	Load	Initial Structural	at Failure
bystemo	Loaded Area	Joist	Test	Load	Damage	Load
-	in	in	1030	1b	.1b	in
				1002	1002	0.65
				1104	1000	0.63 a/
				890	890	0.63
			lu	830	830	0.58
				670	500	0.50
				700	550	0.70
Е	1	16		866	795Average	
				820	630	1.31
				380	380	0.63
			2	-	-	
			2 [.] u	670	530	1.48
				545	240	1.50
				604	445Average	
			3u	1000 Ъ/	<u>c</u> /	0.16 a/
				1000 b/	c/	0.16 a/
				1000 b/	c/	0.21 a/
				1000 b/	<u>c</u> /	0.21 a/
F	5/8	16	lu	950	950	0.55
				890	860	0.58
1/2 - in.	+ 7/32-in.			920	905Average	
3-ply	hardboard			+		
plywood			2u	420	420	0.66
prywood				310	290	0.39
+ 1/4-in.				365	355 Average	
plywood			3u	1000 b/	c/	0.12 a/
			Ju	1000 b/	<u>c</u> /	$0.12 \frac{a}{a}$
				1000 0/	<u> </u>	0.12 4/
				720	670	0.43
			lu	860	680	0.56
				770	690	0.56
				.783	680 Average	
G	5/8	16	2u	350	300	0.55
1/2-in.				370	370	0.53
3-ply				360	335 Average	
plywood				1000 Ъ/	c/	0.20
+ 1/4-in。 plywood			Su	1000 b/	<u>c</u> /	0.20
				1 TOOD D/	0/	0.17

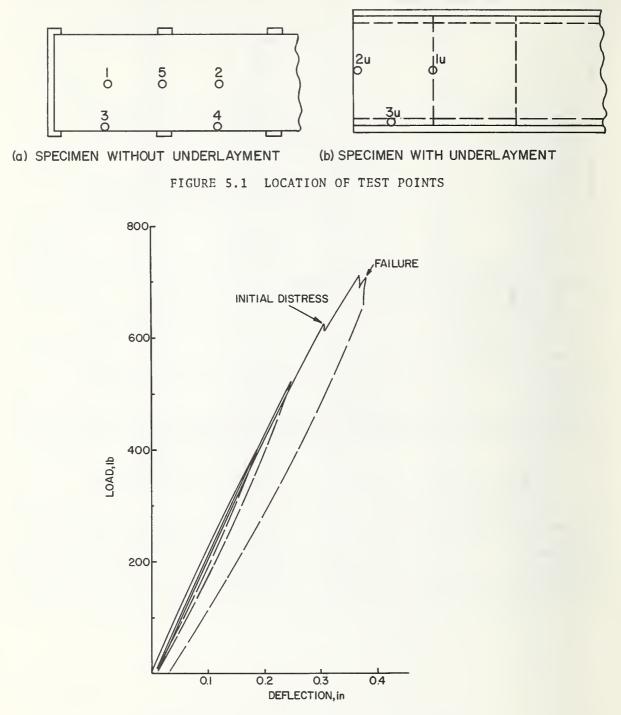



load which is not associated with a change in deflection. Such a drop in load is associated with a residual deflection which is roughly proportional to the magnitude of the drop in load. The load level at which this first distress occurred is identified in column 6 of table 5.1, and is shown in figure 5.2. If loading was subsequently continued, most specimens were able to support additional load increments without an appreciable change in the slope of the load-deflection curve, until an additional drop in load occurred at a higher load level.

The failure load in column 5 of table 5.1 identifies the lowest load level at which a load drop of 30 lb or more occurred. This point does not always represent the highest load that the specimen can support. The definition of failure load is based on the observation that a load drop of 30 lb was associated with irrecoverable deflections approaching 1/16in. It is reasonable to assume that after such a drop in load most specimens would not meet the deflection-recovery requirements in the criterion which specifies a residual deflection of less than 1/16 in, and that a clearly identifiable residual deflection would remain on all specimens after removal of the load.

The information presented in Table 5.1 is summarized in Table 5.2, where the average loads causing failure and initial distress are tabulated for specimens with 16-in joist spacing. Other information that can be derived from the test data, together with plots of typical load-deflection curves, is presented in Section 6 where test results are interpreted.

6. Interpretation of Test Results

6.1 Compliance with the Criterion Adopted for Operation Breakthrough

6.1.1 Concentrated-load capacity

Figure 6.1 is a plot showing the range of load capacities and average load capacities for specimens with 16-in joist spacing. The test data are for test locations 1 and 1u in figure 5.1 since these locations are considered critical. Actually tests at locations 3, 4, and 2u yielded lower results, however, in accordance with FHA Minimum Property Standards, free edges of plywood sheets should be either blocked or tongue and groove joints should be provided. Compliance with the criterion at test locations 3, 4 and 2u is therefore not required.


The shaded rectangles in figure 6.1 show the range of the failure loads and the unshaded rectangles show the range of loads that caused initial distress. The solid and hollow circles $\frac{9}{}$ show the average loads at failure

^{9/}In some cases the test results do not cover a significant range, or only one single test was performed. In these cases only the solid and hollow circles are shown.

TABLE 5.2

Summary of Average Test Results for Specimens with 16-in Joist Spacing

		5/8-i	n Diameter Area	l-in Diameter Area		
Floor	Location	Average	Average Load	Average	Average Load	
Systems	of	Failure	Causing Initial	Failure	Causing Initial	
	Test	Load	Structural Damage	Load	Structural Damag	
		1b	1b	1b	1b	
А	1	565	530	1003	801	
	2	525	455	783	723	
	3	363	355			
	4	300	300			
	5	1000+	975 +			
В	1	795	745			
	2	760	745			
	3	446	428			
	4	537	537			
	5	1000+	903+			
Ċ,	1	580	540	710	625	
	2	770	770			
	3	315	315	540	405	
	4			400	350	
	5	1000+	495			
D	lu	708	583	.1015	945	
	2u	568	330	700	520	
	3u	1000+		1000+		
Е	lu	497	481	866	795	
	2u	425	405	604	445	
	3u	775	740	1000+		
F	lu	920	905			
	2u	365	355			
	3u	1000+				
G	lu	783	680			
	2u	360	335			
	3u	1000+				

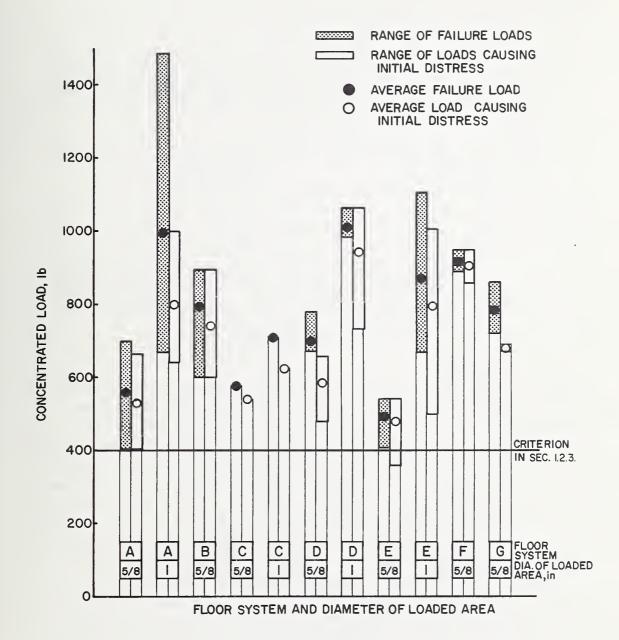

and initial distress respectively. Test results are plotted for loaded areas of 5/8 in, as well as 1 in diameter. The heavy horizontal line shows the load level required by the criterion.

The following conclusions can be derived from figure 6.1:

- 1.) All specimens tested failed at load levels equal to, or higher than that required by the criterion.
- 2.) Except for floor system E, all specimens tested showed first signs of distress at load levels equal to or higher than that required by the criterion. For system E, two out of the three specimens tested showed first signs of distress at load levels higher than that required by the criterion, and the third specimen showed first signs of distress at a load of 390 lb.
- 3.) In all cases, specimens tested by the 1-in diameter disc had significantly greater load capacity than specimens tested with the 5/8-in diameter disc.

The overall conclusion is, that except for one specimen in system E, all specimens satisfied the criterion and most specimens exceeded the capacity required in the criterion by a substantial margin. It should be noted that this conclusion is based on a test setup which uses specimens of 14 in and 12 in width, respectively. This is a conservative simulation of the least strength that a floor may be expected to develop. In an actual building, where floors are continuous over much larger areas, load capacities may be higher.

6.1.2 Deflection Recovery

Figure 6.2 shows the load-deflection curve for a test in which floor system C was loaded in accordance with the requirement of the criterion. Deflections are plotted along the abscissa, and loads along the ordinate.

Note that the instantaneous deflection under the 400-1b load was approximately 0.178 in. When the load was sustained for an hour, this deflection increased to 0.190 in and when the load was removed there was an instantaneous deflection recovery to a residual deflection of 0.02 in. One hour after unloading, the remaining residual deflection was 0.01 in. Thus residual deflection measured for this specimen was substantially smaller than the maximum 1/16-in (0.0625 in) residual deflection stipulated by the criterion.

Figures 6.3 through 6.7 show deflection-recovery characteristics for floor systems A,B,C,F, and G, respectively. In all cases the residual deflection, measured immediately after removal of the 400-1b load, was substantially less than 1/16 in. This is taken as an indication that all these floor systems have deflection-recovery characteristics which would satisfy the criterion. Floor systems D and E were not tested under cycles of unloading and reloading. The observation that load-deflection curves for the

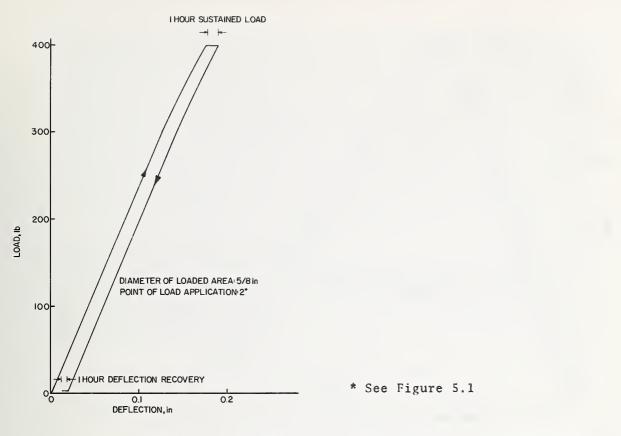


FIGURE 6.2 COMPLIANCE OF FLOOR SYSTEM C WITH BREAKTHROUGH CRITERION

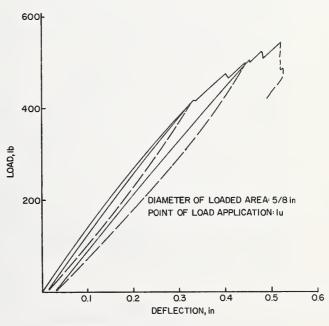


FIGURE 6.3 DEFLECTION RECOVERY CHARACTERISTICS OF FLOOR SYSTEM A

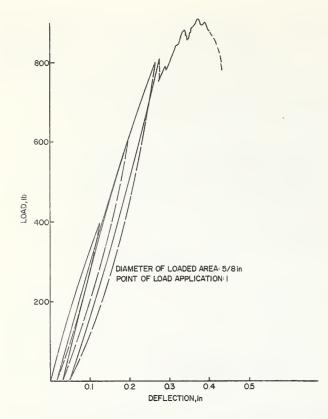


FIGURE 6.4 DEFLECTION RECOVERY CHARACTERISTICS OF FLOOR SYSTEM B

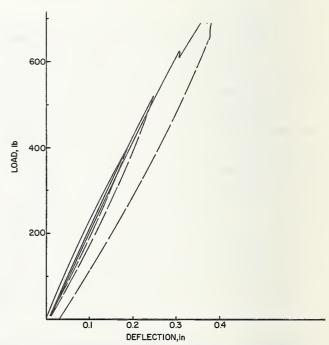


FIGURE 6.5 DEFLECTION RECOVERY CHARACTERISTICS OF FLOOR SYSTEM C

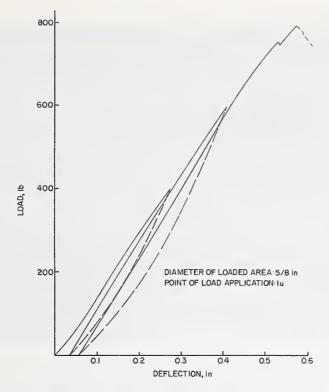


FIGURE 6.6 DEFLECTION RECOVERY CHARACTERISTICS OF FLOOR SYSTEM F

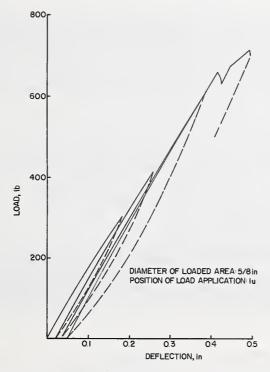


FIGURE 6.7 DEFLECTION RECOVERY CHARACTERISTICS OF FLOOR SYSTEM G

tested specimens of floor systems D and E tended to be linear below the 400-lb load is taken as an indication that these systems have deflectionrecovery characteristics similar to those of systems A,B,C,F, and G.

6.3.1 Sustained-Load Capacity

No long-term tests were conducted to determine the sustained-load capacity of the specimens. Some indication of the magnitude of that capacity can be derived using the data presented in reference [5]. In accordance with these data, a 1-hr capacity of 400 1b would correspond to a 1-year capacity of 290 1b and to a 30-year capacity of 265 1b.

If we define the 30-year capacity as the required sustained load capacity, a one-hour capacity of 422 lb would satisfy the 280-lb requirement in the criterion. Of the 26 specimens tested at load locations 1, 2 and lu, 24 exceeded this capacity. Thus it can be concluded that the floor systems tested generally satisfy the requirement for sustained-load capcity.

6.2 Failure Modes

Figures 6.8 and 6.9 illustrate two typical modes of failure. Figure 6.8 shows a typical failure of a specimen of floor system A loaded over a 1-in diameter area and gives the appearance of a flexural tensile crack. Figure 6.9 shows the failure mode of a specimen of floor system B, loaded over a 5/8-in diameter area, which is typical for most specimens under this loading except for specimens that were loaded over the joist support at locations 5 and 3u. This mode of failure has the appearance of a combination of a local shear failure (punching shear) in the upper four plies together with a flexural tensile failure in the lowest ply.

When test results are interpreted, some conclusions could be drawn from a theoretical consideration of the effects of the variation of the loaded area, the joist spacing, and the location of the applied load. The following theoretical considerations apply to loads acting at locations 1, 2 and lu:

- 1.) Flexural stress would vary with joist spacing, however the diameter of the loaded area would have relatively little effect. Flexural failure would probably occur under the loaded area.
- 2.) Local (punching) shear would vary with the diameter of the loaded area and would not vary with joist spacing. Failure by local shear would occur close to the perimeter of the loaded area.
- 3.) Vertical compression would vary with the diameter of the loaded area and would be independent of the location of the loaded area and of joist spacing.

Indentations caused by vertical compression were determined in the testing program by applying concentrated loads over the joists at locations 5 and 3u. On this basis it was determined that vertical compression would not be critical for the 1-in and the 5/8-in diameter loading discs. The 1/2-in

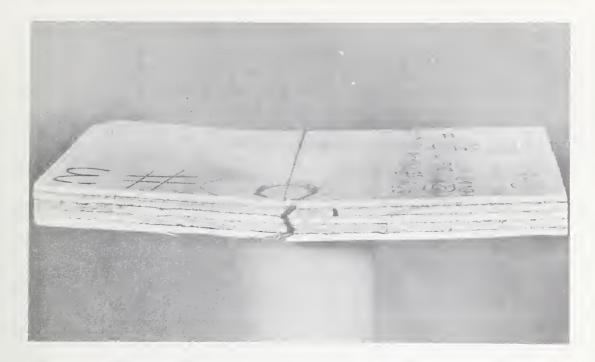


FIGURE 6.8 TYPICAL FAILURE OF FLOOR SYSTEM A LOADED OVER A 1-in DIAMETER AREA

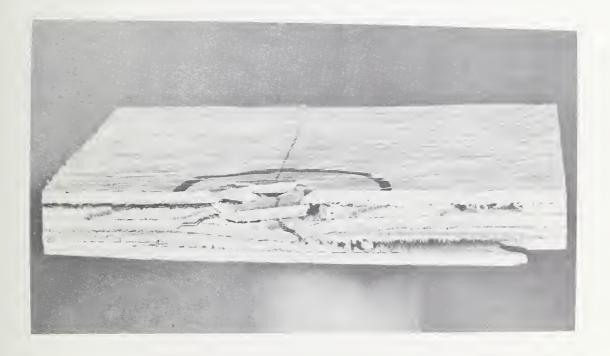


FIGURE 6.9 TYPICAL FAILURE MODE OF FLOOR SYSTEM B LOADED OVER A 5/8 in. DIAMETER AREA diameter disc was ruled out on the basis of tests performed at location 5 on floor system C where it caused a residual deflection in excess of 1/16 in under a 400-1b load. Data for these tests are shown in table 5.1.

Some conclusions about the failure mode can be drawn by considering the effect of joist spacing and of the diameter of the loaded area. It has already been noted in section 6.1.1 that load capacity increased with an increase in the diameter of the loaded area. This effect, and the effect of joist spacing are illustrated in figures 6.10 and 6.11.

Figure 6.10 shows the effect of joist spacing on failure loads and load levels at which initial damage occurred in system A. Note that there was considerable variation in strength between individual specimens. The average values therefore only represent approximate trends since the number of samples used was small.

For the 1-in diameter test load there was no difference in strength between the 6-in and the 10-in joist spacing. At these spacings failure probably occurred by punching shear. For larger joist spacing the failure load decreased with increased spacing. This decrease, together with the characteristics of the typical failures which is shown in figure 6.8, leads to the conclusion that these specimens probably failed by flexural compression and tension.

For the 5/8-in diameter test load the failure load tends to decrease with increased joist spacing between the 6-in and the 16-in spacing. For spacings larger than 16 in the failure load increased. This inconsistency may be attributable to the strength variability (this sample was too small to be statistically significant). The dashed curve, which shows loads causing initial damage, shows a consistent decrease of load with increased joist spacing. Since for flexural failure the failure load would be independent of disc-size and for local shear the load would be independent of joist spacing, it is concluded from figure 6.10 that for the 5/8-in loading diameter failure probably was caused by a complex combination of flexural stresses and local shear.

Figure 6.11 shows the relationship between load capacity and joist spacing for floor system B, loaded over a 5/8-in diameter area. In this case capacity only slightly decreased with joist spacing. The dominant failure mode for these specimens was probably local shear. Tests on specimens with other than 16-in joist spacing were only performed on floor systems A and B.

30


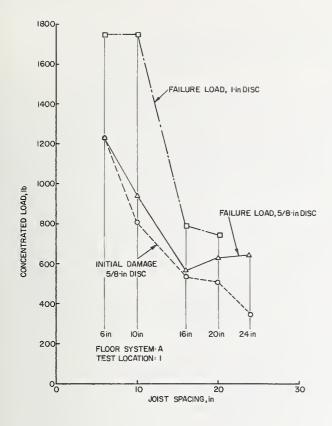


FIGURE 6.10 RELATIONSHIP BETWEEN JOIST SPACING AND STRENGTH

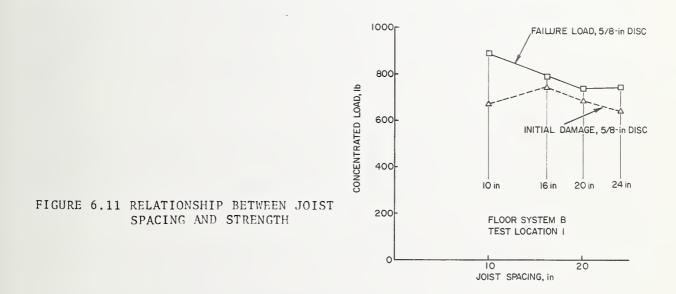

6.3.1 Floor Systems Without Underlayment

Floor systems A, B and C were tested at 5 different locations. Locations 1 and 2 were between joists and 6 in from the free edge of the plywood sheet. These locations differed only in the fixity of the plywood sheet at the joist support. At location 1 the edge of the plywood was nailed to one joist support and the plywood was continuous over the other joist support. At location 2 the plywood was continuous over both joist supports. It was reasoned that location 1 should be weaker than location 2 since there was less fixity at the joist that supported the edge of the plywood sheet. However, comparison of the average test results in table 5.2 indicates that the strength at location 2 was similar to that of location 1 in systems A and B. Only system C had greater strength at location 2. Locations 3 and 4 were at the edge of the plywood sheet between joists and represented points of least strength. This can be seen from the data in table 5.2. Location 5 was over the joist support, and as expected, supported much higher loads.

A comparison of load-deflection characteristics for various loading points is shown for system A in figure 6.12. As expected. location 5 is the stiffest. There is little difference in stiffness between locations 2 and 1, and locations 3 and 4 also have comparable stiffness. This is consistent with the observation that there was no significant difference in strength between locations 1 and 2, as well as between locations 3 and 4.

Location 1 is considered to correspond to the most critical condition in an installed floor since, in a properly constructed floor, the free edge at locations 3 and 4 should be supported by blocking.

6.3.2 Floor Systems With Underlayment

Floor systems D, E, F and G were tested at three locations. Location lu is halfway between joists and at a point where two free edges of the plywood sheet are covered by underlayment. Location 2u is at a free, unsupported edge midway between joists, and location 3u is over a joist. The test results at these locations are shown in table 5.2. As expected, location 3u is the strongest and location 2u the weakest.

The load-deflection characteristics for these loading points are compared in figure 6.13 for floor system E.

Location lu is considered to represent a simulation of the most critical condition that should be considered, since in accordance with "FHA Minimum Property Standards" the free edge at location 2u should be blocked.

32

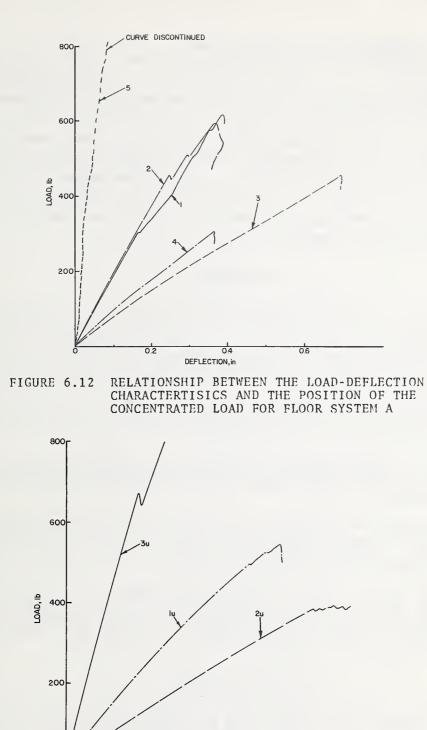


FIGURE 6.13 RELATIONSHIP BETWEEN THE LOAD-DEFLECTION CHARACTERISTOCS ADN THE POSITION OF THE CONCENTRATED LOAD FOR FLOOR SYSTEM E

DEFLECTION, In

0.4

0.2

0.6

00

6.4 Relative Stiffness of the Floor Systems

The load-deflection curves of the floor systems without underlayment, loaded at location 1, are compared in figure 6.14. The ratio between applied load and measured deflection at location 1 can be taken as a measure of stiffness. System A was the least stiff. This system also had the least strength. It has been noted in Section 3.2.4, that system A does not meet the requirements set by "FHA Minimum Property Standards" since the thickness of the plywood was reduced by 1/32 of an inch by the sanding of one surface.

The load-deflection curves of floor systems with underlayment, loaded at location lu, are compared in figure 6.15. Again, the least stiff system (E) developed the least strength.

7. Conclusions

- 1.) Out of 26 tests performed on the specimens at the weakest location likely to be encountered in a built floor, 24 exceed the one-hour load capacity stipulated in the Operation Breakthrough criterion for concentrated-load capacity, which is based on anticipated occupancy loads, by a substantial margin, one test exactly satisfied the criterion, and one test did not comply with the criterion.
- 2.) For those tests that exceeded the one-hour load capacity requirement, residual deflections were generally smaller than the 1/16-in maximum stipulated in the criterion.
- 3.) On the basis of the data presented in reference [5], it can be concluded that in 24 out of 26 tests conducted the specimens probably met the performance level under sustained load stipulated in the criterion.
- 4.) The observed mode of failure under the 5/8-in diameter loaded area was punching shear or a complex combination of flexure and punching shear. Vertical compressive stresses developed under the concentrated load were not critical.
- 5.) Load capacity under a 1-in diameter loaded area exceeded the capacity under a 5/8-in diameter loaded area by a substantial margin. Under a 1/2-in diameter loaded area vertical compressive stresses caused by a 400-1b concentrated load exceeded the compressive strength of the material.

8. Acknowledgement

The contribution of the following persons is acknowledged. Frank A. Rankine, James F. N. Seiler and Lymus Payton from the staff of the Center for Building Technology and James Warfield, formerly on the Staff of the Building Research Division of the National Bureau of Standards.

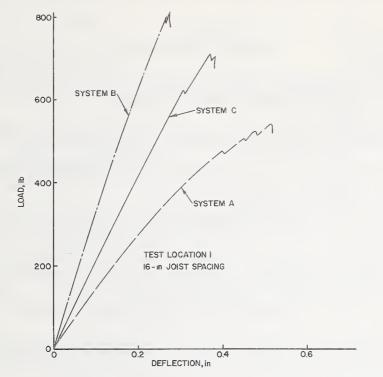


FIGURE 6.14 RELATIVE STIFFNESS OF FLOOR SYSTEMS WITHOUT UNDERLAYMENT

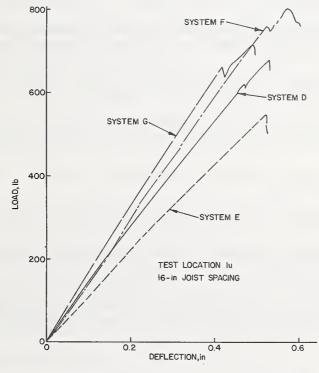


FIGURE 6.15 RELATIVE STIFFNESS OF FLOOR SYSTEMS WITH UNDERLAYMENT

- [1] The Building Research Division Team, Guide Criteria for the Evaluation of Operation Breakthrough Housing Systems, dated December 1970 (NTIS Accession Numbers PB-212055, 212056, 212058).
- [2] Housing and Home Finance Agency, Performance Standards, Structural and Insulation Requirements for Houses, Washington, D.C., June 1947.
- [3] Boyd, J. D., Minimum Strength and Stiffness Necessary for Wooden Floors in Houses, Paper No. 34, CSIRO, Division of Forest Product Technology Melbourne, Australia, 1964.
- [4] Thorburn, H. T., Flooring Damage by Heels, Materials Research Standards, ASTM, Vol. 2, No. 9, Philadelphia, Pa., September 1962.
- [5] Wood, Lyman W., Relation of Strength of Wood to Duration of Load, Forest Products Laboratory, Madison Wisconsin, December 1951.
- [6] ASTM Designation E72-68, Conducting Strength Tests of Panels for Building Construction, American Society for Testing Materials, Philadelphia, Pa., 1968.
- [7] ASTM Designation D 2394-69, Tests for Simulated Service Testing of Wood and Wood-Base Finish Flooring, American Society for Testing Materials, Philadelphia, Pa., 1969.
- [8] National Bureau of Standards, Voluntary Product Standard PS 1-66, Softwood Plywood, Construction and Industrial, U.S. Government Printing Office, Washington, D.C., July 1970.
- [9] General Service Administration, Federal Specification, LLL-B-810 a, Building Board (Hardboard) Hard Pressed, Vegetable Fiber, Washington, D.C., July 7, 1965.
- [10] West Coast Lumber Inspection Bureau (WCLIB), Rules No. 15, Grading and Dressing Rules, Portland, Oregon, January 1, 1969.
- [11] ASTM Designation D 805-63, Veneer, Plywood and other Glued Veneer Construction Testing, American Society for Testing Materila, Philadelphia, Pa., 1963.
- [12] U.S. Department of Commerce, Commerical Standard, CS 251-63, Washington, D.C., April, 1967.
- [13] ASTM Designation D 2016-65, Tests for Moisture Content of Wood, American Society for Testing Materials, Philadelphia, Pa., 1965.
- [14] ASTM Designation D2395-65 T, Tests for Specific Gravity of Wood and Wood-Base Materials, American Society for Testing Materials, Philadelphia, Pa., 1965.
- [15] Federal Housing Administration, Minimum Property Standard for One and Two Living Units, Washington, D.C., November 1966, as subsequently amended.

NBS-114A (REV. 7-73)

U.S. DEPT. OF COMM. BIBLIOGRAPHIC DATA SHEET	1. PUBLICATION OR REPORT NO. NBS BSS-53	2. Gov't Accession No.	3. Recipient's Accession No.
4. FITLE AND SUBTITLE			5. Publication Date
Study of the Local Resistance of Conventional Plywood Subflooring to Concentrated Load 7. AUTHOR(S) Felix Y. Yokel 9. PERFORMING ORGANIZATION NAME AND ADDRESS		Plywood	May 107/
			May 1974 6. Performing Organization Code
			8. Performing Organ. Report No.
			10. Project/Task/Work Unit No.
NATIONAL BUREAU OF STANDARDS DEPARTMENT OF COMMERCE WASHINGTON, D.C. 20234			11. Contract/Grant No.
12. Sponsoring Organization Name and Complete Address (Street, City, State, ZIP)		State, ZIP)	13. Type of Report & Period Covered
Office of Research & Technology			
Department of Housing & Urban Development Washington, D.C. 20410			Final 14. Sponsoring Agency Code
5. SUPPLEMENTARY NOTE Library of Cong		74 - 60007 5	
plywood floor syst their performance basis of anticipat In 24 out of required by the cr	ve specimens, simulating the mems, were tested under conce- with that stipulated by per- ed occupancy loads. 26 tests the performance of riteria. Data on failure loa are presented and discussed	entrated load in formance criteri the specimens e ads, load-deflec	order to compare a developed on the xceeded that
name; separated by semico Evaluation criteri	e entries; alphabetical order; capitalize or lons) a; floors; hardboard; load o ng; subflooring; underlaymen	capacity, perform	mance criteria;
name; separated by semico Evaluation criteri plywood subfloorir	lons) a; floors; hardboard; load (capacity, perform	mance criteria; nstruction. TY CLASS 21. NO. OF PAGES
name; separated by semico Evaluation criteri plywood subfloorir 8. AVAILABILITY	dons) La; floors; hardboard; load ng; subflooring; underlaymen	capacity, perfor t; wood-frame co 19. SECURI	mance criteria; nstruction. TY CLASS EPORT) 43
name; separated by semico Evaluation criteri plywood subfloorir 8. AVAILABILITY For Official Distributi	lons) La; floors; hardboard; load La; subflooring; underlaymen Lx Unlimited	capacity, perform t; wood-frame com 19. securit (THIS RI	mance criteria; nstruction. TY CLASS EPORT) SIFIED TY CLASS AGE) 21. NO. OF PAGES 43 22. Price
name; separated by semico Evaluation criteri plywood subfloorin 8. AVAILABILITY For Official Distributi Criter From Sup. of Do Washington, D.C. 204	 Ions) La; floors; hardboard; load of ag; subflooring; underlayment T Unlimited on. Do Not Release to NTIS c., U.S. Government Printing Office 02, SD Cat. No. C13 • 29/2:53 Fechnical Information Service (NTIS) 	capacity, perform t; wood-frame con 19. SECURIT (THIS RI UNCL AS 20. SECURIT	mance criteria; nstruction. TY CLASS EPORT) 43 SIFIED TY CLASS AGE) 21. NO. OF PAGES 43 22. Price 85 cents



Announcement of New Publications in Building Science Series

Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402

Dear Sir:

Please add my name to the announcement list of new publications to be issued in the series: National Bureau of Standards Building Science Series.

Name _____

Company _____

Address _____

City _____ State ____ Zip Code _____

(Notification key N-339)

NBS TECHNICAL PUBLICATIONS

PERIODICALS

JOURNAL OF RESEARCH reports National Burcau of Standards research and development in physics, mathematics, and chemistry. Comprehensive scientific papers give complete details of the work, including laboratory data, experimental procedures, and theoretical and mathematical analyses. Illustrated with photographs, drawings, and charts. Includes listings of other NBS papers as issued.

Published in two sections, available separately:

• Physics and Chemistry (Section A)

Papers of interest primarily to scientists working in these fields. This scction covers a broad range of physical and chemical research, with major emphasis on standards of physical measurement, fundamental constants, and properties of matter. Issued six times a year. Annual subscription: Domestic, \$17.00; Foreign, \$21.25.

• Mathematical Sciences (Section B)

Studies and compilations designed mainly for the mathematician and theoretical physicist. Topics in mathematical statistics, theory of experiment design, numerical analysis, theoretical physics and chemistry, logical design and programming of computers and computer systems. Short numerical tables. Issued quarterly. Annual subscription: Domestic, \$9.00; Foreign, \$11.25.

DIMENSIONS, NBS

The best single source of information concerning the Bureau's measurement, research, developmental, cooperative, and publication activities, this monthly publication is designed for the layman and also for the industry-oriented individual whose daily work involves intimate contact with science and technology -for engineers, chemists, physicists, research managers, product-development managers, and company executives. Annual subscription: Domestic, \$6.50; Foreign, \$8.25.

NONPERIODICALS

Applied Mathematics Series. Mathematical tables, manuals, and studies.

Building Science Series. Research results, test methods, and performance criteria of building materials, components, systems, and structures.

Handbooks. Recommended codes of engineering and industrial practice (including safety codes) developed in cooperation with interested industries, professional organizations, and regulatory bodies.

Special Publications. Proceedings of NBS conferences, bibliographies, annual reports, wall charts, pamphlets, etc.

Monographs. Major contributions to the technical literature on various subjects related to the Bureau's scientific and technical activities.

National Standard Reference Data Series. NSRDS provides quantitative data on the physical and chemical properties of materials, compiled from the world's literature and critically evaluated.

Product Standards. Provide requirements for sizes, types, quality, and methods for testing various industrial products. These standards are developed cooperatively with interested Government and industry groups and provide the basis for common understanding of product characteristics for both buyers and sellers. Their use is voluntary.

Technical Notes. This series consists of communications and reports (covering both other-agency and NBS-sponsored work) of limited or transitory interest.

Federal Information Processing Standards Publications. This series is the official publication within the Federal Government for information on standards adopted and promulgated under the Public Law 89–306, and Bureau of the Budget Circular A–86 entitled, Standardization of Data Elements and Codes in Data Systems.

Consumer Information Series. Practical information, based on NBS research and experience, covering areas of interest to the consumer. Easily understandable language and illustrations provide useful background knowledge for shopping in today's technological marketplace.

BIBLIOGRAPHIC SUBSCRIPTION SERVICES

The following current-awareness and literature-survey bibliographies are issued periodically by the Bureau:

Cryogenic Data Center Current Awareness Service (Publications and Reports of Interest in Cryogenics). A literature survey issued weekly. Annual subscription : Domestic, \$20.00; foreign, \$25.00.

Liquefied Natural Gas. A literature survey issued quarterly. Annual subscription: \$20.00.

Superconducting Devices and Materials. A literature survey issued quarterly. Annual subscription: \$20.00. Send subscription orders and remittances for the preceding bibliographic services to the U.S. Department of Commerce, National Technical Information Service, Springfield, Va. 22151.

Electromagnetic Metrology Current Awareness Service (Abstracts of Selected Articles on Measurement Techniques and Standards of Electromagnetic Quantities from D-C to Millimeter-Wave Frequencies). Issued monthly. Annual subscription: \$100.00 (Special rates for multi-subscriptions). Send subscription order and remittance to the Electromagnetic Metrology Information Center, Electromagnetics Division, National Bureau of Standards, Boulder, Colo. 80302.

Order NBS publications (except Bibliographic Subscription Services) from: Superintendent of Documents, Government Printing Office, Washington, D.C. 20402.

U.S. DEPARTMENT OF COMMERCE National Bureau of Standards Washington, O.C. 20234

OFFICIAL BUSINESS

Penalty for Private Use, \$300

PDSTAGE AND FEES PAID U.S. DEPARTMENT OF COMMERCE COM-215



