



**NBSIR 84-2971**

# **Thermodynamic Properties of Isobutane-Isopentane Mixtures From 240 to 600 K and Up to 20 MPa**

---

**With Supplemental Tables from  
-40 to +600°F and up to 1000 psia**

J. S. Gallagher, J. M. H. Levelt Sengers,  
G. Morrison and J. V. Sengers

U.S. DEPARTMENT OF COMMERCE  
National Bureau of Standards  
National Engineering Laboratory  
Center for Chemical Engineering  
Thermophysics Division  
Gaithersburg, Maryland 20899

November 1984

Interim Report

Prepared for:

Division of Geothermal and Hydropower Technology  
U.S. Department of Energy  
Oakland, California

QC  
100  
U56  
84-2971  
1984



NBSIR 84-2971

NATIONAL BUREAU  
OF STANDARDS  
LIBRARY

Ref.  
Qi  
100  
USE

NBS 84-2971  
1482

**THERMODYNAMIC PROPERTIES OF  
ISOBUTANE-ISOPENTANE MIXTURES  
FROM 240 TO 600 K AND UP TO 20 MPa**

With Supplemental Tables from  
-40 to +600°F and up to 1000 psia

J. S. Gallagher, J. M. H. Levelt Sengers,  
G. Morrison and J. V. Sengers

U.S. DEPARTMENT OF COMMERCE  
National Bureau of Standards  
National Engineering Laboratory  
Center for Chemical Engineering  
Thermophysics Division  
Gaithersburg, Maryland 20899

November 1984

Interim Report

Prepared for:  
Division of Geothermal and Hydropower Technology  
U.S. Department of Energy  
Oakland, California



---

U.S. DEPARTMENT OF COMMERCE, Malcolm Baldrige, *Secretary*  
NATIONAL BUREAU OF STANDARDS, Ernest Ambler, *Director*





Thermodynamic Properties of  
Isobutane-Isopentane Mixtures  
from 240 to 600 K and up to 20 MPa  
(with Supplemental Tables from -40 to +600°F and up to 1000 psia)

J. S. Gallagher, J. M. H. Levelt Sengers,  
G. Morrison and J. V. Sengers\*

Thermophysics Division, National Bureau of Standards  
Gaithersburg, Maryland 20899

\*and Institute for Physical Science and Technology,  
University of Maryland, College Park, Maryland 20742

Abstract

The Helmholtz function for pure isobutane from a recent correlation has been converted to a dimensionless form and a pressure-enthalpy chart based on this function has been generated by computer. A Helmholtz function for mixtures of isobutane and isopentane has been formed based upon the dimensionless isobutane Helmholtz function as the reference fluid by means of an extended corresponding-states principle. Scarce literature data for saturation properties of isopentane, and new data for its vapor pressure and for the critical line of the mixture were used. The accuracy of the surface was checked by comparing with literature enthalpy data and with new VLE data for the mixture. Tables of thermodynamic properties have been generated from this Helmholtz function for the 0.1 mole fraction isopentane-in-isobutane mixture in the single-phase region and on the dew- and bubble-point curves, together with properties of the coexisting phase. A pressure-enthalpy chart for this mixture has also been generated.

This work is sponsored by the Department of Energy Division of Geothermal and Hydropower Technology, San Francisco Operations Office, Oakland, California



## TABLE OF CONTENTS

Introduction	1
The Dimensionless Reference Function for Isobutane	2
The Thermodynamic Surface for Isopentane	8
Generalized Corresponding States for the Mixture	12
Comparisons with Experimental Data	18
Results and Conclusion	21
References	25
Tables 1, 2 and 3	27
Figures	32
Appendix A: Tables of Properties of the 0.1 Mole Fraction Mixture in SI Units	39
Appendix B: Tables of Properties of the 0.1 Mole Fraction Mixture in Engineering Units	91
Appendix C: FORTRAN Programs for the Generation of Thermodynamic Properties of the Mixture	164



## Introduction

Interest has been growing for several years in the use of isobutane and isobutane-isopentane mixtures as working fluids in binary geothermal power cycles. While these substances appear to have desirable characteristics for such uses, including the possibility of "tuning" the properties of the working fluid to the existing external conditions by adjusting the composition of the mixture, there has been in the past a scarcity of experimental data available and no good basis for predicting with any accuracy the properties needed by the engineer for the efficient design of these power cycles<sup>(1)</sup>. The Division of Geothermal and Hydropower Technology of the Department of Energy has supported for several years a program of research both to improve the available experimental data base and to correlate these data for the production of tables and charts of use to the designer of power cycles.

Preceding the work reported here, scientists at NBS prepared a new correlation of the thermodynamic properties of isobutane, based on existing data and new data taken at NBS<sup>(2)</sup>. Also, a subregion around the critical point was separately described by means of a so-called scaled equation<sup>(3)</sup>. For isopentane, only scarce data were available. The data base available for the mixtures was limited to some data on the location of the critical line obtained at NBS, and a report on enthalpy-of-mixing data. The program TRAPP, developed at NBS<sup>(4)</sup>, allowed prediction of single-phase thermodynamic properties of the mixture of isobutane and isopentane by means of a generalized principle of corresponding states. A serious drawback was, however, that the reference function used in this program was methane. Therefore, the TRAPP predictions of the properties of isobutane, the principal component in the mixture of interest here, were substantially less accurate than the thermodynamic surface that we already had developed for this fluid. We therefore decided to follow the principle embodied in the program TRAPP, but to use our own thermodynamic surface for isobutane as the reference.

The use of the principal component of the mixture as a reference should lead to a significant increase in the reliability of the property predictions.

### 1. DIMENSIONLESS REFERENCE FUNCTION FOR ISOBUTANE

The global Helmholtz function representing the thermodynamic surface for pure isobutane has been described in two earlier publications<sup>(2)</sup>. For use as the reference function for mixtures this Helmholtz function was converted to a dimensionless form in the following way:

Definitions. Quantities in the reduced dimensionless form will be represented with a "bar" above the symbol. The reduction parameters will be represented as symbols with an asterisk ("\*") or double asterisk as superscripts. The primary reduction parameters are:

$$\begin{aligned} \text{Temperature } T^* &= 407.84 \text{ K} \\ \text{Density } \rho^* &= 3879.6 \text{ mol/m}^3 \\ \text{Pressure } P^* &= 3.6290 \text{ MPa} \end{aligned} \quad (1a)$$

These reference constants are the best estimates of the critical point of isobutane<sup>(2,3)</sup>.

Physical constants<sup>(5)</sup>:

$$\begin{aligned} \text{Molecular weight } M &= 0.0581243 \text{ kg/mol} \\ \text{Gas constant } R &= 8.31441 \text{ J/(mol K)} \end{aligned} \quad (1b)$$

Derived reduction parameters:

$$\begin{aligned} A^{**} &= P^*/\rho^* = 935.41 \text{ J/mol} \\ S^{**} &= P^*/(\rho^* T^*) = 2.2936 \text{ J/(mol K)} \\ a^{**} &= (P^*/(\rho^* M))^{1/2} = 126.86 \text{ m/s} \end{aligned} \quad (2)$$



The dimensionless form of the thermodynamic properties will be obtained

by:

Temperature	$\bar{T} = T/T^*$	
Pressure	$\bar{P} = P/P^*$	
Density	$\bar{\rho} = \rho/\rho^*$	
Volume	$\bar{V} = V \cdot \rho^* = 1/\bar{\rho}$	
Helmholtz function	$\bar{A} = A/A^{**}$	
Gibbs function	$\bar{G} = G/A^{**}$	(3)
Internal Energy	$\bar{U} = U/A^{**}$	
Enthalpy	$\bar{H} = H/A^{**}$	
Entropy	$\bar{S} = S/S^{**}$	
Heat capacities	$\bar{C}_v = C_v/S^{**}$	
	and $\bar{C}_p = C_p/S^{**}$	
Speed of Sound	$\bar{a} = a/a^{**}$	

Note: All extensive thermodynamic properties are taken per mole.

We will make use of the following thermodynamic relations between the thermodynamic properties.

$$\begin{aligned}
 \bar{V} &= \bar{\rho}^{-1} \\
 \bar{P} &= \bar{\rho}^2 (\partial \bar{A} / \partial \bar{\rho})_{\bar{T}} \\
 (\partial \bar{P} / \partial \bar{\rho})_{\bar{T}} &= 2 \bar{P} / \bar{\rho} + \bar{\rho}^2 (\partial^2 \bar{A} / \partial \bar{\rho}^2)_{\bar{T}} \\
 (\partial \bar{P} / \partial \bar{T})_{\bar{\rho}} &= \bar{\rho}^2 (\partial^2 \bar{A} / \partial \bar{\rho} \partial \bar{T}) \\
 \bar{S} &= - (\partial \bar{A} / \partial \bar{T})_{\bar{\rho}} \\
 \bar{U} &= \bar{A} + \bar{T} \bar{S} \\
 \bar{H} &= \bar{U} + \bar{P} / \bar{\rho} \\
 \bar{G} &= \bar{A} + \bar{P} / \bar{\rho} \\
 \bar{C}_V &= - \bar{T} (\partial^2 \bar{A} / \partial \bar{T}^2)_{\bar{\rho}} \\
 \bar{C}_P &= \bar{C}_V + (\bar{T} / \bar{\rho}^2) (\partial \bar{P} / \partial \bar{T})_{\bar{\rho}}^2 / (\partial \bar{P} / \partial \bar{\rho})_{\bar{T}} \\
 \bar{a} &= [(\bar{C}_P / \bar{C}_V) (\partial \bar{P} / \partial \bar{\rho})_{\bar{T}}]^{1/2}
 \end{aligned} \tag{4}$$

The Fundamental Equation. The Helmholtz energy function as described in ref. (2) can, with a little re-arranging, be written as:

$$A(T,V) = A_0(T) + A_1(T,V) + A_2(T,V) + A_3(T,V), \tag{5}$$

where the  $A_{\text{base}}$  of ref. (2) has been separated into two functions:  $A_1$  containing those parts of  $A_{\text{base}}$  depending on the "pseudo" second virial  $B$ , and  $A_2$  those parts involving the "excluded volume"  $b$ . Dividing this equation by the reduction parameter  $A^{**}$  and defining  $\bar{\rho} = \bar{V}^{-1}$  we have the fundamental equation in dimensionless form:

$$\bar{A}(\bar{T}, \bar{V}) = \bar{A}_0(\bar{T}) + \bar{A}_1(\bar{T}, \bar{V}) + \bar{A}_2(\bar{T}, \bar{V}) + \bar{A}_3(\bar{T}, \bar{V}), \tag{6}$$

where now the form of each of the component parts of eq (6) is

$$\bar{A}_0 = (A_{00} + A_{01} \bar{T}) \ln \bar{T} + \sum_{i=2}^8 A_{0i} \bar{T}^{i-4} + A_{09} \bar{T} \ln(e^x - 1)$$

$$\text{with } x = \frac{x_0}{\bar{T}} \tag{7}$$



$$\bar{A}_1 = \bar{\rho} \bar{T} \left[ A_{10} + \frac{A_{11}}{\bar{T}} + \frac{A_{12}}{\bar{T}^3} + \frac{A_{13}}{\bar{T}^5} + \frac{A_{14}}{\bar{T}^{10}} \right] \quad (8)$$

$$\bar{A}_2 = A_{20} \bar{T} \left[ \ln \left( \frac{\bar{\rho}}{1-y} \right) + \frac{3}{2(1-y)^2} - 4y \right] \quad (9)$$

$$\text{with } y = \bar{\rho} \left[ y_0 + y_1 \ln \bar{T} + \frac{y_2}{\bar{T}^4} + \frac{y_3}{\bar{T}^8} \right]$$

$$\bar{A}_3 = \sum_{i=1}^{\infty} \sum_{j=1}^{\infty} B_{ij} z^{i+1} \left( \frac{1}{\bar{T}} \right)^j \quad (10)$$

$$\text{with } z = 1 - e^{-z_0 \bar{\rho}}$$

Now the remaining task is to evaluate the various coefficients of these equations in terms of the coefficients of the original dimensioned Helmholtz function of ref. (2). To do so, the following auxiliary quantities will be used:

$$\text{reduced gas constant} \quad R^{**} = R/S^{**} = 3.6250$$

$$\bar{T}_c = T_c/T^*$$

We calculate the coefficients of the dimensionless Helmholtz function in terms of the coefficients of the dimensioned equation<sup>(2)</sup> ( $N_1-N_q$ ,  $B_i$ ,  $b_i$ ,  $C_{ij}$ ) as follows

Coefficients for  $\bar{A}_0$ :

$$x_0 = N_9/T^*$$

$$A_{00} = \frac{R^{**} N_3}{T^*}$$

$$A_{06} = - \frac{R^{**} N_5 T^*}{2}$$

$$A_{01} = - R^{**} (N_4 - 1)$$

$$A_{07} = - \frac{R^{**} N_6 T^{*2}}{6}$$

(11)

$$A_{02} = - \frac{R^{**} N_1}{6 T^{*3}}$$

$$A_{08} = - \frac{R^{**} N_7 T^{*3}}{12}$$

$$A_{03} = - \frac{R^{**} N_2}{2 T^{*2}}$$

$$A_{09} = R^{**} N_8$$

The coefficients  $A_{04}$  and  $A_{05}$  are to be determined from the condition that both  $\bar{A}$  and  $\bar{S}$  should be zero in the reference state.

Coefficients for  $\bar{A}_1$ 

$$A_{10} = R^{**} \rho^* B_0$$

$$A_{13} = R^{**} \rho^* \bar{T}_c^5 B_5$$

$$A_{11} = R^{**} \rho^* \bar{T}_c B_1$$

$$A_{14} = R^{**} \rho^* \bar{T}_c^{10} B_{10}$$

$$A_{12} = R^{**} \rho^* \bar{T}_c^3 B_3$$

(12)

Coefficients for  $\bar{A}_2$ 

$$A_{20} = R^{**}$$

$$y_0 = \frac{\rho^*}{4} (b_0 + b_1 \ln \bar{T}_c),$$

$$y_2 = \frac{\rho^*}{4} b_4 \bar{T}_c^4$$

(13)

$$y_1 = \frac{\rho^*}{4} b_L$$

$$y_3 = \frac{\rho^*}{4} b_8 \bar{T}_c^8$$

Coefficients for  $\bar{A}_3$ 

$$Z_0 = \alpha \rho^*$$

$$B_{ij} = \frac{\rho^*}{\rho^*} \frac{C_{ij} \bar{T}_c^j}{\alpha(i+1)}$$

(14)

The value determined for each of these coefficients is listed in Table I.

The coefficients  $A_{04}$  and  $A_{05}$  have been determined so that  $\bar{A}$  and  $\bar{S}$  are zero at the critical point given in eq (1). The new dimensionless Helmholtz function has now been completely determined.

Evaluation of thermodynamic properties

Through the relations shown in eq (4) the other thermodynamic properties may now be evaluated. The evaluation of the pressure is shown here as typical of the procedures involved.

Pressure

$$P = \bar{\rho}^2 [(\partial \bar{A} / \partial \bar{\rho})] = \bar{\rho}^2 \bar{\Pi}$$

$$\text{where } \bar{\Pi} = \bar{\Pi}_0 + \bar{\Pi}_1 + \bar{\Pi}_2 + \bar{\Pi}_3$$

$$\bar{\Pi}_0 = 0$$

(15)

$$\bar{\Pi}_1 = \frac{\bar{A}_1}{\bar{\rho}}$$

$$\bar{\Pi}_2 = \frac{A_{20} \bar{T}}{\bar{\rho}} [1/(1-y) + 3y/(1-y)^3 - 4y]$$

$$\bar{\Pi}_3 = z_0(1-z) \sum_{i=1} \sum_{j=1} B_{ij} (i+1) z^i (1/\bar{T})^j$$

The Helmholtz function for pure isobutane excludes a small region about the critical point inside of which the values predicted for the thermodynamic functions are less accurate. This region transforms, in the dimensionless units, to an excluded region defined by  $0.7 < \bar{\rho} < 1.3$  and  $0.985 < \bar{T} < 1.015$ . Within this region a separate equation using scaling theory has been formulated<sup>(3)</sup>.

## 2. THE THERMODYNAMIC SURFACE FOR ISOPENTANE.

A Helmholtz function for pure isopentane was next constructed from the Helmholtz function for pure isobutane using extensions to "simple" corresponding states<sup>(4,6,7,8)</sup>. In the following description of this method we will use the subscript 4 to refer to isobutane, and 5 to isopentane. The superscript c will be used to refer to a critical point value.

Let us first define the following quantities:

$$\begin{aligned} f_0 &= \bar{T}_5^C / \bar{T}_4^C, \\ h_0 &= \bar{V}_5^C / \bar{V}_4^C, \\ q_0 &= \bar{P}_5^C / \bar{P}_4^C. \end{aligned} \quad (16)$$

The properties of isopentane used in this definition are made dimensionless by means of the same reference constants as those of isobutane (see eq (1)). The critical constants of isopentane we have used are listed in Table 2a. They were determined at NBS within the framework of another contract<sup>(13)</sup>.

The principle of corresponding states postulates that, for all values of V and T,

$$Z_5(\bar{V}_5, \bar{T}_5) = Z_4(\bar{V}_4 = \bar{V}_5/h_0, \bar{T}_4 = \bar{T}_5/f_0) \quad (17)$$

$$\text{and } \bar{A}_5^{cf}(\bar{V}_5, \bar{T}_5) = f_0 \bar{A}_4^{cf}(\bar{V}_4 = \bar{V}_5/h_0, \bar{T}_4 = \bar{T}_5/f_0) - R^{**} \bar{T}_5 \ln(h_0),$$

where Z is the compressibility factor  $PV/RT (= \bar{P} \bar{V}/R^{**} \bar{T})$ , and  $\bar{A}^{cf}$  is the configurational portion of the Helmholtz function,  $\bar{A}^{cf} = \bar{A} - \bar{A}_0$ . These relations imply that  $f_0 = h_0 q_0$ <sup>(6)</sup>.

Since no two substances obey the principle of corresponding states exactly, Rowlinson et al.<sup>(6)</sup> and Leland et al.<sup>(7,8)</sup> proposed to generalize the principle through the use of two functions,  $\theta(V,T)$  and  $\phi(V,T)$  to be defined, in the dimensionless system we are using here, through:

$$f = (\bar{T}_5^C / \bar{T}_4^C) \theta(\bar{V}_4, \bar{T}_4) \quad (18)$$

$$\text{and } q = (\bar{P}_5^C / \bar{P}_4^C) \theta(\bar{V}_4, \bar{T}_4) / \phi(\bar{V}_4, \bar{T}_4),$$

so that h will be given by

$$h = f/q = (\bar{T}_5^C / \bar{T}_4^C) (\bar{P}_4^C / \bar{P}_5^C) \phi(\bar{V}_4, \bar{T}_4). \quad (18a)$$



These functions  $\theta$  and  $\phi$  are expected to be slowly varying functions of  $\bar{V}_4$  and  $\bar{T}_4$ ; to not be greatly different from unity since  $Z_5^C / Z_4^C$  is close to unity; and to be constructed such that eq (17) will be satisfied for the real fluids and with this new  $f$ ,  $q$  and  $h$  substituted for the  $f_0$ ,  $q_0$  and  $h_0$ .

$$Z_5(\bar{V}_5, \bar{T}_5) = Z_4(\bar{V}_4 = \bar{V}_5/h, \bar{T}_4 = \bar{T}_5/f), \quad (18b)$$

$$\bar{A}_5^{cf}(\bar{V}_5, \bar{T}_5) = f\bar{A}_4^{cf}(\bar{V}_4 = \bar{V}_5/h, \bar{T}_4 = \bar{T}_5/f) - R^{**}\bar{T}_5 \ln(h).$$

With  $h$  defined in this way, the real  $\bar{V}_5^C$  no longer appears in the formulation. In its place appears a constructed  $\bar{V}_5^C$  given by  $h\bar{V}_4^C$ , which, depending on the choice of the function  $\phi$ , may or may not have the same value as the real one. We shall use the symbol  $\bar{V}_5^{C'}$  for this constructed quantity. This quantity was chosen as the one to be constructed since  $\bar{V}_5^C$  is less well known than  $P_5^C$  or  $T_5^C$ .

Our choice for the functions  $\theta$  and  $\phi$  was made through the following steps:

1. The decision was made to map the vapor pressures and coexisting densities of the pure isopentane onto the pure isobutane surface. There have been vapor pressure measurements taken at this laboratory as a part of this project covering the range of 97°C to 181°C<sup>(13)</sup>. Measurements of the coexisting liquid and vapor densities have been made many years ago<sup>(9)</sup>, over the range of 0°C to 180°C, but it was felt that the higher temperature values might be less reliable. This method requires a temperature region where both vapor pressure and coexisting densities are available, so our efforts were concentrated in the range of overlap, 80°C < T < 140°C. A preliminary fit of a simple empirical function to the vapor pressure data was made to make interpolation possible in order to obtain vapor pressures at the same temperatures as the coexisting density data.

2. A numerical value for  $\theta$  and  $\phi$  at each chosen temperature point was found through the following iterative process:

- a. Assume a starting value for  $\theta$  for instance,  $\theta = 1$ . Call it  $\theta_0$ .
- b.  $T_4$  may now be calculated from the input temperature from  $T_4 = \bar{T}_5 / (f_0 \cdot \theta_0)$ .
- c. From the reference Helmholtz function for pure isobutane calculate the corresponding vapor pressure  $\bar{P}_{4S}(T_4)$ .
- d. From the isobutane reference function and this  $T_4$  and  $\bar{P}_{4S}$  find the saturation density  $\bar{\rho}_4$ .
- e. Obtain a value for  $\phi$  from  $\phi = \bar{\rho}_4 / (\bar{\rho}_5 h_0)$ .
- f. Obtain a new value for  $\theta$  from the input pressure through  $\theta_1 = \phi \bar{P}_{5S} / \bar{P}_{4S}$ , where the  $\bar{P}_{5S}$  is obtained from the empirical function obtained in step 1.
- g. Increment the value for  $\theta_i$  and repeat steps a through f until a  $\theta_i$  is found such that  $\theta_{i+1} = \theta_i$ . We now have a numerical value for  $\theta$  and  $\phi$  at the chosen point.

3. With this set of numerical values for  $\theta$  and  $\phi$  at each of the chosen points, empirical functions for  $\theta$  and  $\phi$  were constructed to represent them as functions of the density and temperature with the additional imposed restraint that the value never differs greatly from unity over the desired range of temperatures and densities of the global surface. The value at the critical point could have been fixed, but allowing this value to float made easier the task of representing the  $\theta$  and  $\phi$  at lower temperatures. In fitting to the chosen empirical functions for  $\theta$  and  $\phi$ , the values at the critical point were so close to unity that fixing them at unity caused no significant degradation.

The representations for  $\theta(\bar{V}_4, \bar{T}_4)$  and  $\phi(\bar{V}_4, \bar{T}_4)$  used are

$$\theta = a_1 + a_2 (\bar{\rho}_4 - 1) + a_3 (\bar{T}_4 - 1), \quad (19)$$

$$\phi = b_1 + b_2 (\bar{\rho}_4 - 1) + b_3 (\bar{T}_4 - 1).$$

The values of the constants  $a_1$  through  $b_3$  are given in Table 2b.

Also required for the complete description of the thermodynamic surface of isopentane is the ideal-gas Helmholtz function for isopentane. For this we interpolate in the table of ideal gas thermodynamic functions of isopentane compiled by Scott<sup>(10)</sup>.

### 3. GENERALIZED CORRESPONDING STATES FOR THE MIXTURE.

The principles of corresponding states can be extended to include mixtures through an approximation usually referred to as the "one-fluid" model. In this model the assumption is made that the configurational Helmholtz function for the mixture (less the ideal-mixing term) can be represented as the Helmholtz function for a single equivalent substance, and the finding of the parameters describing this substance becomes our task.

For a mixture of molar fraction  $x$  of isopentane (and  $1-x$  of isobutane), molar volume  $V_x$  and temperature  $T_x$ , we obtain the configurational Helmholtz function from that of isobutane in the same manner as for pure isopentane by the relations

$$Z_x(\bar{V}_x, \bar{T}_x) = Z_4(\bar{V}_4 = \bar{V}_x/h_x, \bar{T}_4 = \bar{T}_x/f_x) \quad (20)$$

and

$$\bar{A}_x^{cf}(\bar{V}_x, \bar{T}_x) = f_x \bar{A}_4^{cf}(\bar{V}_4 = \bar{V}_x/h_x, \bar{T}_4 = \bar{T}_x/f_x) - R^* \bar{T}_x \ln(h_x)$$

where  $h_x$ ,  $f_x$  are defined by

$$h_x = (\bar{V}_x^c / \bar{V}_4^c) [1 + x \{ \phi(\bar{V}_4, \bar{T}_4) - 1 \}]$$

and

$$f_x = (\bar{T}_x^c / \bar{T}_4^c) [1 + x \{ \theta(\bar{V}_4, \bar{T}_4) - 1 \}] \quad (21)$$



Equations (21) insure that for  $x=0$  (pure isobutane)  $f_x$  and  $h_x$  will be unity; and for  $x=1$  (pure isopentane),  $f_x$  and  $h_x$  will reduce to equations (18).

Left to be defined are the constants  $\bar{V}_x^c$  and  $\bar{T}_x^c$  of eqn. (21). We will refer to them as "pseudocritical" constants, since they will define the shape the line of critical points would have if the composition of the liquid and vapor phases were constrained to be the same; that is, the locus of  $(\partial P/\partial V)_{T_x} = 0$ ,  $(\partial^2 P/\partial V^2)_{T_x} = 0$  for the homogeneous mixture. In reality, the mixture separates because of material instability prior to reaching the "pseudocritical" line; the real critical line will be determined by a method to be described later.

Many different prescriptions for obtaining  $\bar{V}_x^c$  and  $\bar{T}_x^c$  have been proposed, referred to as mixing rules. The one we chose is the "van der Waals" type rule:

$$\bar{V}_x^c = (1-x)^2 \bar{V}_4^c + 2x(1-x)\bar{V}_{45}^c + x^2 \bar{V}_5^c, \quad (22)$$

$$\bar{T}_x^c = (1-x)^2 \bar{T}_4^c + 2x(1-x) \bar{T}_{45}^c + x^2 \bar{T}_5^c,$$

where the terms  $\bar{V}_{45}^c$  and  $\bar{T}_{45}^c$  are defined by the "combining rules":

$$\bar{V}_{45}^c = k [0.5(\bar{V}_4^c)^{1/3} + 0.5(\bar{V}_5^c)^{1/3}]^3, \quad (23)$$

$$\bar{T}_{45}^c = \ell [\bar{T}_4^c \bar{T}_5^c]^{1/2}.$$

These definitions allow two more adjustable parameters,  $k$  and  $\ell$ , which change the shape of the pseudo-critical line (and also the real critical line) and which we can use to improve agreement with any mixture data that might be available. As a part of another project, measurements have been made at this laboratory of the critical temperature, pressure and volume of pure isobutane, pure isopentane and of mixtures at three

compositions<sup>(13)</sup>. The critical temperature of isobutane predicted by the global reference function is about 2°C higher than the physical value. This was done on purpose: relaxing the tightness of the fit to the immediate vicinity of the critical point greatly enhances the quality of the fit in the supercritical region. The corresponding-states principle used here induces a similar offset at the pure-isopentane critical point. We chose the values for  $k$  and  $\lambda$  such that this offset also occurs at the measured mixture critical points. The parameters  $k$  and  $\lambda$  are found to be close to unity, and are listed in table 2c.

The ideal-gas portion of the total Helmholtz function is computed as a linear combination of the ideal-gas functions for the pure substances and ideal mixing term:

$$\bar{A}_{x0}(\bar{T}_4) = (1-x)\bar{A}_{40}(\bar{T}_4) + x\bar{A}_{50}(\bar{T}_4) + R^{**}\bar{T}_4 [x \ln(x) + (1-x) \ln(1-x)] \quad (24)$$

The Helmholtz function for the mixture is now complete. All thermodynamic properties obtainable through combinations of derivatives with respect to  $V$  or  $T$  may still be calculated in this way. One more property, the chemical potential, necessary for the determination of coexisting phases and the real critical line, remains to be determined. It differs from the other properties described in that it requires derivatives of the Helmholtz function with respect to  $x$ .

#### Calculation of the chemical potentials

The chemical potentials, defined as

$$\bar{\mu}_4(\bar{P}, \bar{T}, x) = \bar{G} - x(\partial\bar{G}/\partial x)_{\bar{P}, \bar{T}}$$

$$\bar{\mu}_5(\bar{P}, \bar{T}, x) = \bar{G} + (1-x)(\partial\bar{G}/\partial x)_{\bar{P}, \bar{T}}$$

(25)

are calculated here using numerical derivatives  $\Delta\bar{G}/\Delta x$ . Since it can be shown that  $(\partial G/\partial x)_{P,T} \equiv (\partial A/\partial x)_{V,T}^{(11)}$ , we chose the latter form for the derivative as a convenience, since the natural independent variables of the reference function are  $V$  and  $T$ . In terms of derivatives of the Helmholtz function, the expressions for the chemical potential of the two components are:

$$\bar{\mu}_4 = \bar{A}(V, T, x) + \bar{p} \bar{V} - x(\Delta\bar{A}/\Delta x)_{V, T} \quad (26)$$

$$\text{and } \bar{\mu}_5 = \bar{A}(V, T, x) + \bar{p} \bar{V} + (1 - x) (\Delta\bar{A}/\Delta x)_{V, T}$$

### Prediction of coexisting states

With the chemical potentials now available, we are in a position to predict the location of the phase boundary. For the liquid and vapor to be in equilibrium, the chemical potential of each component must be the same on each side of the phase boundary. That is:

$$\mu_{4L}(P, T, x_L) = \mu_{4V}(P, T, x_V) \quad (27)$$

$$\text{and } \mu_{5L}(P, T, x_L) = \mu_{5V}(P, T, x_V),$$

where the subscripts L and v refer to liquid and vapor, respectively. At a specified  $P$  and  $T$  this becomes a system of two non-linear equations in the two unknowns  $x_L$  and  $x_V$ . The solutions were obtained using a commercially available package of programs for solving non-linear problems. All methods for solving systems of non-linear equations require a mechanism for guessing the values of the unknowns to be used as the initial values for an iterative process. In regions where the values of the unknowns are well separated, the requirements on the accuracy of the guesses are not very stringent. For temperatures below the critical temperature of either component, the  $P$ - $x$  dew and bubble curves run from  $x=0$  (vapor pressure of pure isobutane) to

$x=1$  (vapor pressure of pure isopentane). This can be seen graphically in fig. 7. Here an initial guess for  $x_L$  is obtained by interpolation, at the specified pressure  $P$ , on the bubble curve for the specified temperature  $T$ . The bubble curve is approximated by a straight line in  $P$ - $x$  space, connecting the vapor pressures of the individual components. Thus

$$x_L = \frac{P_4^\circ - P}{P_4^\circ - P_5^\circ}, \quad (28)$$

where the superscript  $^\circ$  indicates the vapor pressure of the respective pure component. A first estimate for  $x_V$  then follows from Dalton's law applied to the vapor phase:

$$x_V = 1 - (1-x_L)P_4^\circ/P. \quad (29)$$

If the specified temperature  $T$  is between the two critical temperatures, the dew and bubble curves in  $P$ - $x$  space begin at the isopentane vapor pressure and meet at the critical line (cf. fig. 7). We approximate the bubble curve by a straight line running from the point  $P_C, x_C$ , which is determined once  $T$  is specified, to  $P_5^\circ$  at  $x=1$ . We now apply Raoult's law to a mixture consisting of isopentane and a virtual component with vapor pressure  $P_C$ . We then obtain as an estimate for  $x_L$ :

$$x_L = x_C + (1-x_C) \cdot \frac{P_C - P}{P_C - P_5^\circ}. \quad (30)$$

Application of Dalton's law to the vapor phase of this mixture leads to

$$x_V = 1 - (1-x_L) P_C/P \quad (31)$$

as a first guess of the vapor composition.



As either end point of the coexistence curve is approached, the values for  $x_L$  and  $x_V$  become nearer to each other, and the required accuracy of the initial guesses for these quantities increases, especially at the higher temperatures. This we accomplish by making our first calculation near the middle of the region of coexistence, and then approaching the ends with small increments of  $P$ , if properties along an isotherm are being calculated, or of  $T$ , if properties along an isobar are being calculated. With each calculation after the first, the initial guesses for  $x_L$  and  $x_V$  are taken as the final result of the previous calculations. Even so, a point is always reached very close to the critical point where the calculation breaks down computationally, and a solution cannot be reached.

#### Prediction of the critical line.

For a pure fluid, the critical point is defined as that point where  $(\partial p / \partial \rho)_T$  and  $(\partial^2 p / \partial \rho^2)_T$  are simultaneously zero, because of incipient mechanical instability. The critical point for a fluid mixture of two components, where  $x$  is the concentration of the second component, is defined as the point where  $(\partial \mu / \partial x)_{p,T}$  and  $(\partial^2 \mu / \partial x^2)_{p,T}$  are simultaneously zero because of incipient material instability. The location of this point is computed in the following way: The condition that these two derivatives be simultaneously zero can be seen, according to the definition of the  $\mu$ 's in eq (25), to be equivalent with requiring that  $(\partial^2 G / \partial x^2)_{p,T}$  and  $(\partial^3 G / \partial x^3)_{p,T}$  be simultaneously zero. The condition that  $(\partial^2 G / \partial x^2)_{p,T}$  be zero defines a surface, called by van der Waals a "spinodal", which must lie within the two-phase region but be tangent to the real two-phase region at the point of maximum pressure for an isotherm plotted in the  $P$  vs  $x$  plane. (See diagram in fig. 1, and discussion in ref. (11)) This point of contact, at a maximum of  $P$ , is the point that satisfies the other condition, that  $(\partial^3 G) / (\partial x^3)_{p,T}$  be zero and is the real critical point for the specified  $T$ . This point is found through a search, at the specified  $T$  and a trial  $x$ , by

scanning over a range of densities and searching for the P at the point where  $(\partial^2 G / \partial x^2)_{P,T} = 0$ . This search is repeated at the same T but a different x until the x is found for which the P is a maximum while  $(\partial^2 G / \partial x^2)_{P,T} = 0$ .

#### 4. COMPARISONS WITH EXPERIMENTAL DATA.

For comparisons of the rather sizeable body of data available for pure isobutane with the isobutane reference function, see Waxman and Gallagher<sup>(2)</sup>. The available experimental data for isopentane are much more sparse, and additional data are being taken at this laboratory as a part of this project to supplement those already available. The vapor pressures of pure isopentane have been measured over the range from approximately 97°C to 181°C. Table 3a compares these measurements with the values predicted from the Helmholtz function. The fractional differences between the measured vapor pressures and these predicted are plotted in fig. 2. The estimated experimental uncertainties of these measurements are 0.1%. As can be seen, the predicted values agree well at the higher temperature end, but the differences become somewhat larger at the lower temperatures. Additional data at lower temperatures will be available soon, and at that time a redetermination of the shape factors can be made which should improve the lower temperature results.

The coexisting liquid and vapor densities in the range 20°C to 180°C were measured by Young<sup>(9)</sup>. These measurements were taken 90 years ago and are of unknown reliability. The comparison of these densities with the predicted values, obtained by solving the Gibbs conditions at the specified temperature, appear in Table 3b. These fractional differences between the measured and predicted values are plotted in fig. 3. The agreement is quite good for the liquid densities except at the highest temperature. On the vapor side the differences are much larger, but this is to be expected as vapor density measurements are much more difficult and were given much less weight in the determination of the shape factors. We would not want to improve these agreements if it would be at the expense of the fit to other data.

Measurements of the critical temperature and pressure for mixtures of three different compositions have been taken at this laboratory as a part of another project<sup>(13)</sup>, referred to in the section on predicting the critical line. Figure 4 shows these critical temperatures as a function of the composition. The dashed line on this plot is the critical line predicted by the equation. These critical line data and the predicted values are also tabulated in Table 3c. Note that this predicted critical line lies about 2°C higher than the measurements throughout as intended for the reasons discussed earlier.

Morrison at this Laboratory has made measurements of the bubble pressures and saturated liquid densities for isobutane-isopentane mixtures. His apparatus is described in some detail in another report<sup>(13)</sup>. It is a cylindrical sapphire variable-volume phase-equilibrium apparatus, coupled to a mercury displacement pump. Observations are done of the pressure and the positions of the mercury and vapor-liquid interfaces at fixed temperatures on a sample of known mass and known overall composition. By repeating these measurements at a minimum of two compositions, but both times at the same temperature and pressure, the densities and compositions of the coexisting phases can be inferred without the need for sampling. Temperatures are measured to better than 1 mK, pressures to 0.1% by means of a calibrated pressure transducer, and the overall composition of the prepared sample is estimated to be reliable to  $\pm 0.0002$  in mole fraction. For the present contract, Morrison measured bubble pressures and saturated liquid densities for samples of 0.05 - 0.15 mole fraction of isopentane at approximately 15°C - 55°C in steps of 10°C. For another contract, he did similar measurements for samples near 50% mole fraction. All measurements are listed in Table 3d. In this same table, we also compare the predictions of the thermodynamic surface with these measured data. The comparisons are displayed in four graphs, figs. 5a - d: two figures comparing pressure and two comparing density. We note that our model predicts the densities for the 5 - 15%



mixtures to better than 1%. The densities of the 50% mixtures are predicted with errors from 1-2%. The pressures of the 5-15% mixtures are predicted to better than 0.5% at the highest temperature, but the surface does markedly worse at the lowest temperatures. For the mixtures near 50%, the vapor pressures are predicted within 1% at the highest temperature, but there are systematic departures at the lower temperature. There is therefore room for improvement. We are confident that the new data we are taking, and the flexibility still present in the model, will allow us to do much better in the next round of correlations.

Koppany and Lenoir<sup>(12)</sup> reported measurements of the enthalpy of mixtures of nominally 0.80 mole fraction of isobutane in isopentane. Enthalpies were measured by injecting the mixture into a calorimeter at fixed pressure and a measured temperature, and then cooling it isobarically to a liquid state at 75°F. The enthalpy difference to this liquid reference state is obtained from the hydrocarbon flow rate and the amount of refrigerant evaporated.

The authors performed test measurements using pure isobutane at 250 psia. We have compared their measured enthalpy differences with those predicted by our Helmholtz function for isobutane. The agreement was strikingly good.

For the mixture, seven isobars were measured, six of which were subcritical. Samples of the mixture were taken periodically throughout the runs and analyzed for composition. The authors' preference has been to use the average of these analyses as the composition, and therefore our predictions have been made for these average compositions. In fig. 6, we have displayed the data and our predictions for four of the isobars. The experimental and predicted values are also tabulated in Table 3e. Our predictions generally agree well with the data in the liquid phase, but are somewhat on the low side in the vapor phase, especially near and above the critical point. The authors' estimate of the location of the phase boundary is quite far from



the one predicted by our surface, especially at the vapor side beyond 200°F. We believe that it is very difficult to locate the phase boundary from the enthalpy data alone because of their pronounced curvature in the two-phase region. Although we have as yet no data for the saturated vapor volumes near the critical point, we do have a direct measurement of  $T_c$  at the 0.80 mole fraction of isobutane. Our measured value is about 6°F below that estimated by the authors, which is consistent with our hypothesis that the authors have overestimated the extent of the two phase region. Our surface is certainly capable of some improvement in the supercritical low-density states.

The most worrisome aspect of the data is the strong curvature of the isobars in the two-phase region. We are not hopeful that our model can be made to exhibit such curvature. We do not think that the excellent results obtained with this calorimeter for pure isobutane guarantee proper functioning if a mixture is used. In particular, in this calorimeter, the sample is entered into a side arm at the desired pressure, and then heated in a relatively short section of tubing to the initial temperature. It may not be possible for a mixture to reach complete composition equilibrium if the desired initial state is in the two-phase region. This may explain why our agreement with the one-phase data is so much better than with the two-phase data.

## 5. RESULTS

Some of the predicted thermodynamic properties of this resulting Helmholtz function are shown graphically in figures 7 and 8. Figure 7 displays the predicted dew- and bubble-point pressures for several sub-critical isotherms as a function of the composition. The predicted critical line is also included as a dashed line with the small circles indicating the predicted critical pressure at the temperature of these isotherms. Figure 8 similarly displays the predicted dew - and bubble-point densities and the predicted critical line. The dashed portions of the isotherms are

those parts of the isotherms within the excluded region about the critical line: that is, where  $0.7 < \bar{\rho}_4 < 1.3$  and  $0.985 < \bar{T}_4 < 1.015$ . In the regions very close to the critical points we experience computational difficulty in the solving of the eq (27) for the conditions of coexisting phases.

Appendices A and B present tables of predicted values for the thermodynamic properties of the isopentane in isobutane mixture. Appendix A is in SI units and Appendix B in "engineering" units. Table 1 in each Appendix shows the predicted values for coexisting liquid and vapor. The dew-point tables were generated for a 0.1 mole fraction of isopentane in the vapor, with the composition and predicted properties of the coexisting liquid also tabulated. The bubble-point tables were generated for a 0.1 mole fraction of isopentane in the liquid, with the composition and predicted properties of the coexisting vapor also tabulated.

Table 2 in each Appendix includes properties in the single phase region for the 0.1 mole fraction isopentane in isobutane mixture. They were calculated along isobars and also include at phase boundaries the composition and properties of the coexisting state.

Also included with this report are pressure vs. enthalpy charts for pure isobutane and a mixture of 0.1 mole fraction isopentane in isobutane. These charts were plotted by computer and show isotherms as solid lines, isochores as dashed lines, isentropes as "dash - dot" lines and, in the two phase region for the mixture, lines of constant quality as dotted lines. The isentropes were calculated using a Newton-Raphson iteration where, for the specified entropy, a range of densities was chosen and at each density the temperature was determined, where  $C_V/T = (\partial S/\partial T)_P$  was used for the derivative in the iteration. The "excluded" region in the vicinity of the critical point is left blank in the chart for the mixture because of the expected reduction in accuracy of the values for the predicted properties in that region. In the chart for pure isobutane the plotted values in the

critical region were taken from a separate correlation of the critical region<sup>(3)</sup>; it happens to join to the global equation at the boundaries of the excluded region smoothly to within visual accuracy on the plot. In addition to the improved accuracy, the charts cover a much wider range than any heretofore available.

In Appendix C we have included the computer programs, written in FORTRAN 77, which were used to generate the predicted properties of this surface. The package includes subroutines for calculating the properties of the isobutane reference function, for applying the corresponding states principles previously described, and for converting to and from the internal dimensionless units to any of a wide variety of desired external systems of units. A main program is also included for generating a table of properties along an isobar, which was used for generating the values in Table 5.

## 6. ESTIMATE OF RELIABILITY

The reference function for pure isobutane is generally in accord with the sizeable body of data available for pure isobutane to within 0.1% to 0.15% differences in density over the specified range of 250 to 600 K and 0 to 40 MPa. (0 to 5800 PSIA). The predicted vapor pressures for pure isopentane differ, in the worst case, from the measured values by about 0.9% and on average by about 0.5%. A comparison of the predicted coexisting densities for pure isopentane with the measured ones shows average differences of about 0.3% for the saturated liquid and up to 3% for the saturated vapor. The agreement of the bubble-point pressures for the mixture with the measurements of Morrison range from + 2.4% to - 1.4% with an average difference of about 0.8%, and for the coexisting liquid densities the range of differences is - 2.0% to + 0.1% with an average difference of about -0.9%.

On the basis of these comparisons we would estimate the uncertainty of the predicted vapor pressures to be about 0.5% for pure isopentane, increasing to about 1% for the 50% mixture, then decreasing to that of the pure isobutane



as the mixture becomes more dilute in isopentane. The predicted densities might be expected to have a similar behavior. Comparing a variety of surfaces developed for the mixture, we find that the predicted enthalpies and entropies are relatively insensitive to changes in the shape factors or the critical line. Seldom did these properties change by more than one or two units in the least significant figure displayed in the tables.

The range of validity for the mixture Helmholtz function might be expected to be the same, in reduced units, as that for the pure isobutane reference function.

## 7. CONCLUSION

This resulting Helmholtz function describing the thermodynamic surface can be used to predict equilibrium thermodynamic functions through the entire composition range from pure isobutane to pure isopentane over a wide range of temperatures and pressures. Additional measurements are being made and as they become available, refinements will be made in the expressions for the shape factors and the mixing parameters which should further reduce the uncertainties. In particular, vapor pressure measurements are being made on pure isopentane at lower temperatures which should improve the shape factors in that region and at the same time we hope to improve the representation of the saturated vapor densities for pure isopentane at the high temperatures. Also more measurements of the PVTx relationship at the bubble points will become available: these should also lead to improvements in the shape factors. The accuracy of the predicted thermodynamic values in the single-phase regions for the pure isopentane or for the mixture has not been tested due to an absence of experimental data. We hope to have such measurements and with them test the validity of this method of prediction. This method of using a well-tested Helmholtz function for pure isobutane as the reference fluid already gives a significant improvement in accuracy over previously-used methods where both components of the mixture were referred to a third fluid as the reference fluid.

## References

- [1] J. Kestin, R. DiPippo, H.E. Khalifa and D.J. Ryley, Editors: Sourcebook on the Production of Electricity from Geothermal Energy. Department of Energy (U.S.), 1980.
- [2] M. Waxman and J. S. Gallagher: A Thermodynamic Surface for Pure Isobutane. Proc. 8<sup>th</sup> Symposium on Thermophysical Properties, J.V. Sengers, Ed., ASME, New York (1982) V.I, p. 88.  
M. Waxman and J.S. Gallagher: Thermodynamic Properties of Isobutane for Temperatures from 250 to 600 K and Pressures from 0.1 to 40 MPa, J. Chem. Eng. Data 28, 224 (1983).
- [3] J.M.H. Levelt Sengers, B. Kamgar-Parsi and J.V. Sengers: Thermodynamic Properties of Isobutane in the Critical Region. J. Chem. Eng. Data 28, 354 (1983).
- [4] J.F. Ely and H.J.M. Hanley: A Computer Program for the Prediction of Viscosity and Thermal Conductivity in Hydrocarbon Mixtures. NBS Tech. Note 1039 (1981).
- [5] E.R. Cohen and B.N. Taylor: The 1973 Least-squares Adjustment of the Fundamental Constants. J. Phys. Chem. Ref. Data 2, 663 (1973).
- [6] J.S. Rowlinson and I.D. Watson: The Prediction of the Thermodynamic Properties of Fluids and Fluid Mixtures - I. The Principle of Corresponding States and its Extensions. Chem. Eng. Sci. 24, 1565 (1969).
- [7] J.W. Leach, P.S. Chappellear and T.W. Leland: Use of Molecular Shape Factors in Vapor-Liquid Equilibrium Calculations with the Corresponding States Principle. A.I.Ch.E. Jour. 14, 568 (1968)
- [8] T.W. Leland, Jr. and P. Chappellear: The Corresponding States Principle. Ind. and Eng. Chem. 60, 15 (1968).
- [9] S. Young: The Thermal Properties of Isopentane. Proc. Phys. Soc. London 13, 602 (1895).

- [10] D.W. Scott: The Chemical Thermodynamic Properties of Hydrocarbons and Related Substances - Properties of the Alkane Hydrocarbons  $C_1$  through  $C_{10}$  in the Ideal Gas State from 0 to 1500 K. Dept. of the Interior (U.S.), Bur. Mines Bulletin 666 (1974).
- [11] J.S. Rowlinson: Liquids and Liquid Mixtures. Butterworth and Co. (Publishers) Ltd., London (1969).
- [12] C.R. Koppang and J.M. Lenoir: Experimental Enthalpies for a mixture of .80 mole percent Isobutane in Isopentane. EPRI Report ER-1034 (1979).
- [13] D.E. Diller, J.S. Gallagher, B. Kamgar-Parsi, G. Morrison, J.M.H. Levelt Sengers, J.V. Sengers, L.J. Van Poolen and M. Waxman: Thermophysical Properties of Working Fluids for Binary Geothermal Power Cycles. NBSIR, in press.

TABLE 1.  
COEFFICIENTS OF THE REFERENCE FUNCTION FOR ISOBUTANE

A00	27.849029		
A01	58.138236		
A02	-0.050937093		
A03	2.5252496		
A04	346.65236		
A05	2.5515510		
A06	-53.012165		
A07	3.3434600		
A08	-0.11945060		
A09	-38.124442		
X0	7.9688113		
Y0	0.15388314	A10	3.0020353
Y1	-0.039169870	A11	-6.1529971
Y2	-0.25198404-03	A12	-1.4570002
Y3	0.98801205-06	A13	0.13342155
A20	3.6250	A14	-0.90043710-04
B11	-9.6153074	B23	-50.009149
B21	27.935713	B43	231.53999
B41	-125.69635	B63	-360.80769
B51	544.06550	B83	261.20687
B61	-479.48565	B14	-22.934154
B81	141.34133	B64	-14.503027
B12	-12.372626	B15	-10.167777
B32	-34.731447	B25	30.142576
B52	-575.69010	B55	-33.549797
B62	532.10066	B85	25.502366
B72	415.02454	B26	-0.53441617
B82	-423.59614	B86	0.037213690
B13	58.118355	Z0	0.36796166

TABLE 2A.  
THE CRITICAL POINT OF ISOPENTANE

TEMPERATURE: 460.51 K  
DENSITY: 3247.3 MOL/M3  
PRESSURE: 3.3707 MPA

TABLE 2B.  
PARAMETERS FOR THE SHAPE FACTOR FUNCTIONS

A1	1.0	B1	1.0
A2	0.0065	B2	-0.021
A3	-0.015	B3	-0.065

TABLE 2C.  
PARAMETERS IN THE COMBINING RULES

K 0.995  
L 1.002



TABLE 3A.

THE VAPOR PRESSURE OF PURE ISOPENTANE:  
COMPARISONS OF EXPERIMENTAL VALUES WITH PREDICTED.

T (DEG K)	PS (MPA)		% DIFF
	MEAS	PRED	
370.785	0.68380	0.67797	0.85
386.072	0.94310	0.93466	0.89
400.529	1.24770	1.23824	0.76
411.407	1.52080	1.51103	0.64
425.513	1.93870	1.92907	0.50
437.593	2.35930	2.35239	0.29
447.995	2.77610	2.77247	0.13
454.576	3.07280	3.06895	0.13

TABLE 3B.

PURE ISOPENTANE COEXISTING DENSITIES: MEASURED VS. PREDICTED

T DEG K	SAT LIQ DENS (MOL/DM3)			SAT VAP DENS (MOL/DM3)		
	MEAS	PRED	% DIFF	MEAS	PRED	% DIFF
293.15	8.588	8.582	+0.06	0.0333	0.0323	+2.86
313.15	8.299	8.309	-0.12	0.0624	0.0610	+2.29
333.15	7.996	8.015	-0.23	0.1081	0.1064	+1.57
353.15	7.678	7.694	-0.20	0.1774	0.1755	+1.13
373.15	7.315	7.337	-0.30	0.280	0.277	+0.95
393.15	6.917	6.933	-0.23	0.430	0.426	+0.92
413.15	6.434	6.457	-0.36	0.655	0.648	+1.07
433.15	5.829	5.853	-0.40	1.010	0.998	+1.20
453.15	4.848	4.912	-1.30	1.744	1.678	+3.78

TABLE 3C.

MEASURED VS. PREDICTED POINTS ON THE CRITICAL LINE  
OF ISOPENTANE IN ISOBUTANE MIXTURES.

X	TC (K)		PC (MPA)	
	MEAS	PRED	MEAS	PRED
0.0	407.84	409.66	3.629	3.736
0.2001	419.92	422.18	3.677	3.801
0.3493	428.71	430.69	3.650	3.795
0.5073	437.35	439.09	3.615	3.753
1.0	460.51	462.52	3.371	3.470



TABLE 3D.

MEASURED VS. PREDICTED VALUES FOR THE BUBBLE POINT PRESSURES  
AND DENSITIES OF ISOPENTANE IN ISOBUTANE MIXTURES.

T DEG K	X MOLE FR	P MEAS --- MPA	P PRED ---	% DIFF	D MEAS -- MOL/DM3	D PRED --	% DIFF
288.890	0.0505	0.2524	0.2549	+0.97%	9.6108	9.6182	+0.08%
	0.0863	0.2513	0.2480	-1.34	9.5960	9.5835	-0.13
	0.1454	0.2399	0.2366	-1.38	9.5675	9.5252	-0.44
	0.4968	0.1685	0.1697	+0.69	9.3110	9.1620	-1.63
	0.5010	0.1653	0.1688	+2.14	9.3041	9.1574	-1.60
	0.5097	0.1632	0.1672	+2.44	9.2790	9.1482	-1.43
298.337	0.0505	0.3376	0.3390	+0.41	9.4233	9.4220	-0.01
	0.0863	0.3336	0.3299	-1.13	9.4206	9.3908	-0.32
	0.1454	0.3175	0.3149	-0.82	9.3800	9.3382	-0.45
	0.4968	0.2270	0.2270	+0.02	9.1483	9.0043	-1.60
	0.5010	0.2238	0.2260	+0.98	9.1449	9.0015	-1.59
308.327	0.0505	0.4490	0.4491	+0.02	9.2013	9.2052	+0.04
	0.0863	0.4405	0.4371	-0.78	9.1903	9.1780	-0.13
	0.1454	0.4197	0.4174	-0.55	9.1575	9.1319	-0.28
	0.4968	0.3045	0.3026	-0.63	8.9542	8.8314	-1.39
	0.5010	0.2994	0.3012	+0.61	8.9469	8.8276	-1.35
318.496	0.0505	0.5869	0.5865	+0.07	8.9993	8.9732	-0.29
	0.0863	0.5740	0.5709	-0.55	8.9839	8.9507	-0.37
	0.1454	0.5464	0.5453	-0.20	8.9630	8.9119	-0.57
	0.4968	0.4029	0.3974	-1.38	8.8137	8.6482	-1.92
	0.5010	0.3965	0.3957	-0.21	8.7712	8.6447	-1.46
0.5097	0.3894	0.3920	+0.68	8.8082	8.6376	-1.98	
328.480	0.0505	0.7498	0.7495	-0.04	8.7512	8.7324	-0.22
	0.0863	0.7324	0.7296	-0.38	8.7520	8.7150	-0.42
	0.1454	0.6978	0.6972	-0.09	8.7535	8.6842	-0.80
	0.4968	0.5145	0.5105	-0.78	8.6170	8.4600	-1.86
	0.5010	0.5139	0.5083	-1.10	8.5955	8.4569	-1.64

TABLE 3E.

ENTHALPIES OF THE 0.2 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE:  
 ("#" DENOTES A POINT IN THE PREDICTED TWO-PHASE REGION)

	P MPA	P PSIA	T DEG K	T DEG F	H EXP BTU/LB	H EXP - - - -	H PRED KJ/KG - - - -	DIFF
	0.544	80	321.48	119.0	26.6	61.83	59.97	1.86
	0.544	80	321.54	119.1	27.8	64.62	60.11	4.51
#	0.544	80	323.43	122.5	75.5	175.50	165.62	9.88
#	0.544	80	323.48	122.6	77.5	180.14	168.36	11.78
#	0.544	80	323.82	123.2	81.6	189.67	184.58	5.09
#	0.544	80	324.26	124.0	86.7	201.53	204.64	-3.11
#	0.544	80	325.37	126.0	91.3	212.22	249.55	-37.33
#	0.544	80	325.82	126.8	92.6	215.24	265.71	-50.46
#	0.544	80	326.71	128.4	103.1	239.65	295.83	-56.18
#	0.544	80	326.71	128.4	127.9	297.30	295.83	1.46
#	0.544	80	326.76	128.5	130.8	304.04	297.58	6.46
#	0.544	80	328.26	131.2	141.3	328.44	342.86	-14.41
#	0.544	80	328.65	131.9	144.8	336.58	353.85	-17.27
#	0.544	80	328.82	132.2	159.4	370.52	358.52	11.99
#	0.544	80	328.87	132.3	159.6	370.98	359.94	11.04
	0.544	80	330.93	136.0	166.7	387.48	383.30	4.18
	0.544	80	331.71	137.4	167.5	389.34	384.83	4.51
	0.544	80	334.43	142.3	167.8	390.04	390.23	-0.19
	0.544	80	334.71	142.8	169.0	392.83	390.76	2.07
	0.544	80	340.43	153.1	172.3	400.50	402.13	-1.63
	0.544	80	343.87	159.3	179.1	416.31	408.99	7.32
	0.544	80	344.32	160.1	180.7	420.03	409.89	10.13
	0.544	80	349.26	169.0	184.3	428.40	419.82	8.58
	0.544	80	349.87	170.1	183.5	426.54	421.05	5.49
	0.544	80	355.04	179.4	186.2	432.81	431.51	1.30
	0.544	80	355.59	180.4	189.3	440.02	432.63	7.39
	1.361	200	354.37	178.2	63.7	148.07	148.25	-0.19
	1.361	200	354.98	179.3	63.7	148.07	149.97	-1.91
	1.361	200	357.48	183.8	68.0	158.06	157.09	0.98
	1.361	200	357.65	184.1	66.8	155.27	157.55	-2.28
	1.361	200	359.04	186.6	69.4	161.32	161.53	-0.21
	1.361	200	359.15	186.8	69.1	160.62	161.85	-1.23
	1.361	200	359.98	188.3	70.3	163.41	164.25	-0.84
	1.361	200	360.09	188.5	71.1	165.27	164.57	0.70
	1.361	200	360.71	189.6	73.3	170.38	166.34	4.04
	1.361	200	360.98	190.1	73.1	169.92	167.15	2.77
	1.361	200	362.65	193.1	82.6	192.00	171.99	20.01
	1.361	200	363.04	193.8	87.0	202.23	173.12	29.10
#	1.361	200	365.37	198.0	134.8	313.34	279.82	33.52
#	1.361	200	365.54	198.3	135.9	315.89	287.07	28.82
#	1.361	200	366.76	200.5	156.1	362.85	336.35	26.50
#	1.361	200	367.09	201.1	160.2	372.38	348.57	23.80
#	1.361	200	367.26	201.4	159.8	371.45	354.57	16.88
#	1.361	200	368.09	202.9	168.6	391.90	383.14	8.76
#	1.361	200	369.59	205.6	171.4	398.41	430.21	-31.80
	1.361	200	370.43	207.1	175.2	407.24	436.14	-28.89
	1.361	200	371.59	209.2	182.9	425.14	438.99	-13.85
	1.361	200	371.65	209.3	182.2	423.51	439.11	-15.60
	1.361	200	374.21	213.9	191.6	445.36	445.32	0.05
	1.361	200	374.21	213.9	192.6	447.69	445.32	2.37
	1.361	200	375.32	215.9	194.2	451.41	448.01	3.39
	1.361	200	376.37	217.8	195.2	453.73	450.57	3.16
	1.361	200	376.59	218.2	196.6	456.99	451.10	5.88
	1.361	200	381.54	227.1	200.9	466.98	462.94	4.04
	1.361	200	381.54	227.1	200.8	466.75	462.94	3.81
	1.361	200	386.59	236.2	206.5	480.00	474.98	5.02
	1.361	200	386.82	236.6	206.4	479.77	475.51	4.25

TABLE 3E. (CONT.)

## ENTHALPIES OF THE 0.2 MOLE FRACTION MIXTURE:

	P MFA	P PSIA	T DEG K	T DEG F	H EXP BTU/LB	H EXP - - - - KJ/KG	H PRED - - - - KJ/KG	DIFF - - - -
	2.722	400	393.87	249.3	114.6	266.38	268.78	-2.39
	2.722	400	394.26	250.0	115.6	268.71	270.15	-1.44
	2.722	400	396.04	253.2	120.7	280.56	276.45	4.11
	2.722	400	396.15	253.4	120.0	278.93	276.84	2.09
	2.722	400	397.26	255.4	121.9	283.35	280.86	2.49
	2.722	400	397.26	255.4	122.5	284.74	280.86	3.88
	2.722	400	398.21	257.1	125.9	292.65	284.35	8.30
	2.722	400	398.32	257.3	125.1	290.79	284.77	6.02
	2.722	400	399.65	259.7	127.2	295.67	289.81	5.86
	2.722	400	399.71	259.8	128.0	297.53	290.02	7.51
	2.722	400	400.82	261.8	129.4	300.78	294.32	6.46
	2.722	400	400.98	262.1	131.4	305.43	294.97	10.46
	2.722	400	401.76	263.5	134.6	312.87	298.09	14.78
	2.722	400	401.87	263.7	134.8	313.34	298.53	14.81
#	2.722	400	402.87	265.5	144.5	335.88	318.57	17.32
#	2.722	400	402.93	265.6	150.2	349.13	321.47	27.66
#	2.722	400	404.09	267.7	171.5	398.64	375.30	23.34
#	2.722	400	404.21	267.9	169.8	394.69	380.02	14.67
#	2.722	400	405.15	269.6	182.7	424.68	418.26	6.42
#	2.722	400	405.15	269.6	182.5	424.21	418.26	5.95
	2.722	400	406.82	272.6	197.5	459.08	469.89	-10.81
	2.722	400	407.48	273.8	198.6	461.63	472.42	-10.79
	2.722	400	407.76	274.3	197.3	458.61	473.47	-14.85
	2.722	400	408.87	276.3	211.2	490.92	477.56	13.37
	2.722	400	410.37	279.0	215.5	500.92	482.88	18.04
	2.722	400	410.59	279.4	218.2	507.19	483.67	23.52
	2.722	400	416.37	289.8	220.8	513.24	502.78	10.46
	2.722	400	416.48	290.0	220.3	512.08	503.13	8.95
	4.083	600	400.15	260.6	124.3	288.93	285.51	3.42
	4.083	600	400.15	260.6	122.8	285.44	285.51	-0.07
	4.083	600	404.82	269.0	131.3	305.20	301.50	3.70
	4.083	600	404.87	269.1	130.6	303.57	301.71	1.86
	4.083	600	409.93	278.2	136.8	317.98	319.96	-1.98
	4.083	600	410.09	278.5	139.7	324.72	320.59	4.14
	4.083	600	413.26	284.2	145.0	337.04	332.72	4.32
	4.083	600	413.32	284.3	142.9	332.16	332.93	-0.77
	4.083	600	413.37	284.4	144.6	336.11	333.14	2.98
	4.083	600	416.09	289.3	149.4	347.27	344.20	3.07
	4.083	600	416.09	289.3	149.7	347.97	344.20	3.77
	4.083	600	417.21	291.3	150.8	350.53	348.95	1.58
	4.083	600	416.98	290.9	151.1	351.22	347.99	3.23
	4.083	600	417.71	292.2	151.9	353.08	351.11	1.98
	4.083	600	418.15	293.0	151.1	351.22	353.08	-1.86
	4.083	600	419.43	295.3	156.7	364.24	358.89	5.35
	4.083	600	419.48	295.4	155.8	362.15	359.17	2.98
	4.083	600	420.82	297.8	159.4	370.52	365.59	4.93
	4.083	600	421.09	298.3	158.7	368.89	366.98	1.91
	4.083	600	422.21	300.3	162.3	377.26	372.77	4.49
	4.083	600	422.32	300.5	163.0	378.88	373.35	5.53
	4.083	600	427.76	310.3	185.2	430.49	414.91	15.57
	4.083	600	428.09	310.9	185.3	430.72	419.19	11.53
	4.083	600	432.37	318.6	207.7	482.79	472.58	10.20
	4.083	600	432.48	318.8	206.3	479.53	473.51	6.02

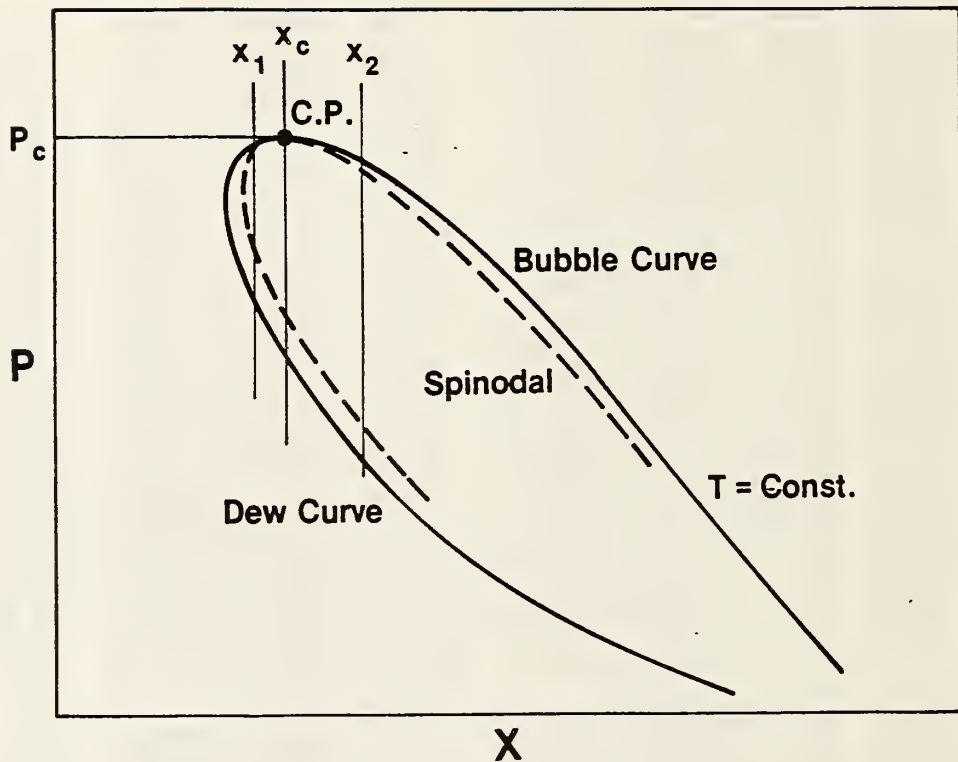


Fig. 1. Diagram showing a liquid-vapor phase boundary for a constant temperature. The critical point for that temperature,  $P_c$  and  $x_c$ , is that point where the pressure is a maximum. The dashed line represents the locus of points for which  $(\partial^2 G / \partial x^2)_{T,P} = 0$ , and the point of maximum pressure for this function coincides with the point  $(P_c, x_c)$ . This is found through a scan, at the specified  $T$  and fixed  $x$ , in which the density is varied in order to find the pressure where  $(\partial^2 G / \partial x^2)_{T,P} = 0$ . The value of  $x$  is varied until the maximum pressure is found. This identifies  $P_c, x_c$  for this particular temperature.



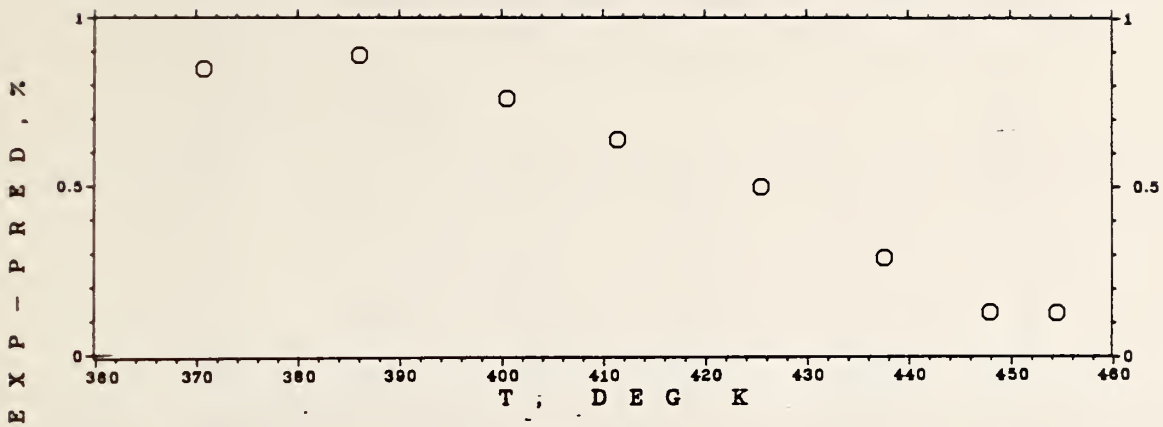


Fig. 2. Differences between vapor pressures of pure isopentane measured at this laboratory(13) and those predicted by the surface, in percent.

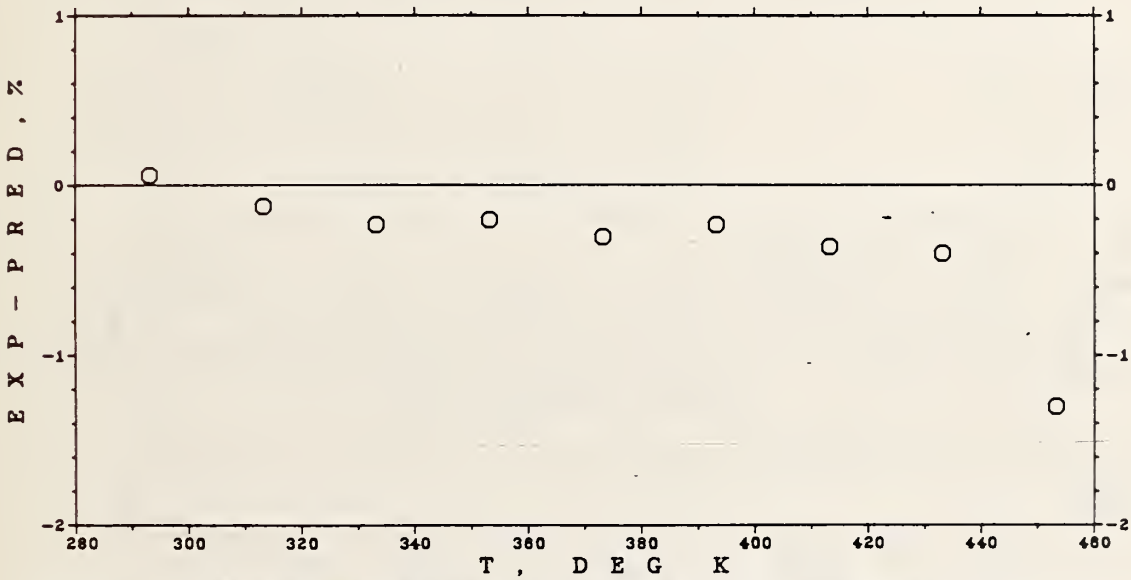


Fig. 3a. Differences between saturated liquid densities of pure isopentane measured by Young(9) and those predicted by the surface, in %.

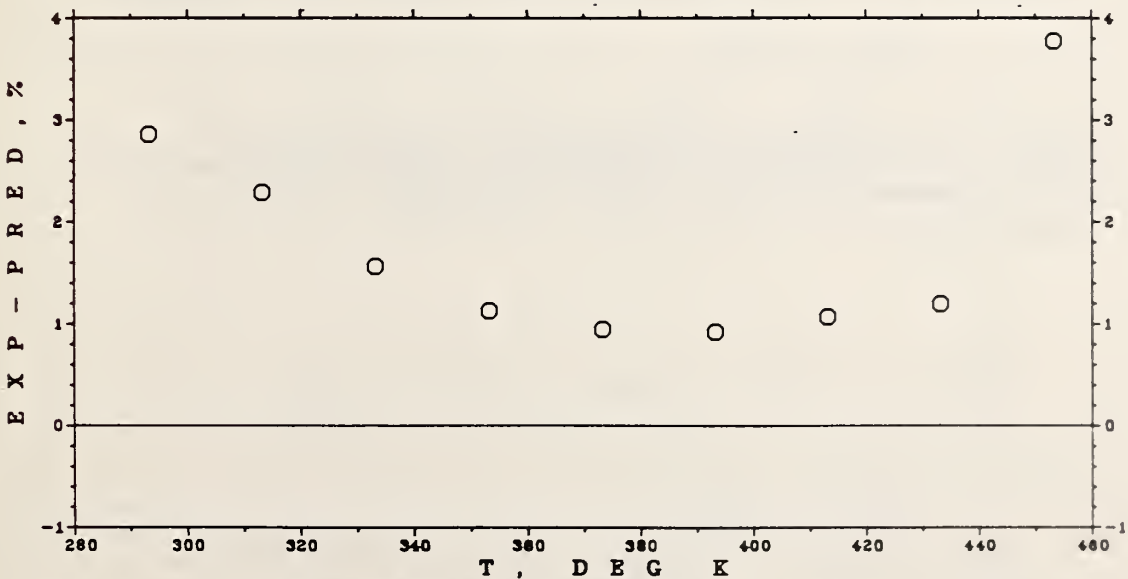


Fig. 3b. Differences between saturated vapor densities of pure isopentane measured by Young(9) and those predicted by the surface, in %.

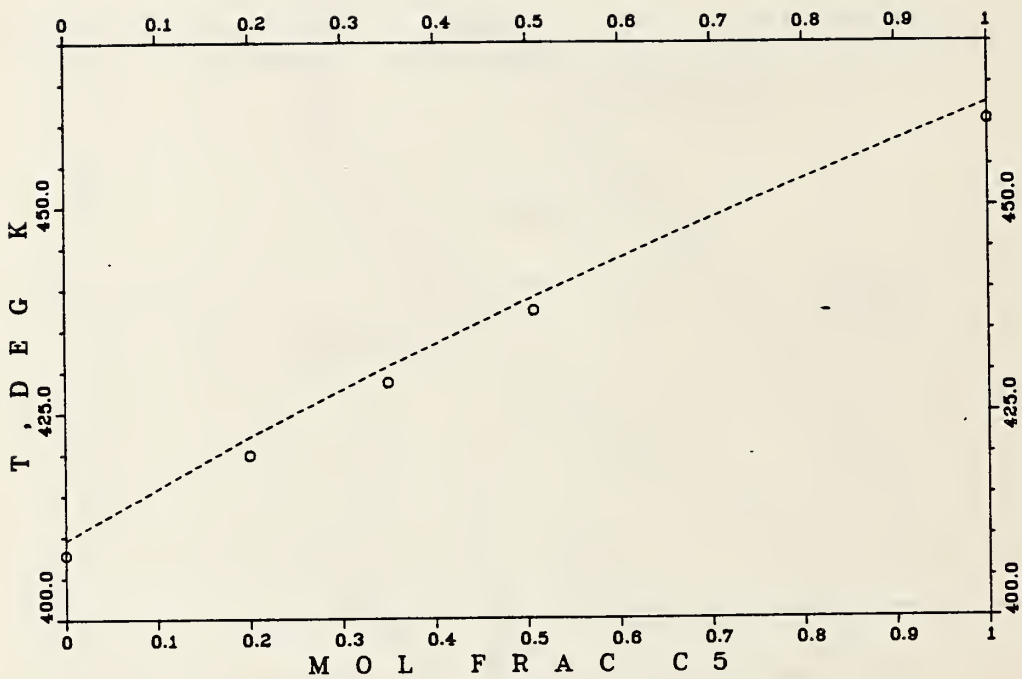


Fig. 4. The critical temperature of isopentane-isobutane mixtures as a function of composition. The measured points are represented by circles, and the predicted values by the dashed line.

Fig. 5. Differences in % between measured bubble-points of mixtures at this laboratory and those predicted by the surface.

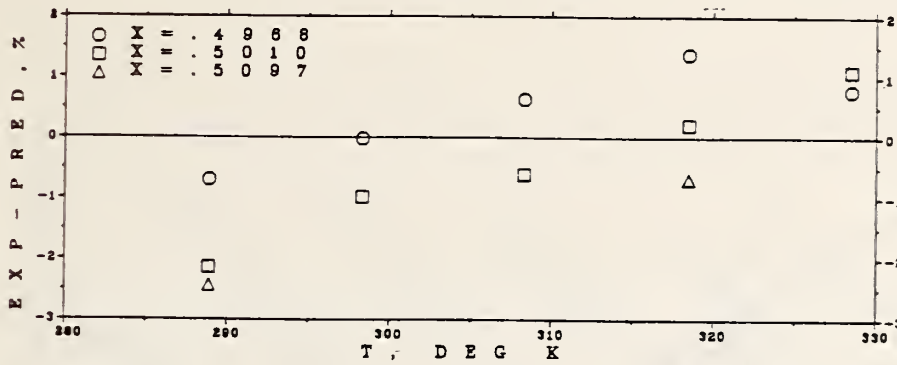


Fig. 5a. Bubble-point pressures of about 0.5 mole fraction isopentane in isobutane mixtures.

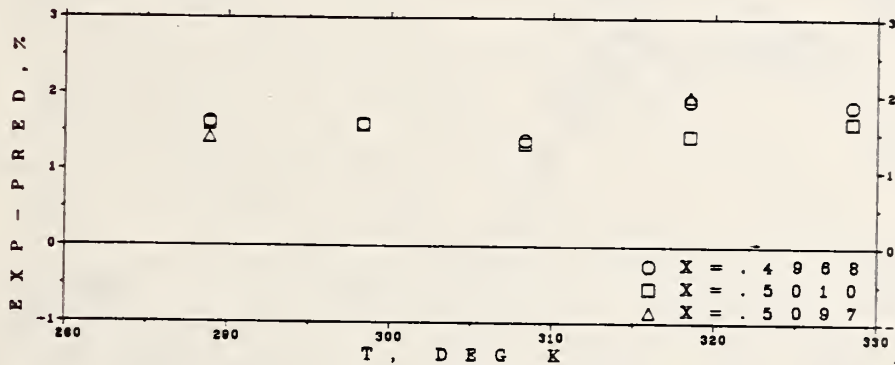


Fig. 5b. Bubble-point densities of about 0.5 mole fraction isopentane in isobutane mixtures.

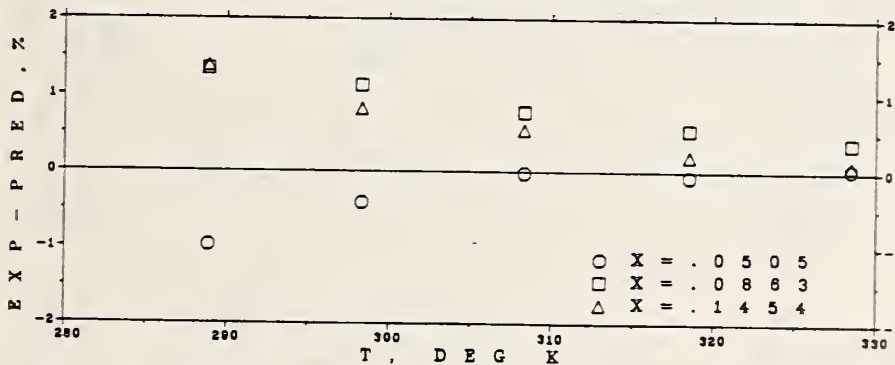


Fig. 5c. Bubble-point pressures of 0.05 to 0.15 mole fraction isopentane in isobutane mixtures.

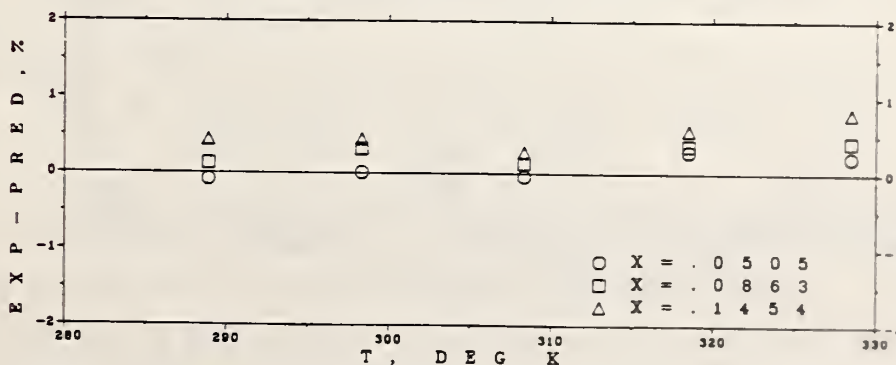


Fig. 5d. Bubble-point densities of 0.05 to 0.15 mole fraction isopentane in isobutane mixtures.

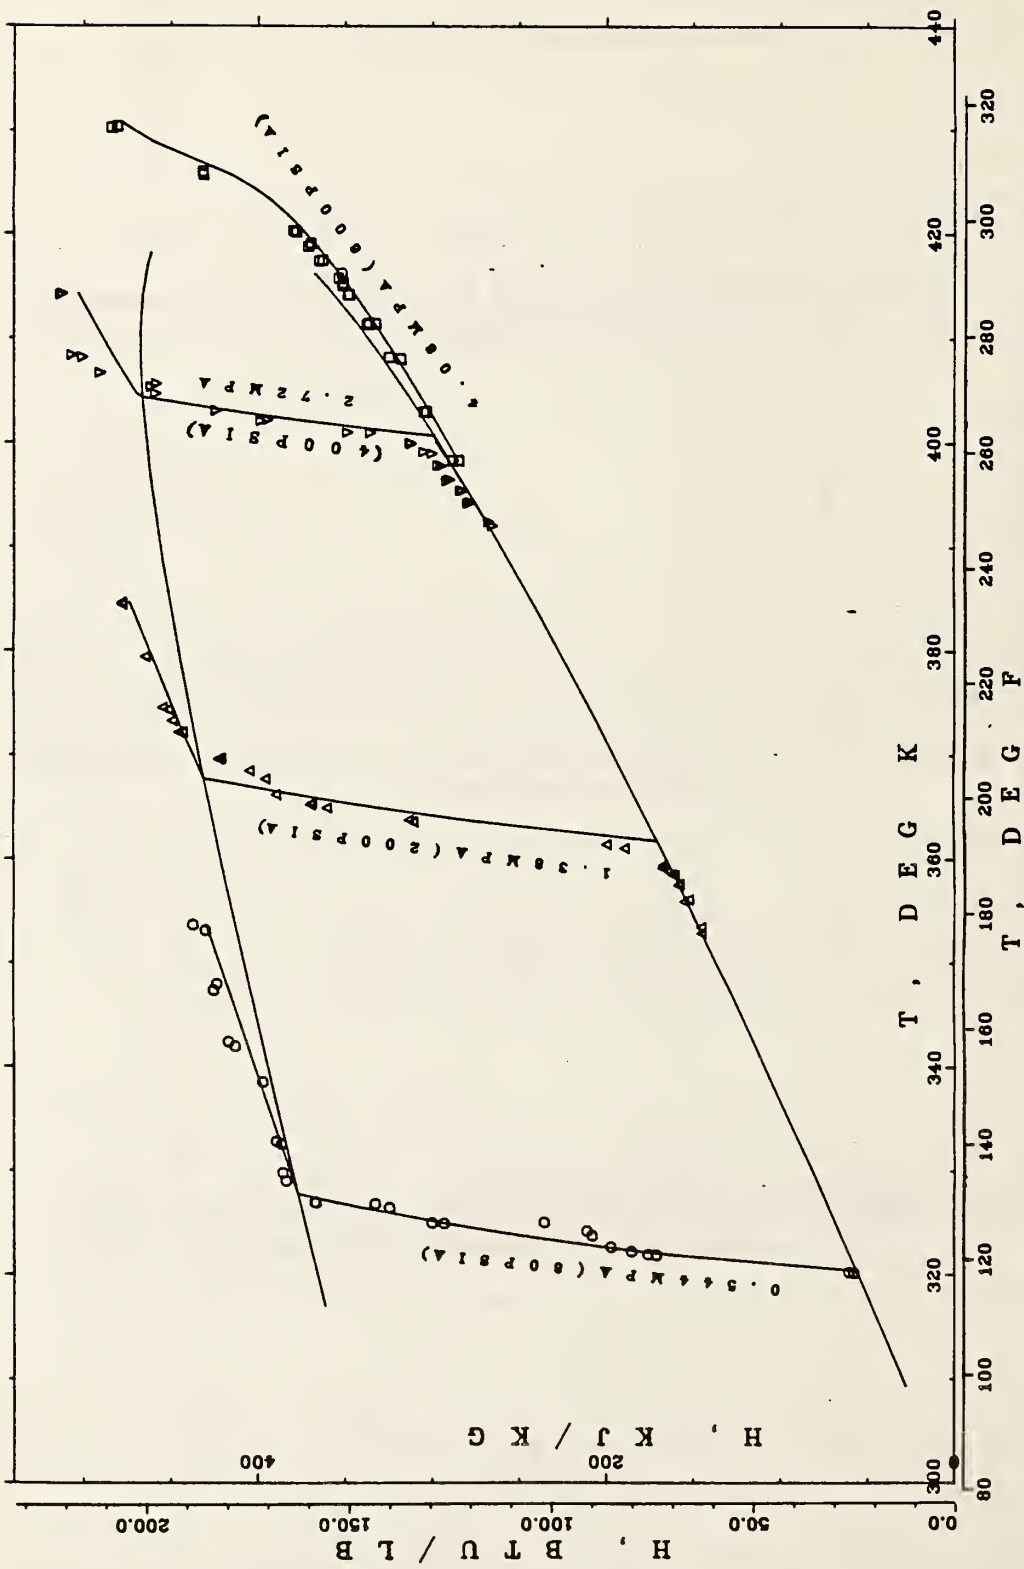


Fig. 6. Enthalpies of the 0.2 mole fraction mixture of isopentane in isobutane. The measured values(12) on isobars are indicated by symbols, and the predicted values by solid lines. The predicted boundaries of the two-phase region are also shown.



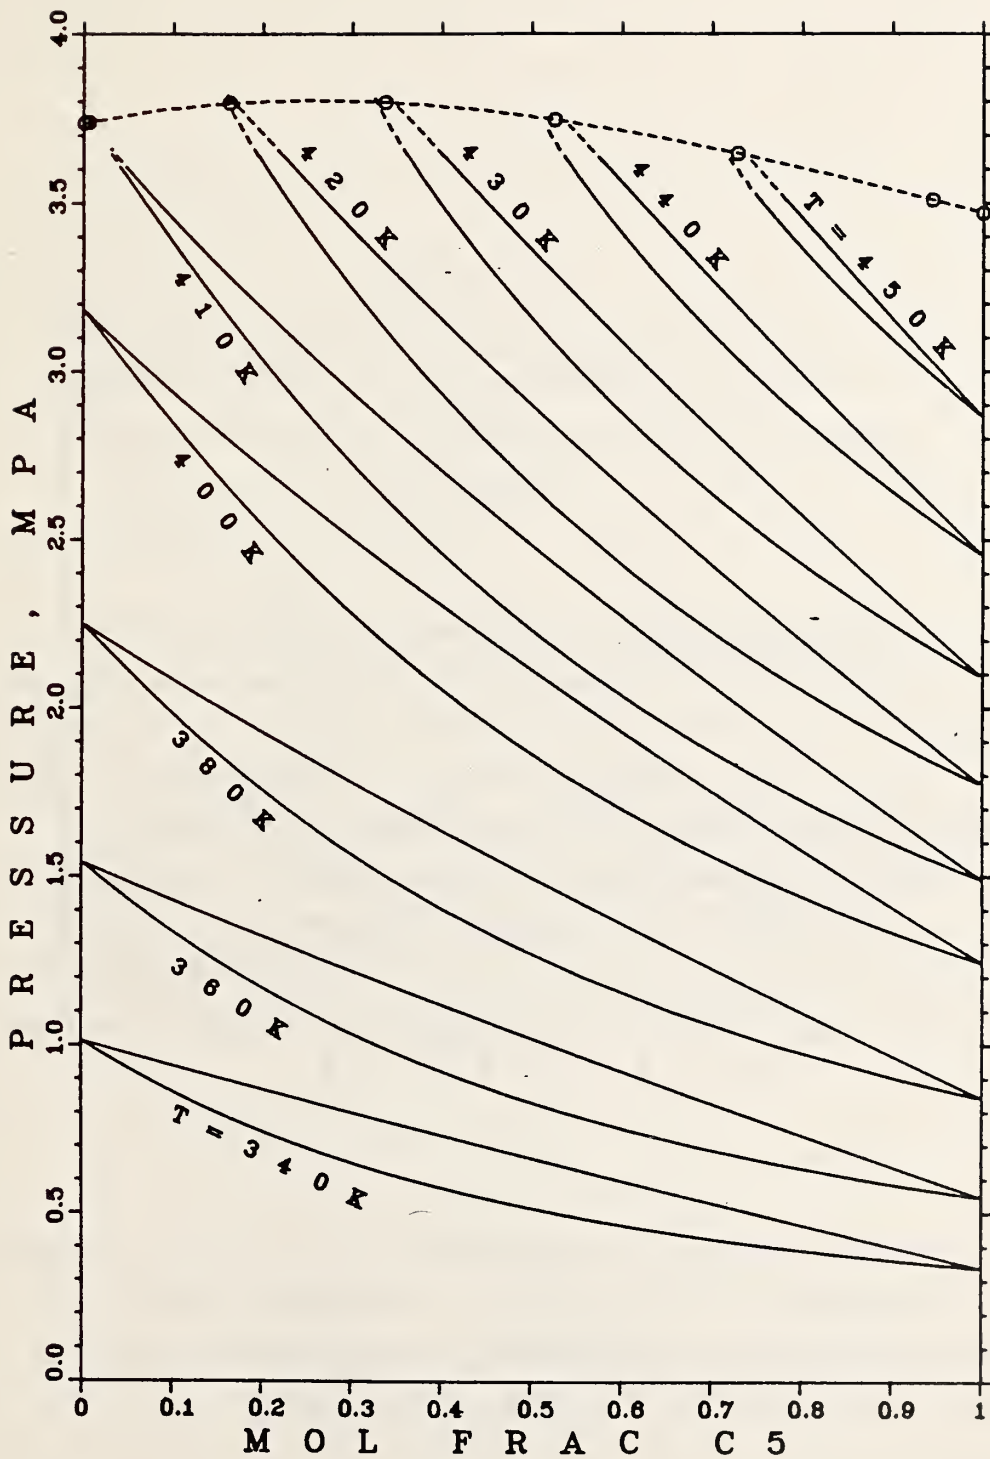


Fig. 7. Predicted pressure vs. concentration for the dew- and bubble-points on isotherms for the isopentane-isobutane mixture. The predicted critical line is also shown. The dashed lines indicate predicted values within the excluded critical region.

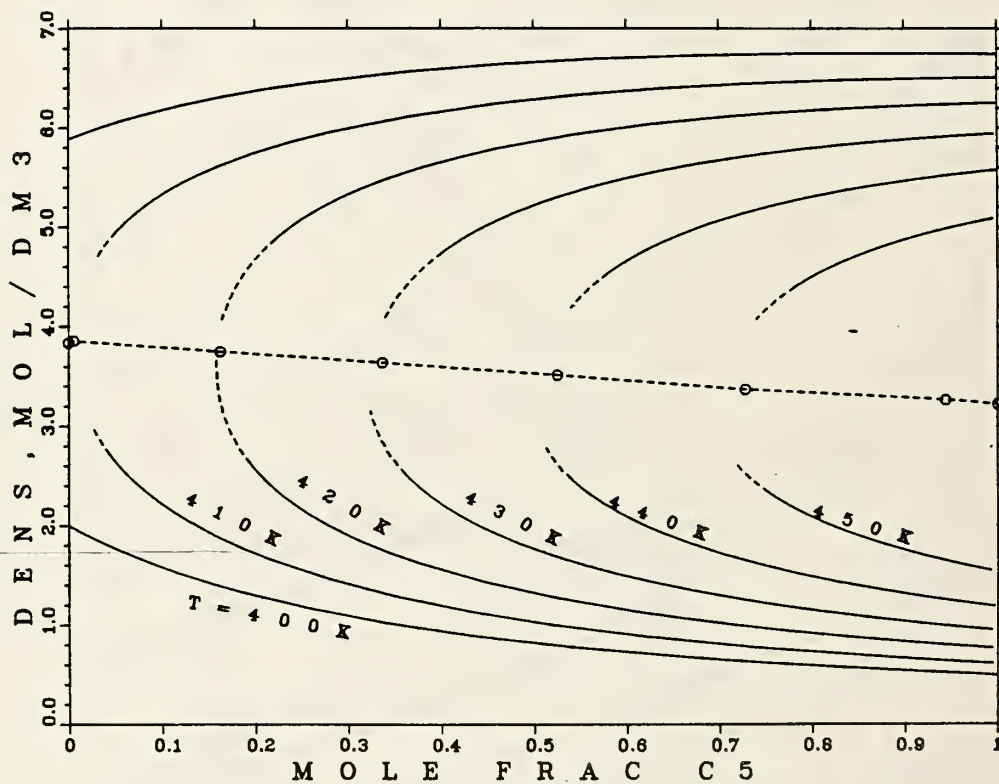


Fig. 8. Predicted density vs. concentration for the dew- and bubble-points on isotherms for the isopentane in isobutane mixture. The predicted critical line is also shown. The dashed lines indicate predicted values within the excluded critical region.

## APPENDIX A.

### Tables of Values for the Thermodynamic Properties of the 0.1 Mole Fraction Isopentane in Isobutane Mixture in SI Units.

Table A1 presents properties for both the dew-points and the bubble-points and at increments of both temperature and pressure. Also shown are the concentrations and thermodynamic properties of the coexisting phase.

Table A2 presents properties along isobars at increments of temperature from the compressed liquid through the superheated vapor. At the bubble-points and dew-points the concentrations and values for the thermodynamic properties of the coexisting phase are also shown.

TABLE A1A. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY  
 THE DEW POINT AT INCREMENTS OF PRESSURE

P MPA	T DEG K	VAPOR, X = 0.1000		COEXISTING LIQUID		S KJ/KG-K	H KJ/KG	M3/KG	X	V M3/KG	H KJ/KG	S KJ/KG-K
		V M3/KG	H KJ/KG	S KJ/KG-K	H KJ/KG							
0.06	255.91	0.5808	-102.9	0.1075	0.3487	0.0016079	-508.2	-1.3849				
0.08	262.68	0.4442	-93.7	0.1040	0.3334	0.0016282	-491.7	-1.3267				
0.10	268.23	0.3607	-86.1	0.1025	0.3216	0.0016454	-478.0	-1.2795				
0.1013	268.56	0.3563	-85.7	0.1025	0.3209	0.0016465	-477.2	-1.2766				
0.15	279.05	0.2467	-71.2	0.1030	0.3002	0.0016810	-450.9	-1.1881				
0.20	287.37	0.18815	-59.6	0.1059	0.2852	0.0017102	-429.7	-1.1187				
0.25	294.22	0.15227	-50.1	0.1096	0.2736	0.0017357	-412.0	-1.0622				
0.30	300.10	0.12794	-41.9	0.1136	0.2642	0.0017587	-396.7	-1.0141				
0.40	309.93	0.09696	-28.4	0.1216	0.2493	0.0017999	-370.7	-0.9344				
0.50	318.05	0.07798	-17.3	0.1292	0.2378	0.0018368	-348.9	-0.8690				
0.60	325.04	0.06510	-7.9	0.1363	0.2283	0.0018712	-329.7	-0.8131				
0.80	336.75	0.04869	7.5	0.1490	0.2133	0.0019350	-296.8	-0.7196				
1.00	346.45	0.03862	19.9	0.1598	0.2015	0.0019952	-268.7	-0.6421				
1.20	354.80	0.03178	30.1	0.1690	0.1918	0.002054	-243.8	-0.5752				
1.40	362.18	0.02681	38.7	0.1766	0.1834	0.002113	-221.1	-0.5158				
1.60	368.81	0.02302	45.9	0.1829	0.1760	0.002173	-200.2	-0.4619				
1.80	374.85	0.02003	52.1	0.1879	0.1693	0.002235	-180.6	-0.4123				
2.00	380.41	0.017590	57.2	0.1916	0.1632	0.002300	-162.0	-0.3661				
2.20	385.55	0.015556	61.5	0.1940	0.1574	0.002369	-144.2	-0.3225				
2.40	390.35	0.013823	64.8	0.1949	0.1519	0.002445	-127.0	-0.2810				
2.60	394.85	0.012316	67.1	0.1942	0.1466	0.002529	-110.1	-0.2410				
2.80	399.07	0.010978	68.4	0.1916	0.1413	0.002623	-93.5	-0.2020				
3.00	403.04	0.009766	68.4	0.1866	0.1360	0.002735	-76.9	-0.1635				
3.10	404.95	0.009193	67.9	0.1829	0.1333	0.002799	-68.5	-0.1441				
3.20	406.79	0.008635	66.9	0.1782	0.1305	0.002872	-59.9	-0.1244				
3.30	408.58	0.008085	65.3	0.1722	0.1275	0.002956	-51.0	-0.1042				
3.40	410.31	0.007635	62.9	0.1646	0.1244	0.003056	-41.7	-0.0833				
3.50	411.99	0.006971	59.6	0.1546	0.1209	0.003180	-31.8	-0.0609				
3.60	413.59	0.006370	54.5	0.1408	0.1168	0.003346	-20.6	-0.0358				
3.70	415.12	0.005670	46.2	0.1192	0.1116	0.003605	-6.7	-0.0048				

\*



TABLE A1B. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY  
 THE BUBBLE POINT AT INCREMENTS OF PRESSURE

P MPA	LIQUID, X = 0.1000		COEXISTING VAPOR -----					
	T DEG K	V M3/KG	H KJ/KG	S KJ/KG-K	X	V M3/KG	H KJ/KG	S KJ/KG-K
0.06	250.54	0.0016336	-484.8	-1.4046	0.0222	0.5788	-98.5	0.0886
0.08	257.42	0.0016532	-469.9	-1.3460	0.0238	0.4430	-89.5	0.0853
0.10	263.06	0.0016699	-457.5	-1.2986	0.0251	0.3594	-82.1	0.0840
0.1013	263.40	0.0016709	-456.8	-1.2957	0.0252	0.3554	-81.7	0.0839
0.15	274.07	0.0017043	-432.9	-1.2073	0.0277	0.2463	-67.5	0.0846
0.20	282.53	0.0017327	-413.5	-1.1380	0.0298	0.18786	-56.3	0.0877
0.25	289.50	0.0017575	-397.2	-1.0814	0.0315	0.15207	-47.0	0.0915
0.30	295.48	0.0017800	-383.0	-1.0332	0.0330	0.12780	-39.1	0.0956
0.40	305.49	0.0018203	-358.7	-0.9532	0.0356	0.09688	-25.9	0.1039
0.50	313.77	0.0018565	-338.2	-0.8874	0.0379	0.07792	-15.1	0.1118
0.60	320.90	0.0018902	-320.1	-0.8311	0.0399	0.06506	-6.0	0.1192
0.80	332.85	0.0019530	-288.8	-0.7367	0.0434	0.04866	9.1	0.1325
1.00	342.77	0.002012	-261.9	-0.6584	0.0465	0.03860	21.1	0.1440
1.20	351.33	0.002071	-238.0	-0.5907	0.0494	0.03176	31.1	0.1537
1.40	358.91	0.002129	-216.1	-0.5305	0.0520	0.02679	39.5	0.1620
1.60	365.72	0.002188	-195.9	-0.4758	0.0546	0.02300	46.6	0.1689
1.80	371.95	0.002250	-176.8	-0.4254	0.0571	0.02001	52.6	0.1746
2.00	377.68	0.002314	-158.7	-0.3784	0.0595	0.017570	57.6	0.1789
2.20	383.01	0.002383	-141.4	-0.3340	0.0620	0.015536	61.7	0.1820
2.40	387.99	0.002459	-124.5	-0.2916	0.0645	0.013802	64.9	0.1836
2.60	392.68	0.002542	-108.1	-0.2507	0.0671	0.012295	67.1	0.1836
2.80	397.09	0.002637	-91.8	-0.2107	0.0698	0.010957	68.3	0.1818
3.00	401.28	0.002748	-75.4	-0.1711	0.0728	0.009743	68.3	0.1776
3.10	403.29	0.002813	-67.1	-0.1512	0.0744	0.009170	67.7	0.1743
3.20	405.26	0.002886	-58.6	-0.1309	0.0761	0.008611	66.7	0.1701
3.30	407.18	0.002970	-49.9	-0.1101	0.0780	0.008060	65.0	0.1647
3.40	409.06	0.003070	-40.7	-0.0884	0.0811	0.007509	62.6	0.1576
3.50	410.89	0.003195	-30.8	-0.0651	0.0825	0.006944	59.2	0.1482
3.60	412.70	0.003362	-19.8	-0.0390	0.0855	0.006342	54.1	0.1352
3.70	414.49	0.003624	-5.9	-0.0065	0.0897	0.005640	45.7	0.1147

\* x

TABLE A1C. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY  
THE DEW POINT AT INCREMENTS OF TEMPERATURE

T DEG K	VAPOR, X = 0.1000		COEXISTING LIQUID		S KJ/KG-K
	P MPA	V M3/KG	H KJ/KG	S KJ/KG-K	
240.0	0.02825	1.1701	-124.3	0.3890	-1.5250
245.0	0.03625	0.9280	-117.6	0.3757	-1.4805
250.0	0.04597	0.7441	-110.9	0.3629	-1.4364
255.0	0.05765	0.6028	-104.2	0.3508	-1.3928
260.0	0.07154	0.4930	-97.4	0.3394	-1.3496
265.0	0.08795	0.4067	-90.6	0.3284	-1.3069
268.56	0.10132	0.3563	-85.7	0.3209	-1.2766
270.0	0.10714	0.3382	-83.7	0.3179	-1.2645
275.0	0.12944	0.2834	-76.8	0.3079	-1.2222
280.0	0.1551	0.2390	-69.9	0.2985	-1.1801
285.0	0.1846	0.2029	-62.9	0.2894	-1.1384
290.0	0.2182	0.17328	-56.0	0.2807	-1.0969
295.0	0.2562	0.14876	-49.0	0.2724	-1.0558
300.0	0.2991	0.12833	-42.1	0.2643	-1.0149
305.0	0.3471	0.11121	-35.2	0.2566	-0.9743
310.0	0.4008	0.09678	-28.3	0.2492	-0.9339
315.0	0.4604	0.08454	-21.5	0.2420	-0.8936
320.0	0.5265	0.07411	-14.7	0.2351	-0.8534
325.0	0.5994	0.06517	-8.0	0.2284	-0.8134
330.0	0.6796	0.05747	-1.3	0.2218	-0.7734
335.0	0.7674	0.05080	5.3	0.2155	-0.7335
340.0	0.8634	0.04501	11.7	0.2093	-0.6936
345.0	0.9681	0.03996	18.1	0.2033	-0.6537
350.0	1.0818	0.03553	24.3	0.1974	-0.6137
355.0	1.2051	0.03163	30.3	0.1916	-0.5736
360.0	1.3386	0.02819	36.2	0.1859	-0.5333
365.0	1.4827	0.02513	41.8	0.1803	-0.4929
370.0	1.6380	0.02240	47.2	0.1747	-0.4522
375.0	1.8051	0.01996	52.2	0.1692	-0.4111
380.0	1.9848	0.01776	56.9	0.1636	-0.3695
385.0	2.1778	0.01577	61.0	0.1580	-0.3273
390.0	2.3848	0.01395	64.5	0.1523	-0.2841
395.0	2.6070	0.01227	67.2	0.1464	-0.2396
400.0	2.8458	0.01069	68.5	0.1401	-0.1932
405.0	3.103	0.00918	67.9	0.1332	-0.1435
410.0	3.382	0.00764	63.4	0.1250	-0.0872
415.0	3.692	0.00573	47.1	0.1121	-0.0076

\*

TABLE A1D. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY  
THE BUBBLE POINT AT INCREMENTS OF TEMPERATURE

T DEG K	LIQUID, X = 0.1000				COEXISTING VAPOR			
	P MPA	V M3/KG	H KJ/KG	S KJ/KG-K	X	V M3/KG	H KJ/KG	S KJ/KG-K
240.0	0.03723	0.0016052	-507.3	-1.4959	0.0199	0.9014	-112.2	0.0978
245.0	0.04697	0.0016185	-496.7	-1.4523	0.0210	0.7266	-105.8	0.0927
250.0	0.05863	0.0016322	-486.0	-1.4092	0.0221	0.5914	-99.2	0.0889
255.0	0.07246	0.0016462	-475.2	-1.3665	0.0233	0.4857	-92.7	0.0862
260.0	0.08873	0.0016607	-464.3	-1.3242	0.0244	0.4023	-86.1	0.0845
263.40	0.10132	0.0016709	-456.8	-1.2957	0.0252	0.3554	-81.7	0.0839
265.0	0.10771	0.0016758	-453.2	-1.2824	0.0256	0.3358	-79.6	0.0838
270.0	0.12969	0.0016913	-442.1	-1.2409	0.0267	0.2822	-72.9	0.0839
275.0	0.15498	0.0017074	-430.8	-1.1996	0.0279	0.2388	-66.3	0.0849
280.0	0.1839	0.0017240	-419.3	-1.1586	0.0291	0.2033	-59.6	0.0866
285.0	0.2168	0.0017414	-407.7	-1.1178	0.0304	0.17409	-53.0	0.0889
290.0	0.2539	0.0017594	-396.0	-1.0774	0.0316	0.14983	-46.4	0.0918
295.0	0.2957	0.0017781	-384.1	-1.0371	0.0329	0.12958	-39.7	0.0952
300.0	0.3425	0.0017977	-372.1	-0.9970	0.0342	0.11255	-33.1	0.0991
305.0	0.3946	0.0018182	-359.9	-0.9571	0.0355	0.09817	-26.6	0.1034
310.0	0.4524	0.0018397	-347.6	-0.9174	0.0368	0.08594	-20.0	0.1081
315.0	0.5163	0.0018622	-335.1	-0.8777	0.0382	0.07550	-13.5	0.1130
320.0	0.5867	0.0018858	-322.4	-0.8382	0.0396	0.06653	-7.1	0.1183
325.0	0.6639	0.0019108	-309.5	-0.7987	0.0411	0.05879	-0.8	0.1237
330.0	0.7484	0.0019372	-296.4	-0.7592	0.0425	0.05209	5.5	0.1293
335.0	0.8406	0.0019652	-283.1	-0.7198	0.0441	0.04625	11.7	0.1350
340.0	0.9408	0.0019950	-269.5	-0.6803	0.0456	0.04115	17.8	0.1408
345.0	1.0495	0.002027	-255.8	-0.6408	0.0472	0.03667	23.8	0.1465
350.0	1.1671	0.002061	-241.8	-0.6013	0.0489	0.03273	29.6	0.1522
355.0	1.2940	0.002098	-227.5	-0.5616	0.0506	0.02924	35.2	0.1578
360.0	1.4308	0.002138	-212.9	-0.5217	0.0524	0.02614	40.6	0.1632
365.0	1.5778	0.002181	-198.1	-0.4816	0.0543	0.02338	45.8	0.1682
370.0	1.7355	0.002229	-182.9	-0.4412	0.0563	0.02090	50.7	0.1729
375.0	1.9045	0.002283	-167.3	-0.4005	0.0584	0.01868	55.3	0.1770
380.0	2.0852	0.002343	-151.3	-0.3591	0.0606	0.01666	59.4	0.1804
385.0	2.2783	0.002412	-134.7	-0.3171	0.0630	0.01483	63.0	0.1828
390.0	2.4843	0.002493	-117.6	-0.2742	0.0656	0.01314	65.9	0.1838
395.0	2.7038	0.002589	-99.6	-0.2299	0.0685	0.01158	67.9	0.1829
400.0	2.9377	0.002711	-80.5	-0.1835	0.0718	0.01011	68.5	0.1792
405.0	3.187	0.002875	-59.8	-0.1336	0.0759	0.00869	66.8	0.1707
410.0	3.451	0.003130	-35.8	-0.0767	0.0813	0.00722	61.0	0.1532
415.0	3.728	0.003738	-0.9	0.0053	0.0914	0.00540	42.0	0.1061

\* 415.0



TABLE A2. THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.06 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001605	-507.2	-1.4962	0.7739	0.789	2.109
250.0	0.001632	-485.9	-1.4094	0.7129	0.745	2.155
250.54	0.001633	-484.8	-1.4048	0.7096	0.743	2.158
COEXISTING VAPOR (X=.0222)						
250.54	0.5789	-98.5	0.0886	0.0338	0.000252	1.465

VAPOR

COEXISTING LIQUID (X=.3487)

255.91	0.001607	-507.9	-1.3858	0.7160	0.724	2.137
255.91	0.5809	-102.9	0.1076	0.0339	0.000246	1.486
260.0	0.5909	-96.9	0.1311	0.0346	0.000242	1.504
270.0	0.6152	-81.7	0.1883	0.0361	0.000232	1.547
280.0	0.6394	-66.0	0.2453	0.0376	0.000222	1.592
290.0	0.6636	-49.9	0.3020	0.0391	0.000214	1.637
300.0	0.6876	-33.3	0.3583	0.0406	0.000206	1.683
310.0	0.7116	-16.2	0.4142	0.0421	0.000199	1.729
320.0	0.7355	1.3	0.4699	0.0436	0.000192	1.775
330.0	0.7594	19.3	0.5252	0.0450	0.000186	1.821
340.0	0.7832	37.7	0.5803	0.0465	0.000180	1.868
350.0	0.8069	56.7	0.6351	0.0479	0.000175	1.914
360.0	0.8307	76.0	0.6897	0.0494	0.000170	1.961
370.0	0.8544	95.9	0.7440	0.0508	0.000165	2.007
380.0	0.8780	116.2	0.7982	0.0523	0.000160	2.053
390.0	0.9017	136.9	0.8521	0.0537	0.000156	2.098
400.0	0.9253	158.1	0.9057	0.0552	0.000152	2.143
410.0	0.9489	179.8	0.9592	0.0566	0.000148	2.188
420.0	0.9724	201.9	1.0125	0.0580	0.000145	2.232
430.0	0.9960	224.4	1.0655	0.0595	0.000141	2.276
440.0	1.0195	247.4	1.1183	0.0609	0.000138	2.319
450.0	1.0431	270.8	1.1709	0.0623	0.000135	2.362
460.0	1.0666	294.6	1.2233	0.0637	0.000132	2.404
470.0	1.0901	318.9	1.2754	0.0652	0.000129	2.445
480.0	1.1135	343.5	1.3273	0.0666	0.000126	2.486
490.0	1.1370	368.6	1.3790	0.0680	0.000123	2.527
500.0	1.1605	394.0	1.4304	0.0694	0.000121	2.566
510.0	1.1839	419.9	1.4816	0.0708	0.000119	2.605
520.0	1.2074	446.1	1.5325	0.0723	0.000116	2.644
530.0	1.2308	472.7	1.5832	0.0737	0.000114	2.682
540.0	1.2543	499.7	1.6337	0.0751	0.000112	2.719
550.0	1.2777	527.1	1.6839	0.0765	0.000110	2.756
560.0	1.3011	554.8	1.7338	0.0779	0.000108	2.792
570.0	1.3245	582.9	1.7835	0.0793	0.000106	2.828
580.0	1.3479	611.3	1.8330	0.0807	0.000104	2.862
590.0	1.3713	640.1	1.8822	0.0821	0.000102	2.897
600.0	1.3947	669.2	1.9312	0.0836	0.000100	2.931



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.08 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001605	-507.2	-1.4962	0.7745	0.789	2.109
250.0	0.001632	-485.9	-1.4094	0.7134	0.746	2.155
257.42	0.001653	-469.9	-1.3462	0.6673	0.713	2.187
COEXISTING VAPOR (X=.0238)						
257.42	0.4430	-89.5	0.0853	0.0342	0.000331	1.502

VAPOR

COEXISTING LIQUID (X=.3334)						
T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
262.68	0.001627	-491.4	-1.3275	0.6742	0.697	2.170
262.68	0.4443	-93.7	0.1040	0.0344	0.000324	1.523
270.0	0.4579	-82.5	0.1461	0.0355	0.000314	1.554
280.0	0.4764	-66.8	0.2033	0.0371	0.000301	1.598
290.0	0.4947	-50.6	0.2602	0.0386	0.000289	1.642
300.0	0.5130	-33.9	0.3166	0.0402	0.000278	1.687
310.0	0.5311	-16.8	0.3727	0.0417	0.000268	1.733
320.0	0.5492	0.7	0.4285	0.0432	0.000259	1.779
330.0	0.5673	18.8	0.4839	0.0447	0.000250	1.825
340.0	0.5853	37.2	0.5391	0.0462	0.000242	1.871
350.0	0.6032	56.2	0.5940	0.0476	0.000235	1.917
360.0	0.6211	75.6	0.6486	0.0491	0.000228	1.963
370.0	0.6390	95.4	0.7030	0.0506	0.000221	2.009
380.0	0.6569	115.7	0.7572	0.0520	0.000215	2.055
390.0	0.6747	136.5	0.8112	0.0535	0.000209	2.100
400.0	0.6925	157.7	0.8649	0.0549	0.000204	2.145
410.0	0.7103	179.4	0.9184	0.0564	0.000198	2.190
420.0	0.7280	201.5	0.9717	0.0578	0.000194	2.234
430.0	0.7457	224.1	1.0248	0.0593	0.000189	2.277
440.0	0.7635	247.1	1.0776	0.0607	0.000184	2.320
450.0	0.7812	270.5	1.1303	0.0621	0.000180	2.363
460.0	0.7989	294.3	1.1826	0.0636	0.000176	2.405
470.0	0.8165	318.6	1.2348	0.0650	0.000172	2.446
480.0	0.8342	343.3	1.2867	0.0664	0.000169	2.487
490.0	0.8518	368.3	1.3384	0.0679	0.000165	2.528
500.0	0.8695	393.8	1.3899	0.0693	0.000162	2.567
510.0	0.8871	419.7	1.4411	0.0707	0.000158	2.606
520.0	0.9048	445.9	1.4920	0.0721	0.000155	2.645
530.0	0.9224	472.5	1.5427	0.0736	0.000152	2.683
540.0	0.9400	499.5	1.5932	0.0750	0.000149	2.720
550.0	0.9576	526.9	1.6434	0.0764	0.000147	2.757
560.0	0.9752	554.6	1.6934	0.0778	0.000144	2.793
570.0	0.9928	582.7	1.7431	0.0792	0.000141	2.828
580.0	1.0104	611.1	1.7926	0.0806	0.000139	2.863
590.0	1.0279	639.9	1.8418	0.0821	0.000137	2.897
600.0	1.0455	669.1	1.8908	0.0835	0.000134	2.931

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.1 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001605	-507.2	-1.4963	0.7750	0.790	2.109
250.0	0.001632	-485.9	-1.4095	0.7140	0.746	2.155
260.0	0.001660	-464.2	-1.3245	0.6516	0.702	2.199
263.06	0.001670	-457.5	-1.2988	0.6325	0.688	2.212
COEXISTING VAPOR (X=.0251)						
263.06	0.3599	-82.1	0.0840	0.0345	0.000411	1.534

VAPOR

COEXISTING LIQUID (X=.3216)						
T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
268.23	0.001644	-477.8	-1.2802	0.6396	0.674	2.196
268.23	0.3608	-86.1	0.1026	0.0347	0.000402	1.555
270.0	0.3635	-83.4	0.1128	0.0350	0.000399	1.562
280.0	0.3785	-67.6	0.1702	0.0366	0.000381	1.604
290.0	0.3933	-51.3	0.2273	0.0382	0.000366	1.648
300.0	0.4081	-34.6	0.2839	0.0397	0.000351	1.692
310.0	0.4228	-17.5	0.3402	0.0413	0.000338	1.737
320.0	0.4374	0.1	0.3961	0.0428	0.000326	1.782
330.0	0.4520	18.2	0.4516	0.0443	0.000315	1.828
340.0	0.4665	36.7	0.5069	0.0458	0.000305	1.874
350.0	0.4810	55.7	0.5619	0.0473	0.000295	1.920
360.0	0.4954	75.1	0.6166	0.0488	0.000286	1.965
370.0	0.5098	95.0	0.6711	0.0503	0.000278	2.011
380.0	0.5242	115.3	0.7253	0.0518	0.000270	2.057
390.0	0.5385	136.1	0.7793	0.0532	0.000263	2.102
400.0	0.5528	157.4	0.8331	0.0547	0.000256	2.147
410.0	0.5671	179.0	0.8867	0.0562	0.000249	2.191
420.0	0.5813	201.2	0.9400	0.0576	0.000243	2.235
430.0	0.5956	223.8	0.9931	0.0591	0.000237	2.279
440.0	0.6098	246.8	1.0460	0.0605	0.000231	2.322
450.0	0.6240	270.2	1.0986	0.0620	0.000226	2.364
460.0	0.6382	294.0	1.1510	0.0634	0.000221	2.406
470.0	0.6524	318.3	1.2032	0.0648	0.000216	2.448
480.0	0.6666	343.0	1.2552	0.0663	0.000211	2.488
490.0	0.6807	368.1	1.3069	0.0677	0.000207	2.529
500.0	0.6949	393.6	1.3584	0.0691	0.000203	2.568
510.0	0.7090	419.4	1.4096	0.0706	0.000198	2.607
520.0	0.7232	445.7	1.4605	0.0720	0.000195	2.646
530.0	0.7373	472.3	1.5113	0.0734	0.000191	2.683
540.0	0.7514	499.3	1.5617	0.0749	0.000187	2.721
550.0	0.7655	526.7	1.6120	0.0763	0.000184	2.757
560.0	0.7796	554.4	1.6620	0.0777	0.000180	2.793
570.0	0.7937	582.5	1.7117	0.0791	0.000177	2.829
580.0	0.8078	610.9	1.7612	0.0806	0.000174	2.864
590.0	0.8219	639.7	1.8104	0.0820	0.000171	2.898
600.0	0.8360	668.9	1.8594	0.0834	0.000168	2.932

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.15 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001605	-507.1	-1.4964	0.7765	0.791	2.109
250.0	0.001632	-485.8	-1.4096	0.7153	0.747	2.155
260.0	0.001660	-464.1	-1.3246	0.6529	0.703	2.198
270.0	0.001691	-442.0	-1.2411	0.5906	0.657	2.244
274.06	0.001704	-432.8	-1.2075	0.5654	0.639	2.263
COEXISTING VAPOR (X=.0277)						
274.06	0.2463	-67.5	0.0847	0.0349	0.000609	1.600

VAPOR

COEXISTING LIQUID (X=.3002)						
279.05	0.001680	-450.7	-1.1888	0.5725	0.628	2.250
279.05	0.2468	-71.2	0.1031	0.0350	0.000597	1.620
280.0	0.2478	-69.6	0.1086	0.0352	0.000594	1.623
290.0	0.2581	-53.2	0.1662	0.0369	0.000567	1.664
300.0	0.2683	-36.3	0.2234	0.0386	0.000543	1.706
310.0	0.2783	-19.1	0.2800	0.0402	0.000521	1.749
320.0	0.2883	-1.4	0.3362	0.0418	0.000501	1.793
330.0	0.2983	16.8	0.3921	0.0434	0.000483	1.837
340.0	0.3081	35.4	0.4476	0.0450	0.000466	1.882
350.0	0.3180	54.4	0.5028	0.0465	0.000451	1.927
360.0	0.3278	73.9	0.5577	0.0480	0.000437	1.972
370.0	0.3375	93.9	0.6124	0.0496	0.000423	2.017
380.0	0.3472	114.3	0.6668	0.0511	0.000411	2.062
390.0	0.3569	135.1	0.7209	0.0526	0.000399	2.107
400.0	0.3665	156.4	0.7748	0.0541	0.000388	2.151
410.0	0.3762	178.1	0.8285	0.0556	0.000378	2.195
420.0	0.3858	200.3	0.8819	0.0571	0.000368	2.239
430.0	0.3954	222.9	0.9351	0.0586	0.000359	2.282
440.0	0.4049	246.0	0.9881	0.0600	0.000350	2.325
450.0	0.4145	269.4	1.0408	0.0615	0.000342	2.367
460.0	0.4240	293.3	1.0933	0.0630	0.000334	2.409
470.0	0.4336	317.6	1.1455	0.0644	0.000326	2.450
480.0	0.4431	342.3	1.1975	0.0659	0.000319	2.491
490.0	0.4526	367.4	1.2493	0.0673	0.000312	2.531
500.0	0.4621	392.9	1.3008	0.0688	0.000306	2.571
510.0	0.4716	418.8	1.3521	0.0702	0.000300	2.609
520.0	0.4811	445.1	1.4031	0.0717	0.000293	2.648
530.0	0.4905	471.7	1.4539	0.0731	0.000288	2.685
540.0	0.5000	498.8	1.5044	0.0746	0.000282	2.723
550.0	0.5095	526.1	1.5546	0.0760	0.000277	2.759
560.0	0.5189	553.9	1.6046	0.0775	0.000272	2.795
570.0	0.5284	582.0	1.6544	0.0789	0.000267	2.830
580.0	0.5378	610.5	1.7039	0.0803	0.000262	2.865
590.0	0.5472	639.3	1.7532	0.0818	0.000257	2.899
600.0	0.5567	668.4	1.8022	0.0832	0.000253	2.933



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.2 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001604	-507.1	-1.4965	0.7779	0.792	2.108
250.0	0.001631	-485.8	-1.4098	0.7167	0.748	2.155
260.0	0.001660	-464.1	-1.3248	0.6542	0.703	2.198
270.0	0.001691	-442.0	-1.2413	0.5918	0.658	2.244
280.0	0.001724	-419.3	-1.1588	0.5303	0.613	2.293
282.53	0.001732	-413.4	-1.1381	0.5150	0.601	2.307
COEXISTING VAPOR (X=.0298)						
282.53	0.18788	-56.3	0.0877	0.0350	0.000811	1.655

VAPOR

COEXISTING LIQUID (X=.2852)						
T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
287.37	0.001709	-429.5	-1.1193	0.5218	0.592	2.294
287.37	0.18818	-59.6	0.1060	0.0351	0.000795	1.673
290.0	0.19029	-55.2	0.1212	0.0356	0.000784	1.683
300.0	0.19820	-38.2	0.1790	0.0373	0.000747	1.722
310.0	0.2060	-20.7	0.2361	0.0391	0.000714	1.762
320.0	0.2137	-2.9	0.2927	0.0408	0.000684	1.804
330.0	0.2214	15.4	0.3489	0.0424	0.000658	1.847
340.0	0.2289	34.0	0.4047	0.0441	0.000634	1.891
350.0	0.2364	53.2	0.4602	0.0457	0.000612	1.935
360.0	0.2439	72.7	0.5153	0.0473	0.000592	1.979
370.0	0.2513	92.8	0.5701	0.0489	0.000573	2.023
380.0	0.2587	113.2	0.6247	0.0504	0.000555	2.068
390.0	0.2661	134.1	0.6790	0.0520	0.000539	2.112
400.0	0.2734	155.4	0.7330	0.0535	0.000524	2.156
410.0	0.2807	177.2	0.7868	0.0550	0.000509	2.200
420.0	0.2880	199.4	0.8403	0.0565	0.000496	2.243
430.0	0.2953	222.1	0.8936	0.0581	0.000483	2.286
440.0	0.3025	245.2	0.9466	0.0596	0.000471	2.329
450.0	0.3097	268.7	0.9994	0.0610	0.000460	2.371
460.0	0.3170	292.6	1.0520	0.0625	0.000449	2.412
470.0	0.3242	316.9	1.1043	0.0640	0.000438	2.453
480.0	0.3314	341.6	1.1564	0.0655	0.000429	2.494
490.0	0.3385	366.8	1.2082	0.0670	0.000419	2.534
500.0	0.3457	392.3	1.2597	0.0684	0.000410	2.573
510.0	0.3529	418.2	1.3110	0.0699	0.000402	2.612
520.0	0.3600	444.5	1.3621	0.0714	0.000394	2.650
530.0	0.3672	471.2	1.4129	0.0728	0.000386	2.687
540.0	0.3743	498.2	1.4635	0.0743	0.000378	2.724
550.0	0.3814	525.6	1.5137	0.0758	0.000371	2.761
560.0	0.3885	553.4	1.5638	0.0772	0.000364	2.797
570.0	0.3957	581.5	1.6136	0.0787	0.000357	2.832
580.0	0.4028	610.0	1.6631	0.0801	0.000351	2.867
590.0	0.4099	638.8	1.7124	0.0815	0.000345	2.901
600.0	0.4170	668.0	1.7614	0.0830	0.000339	2.935



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.3 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001604	-507.0	-1.4968	0.7808	0.794	2.108
250.0	0.001631	-485.7	-1.4101	0.7194	0.750	2.154
260.0	0.001660	-464.0	-1.3251	0.6568	0.705	2.198
270.0	0.001690	-441.9	-1.2416	0.5943	0.660	2.243
280.0	0.001723	-419.2	-1.1592	0.5327	0.614	2.293
290.0	0.001759	-395.9	-1.0777	0.4727	0.569	2.348
295.48	0.001780	-383.0	-1.0334	0.4407	0.544	2.381
COEXISTING VAPOR (X=.0330)						
295.48	0.12781	-39.1	0.0956	0.0347	0.001224	1.746

VAPOR

COEXISTING LIQUID (X=.2642)						
T	V	H	S	DP/DD	DP/DT	CP
300.10	0.001758	-396.6	-1.0147	0.4469	0.538	2.369
300.10	0.12796	-41.9	0.1136	0.0348	0.001201	1.763
310.0	0.13349	-24.3	0.1713	0.0368	0.001138	1.795
320.0	0.13895	-6.2	0.2289	0.0387	0.001082	1.832
330.0	0.14432	12.3	0.2859	0.0405	0.001034	1.871
340.0	0.14960	31.2	0.3424	0.0423	0.000991	1.911
350.0	0.15482	50.6	0.3984	0.0440	0.000953	1.952
360.0	0.15998	70.3	0.4540	0.0457	0.000918	1.995
370.0	0.16510	90.5	0.5092	0.0474	0.000886	2.037
380.0	0.17018	111.0	0.5641	0.0490	0.000857	2.080
390.0	0.17522	132.1	0.6187	0.0507	0.000830	2.123
400.0	0.18024	153.5	0.6730	0.0523	0.000805	2.166
410.0	0.18523	175.4	0.7270	0.0539	0.000781	2.209
420.0	0.19019	197.7	0.7807	0.0555	0.000759	2.252
430.0	0.19513	220.4	0.8342	0.0570	0.000739	2.294
440.0	0.2001	243.6	0.8874	0.0586	0.000719	2.336
450.0	0.2050	267.1	0.9404	0.0601	0.000701	2.377
460.0	0.2099	291.1	0.9931	0.0617	0.000684	2.418
470.0	0.2147	315.5	1.0455	0.0632	0.000668	2.459
480.0	0.2196	340.3	1.0977	0.0647	0.000652	2.499
490.0	0.2245	365.5	1.1496	0.0662	0.000637	2.539
500.0	0.2293	391.1	1.2013	0.0678	0.000623	2.578
510.0	0.2341	417.0	1.2527	0.0693	0.000610	2.616
520.0	0.2390	443.3	1.3038	0.0708	0.000597	2.654
530.0	0.2438	470.1	1.3547	0.0722	0.000585	2.691
540.0	0.2486	497.1	1.4053	0.0737	0.000573	2.728
550.0	0.2534	524.6	1.4557	0.0752	0.000562	2.764
560.0	0.2582	552.4	1.5058	0.0767	0.000551	2.800
570.0	0.2630	580.5	1.5557	0.0782	0.000541	2.835
580.0	0.2678	609.1	1.6053	0.0796	0.000531	2.870
590.0	0.2725	637.9	1.6546	0.0811	0.000521	2.904
600.0	0.2773	667.1	1.7037	0.0826	0.000512	2.937

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.4 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001604	-506.9	-1.4971	0.7836	0.796	2.108
250.0	0.001631	-485.6	-1.4103	0.7220	0.752	2.154
260.0	0.001659	-463.9	-1.3253	0.6593	0.707	2.197
270.0	0.001690	-441.8	-1.2419	0.5968	0.662	2.242
280.0	0.001723	-419.1	-1.1595	0.5351	0.616	2.292
290.0	0.001758	-395.9	-1.0781	0.4751	0.571	2.347
300.0	0.001797	-372.1	-0.9974	0.4170	0.526	2.408
305.49	0.001820	-358.7	-0.9534	0.3861	0.501	2.445
COEXISTING VAPOR (X=.0356)						
305.49	0.09689	-25.9	0.1039	0.0341	0.001656	1.824

VAPOR

COEXISTING LIQUID (X=.2493)						
T	V	H	S	DP/DD	DP/DT	CP
309.93	0.001799	-370.7	-0.9349	0.3917	0.496	2.434
309.93	0.09698	-28.4	0.1216	0.0342	0.001625	1.839
310.0	0.09701	-28.3	0.1220	0.0342	0.001624	1.839
320.0	0.10140	-9.7	0.1808	0.0364	0.001530	1.867
330.0	0.10567	9.1	0.2388	0.0384	0.001451	1.899
340.0	0.10984	28.3	0.2960	0.0404	0.001382	1.935
350.0	0.11394	47.8	0.3527	0.0423	0.001322	1.973
360.0	0.11797	67.7	0.4088	0.0441	0.001268	2.012
370.0	0.12194	88.1	0.4645	0.0459	0.001220	2.053
380.0	0.12588	108.8	0.5198	0.0477	0.001176	2.094
390.0	0.12977	129.9	0.5747	0.0494	0.001136	2.135
400.0	0.13363	151.5	0.6293	0.0511	0.001099	2.177
410.0	0.13746	173.5	0.6836	0.0527	0.001065	2.219
420.0	0.14127	195.9	0.7376	0.0544	0.001034	2.261
430.0	0.14506	218.7	0.7912	0.0560	0.001004	2.302
440.0	0.14882	241.9	0.8446	0.0576	0.000977	2.343
450.0	0.15257	265.6	0.8978	0.0592	0.000951	2.384
460.0	0.15630	289.6	0.9506	0.0608	0.000927	2.425
470.0	0.16002	314.1	1.0032	0.0624	0.000904	2.465
480.0	0.16372	338.9	1.0555	0.0640	0.000882	2.505
490.0	0.16741	364.2	1.1075	0.0655	0.000861	2.544
500.0	0.17109	389.8	1.1593	0.0671	0.000842	2.583
510.0	0.17476	415.8	1.2108	0.0686	0.000823	2.621
520.0	0.17843	442.2	1.2620	0.0701	0.000805	2.658
530.0	0.18208	468.9	1.3130	0.0716	0.000789	2.695
540.0	0.18573	496.0	1.3637	0.0732	0.000772	2.732
550.0	0.18936	523.5	1.4141	0.0747	0.000757	2.768
560.0	0.19300	551.4	1.4643	0.0762	0.000742	2.804
570.0	0.19662	579.6	1.5142	0.0777	0.000728	2.839
580.0	0.2002	608.1	1.5638	0.0792	0.000714	2.873
590.0	0.2039	637.0	1.6132	0.0807	0.000701	2.907
600.0	0.2075	666.2	1.6623	0.0822	0.000688	2.940

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.5 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001603	-506.8	-1.4973	0.7864	0.798	2.107
250.0	0.001630	-485.5	-1.4106	0.7247	0.754	2.153
260.0	0.001659	-463.8	-1.3256	0.6619	0.709	2.197
270.0	0.001689	-441.7	-1.2422	0.5992	0.663	2.242
280.0	0.001722	-419.0	-1.1599	0.5375	0.618	2.291
290.0	0.001757	-395.8	-1.0785	0.4775	0.572	2.346
300.0	0.001796	-372.0	-0.9978	0.4194	0.527	2.407
310.0	0.001839	-347.5	-0.9177	0.3635	0.483	2.475
313.77	0.001856	-338.1	-0.8876	0.3430	0.466	2.503
COEXISTING VAPOR (X=.0379)						
313.77	0.07793	-15.1	0.1118	0.0334	0.002106	1.895

VAPOR

COEXISTING LIQUID (X=.2378)						
318.05	0.001836	-348.8	-0.8695	0.3481	0.462	2.492
318.05	0.07799	-17.3	0.1292	0.0335	0.002068	1.908
320.0	0.07872	-13.6	0.1409	0.0340	0.002041	1.912
330.0	0.08237	5.6	0.2001	0.0363	0.001916	1.935
340.0	0.08590	25.1	0.2583	0.0384	0.001812	1.964
350.0	0.08934	44.9	0.3157	0.0405	0.001723	1.997
360.0	0.09270	65.1	0.3724	0.0425	0.001645	2.032
370.0	0.09601	85.6	0.4286	0.0444	0.001576	2.070
380.0	0.09926	106.5	0.4844	0.0462	0.001515	2.109
390.0	0.10247	127.8	0.5397	0.0480	0.001460	2.149
400.0	0.10564	149.5	0.5946	0.0498	0.001409	2.189
410.0	0.10879	171.6	0.6491	0.0516	0.001363	2.229
420.0	0.11190	194.1	0.7033	0.0533	0.001320	2.270
430.0	0.11500	217.0	0.7572	0.0550	0.001281	2.311
440.0	0.11807	240.3	0.8108	0.0567	0.001244	2.351
450.0	0.12112	264.0	0.8641	0.0583	0.001210	2.392
460.0	0.12416	288.1	0.9171	0.0599	0.001177	2.432
470.0	0.12718	312.6	0.9698	0.0616	0.001147	2.471
480.0	0.13019	337.5	1.0223	0.0632	0.001118	2.510
490.0	0.13318	362.8	1.0744	0.0648	0.001091	2.549
500.0	0.13617	388.5	1.1263	0.0664	0.001066	2.588
510.0	0.13914	414.6	1.1779	0.0679	0.001042	2.625
520.0	0.14211	441.0	1.2292	0.0695	0.001018	2.663
530.0	0.14506	467.8	1.2802	0.0711	0.000996	2.700
540.0	0.14801	495.0	1.3310	0.0726	0.000976	2.736
550.0	0.15095	522.5	1.3815	0.0741	0.000955	2.772
560.0	0.15388	550.4	1.4317	0.0757	0.000936	2.807
570.0	0.15681	578.6	1.4817	0.0772	0.000918	2.842
580.0	0.15973	607.2	1.5314	0.0787	0.000900	2.876
590.0	0.16265	636.1	1.5809	0.0803	0.000884	2.910
600.0	0.16556	665.3	1.6300	0.0818	0.000867	2.943



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.6 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001603	-506.7	-1.4976	0.7893	0.800	2.107
250.0	0.001630	-485.4	-1.4109	0.7274	0.756	2.153
260.0	0.001658	-463.7	-1.3259	0.6645	0.711	2.196
270.0	0.001689	-441.6	-1.2425	0.6017	0.665	2.241
280.0	0.001721	-419.0	-1.1602	0.5399	0.619	2.290
290.0	0.001757	-395.7	-1.0788	0.4798	0.574	2.345
300.0	0.001795	-371.9	-0.9982	0.4217	0.529	2.406
310.0	0.001838	-347.5	-0.9182	0.3658	0.484	2.474
320.0	0.001885	-322.3	-0.8384	0.3123	0.441	2.550
320.90	0.001890	-320.0	-0.8312	0.3076	0.437	2.557
COEXISTING VAPOR (X=.0399)						
320.90	0.06506	-6.0	0.1193	0.0326	0.002577	1.961

VAPOR

COEXISTING LIQUID (X=.2283)						
325.0	0.001870	-329.7	-0.8135	0.3122	0.433	2.546
325.0	0.06511	-7.9	0.1364	0.0327	0.002532	1.973
340.0	0.06986	21.8	0.2257	0.0364	0.002289	1.998
350.0	0.07288	41.9	0.2840	0.0386	0.002162	2.025
360.0	0.07581	62.3	0.3415	0.0408	0.002053	2.056
370.0	0.07868	83.0	0.3983	0.0428	0.001959	2.090
380.0	0.08149	104.1	0.4545	0.0448	0.001876	2.126
390.0	0.08425	125.6	0.5102	0.0467	0.001802	2.163
400.0	0.08697	147.4	0.5654	0.0486	0.001735	2.202
410.0	0.08966	169.6	0.6203	0.0504	0.001674	2.241
420.0	0.09231	192.2	0.6747	0.0522	0.001619	2.280
430.0	0.09495	215.2	0.7289	0.0539	0.001568	2.320
440.0	0.09756	238.6	0.7827	0.0557	0.001521	2.360
450.0	0.10015	262.4	0.8361	0.0574	0.001477	2.399
460.0	0.10272	286.6	0.8893	0.0591	0.001436	2.438
470.0	0.10528	311.2	0.9421	0.0607	0.001398	2.478
480.0	0.10783	336.1	0.9947	0.0624	0.001361	2.516
490.0	0.11036	361.5	1.0470	0.0640	0.001328	2.555
500.0	0.11288	387.2	1.0990	0.0657	0.001295	2.593
510.0	0.11539	413.3	1.1506	0.0673	0.001265	2.630
520.0	0.11789	439.8	1.2021	0.0689	0.001236	2.667
530.0	0.12038	466.7	1.2532	0.0705	0.001209	2.704
540.0	0.12287	493.9	1.3040	0.0720	0.001183	2.740
550.0	0.12534	521.4	1.3546	0.0736	0.001158	2.776
560.0	0.12781	549.3	1.4049	0.0752	0.001134	2.811
570.0	0.13027	577.6	1.4549	0.0767	0.001112	2.845
580.0	0.13273	606.2	1.5047	0.0783	0.001090	2.879
590.0	0.13518	635.2	1.5542	0.0798	0.001069	2.913
600.0	0.13762	664.4	1.6034	0.0814	0.001049	2.946



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=0.8 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001602	-506.5	-1.4981	0.7949	0.804	2.106
250.0	0.001629	-485.2	-1.4114	0.7327	0.760	2.152
260.0	0.001657	-463.6	-1.3265	0.6696	0.714	2.195
270.0	0.001688	-441.5	-1.2432	0.6066	0.668	2.240
280.0	0.001720	-418.8	-1.1609	0.5447	0.622	2.289
290.0	0.001755	-395.6	-1.0796	0.4845	0.577	2.343
300.0	0.001794	-371.8	-0.9991	0.4263	0.532	2.404
310.0	0.001836	-347.4	-0.9191	0.3704	0.488	2.471
320.0	0.001883	-322.3	-0.8394	0.3169	0.444	2.546
330.0	0.001936	-296.4	-0.7597	0.2657	0.401	2.632
332.85	0.001953	-288.8	-0.7369	0.2515	0.389	2.659
COEXISTING VAPOR (X=.0434)						
332.85	0.04867	9.1	0.1326	0.0308	0.003584	2.087

VAPOR

COEXISTING LIQUID (X=.2133)

336.75	0.001934	-296.8	-0.7199	0.2554	0.386	2.647
336.75	0.04870	7.5	0.1491	0.0310	0.003523	2.095
340.0	0.04957	14.3	0.1692	0.0319	0.003429	2.093
350.0	0.05213	35.3	0.2299	0.0346	0.003180	2.097
360.0	0.05458	56.3	0.2892	0.0372	0.002980	2.114
370.0	0.05692	77.6	0.3475	0.0395	0.002813	2.137
380.0	0.05920	99.1	0.4048	0.0418	0.002671	2.165
390.0	0.06141	120.9	0.4615	0.0439	0.002548	2.197
400.0	0.06358	143.1	0.5175	0.0460	0.002440	2.231
410.0	0.06570	165.5	0.5730	0.0480	0.002343	2.266
420.0	0.06780	188.4	0.6281	0.0499	0.002257	2.303
430.0	0.06986	211.6	0.6827	0.0518	0.002178	2.340
440.0	0.07190	235.2	0.7369	0.0537	0.002106	2.378
450.0	0.07392	259.2	0.7908	0.0555	0.002040	2.415
460.0	0.07592	283.5	0.8443	0.0573	0.001978	2.453
470.0	0.07790	308.2	0.8975	0.0591	0.001922	2.491
480.0	0.07987	333.3	0.9503	0.0608	0.001869	2.529
490.0	0.08182	358.8	1.0028	0.0626	0.001819	2.566
500.0	0.08377	384.7	1.0550	0.0643	0.001772	2.603
510.0	0.08570	410.9	1.1069	0.0659	0.001728	2.640
520.0	0.08762	437.4	1.1585	0.0676	0.001687	2.677
530.0	0.08953	464.4	1.2098	0.0693	0.001647	2.713
540.0	0.09143	491.7	1.2608	0.0709	0.001610	2.748
550.0	0.09333	519.3	1.3115	0.0725	0.001575	2.783
560.0	0.09521	547.3	1.3620	0.0742	0.001541	2.818
570.0	0.09710	575.6	1.4121	0.0758	0.001509	2.852
580.0	0.09897	604.3	1.4620	0.0774	0.001478	2.886
590.0	0.10084	633.3	1.5116	0.0790	0.001449	2.919
600.0	0.10270	662.7	1.5610	0.0806	0.001421	2.952

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=1.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001602	-506.3	-1.4986	0.8005	0.809	2.106
250.0	0.001628	-485.1	-1.4120	0.7380	0.764	2.151
260.0	0.001657	-463.4	-1.3271	0.6746	0.718	2.194
270.0	0.001687	-441.3	-1.2438	0.6115	0.672	2.239
280.0	0.001719	-418.6	-1.1616	0.5495	0.626	2.287
290.0	0.001754	-395.5	-1.0803	0.4892	0.580	2.341
300.0	0.001792	-371.7	-0.9999	0.4310	0.535	2.401
310.0	0.001834	-347.3	-0.9200	0.3750	0.491	2.468
320.0	0.001881	-322.2	-0.8404	0.3215	0.447	2.543
330.0	0.001933	-296.3	-0.7608	0.2704	0.404	2.627
340.0	0.001994	-269.5	-0.6809	0.2216	0.362	2.725
342.77	0.002012	-261.9	-0.6586	0.2084	0.350	2.756
COEXISTING VAPOR (X=.0465)						
342.77	0.03860	21.1	0.1440	0.0289	0.004683	2.208

VAPOR

COEXISTING LIQUID (X=.2015)						
346.45	0.001994	-268.7	-0.6424	0.2118	0.348	2.743
346.45	0.03863	19.9	0.1599	0.0291	0.004606	2.213
350.0	0.03945	27.7	0.1824	0.0303	0.004454	2.203
360.0	0.04167	49.7	0.2443	0.0333	0.004098	2.193
370.0	0.04375	71.7	0.3045	0.0361	0.003816	2.199
380.0	0.04573	93.7	0.3633	0.0386	0.003585	2.215
390.0	0.04764	116.0	0.4211	0.0410	0.003392	2.238
400.0	0.04949	138.5	0.4781	0.0433	0.003226	2.265
410.0	0.05129	161.3	0.5344	0.0455	0.003081	2.296
420.0	0.05305	184.4	0.5901	0.0477	0.002954	2.328
430.0	0.05478	207.9	0.6453	0.0497	0.002839	2.362
440.0	0.05649	231.7	0.7000	0.0517	0.002736	2.397
450.0	0.05817	255.8	0.7543	0.0536	0.002643	2.433
460.0	0.05982	280.4	0.8082	0.0556	0.002557	2.469
470.0	0.06146	305.2	0.8617	0.0574	0.002478	2.506
480.0	0.06309	330.5	0.9148	0.0593	0.002405	2.542
490.0	0.06470	356.1	0.9676	0.0611	0.002337	2.578
500.0	0.06629	382.0	1.0200	0.0629	0.002273	2.615
510.0	0.06788	408.4	1.0722	0.0646	0.002214	2.651
520.0	0.06945	435.0	1.1239	0.0664	0.002158	2.686
530.0	0.07101	462.1	1.1754	0.0681	0.002105	2.722
540.0	0.07257	489.4	1.2266	0.0698	0.002055	2.757
550.0	0.07412	517.2	1.2775	0.0715	0.002008	2.791
560.0	0.07566	545.2	1.3280	0.0732	0.001963	2.825
570.0	0.07719	573.6	1.3783	0.0748	0.001921	2.859
580.0	0.07872	602.4	1.4283	0.0765	0.001880	2.893
590.0	0.08024	631.5	1.4780	0.0781	0.001841	2.925
600.0	0.08175	660.9	1.5275	0.0798	0.001805	2.958

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=1.2 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001601	-506.1	-1.4991	0.8062	0.813	2.105
250.0	0.001628	-484.9	-1.4125	0.7433	0.767	2.151
260.0	0.001656	-463.2	-1.3277	0.6797	0.721	2.193
270.0	0.001686	-441.1	-1.2444	0.6164	0.675	2.237
280.0	0.001718	-418.5	-1.1622	0.5542	0.629	2.286
290.0	0.001753	-395.3	-1.0810	0.4938	0.583	2.340
300.0	0.001791	-371.6	-1.0006	0.4356	0.538	2.399
310.0	0.001832	-347.2	-0.9208	0.3796	0.494	2.465
320.0	0.001879	-322.2	-0.8414	0.3261	0.450	2.539
330.0	0.001931	-296.3	-0.7619	0.2750	0.407	2.622
340.0	0.001990	-269.6	-0.6822	0.2263	0.365	2.718
350.0	0.002060	-241.8	-0.6017	0.1798	0.323	2.834
351.33	0.002070	-238.0	-0.5908	0.1738	0.317	2.852
COEXISTING VAPOR (X=.0494)						
351.33	0.03176	31.1	0.1537	0.0270	0.005882	2.332

VAPOR

COEXISTING LIQUID (X=.1918)						
354.80	0.002053	-243.8	-0.5755	0.1766	0.316	2.838
354.80	0.03178	30.1	0.1690	0.0272	0.005789	2.333
360.0	0.03288	42.2	0.2028	0.0290	0.005485	2.306
370.0	0.03483	65.1	0.2656	0.0323	0.005015	2.282
380.0	0.03666	87.9	0.3264	0.0353	0.004649	2.278
390.0	0.03839	110.7	0.3857	0.0380	0.004354	2.288
400.0	0.04004	133.7	0.4438	0.0406	0.004106	2.306
410.0	0.04164	156.9	0.5011	0.0430	0.003899	2.330
420.0	0.04319	180.3	0.5575	0.0453	0.003718	2.357
430.0	0.04471	204.0	0.6134	0.0475	0.003558	2.387
440.0	0.04619	228.1	0.6686	0.0497	0.003417	2.419
450.0	0.04765	252.4	0.7234	0.0517	0.003289	2.453
460.0	0.04908	277.1	0.7776	0.0538	0.003174	2.487
470.0	0.05049	302.2	0.8315	0.0557	0.003069	2.521
480.0	0.05189	327.6	0.8849	0.0577	0.002972	2.556
490.0	0.05327	353.3	0.9380	0.0596	0.002882	2.591
500.0	0.05464	379.4	0.9907	0.0615	0.002799	2.627
510.0	0.05599	405.8	1.0430	0.0633	0.002722	2.662
520.0	0.05734	432.6	1.0950	0.0651	0.002649	2.696
530.0	0.05867	459.7	1.1467	0.0669	0.002582	2.731
540.0	0.05999	487.2	1.1980	0.0687	0.002518	2.765
550.0	0.06131	515.0	1.2491	0.0704	0.002457	2.799
560.0	0.06262	543.1	1.2998	0.0722	0.002400	2.833
570.0	0.06392	571.6	1.3502	0.0739	0.002346	2.866
580.0	0.06521	600.4	1.4003	0.0756	0.002295	2.899
590.0	0.06650	629.6	1.4502	0.0773	0.002246	2.932
600.0	0.06779	659.1	1.4997	0.0790	0.002200	2.964



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=1.4 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001601	-505.9	-1.4997	0.8117	0.817	2.104
250.0	0.001627	-484.7	-1.4131	0.7486	0.771	2.150
260.0	0.001655	-463.0	-1.3283	0.6847	0.725	2.192
270.0	0.001685	-441.0	-1.2450	0.6212	0.678	2.236
280.0	0.001717	-418.3	-1.1629	0.5589	0.632	2.284
290.0	0.001752	-395.2	-1.0817	0.4985	0.586	2.338
300.0	0.001789	-371.5	-1.0014	0.4401	0.541	2.397
310.0	0.001831	-347.1	-0.9217	0.3842	0.497	2.463
320.0	0.001876	-322.1	-0.8423	0.3306	0.453	2.535
330.0	0.001928	-296.3	-0.7630	0.2796	0.411	2.617
340.0	0.001986	-269.6	-0.6834	0.2310	0.368	2.711
350.0	0.002055	-241.9	-0.6032	0.1847	0.326	2.824
358.91	0.002128	-216.2	-0.5306	0.1451	0.289	2.952
COEXISTING VAPOR (X=.0520)						
358.91	0.02679	39.5	0.1620	0.0250	0.007190	2.461

VAPOR

COEXISTING LIQUID (X=.1834)						
362.18	0.002112	-221.2	-0.5160	0.1476	0.288	2.937
362.18	0.02681	38.7	0.1767	0.0252	0.007080	2.459
370.0	0.02832	57.7	0.2285	0.0283	0.006486	2.398
380.0	0.03008	81.4	0.2920	0.0318	0.005909	2.362
390.0	0.03171	105.0	0.3532	0.0349	0.005463	2.352
400.0	0.03324	128.5	0.4127	0.0377	0.005106	2.356
410.0	0.03471	152.2	0.4711	0.0404	0.004810	2.370
420.0	0.03612	176.0	0.5285	0.0429	0.004559	2.391
430.0	0.03749	200.0	0.5850	0.0453	0.004342	2.416
440.0	0.03882	224.3	0.6409	0.0476	0.004152	2.444
450.0	0.04012	248.9	0.6961	0.0498	0.003984	2.474
460.0	0.04139	273.8	0.7509	0.0520	0.003833	2.506
470.0	0.04265	299.0	0.8051	0.0541	0.003696	2.538
480.0	0.04388	324.6	0.8589	0.0561	0.003572	2.571
490.0	0.04510	350.5	0.9123	0.0581	0.003457	2.605
500.0	0.04631	376.7	0.9652	0.0601	0.003352	2.639
510.0	0.04750	403.3	1.0178	0.0620	0.003254	2.673
520.0	0.04868	430.1	1.0700	0.0639	0.003163	2.707
530.0	0.04985	457.4	1.1219	0.0657	0.003078	2.741
540.0	0.05101	484.9	1.1734	0.0676	0.002999	2.775
550.0	0.05216	512.8	1.2246	0.0694	0.002924	2.808
560.0	0.05330	541.1	1.2754	0.0712	0.002853	2.841
570.0	0.05444	569.6	1.3260	0.0730	0.002787	2.874
580.0	0.05557	598.5	1.3762	0.0747	0.002723	2.906
590.0	0.05669	627.7	1.4262	0.0764	0.002664	2.938
600.0	0.05781	657.3	1.4758	0.0782	0.002607	2.970



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=1.6 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001600	-505.7	-1.5002	0.8173	0.821	2.104
250.0	0.001626	-484.5	-1.4136	0.7539	0.775	2.149
260.0	0.001654	-462.8	-1.3289	0.6897	0.728	2.191
270.0	0.001684	-440.8	-1.2457	0.6261	0.681	2.235
280.0	0.001716	-418.2	-1.1636	0.5636	0.635	2.283
290.0	0.001750	-395.0	-1.0825	0.5031	0.589	2.336
300.0	0.001788	-371.3	-1.0022	0.4447	0.544	2.395
310.0	0.001829	-347.0	-0.9226	0.3887	0.500	2.460
320.0	0.001874	-322.0	-0.8433	0.3352	0.456	2.532
330.0	0.001925	-296.3	-0.7641	0.2842	0.414	2.612
340.0	0.001983	-269.6	-0.6847	0.2357	0.372	2.705
350.0	0.002051	-242.0	-0.6047	0.1895	0.330	2.815
360.0	0.002132	-213.2	-0.5234	0.1454	0.288	2.955
365.72	0.002188	-195.9	-0.4759	0.1209	0.264	3.059
COEXISTING VAPOR (X=.0546)						
365.72	0.02300	46.6	0.1690	0.0230	0.008621	2.601

VAPOR

COEXISTING LIQUID (X=.1760)						
368.81	0.002172	-200.2	-0.4621	0.1231	0.263	3.042
368.81	0.02303	45.9	0.1830	0.0232	0.008494	2.595
370.0	0.02325	49.0	0.1913	0.0237	0.008358	2.577
380.0	0.02503	74.2	0.2586	0.0279	0.007432	2.478
390.0	0.02662	98.8	0.3223	0.0315	0.006761	2.433
400.0	0.02809	123.0	0.3837	0.0348	0.006244	2.418
410.0	0.02947	147.2	0.4434	0.0377	0.005831	2.419
420.0	0.03079	171.5	0.5018	0.0405	0.005488	2.430
430.0	0.03205	195.9	0.5592	0.0431	0.005199	2.449
440.0	0.03327	220.5	0.6158	0.0455	0.004949	2.471
450.0	0.03446	245.3	0.6716	0.0479	0.004731	2.498
460.0	0.03562	270.4	0.7268	0.0502	0.004537	2.526
470.0	0.03676	295.9	0.7815	0.0524	0.004363	2.556
480.0	0.03787	321.6	0.8356	0.0545	0.004206	2.588
490.0	0.03897	347.6	0.8893	0.0566	0.004063	2.620
500.0	0.04006	374.0	0.9425	0.0587	0.003932	2.652
510.0	0.04113	400.7	0.9954	0.0607	0.003812	2.685
520.0	0.04219	427.7	1.0478	0.0626	0.003700	2.718
530.0	0.04323	455.0	1.0999	0.0646	0.003596	2.751
540.0	0.04427	482.6	1.1516	0.0665	0.003499	2.784
550.0	0.04530	510.6	1.2029	0.0683	0.003408	2.817
560.0	0.04632	539.0	1.2540	0.0702	0.003322	2.849
570.0	0.04733	567.6	1.3047	0.0720	0.003242	2.881
580.0	0.04834	596.6	1.3550	0.0738	0.003166	2.913
590.0	0.04934	625.8	1.4051	0.0756	0.003094	2.945
600.0	0.05033	655.4	1.4548	0.0774	0.003025	2.977

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=1.8 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001599	-505.5	-1.5007	0.8228	0.825	2.103
250.0	0.001626	-484.3	-1.4142	0.7591	0.778	2.148
260.0	0.001653	-462.7	-1.3294	0.6947	0.732	2.190
270.0	0.001683	-440.6	-1.2463	0.6309	0.685	2.234
280.0	0.001715	-418.0	-1.1642	0.5683	0.638	2.282
290.0	0.001749	-394.9	-1.0832	0.5077	0.592	2.334
300.0	0.001786	-371.2	-1.0030	0.4492	0.547	2.393
310.0	0.001827	-346.9	-0.9234	0.3932	0.503	2.457
320.0	0.001872	-322.0	-0.8442	0.3397	0.459	2.528
330.0	0.001923	-296.2	-0.7652	0.2887	0.417	2.608
340.0	0.001980	-269.7	-0.6859	0.2403	0.375	2.698
350.0	0.002046	-242.1	-0.6061	0.1942	0.334	2.805
360.0	0.002126	-213.4	-0.5252	0.1503	0.292	2.940
370.0	0.002226	-183.0	-0.4421	0.1083	0.250	3.129
371.95	0.002249	-176.9	-0.4255	0.1003	0.242	3.177
COEXISTING VAPOR (X=.0571)						
371.95	0.02001	52.6	0.1746	0.0210	0.010190	2.757

VAPOR

COEXISTING LIQUID (X=.1693)						
374.85	0.002234	-180.6	-0.4125	0.1021	0.241	3.158
374.85	0.02003	52.1	0.1880	0.0212	0.010045	2.747
380.0	0.02096	66.0	0.2247	0.0237	0.009335	2.649
390.0	0.02258	91.9	0.2920	0.0280	0.008306	2.544
400.0	0.02402	117.1	0.3558	0.0316	0.007559	2.496
410.0	0.02536	141.9	0.4172	0.0349	0.006984	2.478
420.0	0.02661	166.7	0.4769	0.0380	0.006521	2.476
430.0	0.02780	191.5	0.5352	0.0408	0.006139	2.486
440.0	0.02894	216.5	0.5926	0.0434	0.005814	2.502
450.0	0.03005	241.6	0.6490	0.0459	0.005535	2.524
460.0	0.03112	267.0	0.7048	0.0484	0.005290	2.549
470.0	0.03217	292.6	0.7599	0.0507	0.005073	2.576
480.0	0.03319	318.5	0.8144	0.0529	0.004878	2.605
490.0	0.03420	344.7	0.8685	0.0551	0.004702	2.635
500.0	0.03519	371.2	0.9220	0.0573	0.004542	2.666
510.0	0.03617	398.0	0.9751	0.0594	0.004396	2.698
520.0	0.03713	425.1	1.0278	0.0614	0.004260	2.730
530.0	0.03809	452.6	1.0800	0.0634	0.004135	2.762
540.0	0.03903	480.4	1.1319	0.0654	0.004019	2.794
550.0	0.03996	508.4	1.1835	0.0673	0.003910	2.826
560.0	0.04088	536.8	1.2346	0.0692	0.003808	2.858
570.0	0.04180	565.6	1.2855	0.0711	0.003712	2.889
580.0	0.04271	594.6	1.3360	0.0730	0.003622	2.921
590.0	0.04361	624.0	1.3862	0.0748	0.003537	2.952
600.0	0.04451	653.6	1.4360	0.0766	0.003457	2.983

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=2.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001599	-505.3	-1.5012	0.8283	0.829	2.102
250.0	0.001625	-484.1	-1.4147	0.7643	0.782	2.147
260.0	0.001653	-462.5	-1.3300	0.6997	0.735	2.189
270.0	0.001682	-440.4	-1.2469	0.6357	0.688	2.233
280.0	0.001714	-417.9	-1.1649	0.5730	0.641	2.280
290.0	0.001748	-394.8	-1.0839	0.5122	0.595	2.333
300.0	0.001785	-371.1	-1.0038	0.4537	0.550	2.391
310.0	0.001826	-346.8	-0.9243	0.3976	0.506	2.455
320.0	0.001870	-321.9	-0.8452	0.3441	0.462	2.525
330.0	0.001920	-296.2	-0.7662	0.2932	0.420	2.603
340.0	0.001977	-269.7	-0.6871	0.2448	0.378	2.692
350.0	0.002042	-242.2	-0.6075	0.1989	0.337	2.797
360.0	0.002120	-213.6	-0.5269	0.1552	0.296	2.926
370.0	0.002217	-183.4	-0.4444	0.1135	0.254	3.104
377.68	0.002314	-158.8	-0.3785	0.0824	0.221	3.313
COEXISTING VAPOR (X=.0595)						
377.68	0.017572	57.6	0.1790	0.0190	0.011917	2.936

VAPOR

COEXISTING LIQUID (X=.1632)						
380.41	0.002299	-162.0	-0.3663	0.0840	0.221	3.289
380.41	0.017592	57.3	0.1917	0.0192	0.011754	2.921
390.0	0.019240	84.1	0.2613	0.0241	0.010197	2.701
400.0	0.02071	110.5	0.3283	0.0283	0.009101	2.598
410.0	0.02202	136.3	0.3918	0.0320	0.008298	2.550
420.0	0.02323	161.7	0.4530	0.0354	0.007676	2.531
430.0	0.02437	187.0	0.5125	0.0384	0.007174	2.529
440.0	0.02546	212.3	0.5708	0.0413	0.006757	2.538
450.0	0.02650	237.8	0.6280	0.0440	0.006403	2.553
460.0	0.02751	263.4	0.6843	0.0465	0.006097	2.574
470.0	0.02849	289.3	0.7399	0.0490	0.005828	2.597
480.0	0.02945	315.4	0.7949	0.0514	0.005590	2.624
490.0	0.03038	341.7	0.8493	0.0536	0.005376	2.652
500.0	0.03130	368.4	0.9031	0.0559	0.005183	2.681
510.0	0.03220	395.4	0.9565	0.0580	0.005007	2.711
520.0	0.03309	422.6	1.0094	0.0602	0.004845	2.742
530.0	0.03397	450.2	1.0619	0.0622	0.004697	2.773
540.0	0.03483	478.0	1.1140	0.0643	0.004559	2.804
550.0	0.03569	506.2	1.1657	0.0663	0.004430	2.835
560.0	0.03654	534.7	1.2170	0.0683	0.004311	2.866
570.0	0.03738	563.5	1.2680	0.0702	0.004198	2.897
580.0	0.03821	592.6	1.3187	0.0721	0.004093	2.928
590.0	0.03904	622.1	1.3690	0.0740	0.003994	2.959
600.0	0.03986	651.8	1.4190	0.0759	0.003900	2.990



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=2.2 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001598	-505.1	-1.5017	0.8338	0.833	2.102
250.0	0.001624	-483.9	-1.4153	0.7695	0.786	2.147
260.0	0.001652	-462.3	-1.3306	0.7046	0.738	2.188
270.0	0.001681	-440.3	-1.2475	0.6404	0.691	2.232
280.0	0.001713	-417.7	-1.1655	0.5776	0.644	2.279
290.0	0.001747	-394.6	-1.0846	0.5168	0.598	2.331
300.0	0.001784	-371.0	-1.0046	0.4582	0.553	2.389
310.0	0.001824	-346.7	-0.9251	0.4021	0.509	2.452
320.0	0.001868	-321.8	-0.8461	0.3486	0.465	2.522
330.0	0.001918	-296.2	-0.7673	0.2977	0.423	2.599
340.0	0.001973	-269.7	-0.6883	0.2494	0.381	2.687
350.0	0.002038	-242.3	-0.6089	0.2035	0.340	2.788
360.0	0.002114	-213.8	-0.5286	0.1600	0.300	2.913
370.0	0.002209	-183.8	-0.4465	0.1185	0.259	3.081
380.0	0.002334	-151.7	-0.3610	0.0787	0.216	3.349
383.01	0.002383	-141.4	-0.3341	0.0669	0.202	3.473
COEXISTING VAPOR (X=.0620)						
383.01	0.015538	61.7	0.1820	0.0169	0.013832	3.149

VAPOR

COEXISTING LIQUID (X=.1574)						
385.55	0.002369	-144.2	-0.3227	0.0683	0.202	3.445
385.55	0.015558	61.5	0.1940	0.0171	0.013651	3.127
390.0	0.016365	75.0	0.2288	0.0198	0.012604	2.947
400.0	0.017913	103.2	0.3004	0.0248	0.010947	2.737
410.0	0.019243	130.1	0.3668	0.0290	0.009816	2.642
420.0	0.02044	156.3	0.4299	0.0327	0.008976	2.597
430.0	0.02155	182.2	0.4907	0.0360	0.008320	2.580
440.0	0.02260	208.0	0.5500	0.0391	0.007786	2.578
450.0	0.02359	233.8	0.6080	0.0420	0.007341	2.586
460.0	0.02455	259.7	0.6650	0.0447	0.006962	2.601
470.0	0.02547	285.8	0.7212	0.0473	0.006633	2.621
480.0	0.02637	312.2	0.7766	0.0498	0.006344	2.644
490.0	0.02725	338.7	0.8314	0.0522	0.006087	2.669
500.0	0.02811	365.6	0.8856	0.0545	0.005856	2.697
510.0	0.02895	392.7	0.9392	0.0567	0.005647	2.725
520.0	0.02978	420.0	0.9924	0.0589	0.005456	2.754
530.0	0.03060	447.7	1.0451	0.0611	0.005281	2.784
540.0	0.03140	475.7	1.0974	0.0632	0.005120	2.814
550.0	0.03220	504.0	1.1493	0.0653	0.004970	2.845
560.0	0.03298	532.6	1.2008	0.0673	0.004831	2.875
570.0	0.03376	561.5	1.2520	0.0693	0.004701	2.906
580.0	0.03453	590.7	1.3027	0.0713	0.004579	2.936
590.0	0.03529	620.2	1.3532	0.0732	0.004464	2.966
600.0	0.03605	650.0	1.4033	0.0751	0.004356	2.996



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=2.4 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001597	-504.9	-1.5022	0.8393	0.837	2.101
250.0	0.001624	-483.7	-1.4158	0.7746	0.789	2.146
260.0	0.001651	-462.1	-1.3312	0.7096	0.742	2.187
270.0	0.001680	-440.1	-1.2481	0.6452	0.694	2.231
280.0	0.001712	-417.5	-1.1662	0.5823	0.647	2.278
290.0	0.001746	-394.5	-1.0853	0.5213	0.601	2.329
300.0	0.001782	-370.8	-1.0053	0.4626	0.556	2.387
310.0	0.001822	-346.6	-0.9260	0.4065	0.512	2.450
320.0	0.001866	-321.7	-0.8471	0.3530	0.468	2.519
330.0	0.001915	-296.1	-0.7683	0.3021	0.426	2.595
340.0	0.001970	-269.7	-0.6895	0.2539	0.385	2.681
350.0	0.002034	-242.4	-0.6103	0.2081	0.344	2.780
360.0	0.002109	-213.9	-0.5303	0.1647	0.303	2.901
370.0	0.002200	-184.1	-0.4486	0.1235	0.263	3.060
380.0	0.002321	-152.3	-0.3639	0.0841	0.221	3.304
387.99	0.002458	-124.6	-0.2917	0.0534	0.185	3.670
COEXISTING VAPOR (X=.0595)						
387.99	0.013804	64.9	0.1836	0.0148	0.015971	3.412

VAPOR

COEXISTING LIQUID (X=.1519)						
390.35	0.002444	-127.0	-0.2812	0.0545	0.185	3.637
390.35	0.013825	64.8	0.1950	0.0150	0.015771	3.382
400.0	0.015487	94.9	0.2713	0.0210	0.013223	2.942
410.0	0.016873	123.4	0.3415	0.0258	0.011595	2.763
420.0	0.018080	150.5	0.4070	0.0299	0.010455	2.679
430.0	0.019176	177.1	0.4695	0.0336	0.009595	2.639
440.0	0.02019	203.4	0.5300	0.0369	0.008915	2.623
450.0	0.02116	229.7	0.5890	0.0400	0.008359	2.622
460.0	0.02207	255.9	0.6467	0.0428	0.007892	2.631
470.0	0.02296	282.3	0.7034	0.0456	0.007492	2.646
480.0	0.02381	308.9	0.7593	0.0482	0.007144	2.665
490.0	0.02464	335.7	0.8145	0.0507	0.006837	2.688
500.0	0.02545	362.7	0.8691	0.0531	0.006563	2.713
510.0	0.02624	389.9	0.9231	0.0555	0.006317	2.740
520.0	0.02702	417.4	0.9765	0.0577	0.006094	2.767
530.0	0.02779	445.3	1.0295	0.0600	0.005890	2.796
540.0	0.02854	473.3	1.0820	0.0621	0.005702	2.825
550.0	0.02928	501.7	1.1341	0.0643	0.005529	2.855
560.0	0.03002	530.4	1.1857	0.0664	0.005368	2.884
570.0	0.03074	559.4	1.2370	0.0684	0.005219	2.914
580.0	0.03146	588.7	1.2880	0.0704	0.005079	2.944
590.0	0.03217	618.3	1.3385	0.0724	0.004948	2.974
600.0	0.03288	648.1	1.3887	0.0744	0.004825	3.003

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=2.6 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001597	-504.7	-1.5027	0.8447	0.841	2.101
250.0	0.001623	-483.5	-1.4163	0.7798	0.793	2.145
260.0	0.001650	-461.9	-1.3317	0.7145	0.745	2.187
270.0	0.001680	-439.9	-1.2487	0.6499	0.697	2.230
280.0	0.001711	-417.4	-1.1668	0.5869	0.650	2.276
290.0	0.001745	-394.3	-1.0860	0.5258	0.604	2.328
300.0	0.001781	-370.7	-1.0061	0.4671	0.559	2.385
310.0	0.001821	-346.5	-0.9268	0.4109	0.514	2.447
320.0	0.001864	-321.7	-0.8480	0.3574	0.471	2.516
330.0	0.001913	-296.1	-0.7694	0.3066	0.429	2.591
340.0	0.001967	-269.7	-0.6907	0.2583	0.388	2.676
350.0	0.002030	-242.4	-0.6117	0.2127	0.347	2.773
360.0	0.002103	-214.1	-0.5319	0.1694	0.307	2.890
370.0	0.002193	-184.4	-0.4507	0.1285	0.267	3.041
380.0	0.002309	-152.9	-0.3667	0.0894	0.226	3.265
390.0	0.002478	-118.3	-0.2769	0.0517	0.181	3.702
392.68	0.002541	-108.1	-0.2508	0.0416	0.168	3.926
COEXISTING VAPOR (X=.0671)						
392.68	0.012296	67.1	0.1837	0.0128	0.018390	3.753

VAPOR

COEXISTING LIQUID (X=.1466)						
394.85	0.002528	-110.2	-0.2412	0.0426	0.168	3.885
394.85	0.012318	67.1	0.1943	0.0130	0.018169	3.712
400.0	0.013296	85.0	0.2393	0.0167	0.016167	3.281
410.0	0.014800	115.8	0.3154	0.0224	0.013725	2.931
420.0	0.016043	144.3	0.3840	0.0270	0.012155	2.783
430.0	0.017141	171.8	0.4486	0.0311	0.011025	2.711
440.0	0.018145	198.7	0.5105	0.0346	0.010159	2.677
450.0	0.019082	225.4	0.5705	0.0379	0.009465	2.664
460.0	0.019970	252.0	0.6291	0.0410	0.008893	2.664
470.0	0.02082	278.7	0.6865	0.0439	0.008409	2.674
480.0	0.02164	305.5	0.7429	0.0466	0.007993	2.689
490.0	0.02243	332.5	0.7986	0.0492	0.007629	2.708
500.0	0.02320	359.7	0.8535	0.0517	0.007307	2.731
510.0	0.02395	387.2	0.9078	0.0542	0.007019	2.755
520.0	0.02469	414.8	0.9615	0.0565	0.006759	2.781
530.0	0.02541	442.8	1.0147	0.0588	0.006523	2.808
540.0	0.02612	471.0	1.0675	0.0611	0.006307	2.836
550.0	0.02682	499.5	1.1198	0.0633	0.006108	2.865
560.0	0.02751	528.2	1.1716	0.0654	0.005924	2.894
570.0	0.02819	557.3	1.2231	0.0675	0.005754	2.923
580.0	0.02887	586.7	1.2741	0.0696	0.005595	2.952
590.0	0.02953	616.3	1.3248	0.0716	0.005446	2.981
600.0	0.03020	646.3	1.3752	0.0736	0.005307	3.010

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=2.8 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001596	-504.5	-1.5032	0.8502	0.845	2.100
250.0	0.001622	-483.3	-1.4169	0.7849	0.796	2.144
260.0	0.001650	-461.8	-1.3323	0.7194	0.748	2.186
270.0	0.001679	-439.8	-1.2493	0.6547	0.700	2.228
280.0	0.001710	-417.2	-1.1675	0.5914	0.653	2.275
290.0	0.001743	-394.2	-1.0867	0.5303	0.607	2.326
300.0	0.001780	-370.6	-1.0068	0.4715	0.562	2.383
310.0	0.001819	-346.4	-0.9276	0.4153	0.517	2.445
320.0	0.001862	-321.6	-0.8489	0.3618	0.474	2.513
330.0	0.001910	-296.0	-0.7704	0.3109	0.432	2.587
340.0	0.001964	-269.7	-0.6919	0.2628	0.391	2.670
350.0	0.002026	-242.5	-0.6130	0.2172	0.350	2.765
360.0	0.002098	-214.3	-0.5335	0.1741	0.310	2.879
370.0	0.002185	-184.7	-0.4526	0.1333	0.271	3.023
380.0	0.002297	-153.5	-0.3693	0.0946	0.230	3.231
390.0	0.002455	-119.4	-0.2810	0.0574	0.187	3.607
397.09	0.002636	-91.8	-0.2108	0.0313	0.152	4.278
COEXISTING VAPOR (X=.0698)						
397.09	0.01095	68.4	0.1818	0.0107	0.021164	4.220

VAPOR

COEXISTING LIQUID (X=.1413)						
399.07	0.00262	-93.6	-0.2022	0.0321	0.153	4.225
399.07	0.01098	68.4	0.1917	0.0108	0.020923	4.163
400.0	0.01119	72.2	0.2012	0.0117	0.020343	3.991
410.0	0.01293	107.1	0.2875	0.0187	0.016357	3.180
420.0	0.01425	137.5	0.3606	0.0240	0.014139	2.918
430.0	0.01537	166.0	0.4277	0.0285	0.012642	2.799
440.0	0.01637	193.7	0.4913	0.0324	0.011535	2.739
450.0	0.01729	220.9	0.5526	0.0359	0.010672	2.711
460.0	0.01815	248.0	0.6120	0.0391	0.009973	2.702
470.0	0.01898	275.0	0.6702	0.0422	0.009390	2.704
480.0	0.01976	302.1	0.7272	0.0450	0.008895	2.714
490.0	0.02053	329.4	0.7833	0.0478	0.008465	2.730
500.0	0.02127	356.8	0.8387	0.0504	0.008088	2.749
510.0	0.02198	384.3	0.8933	0.0529	0.007754	2.771
520.0	0.02269	412.2	0.9473	0.0554	0.007454	2.796
530.0	0.02337	440.2	1.0008	0.0577	0.007182	2.821
540.0	0.02405	468.6	1.0538	0.0600	0.006935	2.848
550.0	0.02471	497.2	1.1062	0.0623	0.006708	2.875
560.0	0.02536	526.1	1.1583	0.0645	0.006499	2.903
570.0	0.02601	555.2	1.2099	0.0667	0.006306	2.932
580.0	0.02664	584.7	1.2611	0.0688	0.006126	2.960
590.0	0.02727	614.4	1.3120	0.0709	0.005959	2.989
600.0	0.02790	644.4	1.3624	0.0729	0.005802	3.017



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=3.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001596	-504.3	-1.5037	0.8556	0.848	2.099
250.0	0.001621	-483.2	-1.4174	0.7900	0.800	2.144
260.0	0.001649	-461.6	-1.3329	0.7243	0.751	2.185
270.0	0.001678	-439.6	-1.2499	0.6594	0.703	2.227
280.0	0.001709	-417.1	-1.1681	0.5960	0.656	2.274
290.0	0.001742	-394.0	-1.0874	0.5347	0.610	2.325
300.0	0.001778	-370.5	-1.0076	0.4759	0.564	2.381
310.0	0.001817	-346.3	-0.9285	0.4197	0.520	2.442
320.0	0.001860	-321.5	-0.8498	0.3661	0.477	2.510
330.0	0.001908	-296.0	-0.7714	0.3153	0.435	2.583
340.0	0.001961	-269.7	-0.6930	0.2672	0.394	2.665
350.0	0.002022	-242.6	-0.6143	0.2217	0.353	2.758
360.0	0.002093	-214.4	-0.5351	0.1787	0.314	2.868
370.0	0.002178	-185.0	-0.4546	0.1381	0.274	3.007
380.0	0.002286	-154.0	-0.3719	0.0996	0.235	3.200
390.0	0.002435	-120.4	-0.2848	0.0630	0.193	3.530
400.0	0.002693	-81.4	-0.1861	0.0271	0.145	4.482
401.28	0.002748	-75.4	-0.1712	0.0224	0.137	4.803
COEXISTING VAPOR (X=.0728)						
401.28	0.00974	68.3	0.1776	0.0085	0.024422	4.913

VAPOR

COEXISTING LIQUID (X=.1360)						
403.04	0.00273	-76.9	-0.1635	0.0231	0.137	4.731
403.04	0.00976	68.4	0.1866	0.0087	0.024155	4.828
410.0	0.01119	96.8	0.2563	0.0147	0.019776	3.599
420.0	0.01264	129.9	0.3361	0.0209	0.016502	3.104
430.0	0.01380	159.8	0.4066	0.0258	0.014487	2.908
440.0	0.01481	188.4	0.4722	0.0300	0.013068	2.813
450.0	0.01573	216.3	0.5349	0.0338	0.011993	2.765
460.0	0.01658	243.8	0.5954	0.0372	0.011140	2.743
470.0	0.01738	271.2	0.6543	0.0405	0.010441	2.737
480.0	0.01814	298.6	0.7120	0.0435	0.009853	2.742
490.0	0.01888	326.1	0.7687	0.0463	0.009349	2.753
500.0	0.01959	353.7	0.8244	0.0490	0.008910	2.769
510.0	0.02026	381.5	0.8794	0.0517	0.008523	2.788
520.0	0.02095	409.5	0.9338	0.0542	0.008178	2.811
530.0	0.02161	437.7	0.9875	0.0566	0.007868	2.835
540.0	0.02225	466.2	1.0407	0.0590	0.007586	2.860
550.0	0.02288	494.9	1.0934	0.0613	0.007329	2.886
560.0	0.02350	523.9	1.1457	0.0636	0.007093	2.913
570.0	0.02411	553.1	1.1974	0.0658	0.006876	2.941
580.0	0.02472	582.7	1.2488	0.0680	0.006674	2.968
590.0	0.02532	612.5	1.2998	0.0701	0.006486	2.996
600.0	0.02591	642.6	1.3504	0.0722	0.006310	3.024



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=3.2 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001595	-504.1	-1.5042	0.8610	0.852	2.099
250.0	0.001621	-483.0	-1.4179	0.7951	0.803	2.143
260.0	0.001648	-461.4	-1.3334	0.7291	0.755	2.184
270.0	0.001677	-439.4	-1.2505	0.6640	0.707	2.226
280.0	0.001708	-416.9	-1.1688	0.6006	0.659	2.272
290.0	0.001741	-393.9	-1.0881	0.5392	0.613	2.323
300.0	0.001777	-370.3	-1.0083	0.4803	0.567	2.379
310.0	0.001816	-346.2	-0.9293	0.4240	0.523	2.440
320.0	0.001858	-321.4	-0.8507	0.3704	0.480	2.507
330.0	0.001906	-295.9	-0.7724	0.3196	0.438	2.580
340.0	0.001958	-269.7	-0.6941	0.2716	0.397	2.660
350.0	0.002018	-242.6	-0.6156	0.2261	0.356	2.752
360.0	0.002088	-214.5	-0.5366	0.1832	0.317	2.859
370.0	0.002172	-185.3	-0.4564	0.1428	0.278	2.991
380.0	0.002276	-154.4	-0.3743	0.1046	0.239	3.172
390.0	0.002417	-121.3	-0.2883	0.0684	0.198	3.466
400.0	0.002646	-83.7	-0.1931	0.0336	0.153	4.178
405.26	0.002885	-58.6	-0.1310	0.0148	0.122	5.686
COEXISTING VAPOR (X=.0761)						
405.26	0.008613	66.7	0.1701	0.0064	0.028370	6.058

VAPOR

COEXISTING LIQUID (X=.1305)						
406.79	0.002872	-59.9	-0.1245	0.0153	0.122	5.573
406.79	0.008636	66.9	0.1782	0.0066	0.028078	5.922
410.0	0.009473	83.2	0.2182	0.0100	0.024658	4.499
420.0	0.011170	121.2	0.3097	0.0175	0.019395	3.376
430.0	0.012402	153.1	0.3848	0.0230	0.016621	3.049
440.0	0.013435	182.8	0.4531	0.0277	0.014785	2.902
450.0	0.014352	211.4	0.5174	0.0317	0.013444	2.828
460.0	0.015194	239.5	0.5791	0.0354	0.012405	2.790
470.0	0.015980	267.3	0.6389	0.0387	0.011568	2.774
480.0	0.016725	295.1	0.6973	0.0419	0.010873	2.771
490.0	0.017437	322.8	0.7545	0.0449	0.010284	2.777
500.0	0.018122	350.6	0.8107	0.0477	0.009775	2.790
510.0	0.018766	378.6	0.8661	0.0504	0.009330	2.807
520.0	0.019431	406.8	0.9208	0.0530	0.008935	2.826
530.0	0.02006	435.1	0.9748	0.0556	0.008582	2.849
540.0	0.02068	463.7	1.0283	0.0580	0.008263	2.872
550.0	0.02128	492.6	1.0812	0.0604	0.007973	2.898
560.0	0.02187	521.7	1.1336	0.0627	0.007707	2.923
570.0	0.02246	551.0	1.1856	0.0650	0.007463	2.950
580.0	0.02303	580.7	1.2371	0.0672	0.007237	2.977
590.0	0.02360	610.6	1.2882	0.0694	0.007028	3.004
600.0	0.02416	640.7	1.3390	0.0715	0.006832	3.032

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=3.4 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001594	-503.9	-1.5047	0.8663	0.856	2.098
250.0	0.001620	-482.8	-1.4185	0.8002	0.807	2.142
260.0	0.001647	-461.2	-1.3340	0.7340	0.758	2.183
270.0	0.001676	-439.2	-1.2511	0.6687	0.710	2.225
280.0	0.001707	-416.7	-1.1694	0.6051	0.662	2.271
290.0	0.001740	-393.7	-1.0888	0.5436	0.615	2.322
300.0	0.001776	-370.2	-1.0091	0.4846	0.570	2.377
310.0	0.001814	-346.1	-0.9301	0.4283	0.526	2.438
320.0	0.001857	-321.3	-0.8516	0.3747	0.482	2.504
330.0	0.001903	-295.9	-0.7734	0.3239	0.440	2.576
340.0	0.001956	-269.7	-0.6952	0.2759	0.399	2.656
350.0	0.002015	-242.7	-0.6169	0.2305	0.360	2.745
360.0	0.002083	-214.6	-0.5381	0.1878	0.320	2.849
370.0	0.002165	-185.5	-0.4582	0.1475	0.282	2.977
380.0	0.002266	-154.9	-0.3766	0.1095	0.243	3.147
390.0	0.002401	-122.1	-0.2916	0.0737	0.203	3.412
400.0	0.002607	-85.5	-0.1991	0.0396	0.160	3.978
409.06	0.003070	-40.7	-0.0884	0.0085	0.107	7.491
COEXISTING VAPOR (X=.0801)						
409.06	0.007510	62.7	0.1576	0.0043	0.033444	8.331

VAPOR

COEXISTING LIQUID (X=.1244)						
410.31	0.003055	-41.7	-0.0833	0.0089	0.107	7.282
410.31	0.007536	63.0	0.1646	0.0045	0.033119	8.073
420.0	0.009776	110.9	0.2802	0.0139	0.023091	3.816
430.0	0.011124	145.7	0.3620	0.0202	0.019129	3.237
440.0	0.012195	176.8	0.4336	0.0253	0.016726	3.011
450.0	0.013123	206.3	0.4999	0.0296	0.015046	2.901
460.0	0.013961	235.0	0.5630	0.0335	0.013779	2.843
470.0	0.014737	263.3	0.6238	0.0370	0.012778	2.815
480.0	0.015466	291.4	0.6830	0.0403	0.011960	2.804
490.0	0.016160	319.4	0.7408	0.0434	0.011273	2.804
500.0	0.016826	347.5	0.7975	0.0464	0.010685	2.812
510.0	0.017468	375.7	0.8533	0.0492	0.010175	2.826
520.0	0.018091	404.0	0.9083	0.0519	0.009725	2.843
530.0	0.018697	432.6	0.9626	0.0545	0.009324	2.863
540.0	0.019289	461.3	1.0163	0.0570	0.008964	2.885
550.0	0.019869	490.2	1.0695	0.0595	0.008638	2.909
560.0	0.02044	519.5	1.1221	0.0619	0.008341	2.934
570.0	0.02100	548.9	1.1743	0.0642	0.008069	2.960
580.0	0.02155	578.6	1.2259	0.0665	0.007817	2.986
590.0	0.02209	608.6	1.2772	0.0687	0.007585	3.012
600.0	0.02263	638.9	1.3281	0.0709	0.007368	3.039

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

LIQUID, P=3.6 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001594	-503.7	-1.5053	0.8717	0.860	2.097
250.0	0.001619	-482.6	-1.4190	0.8053	0.810	2.141
260.0	0.001647	-461.0	-1.3345	0.7388	0.761	2.182
270.0	0.001675	-439.1	-1.2517	0.6734	0.713	2.224
280.0	0.001706	-416.6	-1.1701	0.6096	0.665	2.270
290.0	0.001739	-393.6	-1.0895	0.5480	0.618	2.320
300.0	0.001774	-370.1	-1.0098	0.4890	0.573	2.375
310.0	0.001813	-346.0	-0.9309	0.4326	0.528	2.436
320.0	0.001855	-321.2	-0.8525	0.3790	0.485	2.501
330.0	0.001901	-295.8	-0.7744	0.3282	0.443	2.572
340.0	0.001953	-269.7	-0.6963	0.2802	0.402	2.651
350.0	0.002011	-242.7	-0.6182	0.2349	0.363	2.739
360.0	0.002079	-214.8	-0.5396	0.1922	0.324	2.840
370.0	0.002159	-185.7	-0.4600	0.1521	0.285	2.963
380.0	0.002257	-155.3	-0.3789	0.1143	0.247	3.124
390.0	0.002385	-122.8	-0.2947	0.0788	0.208	3.365
400.0	0.002576	-87.1	-0.2043	0.0453	0.166	3.833
410.0	0.002986	-41.7	-0.0923	0.0130	0.114	6.001
412.70	0.003362	-19.7	-0.0390	0.0036	0.090197	13.005
COEXISTING VAPOR (X=.0855)						
412.70	0.006345	54.1	0.1353	0.0022	0.040796	14.813

VAPOR

COEXISTING LIQUID (X=.1168)						
413.59	0.003347	-20.6	-0.0357	0.0038	0.090553	12.452
413.59	0.006371	54.5	0.1408	0.0023	0.040439	14.142
420.0	0.008393	97.9	0.2450	0.0100	0.028165	4.660
430.0	0.009941	137.3	0.3377	0.0173	0.022137	3.499
440.0	0.011071	170.3	0.4136	0.0228	0.018938	3.147
450.0	0.012018	200.9	0.4823	0.0275	0.016822	2.986
460.0	0.012858	230.3	0.5470	0.0316	0.015277	2.903
470.0	0.013627	259.1	0.6089	0.0354	0.014081	2.859
480.0	0.014345	287.6	0.6689	0.0388	0.013118	2.839
490.0	0.015024	316.0	0.7274	0.0420	0.012320	2.833
500.0	0.015673	344.3	0.7846	0.0451	0.011643	2.836
510.0	0.016296	372.7	0.8409	0.0480	0.011060	2.846
520.0	0.016900	401.3	0.8962	0.0508	0.010549	2.860
530.0	0.017486	429.9	0.9509	0.0535	0.010097	2.878
540.0	0.018057	458.8	1.0049	0.0560	0.009692	2.899
550.0	0.018616	487.9	1.0582	0.0586	0.009327	2.921
560.0	0.019163	517.2	1.1111	0.0610	0.008996	2.945
570.0	0.019701	546.8	1.1634	0.0634	0.008693	2.969
580.0	0.02023	576.6	1.2152	0.0657	0.008414	2.995
590.0	0.02075	606.7	1.2667	0.0680	0.008157	3.021
600.0	0.02126	637.0	1.3176	0.0702	0.007918	3.047



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=3.8 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001593	-503.5	-1.5058	0.8770	0.864	2.097
250.0	0.001619	-482.4	-1.4195	0.8103	0.814	2.141
260.0	0.001646	-460.8	-1.3351	0.7436	0.764	2.181
270.0	0.001674	-438.9	-1.2523	0.6780	0.716	2.223
280.0	0.001705	-416.4	-1.1707	0.6141	0.668	2.269
290.0	0.001738	-393.4	-1.0902	0.5524	0.621	2.319
300.0	0.001773	-369.9	-1.0106	0.4933	0.575	2.374
310.0	0.001811	-345.9	-0.9317	0.4369	0.531	2.433
320.0	0.001853	-321.2	-0.8534	0.3833	0.488	2.498
330.0	0.001899	-295.8	-0.7753	0.3325	0.446	2.569
340.0	0.001950	-269.7	-0.6974	0.2845	0.405	2.647
350.0	0.002008	-242.7	-0.6194	0.2392	0.366	2.733
360.0	0.002074	-214.9	-0.5410	0.1966	0.327	2.832
370.0	0.002153	-185.9	-0.4617	0.1566	0.289	2.951
380.0	0.002248	-155.6	-0.3810	0.1190	0.251	3.103
385.0	0.002305	-139.8	-0.3398	0.1011	0.232	3.202
390.0	0.002372	-123.5	-0.2976	0.0838	0.212	3.324
395.0	0.002450	-106.5	-0.2542	0.0670	0.1928	3.487
400.0	0.002548	-88.4	-0.2089	0.0508	0.1723	3.722
405.0	0.002678	-68.9	-0.1603	0.0350	0.1503	4.117
410.0	0.002879	-46.4	-0.1051	0.0197	0.1254	5.004
415.0	0.003383	-12.8	-0.0240	0.0045	0.0898	10.873
420.0	0.006883	79.2	0.1968	0.0057	0.0363	6.979
425.0	0.008027	106.7	0.2619	0.0105	0.0295	4.606
430.0	0.008824	127.7	0.3110	0.0142	0.0258	3.885
435.0	0.009475	146.2	0.3537	0.0175	0.0234	3.530
440.0	0.010040	163.3	0.3928	0.0203	0.0215	3.319
445.0	0.010548	179.5	0.4295	0.0230	0.0200	3.182
450.0	0.011016	195.2	0.4645	0.0254	0.01880	3.088
460.0	0.011863	225.4	0.5310	0.0298	0.01691	2.971
470.0	0.012630	254.8	0.5942	0.0337	0.01549	2.909
480.0	0.013339	283.8	0.6551	0.0373	0.01435	2.877
490.0	0.014006	312.5	0.7143	0.0406	0.01343	2.863
500.0	0.014640	341.1	0.7721	0.0438	0.01265	2.861
510.0	0.015248	369.7	0.8288	0.0468	0.01199	2.867
520.0	0.015834	398.4	0.8846	0.0497	0.01141	2.878
530.0	0.016402	427.3	0.9395	0.0524	0.01090	2.894
540.0	0.016955	456.3	0.9938	0.0551	0.01045	2.913
550.0	0.017495	485.6	1.0474	0.0577	0.01004	2.933
560.0	0.018023	515.0	1.1004	0.0602	0.00967	2.956
570.0	0.018541	544.7	1.1530	0.0626	0.00934	2.979
580.0	0.019050	574.6	1.2050	0.0650	0.00903	3.004
590.0	0.019551	604.7	1.2565	0.0673	0.00874	3.029
600.0	0.02004	635.1	1.3077	0.0696	0.00848	3.055



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=4.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT KJ/(KG.K)	CP KJ/(KG.K)
240.0	0.001593	-503.3	-1.5063	0.8823	0.867	2.096
250.0	0.001618	-482.2	-1.4200	0.8153	0.817	2.140
260.0	0.001645	-460.7	-1.3357	0.7484	0.767	2.180
270.0	0.001674	-438.7	-1.2529	0.6826	0.719	2.222
280.0	0.001704	-416.3	-1.1713	0.6186	0.671	2.268
290.0	0.001737	-393.3	-1.0908	0.5568	0.624	2.317
300.0	0.001772	-369.8	-1.0113	0.4976	0.578	2.372
310.0	0.001810	-345.7	-0.9325	0.4412	0.534	2.431
320.0	0.001851	-321.1	-0.8542	0.3875	0.490	2.496
330.0	0.001897	-295.7	-0.7763	0.3367	0.449	2.566
340.0	0.001947	-269.6	-0.6985	0.2888	0.408	2.642
350.0	0.002005	-242.8	-0.6207	0.2436	0.368	2.727
360.0	0.002070	-215.0	-0.5424	0.2010	0.330	2.824
370.0	0.002147	-186.1	-0.4634	0.1611	0.292	2.939
380.0	0.002240	-156.0	-0.3831	0.1237	0.255	3.084
385.0	0.002295	-140.3	-0.3422	0.1059	0.236	3.176
390.0	0.002358	-124.1	-0.3004	0.0887	0.217	3.288
395.0	0.002433	-107.3	-0.2576	0.0721	0.1976	3.433
400.0	0.002524	-89.6	-0.2131	0.0561	0.1778	3.634
405.0	0.002641	-70.7	-0.1661	0.0406	0.1569	3.944
410.0	0.002807	-49.6	-0.1144	0.0257	0.1341	4.529
415.0	0.003104	-23.5	-0.0512	0.0116	0.1067	6.258
* 420.0	0.004710	38.9	0.0981	0.0017	0.0572	20.830
425.0	0.006757	90.4	0.2201	0.0069	0.0368	6.167
430.0	0.007743	116.3	0.2806	0.0112	0.0306	4.500
435.0	0.008475	137.1	0.3286	0.0148	0.0270	3.873
440.0	0.009084	155.5	0.3709	0.0179	0.0245	3.543
445.0	0.009618	172.7	0.4097	0.0207	0.0226	3.343
450.0	0.010100	189.1	0.4463	0.0233	0.0210	3.209
460.0	0.010961	220.3	0.5150	0.0279	0.01871	3.050
470.0	0.011728	250.4	0.5796	0.0320	0.01700	2.965
480.0	0.012431	279.8	0.6415	0.0358	0.01568	2.919
490.0	0.013089	308.9	0.7014	0.0393	0.01460	2.896
500.0	0.013710	337.8	0.7599	0.0426	0.01371	2.888
510.0	0.014304	366.7	0.8170	0.0457	0.01296	2.889
520.0	0.014875	395.6	0.8732	0.0486	0.01231	2.897
530.0	0.015428	424.6	0.9285	0.0514	0.01174	2.911
540.0	0.015964	453.8	0.9830	0.0542	0.01123	2.927
550.0	0.016487	483.2	1.0369	0.0568	0.01078	2.946
560.0	0.016998	512.7	1.0902	0.0594	0.01037	2.967
570.0	0.017498	542.5	1.1429	0.0618	0.01000	2.990
580.0	0.017989	572.5	1.1951	0.0643	0.00966	3.013
590.0	0.018472	602.8	1.2468	0.0666	0.00935	3.038
600.0	0.018948	633.3	1.2980	0.0690	0.00906	3.063

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=4.2 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001592	-503.1	-1.5068	0.8876	0.871	2.096
250.0	0.001618	-482.0	-1.4206	0.8203	0.821	2.139
260.0	0.001644	-460.5	-1.3362	0.7532	0.771	2.180
270.0	0.001673	-438.5	-1.2535	0.6872	0.721	2.221
280.0	0.001703	-416.1	-1.1720	0.6231	0.673	2.266
290.0	0.001736	-393.1	-1.0915	0.5612	0.626	2.316
300.0	0.001770	-369.7	-1.0120	0.5019	0.581	2.370
310.0	0.001808	-345.6	-0.9333	0.4454	0.536	2.429
320.0	0.001849	-321.0	-0.8551	0.3917	0.493	2.493
330.0	0.001895	-295.7	-0.7773	0.3410	0.451	2.562
340.0	0.001945	-269.6	-0.6996	0.2930	0.411	2.638
350.0	0.002001	-242.8	-0.6219	0.2478	0.371	2.721
360.0	0.002066	-215.1	-0.5438	0.2054	0.333	2.816
370.0	0.002141	-186.3	-0.4651	0.1656	0.295	2.927
380.0	0.002232	-156.3	-0.3852	0.1283	0.258	3.066
385.0	0.002285	-140.7	-0.3445	0.1106	0.240	3.152
390.0	0.002346	-124.7	-0.3031	0.0935	0.221	3.256
395.0	0.002417	-108.1	-0.2608	0.0771	0.202	3.387
400.0	0.002502	-90.7	-0.2170	0.0612	0.1829	3.561
405.0	0.002609	-72.2	-0.1712	0.0460	0.1629	3.815
410.0	0.002752	-52.1	-0.1219	0.0314	0.1416	4.242
415.0	0.002975	-28.9	-0.0656	0.0177	0.1177	5.172
* 420.0	0.003481	4.0	0.0130	0.0058	0.0867	8.993
425.0	0.005338	66.0	0.1599	0.0038	0.0491	10.019
430.0	0.006667	102.2	0.2444	0.0082	0.0371	5.561
435.0	0.007521	126.6	0.3008	0.0121	0.0315	4.372
440.0	0.008189	147.0	0.3475	0.0154	0.0280	3.841
445.0	0.008756	165.4	0.3891	0.0185	0.0255	3.543
450.0	0.009258	182.6	0.4276	0.0212	0.0235	3.356
460.0	0.010137	215.0	0.4988	0.0261	0.0207	3.139
470.0	0.010908	245.8	0.5650	0.0304	0.01864	3.027
480.0	0.011608	275.7	0.6280	0.0343	0.01709	2.965
490.0	0.012257	305.2	0.6888	0.0379	0.01585	2.931
500.0	0.012869	334.5	0.7479	0.0413	0.01483	2.916
510.0	0.013451	363.6	0.8056	0.0445	0.01398	2.913
520.0	0.014009	392.7	0.8621	0.0476	0.01324	2.917
530.0	0.014547	422.0	0.9178	0.0505	0.01260	2.928
540.0	0.015068	451.3	0.9726	0.0533	0.01204	2.942
550.0	0.015576	480.8	1.0268	0.0560	0.01154	2.959
560.0	0.016071	510.5	1.0802	0.0586	0.01109	2.979
570.0	0.016556	540.4	1.1331	0.0611	0.01068	3.000
580.0	0.017031	570.5	1.1855	0.0636	0.01031	3.023
590.0	0.017498	600.8	1.2374	0.0660	0.00997	3.046
600.0	0.017957	631.4	1.2888	0.0684	0.00965	3.071

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=4.4 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001592	-502.9	-1.5072	0.8929	0.875	2.095
250.0	0.001617	-481.8	-1.4211	0.8253	0.824	2.139
260.0	0.001644	-460.3	-1.3368	0.7580	0.774	2.179
270.0	0.001672	-438.4	-1.2541	0.6918	0.724	2.220
280.0	0.001702	-415.9	-1.1726	0.6275	0.676	2.265
290.0	0.001734	-393.0	-1.0922	0.5655	0.629	2.315
300.0	0.001769	-369.5	-1.0128	0.5062	0.583	2.368
310.0	0.001807	-345.5	-0.9341	0.4496	0.539	2.427
320.0	0.001848	-320.9	-0.8560	0.3959	0.496	2.491
330.0	0.001893	-295.6	-0.7782	0.3451	0.454	2.559
340.0	0.001942	-269.6	-0.7006	0.2972	0.414	2.634
350.0	0.001998	-242.8	-0.6231	0.2521	0.374	2.716
360.0	0.002062	-215.1	-0.5452	0.2097	0.336	2.809
370.0	0.002136	-186.5	-0.4667	0.1700	0.299	2.917
380.0	0.002224	-156.6	-0.3872	0.1328	0.262	3.049
385.0	0.002276	-141.1	-0.3467	0.1152	0.243	3.131
390.0	0.002335	-125.2	-0.3057	0.0983	0.225	3.227
395.0	0.002402	-108.8	-0.2638	0.0819	0.207	3.346
400.0	0.002482	-91.6	-0.2207	0.0662	0.1878	3.500
405.0	0.002581	-73.6	-0.1759	0.0512	0.1685	3.714
410.0	0.002708	-54.2	-0.1283	0.0369	0.1483	4.045
415.0	0.002891	-32.6	-0.0759	0.0234	0.1264	4.653
420.0	0.003209	-6.0	-0.0123	0.0115	0.1011	6.196
425.0	0.004076	36.0	0.0870	0.0039	0.0688	10.886
430.0	0.005581	84.1	0.1995	0.0058	0.0463	7.332
435.0	0.006599	114.2	0.2693	0.0096	0.0372	5.108
440.0	0.007344	137.4	0.3221	0.0131	0.0322	4.239
445.0	0.007953	157.4	0.3674	0.0163	0.0289	3.797
450.0	0.008479	175.7	0.4082	0.0192	0.0264	3.533
460.0	0.009382	209.4	0.4824	0.0243	0.0229	3.243
470.0	0.010159	241.0	0.5504	0.0288	0.0204	3.095
480.0	0.010858	271.6	0.6147	0.0329	0.01860	3.014
490.0	0.011501	301.5	0.6763	0.0366	0.01717	2.969
500.0	0.012104	331.1	0.7361	0.0401	0.01601	2.946
510.0	0.012675	360.5	0.7943	0.0434	0.01504	2.937
520.0	0.013221	389.9	0.8513	0.0465	0.01422	2.938
530.0	0.013747	419.3	0.9074	0.0495	0.01351	2.945
540.0	0.014255	448.8	0.9625	0.0524	0.01288	2.957
550.0	0.014749	478.4	1.0169	0.0551	0.01233	2.973
560.0	0.015230	508.2	1.0706	0.0578	0.01183	2.991
570.0	0.015700	538.2	1.1237	0.0604	0.01138	3.011
580.0	0.016161	568.4	1.1763	0.0629	0.01098	3.033
590.0	0.016613	598.9	1.2283	0.0654	0.01060	3.055
600.0	0.017057	629.5	1.2798	0.0678	0.01026	3.079



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=4.6 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001591	-502.8	-1.5077	0.8981	0.878	2.095
250.0	0.001616	-481.6	-1.4216	0.8303	0.827	2.138
260.0	0.001643	-460.1	-1.3373	0.7627	0.777	2.178
270.0	0.001671	-438.2	-1.2547	0.6964	0.727	2.219
280.0	0.001701	-415.8	-1.1732	0.6319	0.679	2.264
290.0	0.001733	-392.8	-1.0929	0.5699	0.632	2.313
300.0	0.001768	-369.4	-1.0135	0.5105	0.586	2.367
310.0	0.001805	-345.4	-0.9349	0.4538	0.541	2.425
320.0	0.001846	-320.8	-0.8568	0.4001	0.498	2.488
330.0	0.001890	-295.5	-0.7792	0.3493	0.457	2.556
340.0	0.001940	-269.6	-0.7017	0.3014	0.416	2.630
350.0	0.001995	-242.8	-0.6242	0.2563	0.377	2.711
360.0	0.002058	-215.2	-0.5466	0.2140	0.339	2.801
370.0	0.002130	-186.6	-0.4683	0.1743	0.302	2.906
380.0	0.002217	-156.9	-0.3891	0.1373	0.265	3.034
385.0	0.002267	-141.5	-0.3489	0.1198	0.247	3.111
390.0	0.002324	-125.7	-0.3081	0.1029	0.229	3.201
395.0	0.002389	-109.4	-0.2666	0.0867	0.211	3.310
400.0	0.002465	-92.5	-0.2241	0.0711	0.1925	3.448
405.0	0.002556	-74.8	-0.1801	0.0562	0.1738	3.632
410.0	0.002671	-55.9	-0.1339	0.0421	0.1544	3.899
415.0	0.002828	-35.4	-0.0841	0.0289	0.1339	4.339
420.0	0.003067	-11.7	-0.0273	0.0169	0.1114	5.220
425.0	0.003538	19.3	0.0460	0.0076	0.0853	7.458
430.0	0.004591	62.9	0.1479	0.0050	0.0590	8.728
435.0	0.005713	99.8	0.2332	0.0076	0.0447	6.103
440.0	0.006544	126.5	0.2944	0.0110	0.0374	4.764
445.0	0.007201	148.6	0.3442	0.0143	0.0328	4.114
450.0	0.007756	168.2	0.3880	0.0173	0.0296	3.747
460.0	0.008686	203.5	0.4657	0.0226	0.0253	3.361
470.0	0.009473	236.1	0.5357	0.0273	0.0223	3.171
480.0	0.010171	267.3	0.6014	0.0315	0.0202	3.068
490.0	0.010810	297.7	0.6640	0.0354	0.01857	3.010
500.0	0.011406	327.6	0.7245	0.0390	0.01725	2.978
510.0	0.011967	357.3	0.7833	0.0423	0.01616	2.963
520.0	0.012503	386.9	0.8408	0.0455	0.01524	2.960
530.0	0.013017	416.5	0.8972	0.0486	0.01445	2.964
540.0	0.013513	446.2	0.9526	0.0515	0.01375	2.973
550.0	0.013994	476.0	1.0073	0.0543	0.01314	2.987
560.0	0.014463	505.9	1.0612	0.0571	0.01260	3.003
570.0	0.014920	536.1	1.1146	0.0597	0.01211	3.022
580.0	0.015367	566.4	1.1673	0.0623	0.01166	3.042
590.0	0.015806	596.9	1.2195	0.0648	0.01125	3.064
600.0	0.016237	627.7	1.2712	0.0672	0.01088	3.087



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=4.8 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001590	-502.6	-1.5082	0.9034	0.882	2.094
250.0	0.001616	-481.4	-1.4221	0.8352	0.830	2.137
260.0	0.001642	-459.9	-1.3379	0.7674	0.780	2.177
270.0	0.001670	-438.0	-1.2553	0.7009	0.730	2.218
280.0	0.001700	-415.6	-1.1738	0.6364	0.682	2.263
290.0	0.001732	-392.7	-1.0935	0.5742	0.634	2.312
300.0	0.001767	-369.3	-1.0142	0.5147	0.589	2.365
310.0	0.001804	-345.3	-0.9356	0.4580	0.544	2.423
320.0	0.001844	-320.7	-0.8577	0.4043	0.501	2.486
330.0	0.001888	-295.5	-0.7801	0.3535	0.459	2.553
340.0	0.001937	-269.5	-0.7027	0.3056	0.419	2.626
350.0	0.001992	-242.8	-0.6254	0.2605	0.380	2.706
360.0	0.002054	-215.3	-0.5479	0.2182	0.342	2.795
370.0	0.002125	-186.8	-0.4699	0.1787	0.305	2.897
380.0	0.002210	-157.2	-0.3910	0.1418	0.269	3.019
385.0	0.002259	-141.9	-0.3510	0.1243	0.251	3.092
390.0	0.002314	-126.2	-0.3105	0.1075	0.233	3.177
395.0	0.002376	-110.0	-0.2693	0.0913	0.215	3.278
400.0	0.002448	-93.3	-0.2273	0.0759	0.1969	3.402
405.0	0.002534	-75.9	-0.1840	0.0611	0.1787	3.564
410.0	0.002640	-57.5	-0.1389	0.0471	0.1600	3.787
415.0	0.002777	-37.7	-0.0910	0.0341	0.1406	4.126
420.0	0.002973	-15.7	-0.0382	0.0222	0.1199	4.714
425.0	0.003296	10.7	0.0240	0.0122	0.0971	5.912
430.0	0.003934	45.3	0.1050	0.0065	0.0727	7.797
435.0	0.004915	83.8	0.1940	0.0067	0.0540	6.986
440.0	0.005796	114.5	0.2642	0.0094	0.0436	5.389
445.0	0.006500	139.0	0.3196	0.0125	0.0375	4.498
450.0	0.007084	160.2	0.3669	0.0155	0.0333	4.000
460.0	0.008044	197.4	0.4486	0.0210	0.0279	3.495
470.0	0.008841	231.0	0.5210	0.0258	0.0244	3.256
480.0	0.009542	262.9	0.5881	0.0302	0.0219	3.127
490.0	0.010177	293.8	0.6518	0.0341	0.0201	3.054
500.0	0.010766	324.1	0.7130	0.0378	0.01856	3.012
510.0	0.011320	354.1	0.7724	0.0413	0.01733	2.991
520.0	0.011846	384.0	0.8304	0.0446	0.01630	2.982
530.0	0.012349	413.8	0.8872	0.0477	0.01542	2.983
540.0	0.012834	443.6	0.9430	0.0507	0.01466	2.989
550.0	0.013304	473.6	0.9979	0.0536	0.01398	3.001
560.0	0.013761	503.7	1.0521	0.0563	0.01339	3.016
570.0	0.014206	533.9	1.1056	0.0590	0.01285	3.033
580.0	0.014641	564.3	1.1586	0.0617	0.01236	3.052
590.0	0.015067	594.9	1.2109	0.0642	0.01192	3.073
600.0	0.015486	625.8	1.2627	0.0667	0.01152	3.095

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=5.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001590	-502.4	-1.5087	0.9086	0.886	2.093
250.0	0.001615	-481.2	-1.4227	0.8402	0.834	2.137
260.0	0.001642	-459.7	-1.3384	0.7721	0.783	2.176
270.0	0.001670	-437.8	-1.2558	0.7055	0.733	2.217
280.0	0.001699	-415.4	-1.1744	0.6408	0.684	2.262
290.0	0.001731	-392.5	-1.0942	0.5785	0.637	2.310
300.0	0.001766	-369.1	-1.0149	0.5189	0.591	2.364
310.0	0.001802	-345.2	-0.9364	0.4622	0.547	2.421
320.0	0.001843	-320.6	-0.8585	0.4084	0.504	2.483
330.0	0.001886	-295.4	-0.7810	0.3576	0.462	2.550
340.0	0.001935	-269.5	-0.7038	0.3097	0.422	2.622
350.0	0.001989	-242.8	-0.6266	0.2647	0.383	2.701
360.0	0.002050	-215.3	-0.5492	0.2224	0.345	2.788
370.0	0.002120	-186.9	-0.4714	0.1830	0.308	2.887
380.0	0.002203	-157.4	-0.3928	0.1461	0.272	3.006
385.0	0.002251	-142.2	-0.3530	0.1287	0.254	3.075
390.0	0.002304	-126.6	-0.3128	0.1120	0.237	3.155
395.0	0.002364	-110.6	-0.2719	0.0959	0.219	3.249
400.0	0.002433	-94.0	-0.2303	0.0806	0.201	3.362
405.0	0.002514	-76.8	-0.1876	0.0659	0.1834	3.506
410.0	0.002612	-58.8	-0.1434	0.0520	0.1653	3.696
415.0	0.002735	-39.6	-0.0970	0.0391	0.1466	3.969
420.0	0.002902	-18.7	-0.0469	0.0272	0.1272	4.398
425.0	0.003151	5.1	0.0093	0.0170	0.1065	5.153
430.0	0.003576	34.0	0.0770	0.0097	0.0846	6.437
435.0	0.004293	68.8	0.1573	0.0072	0.0646	7.049
440.0	0.005126	101.7	0.2326	0.0085	0.0511	5.952
445.0	0.005852	128.7	0.2937	0.0111	0.0429	4.920
450.0	0.006462	151.6	0.3449	0.0140	0.0376	4.288
460.0	0.007451	190.9	0.4312	0.0195	0.0308	3.646
470.0	0.008259	225.7	0.5061	0.0244	0.0267	3.348
480.0	0.008962	258.4	0.5749	0.0289	0.0238	3.190
490.0	0.009595	289.8	0.6397	0.0330	0.0216	3.100
500.0	0.010178	320.6	0.7017	0.0368	0.01994	3.048
510.0	0.010724	350.9	0.7618	0.0403	0.01856	3.019
520.0	0.011242	381.0	0.8202	0.0437	0.01741	3.005
530.0	0.011736	411.0	0.8774	0.0468	0.01644	3.002
540.0	0.012211	441.1	0.9336	0.0499	0.01559	3.006
550.0	0.012670	471.2	0.9888	0.0528	0.01485	3.015
560.0	0.013116	501.4	1.0432	0.0557	0.01420	3.029
570.0	0.013550	531.7	1.0970	0.0584	0.01361	3.045
580.0	0.013974	562.3	1.1501	0.0611	0.01309	3.063
590.0	0.014389	593.0	1.2026	0.0636	0.01261	3.082
600.0	0.014796	623.9	1.2546	0.0662	0.01217	3.104

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=5.5 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001588	-501.9	-1.5100	0.9216	0.894	2.092
250.0	0.001613	-480.8	-1.4240	0.8524	0.842	2.135
260.0	0.001640	-459.3	-1.3398	0.7839	0.790	2.174
270.0	0.001668	-437.4	-1.2573	0.7168	0.740	2.215
280.0	0.001697	-415.0	-1.1760	0.6517	0.691	2.259
290.0	0.001729	-392.1	-1.0958	0.5892	0.644	2.307
300.0	0.001763	-368.8	-1.0167	0.5294	0.597	2.360
310.0	0.001799	-344.8	-0.9383	0.4726	0.553	2.416
320.0	0.001838	-320.3	-0.8606	0.4187	0.510	2.477
330.0	0.001881	-295.2	-0.7833	0.3678	0.468	2.543
340.0	0.001929	-269.4	-0.7063	0.3199	0.428	2.613
350.0	0.001981	-242.8	-0.6294	0.2750	0.389	2.689
360.0	0.002041	-215.5	-0.5524	0.2328	0.352	2.772
370.0	0.002108	-187.3	-0.4751	0.1935	0.315	2.866
380.0	0.002187	-158.0	-0.3972	0.1569	0.280	2.975
385.0	0.002232	-143.0	-0.3579	0.1396	0.263	3.037
390.0	0.002281	-127.6	-0.3182	0.1230	0.245	3.107
395.0	0.002336	-111.8	-0.2781	0.1071	0.228	3.187
400.0	0.002399	-95.6	-0.2373	0.0920	0.211	3.280
405.0	0.002470	-78.9	-0.1958	0.0775	0.1942	3.392
410.0	0.002554	-61.6	-0.1533	0.0638	0.1772	3.531
415.0	0.002654	-43.5	-0.1094	0.0510	0.1600	3.710
420.0	0.002779	-24.3	-0.0635	0.0392	0.1425	3.954
425.0	0.002942	-3.6	-0.0147	0.0287	0.1248	4.302
430.0	0.003169	19.2	0.0386	0.0199	0.1066	4.810
435.0	0.003503	44.9	0.0982	0.0135	0.0885	5.461
440.0	0.003983	73.6	0.1637	0.0105	0.0722	5.854
445.0	0.004565	102.5	0.2289	0.0104	0.0595	5.562
450.0	0.005150	128.9	0.2879	0.0119	0.0505	4.966
460.0	0.006165	173.7	0.3864	0.0166	0.0396	4.069
470.0	0.006994	211.9	0.4685	0.0214	0.0332	3.611
480.0	0.007702	246.7	0.5418	0.0260	0.0290	3.366
490.0	0.008330	279.6	0.6097	0.0303	0.0260	3.227
500.0	0.008901	311.5	0.6740	0.0343	0.0237	3.144
510.0	0.009432	342.6	0.7357	0.0380	0.0219	3.095
520.0	0.009930	373.4	0.7956	0.0415	0.0204	3.067
530.0	0.010404	404.0	0.8538	0.0449	0.01914	3.054
540.0	0.010857	434.5	0.9109	0.0481	0.01807	3.050
550.0	0.011293	465.1	0.9668	0.0511	0.01715	3.053
560.0	0.011715	495.6	1.0219	0.0541	0.01634	3.062
570.0	0.012125	526.3	1.0762	0.0569	0.01562	3.074
580.0	0.012524	557.1	1.1298	0.0597	0.01498	3.089
590.0	0.012914	588.1	1.1827	0.0624	0.01440	3.106
600.0	0.013296	619.2	1.2351	0.0650	0.01387	3.125



TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=6.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001587	-501.4	-1.5112	0.9344	0.903	2.091
250.0	0.001612	-480.3	-1.4252	0.8646	0.850	2.133
260.0	0.001638	-458.8	-1.3411	0.7955	0.798	2.173
270.0	0.001666	-436.9	-1.2587	0.7280	0.747	2.213
280.0	0.001695	-414.6	-1.1775	0.6626	0.698	2.256
290.0	0.001726	-391.7	-1.0975	0.5998	0.650	2.304
300.0	0.001760	-368.4	-1.0184	0.5398	0.604	2.356
310.0	0.001796	-344.5	-0.9402	0.4828	0.559	2.412
320.0	0.001834	-320.1	-0.8626	0.4289	0.516	2.472
330.0	0.001877	-295.0	-0.7855	0.3780	0.474	2.536
340.0	0.001923	-269.3	-0.7087	0.3301	0.434	2.604
350.0	0.001974	-242.8	-0.6321	0.2851	0.396	2.678
360.0	0.002032	-215.6	-0.5555	0.2431	0.358	2.758
370.0	0.002097	-187.5	-0.4787	0.2039	0.322	2.847
380.0	0.002172	-158.5	-0.4014	0.1674	0.287	2.948
385.0	0.002215	-143.6	-0.3624	0.1503	0.270	3.005
390.0	0.002261	-128.4	-0.3232	0.1338	0.254	3.067
395.0	0.002312	-112.9	-0.2837	0.1180	0.237	3.137
400.0	0.002369	-97.0	-0.2437	0.1029	0.220	3.216
405.0	0.002434	-80.6	-0.2031	0.0886	0.204	3.308
410.0	0.002507	-63.8	-0.1618	0.0751	0.1877	3.416
415.0	0.002593	-46.3	-0.1195	0.0623	0.1715	3.548
420.0	0.002695	-28.2	-0.0760	0.0506	0.1553	3.713
425.0	0.002820	-9.0	-0.0308	0.0399	0.1390	3.924
430.0	0.002978	11.3	0.0168	0.0305	0.1228	4.200
435.0	0.003186	33.2	0.0674	0.0228	0.1067	4.548
440.0	0.003463	57.0	0.1217	0.0172	0.0912	4.921
445.0	0.003826	82.4	0.1791	0.0141	0.0773	5.149
450.0	0.004257	108.1	0.2366	0.0133	0.0658	5.074
460.0	0.005159	155.9	0.3416	0.0155	0.0502	4.428
470.0	0.005969	197.3	0.4307	0.0195	0.0410	3.885
480.0	0.006670	234.5	0.5089	0.0239	0.0351	3.559
490.0	0.007289	269.0	0.5802	0.0282	0.0310	3.367
500.0	0.007849	302.1	0.6469	0.0322	0.0280	3.250
510.0	0.008365	334.2	0.7105	0.0361	0.0256	3.178
520.0	0.008847	365.8	0.7718	0.0397	0.0237	3.134
530.0	0.009303	397.0	0.8312	0.0431	0.0221	3.109
540.0	0.009737	428.0	0.8892	0.0464	0.0208	3.096
550.0	0.010154	458.9	0.9460	0.0496	0.01963	3.093
560.0	0.010556	489.9	1.0017	0.0527	0.01864	3.096
570.0	0.010945	520.9	1.0566	0.0556	0.01777	3.104
580.0	0.011323	552.0	1.1107	0.0585	0.01699	3.116
590.0	0.011692	583.2	1.1640	0.0612	0.01629	3.130
600.0	0.012052	614.6	1.2168	0.0639	0.01566	3.147



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=6.5 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001586	-500.9	-1.5124	0.9472	0.912	2.089
250.0	0.001610	-479.8	-1.4265	0.8767	0.858	2.132
260.0	0.001636	-458.3	-1.3425	0.8070	0.805	2.171
270.0	0.001664	-436.5	-1.2601	0.7391	0.754	2.211
280.0	0.001693	-414.2	-1.1790	0.6734	0.704	2.254
290.0	0.001724	-391.4	-1.0991	0.6103	0.656	2.301
300.0	0.001757	-368.0	-1.0201	0.5501	0.610	2.352
310.0	0.001792	-344.2	-0.9421	0.4930	0.565	2.407
320.0	0.001830	-319.8	-0.8646	0.4389	0.522	2.466
330.0	0.001872	-294.8	-0.7877	0.3880	0.480	2.529
340.0	0.001918	-269.1	-0.7112	0.3401	0.440	2.596
350.0	0.001968	-242.8	-0.6348	0.2951	0.402	2.668
360.0	0.002024	-215.6	-0.5585	0.2531	0.365	2.745
370.0	0.002087	-187.7	-0.4821	0.2140	0.329	2.829
380.0	0.002159	-158.9	-0.4053	0.1777	0.295	2.924
385.0	0.002199	-144.2	-0.3667	0.1606	0.278	2.976
390.0	0.002243	-129.1	-0.3279	0.1442	0.261	3.033
395.0	0.002291	-113.8	-0.2888	0.1285	0.245	3.095
400.0	0.002343	-98.1	-0.2494	0.1135	0.229	3.165
405.0	0.002402	-82.1	-0.2096	0.0993	0.213	3.242
410.0	0.002468	-65.6	-0.1692	0.0858	0.1974	3.331
415.0	0.002544	-48.6	-0.1282	0.0732	0.1818	3.435
420.0	0.002631	-31.1	-0.0862	0.0614	0.1664	3.558
425.0	0.002734	-12.9	-0.0432	0.0506	0.1511	3.705
430.0	0.002857	6.1	0.0012	0.0409	0.1360	3.885
435.0	0.003010	26.1	0.0475	0.0326	0.1211	4.101
440.0	0.003200	47.2	0.0958	0.0258	0.1067	4.343
445.0	0.003439	69.6	0.1464	0.0208	0.0932	4.573
450.0	0.003733	93.0	0.1985	0.0178	0.0810	4.709
460.0	0.004436	139.7	0.3013	0.0166	0.0622	4.534
470.0	0.005163	183.0	0.3943	0.0190	0.0501	4.096
480.0	0.005832	222.1	0.4766	0.0227	0.0422	3.741
490.0	0.006432	258.3	0.5513	0.0267	0.0367	3.508
500.0	0.006977	292.6	0.6206	0.0307	0.0327	3.359
510.0	0.007477	325.7	0.6861	0.0345	0.0297	3.263
520.0	0.007944	358.0	0.7488	0.0382	0.0273	3.203
530.0	0.008383	389.9	0.8095	0.0417	0.0253	3.166
540.0	0.008801	421.4	0.8684	0.0451	0.0237	3.144
550.0	0.009200	452.8	0.9260	0.0483	0.0223	3.134
560.0	0.009584	484.1	0.9824	0.0515	0.0211	3.132
570.0	0.009955	515.4	1.0379	0.0545	0.0200	3.135
580.0	0.010315	546.8	1.0925	0.0574	0.0191	3.143
590.0	0.010665	578.3	1.1463	0.0603	0.0183	3.155
600.0	0.011007	609.9	1.1995	0.0630	0.0176	3.169

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=7.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001584	-500.4	-1.5136	0.9599	0.920	2.088
250.0	0.001609	-479.3	-1.4278	0.8887	0.865	2.130
260.0	0.001635	-457.9	-1.3438	0.8185	0.812	2.169
270.0	0.001662	-436.0	-1.2615	0.7501	0.761	2.208
280.0	0.001691	-413.7	-1.1805	0.6840	0.711	2.251
290.0	0.001721	-391.0	-1.1007	0.6207	0.662	2.298
300.0	0.001754	-367.7	-1.0218	0.5604	0.616	2.349
310.0	0.001789	-343.9	-0.9439	0.5031	0.571	2.403
320.0	0.001827	-319.5	-0.8666	0.4489	0.528	2.461
330.0	0.001868	-294.6	-0.7899	0.3979	0.486	2.523
340.0	0.001912	-269.0	-0.7135	0.3499	0.446	2.589
350.0	0.001961	-242.7	-0.6374	0.3050	0.408	2.658
360.0	0.002016	-215.7	-0.5614	0.2631	0.371	2.733
370.0	0.002077	-187.9	-0.4854	0.2240	0.336	2.814
380.0	0.002146	-159.3	-0.4091	0.1878	0.302	2.903
385.0	0.002184	-144.6	-0.3708	0.1708	0.285	2.951
390.0	0.002226	-129.7	-0.3324	0.1544	0.269	3.004
395.0	0.002271	-114.6	-0.2937	0.1388	0.253	3.060
400.0	0.002320	-99.1	-0.2548	0.1239	0.237	3.122
405.0	0.002375	-83.3	-0.2155	0.1097	0.222	3.189
410.0	0.002435	-67.1	-0.1759	0.0963	0.206	3.265
415.0	0.002503	-50.5	-0.1358	0.0837	0.1912	3.350
420.0	0.002580	-33.5	-0.0950	0.0719	0.1764	3.448
425.0	0.002668	-16.0	-0.0535	0.0610	0.1618	3.560
430.0	0.002771	2.2	-0.0110	0.0511	0.1474	3.690
435.0	0.002892	21.1	0.0326	0.0423	0.1334	3.840
440.0	0.003038	40.7	0.0775	0.0349	0.1198	4.007
445.0	0.003213	61.3	0.1238	0.0288	0.1068	4.179
450.0	0.003424	82.6	0.1715	0.0243	0.0947	4.327
460.0	0.003950	126.7	0.2684	0.0200	0.0744	4.406
470.0	0.004558	169.9	0.3612	0.0202	0.0599	4.179
480.0	0.005165	210.2	0.4461	0.0227	0.0499	3.876
490.0	0.005731	247.7	0.5234	0.0261	0.0430	3.633
500.0	0.006253	283.2	0.5951	0.0298	0.0380	3.463
510.0	0.006735	317.2	0.6625	0.0335	0.0342	3.348
520.0	0.007185	350.3	0.7267	0.0371	0.0312	3.272
530.0	0.007608	382.8	0.7885	0.0406	0.0288	3.223
540.0	0.008009	414.8	0.8485	0.0440	0.0268	3.193
550.0	0.008392	446.7	0.9069	0.0473	0.0252	3.175
560.0	0.008760	478.4	0.9640	0.0505	0.0237	3.167
570.0	0.009115	510.0	1.0201	0.0536	0.0225	3.167
580.0	0.009459	541.7	1.0752	0.0566	0.0214	3.171
590.0	0.009793	573.5	1.1295	0.0595	0.0204	3.180
600.0	0.010118	605.3	1.1830	0.0623	0.0195	3.192

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=7.5 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001583	-499.8	-1.5148	0.9724	0.929	2.087
250.0	0.001607	-478.8	-1.4290	0.9006	0.873	2.129
260.0	0.001633	-457.4	-1.3451	0.8299	0.819	2.167
270.0	0.001660	-435.6	-1.2629	0.7610	0.767	2.206
280.0	0.001689	-413.3	-1.1820	0.6947	0.717	2.249
290.0	0.001719	-390.5	-1.1022	0.6311	0.668	2.295
300.0	0.001751	-367.3	-1.0235	0.5705	0.622	2.345
310.0	0.001786	-343.5	-0.9457	0.5130	0.577	2.399
320.0	0.001823	-319.2	-0.8686	0.4588	0.534	2.456
330.0	0.001863	-294.3	-0.7920	0.4077	0.492	2.517
340.0	0.001907	-268.8	-0.7158	0.3597	0.452	2.581
350.0	0.001955	-242.6	-0.6400	0.3148	0.414	2.649
360.0	0.002008	-215.7	-0.5643	0.2728	0.377	2.722
370.0	0.002067	-188.1	-0.4886	0.2338	0.342	2.799
380.0	0.002134	-159.6	-0.4128	0.1977	0.308	2.884
385.0	0.002171	-145.1	-0.3747	0.1807	0.292	2.929
390.0	0.002210	-130.3	-0.3366	0.1644	0.276	2.978
395.0	0.002253	-115.2	-0.2983	0.1488	0.260	3.029
400.0	0.002300	-99.9	-0.2598	0.1340	0.245	3.085
405.0	0.002350	-84.3	-0.2210	0.1198	0.229	3.145
410.0	0.002406	-68.4	-0.1820	0.1064	0.215	3.211
415.0	0.002468	-52.1	-0.1426	0.0938	0.1999	3.284
420.0	0.002537	-35.5	-0.1027	0.0820	0.1855	3.365
425.0	0.002615	-18.4	-0.0623	0.0710	0.1714	3.455
430.0	0.002703	-0.8	-0.0213	0.0610	0.1576	3.557
435.0	0.002805	17.3	0.0206	0.0520	0.1442	3.670
440.0	0.002924	36.0	0.0633	0.0440	0.1311	3.793
445.0	0.003063	55.3	0.1069	0.0373	0.1186	3.922
450.0	0.003225	75.3	0.1516	0.0319	0.1068	4.046
460.0	0.003628	116.7	0.2427	0.0251	0.0861	4.199
470.0	0.004120	158.7	0.3329	0.0230	0.0699	4.141
480.0	0.004647	199.2	0.4182	0.0239	0.0583	3.939
490.0	0.005165	237.6	0.4972	0.0264	0.0499	3.724
500.0	0.005655	274.0	0.5707	0.0296	0.0437	3.552
510.0	0.006114	308.8	0.6398	0.0330	0.0391	3.426
520.0	0.006545	342.6	0.7054	0.0365	0.0355	3.339
530.0	0.006951	375.7	0.7684	0.0399	0.0326	3.279
540.0	0.007336	408.3	0.8293	0.0433	0.0302	3.241
550.0	0.007703	440.6	0.8886	0.0466	0.0282	3.216
560.0	0.008056	472.7	0.9464	0.0498	0.0265	3.203
570.0	0.008396	504.7	1.0030	0.0529	0.0250	3.198
580.0	0.008725	536.7	1.0587	0.0560	0.0238	3.199
590.0	0.009044	568.7	1.1134	0.0589	0.0226	3.205
600.0	0.009355	600.8	1.1673	0.0618	0.0216	3.214



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=8.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT KJ/(KG.K)	CP KJ/(KG.K)
240.0	0.001582	-499.3	-1.5160	0.9849	0.937	2.086
250.0	0.001606	-478.3	-1.4303	0.9124	0.880	2.127
260.0	0.001632	-456.9	-1.3465	0.8411	0.826	2.165
270.0	0.001658	-435.1	-1.2643	0.7719	0.774	2.204
280.0	0.001687	-412.9	-1.1835	0.7052	0.723	2.246
290.0	0.001717	-390.1	-1.1038	0.6413	0.674	2.292
300.0	0.001749	-366.9	-1.0252	0.5806	0.628	2.342
310.0	0.001783	-343.2	-0.9475	0.5229	0.583	2.395
320.0	0.001819	-318.9	-0.8705	0.4686	0.539	2.452
330.0	0.001859	-294.1	-0.7941	0.4174	0.498	2.512
340.0	0.001902	-268.6	-0.7181	0.3694	0.458	2.575
350.0	0.001949	-242.5	-0.6425	0.3244	0.420	2.641
360.0	0.002001	-215.7	-0.5670	0.2825	0.383	2.711
370.0	0.002058	-188.2	-0.4917	0.2435	0.348	2.786
380.0	0.002123	-159.9	-0.4162	0.2074	0.315	2.866
385.0	0.002158	-145.4	-0.3785	0.1905	0.299	2.909
390.0	0.002196	-130.7	-0.3406	0.1742	0.283	2.955
395.0	0.002237	-115.8	-0.3026	0.1587	0.267	3.003
400.0	0.002281	-100.7	-0.2645	0.1438	0.252	3.054
405.0	0.002328	-85.2	-0.2262	0.1297	0.237	3.108
410.0	0.002380	-69.5	-0.1876	0.1163	0.222	3.167
415.0	0.002437	-53.5	-0.1488	0.1037	0.208	3.230
420.0	0.002500	-37.1	-0.1097	0.0919	0.1939	3.299
425.0	0.002570	-20.4	-0.0701	0.0808	0.1802	3.375
430.0	0.002649	-3.3	-0.0301	0.0707	0.1669	3.458
435.0	0.002737	14.2	0.0104	0.0614	0.1539	3.548
440.0	0.002838	32.3	0.0516	0.0532	0.1413	3.645
445.0	0.002953	50.8	0.0934	0.0460	0.1292	3.746
450.0	0.003085	69.8	0.1359	0.0399	0.1177	3.846
460.0	0.003407	109.2	0.2225	0.0313	0.0969	4.004
470.0	0.003804	149.6	0.3093	0.0271	0.0799	4.036
480.0	0.004251	189.6	0.3936	0.0264	0.0668	3.935
490.0	0.004713	228.2	0.4732	0.0277	0.0571	3.773
500.0	0.005164	265.2	0.5478	0.0301	0.0498	3.617
510.0	0.005596	300.8	0.6182	0.0331	0.0443	3.491
520.0	0.006004	335.2	0.6851	0.0364	0.0400	3.398
530.0	0.006392	368.8	0.7492	0.0397	0.0366	3.332
540.0	0.006760	401.9	0.8110	0.0430	0.0338	3.286
550.0	0.007113	434.6	0.8710	0.0462	0.0314	3.256
560.0	0.007451	467.1	0.9295	0.0494	0.0294	3.238
570.0	0.007776	499.4	0.9867	0.0525	0.0277	3.229
580.0	0.008092	531.7	1.0428	0.0555	0.0263	3.226
590.0	0.008397	564.0	1.0980	0.0585	0.0250	3.229
600.0	0.008695	596.3	1.1524	0.0614	0.0238	3.236



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=8.5 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001581	-498.8	-1.5172	0.9973	0.945	2.084
250.0	0.001605	-477.8	-1.4315	0.9241	0.888	2.126
260.0	0.001630	-456.4	-1.3478	0.8524	0.833	2.164
270.0	0.001656	-434.7	-1.2657	0.7827	0.780	2.202
280.0	0.001685	-412.4	-1.1849	0.7156	0.729	2.244
290.0	0.001714	-389.7	-1.1053	0.6515	0.680	2.289
300.0	0.001746	-366.6	-1.0268	0.5905	0.633	2.338
310.0	0.001780	-342.9	-0.9492	0.5328	0.588	2.391
320.0	0.001816	-318.6	-0.8724	0.4783	0.545	2.447
330.0	0.001855	-293.8	-0.7961	0.4270	0.503	2.506
340.0	0.001897	-268.4	-0.7203	0.3789	0.464	2.568
350.0	0.001943	-242.4	-0.6449	0.3340	0.426	2.633
360.0	0.001994	-215.7	-0.5697	0.2920	0.389	2.701
370.0	0.002050	-188.3	-0.4947	0.2531	0.354	2.773
380.0	0.002112	-160.1	-0.4196	0.2170	0.321	2.851
390.0	0.002183	-131.1	-0.3444	0.1838	0.289	2.934
400.0	0.002263	-101.3	-0.2689	0.1535	0.259	3.026
410.0	0.002357	-70.5	-0.1929	0.1260	0.230	3.129
420.0	0.002468	-38.6	-0.1160	0.1015	0.202	3.246
430.0	0.002603	-5.4	-0.0380	0.0801	0.1754	3.381
440.0	0.002769	29.3	0.0416	0.0622	0.1505	3.536
450.0	0.002980	65.5	0.1230	0.0481	0.1275	3.700
460.0	0.003246	103.4	0.2061	0.0381	0.1069	3.844
470.0	0.003573	142.3	0.2899	0.0322	0.0894	3.915
480.0	0.003951	181.5	0.3723	0.0299	0.0753	3.885
490.0	0.004355	219.9	0.4515	0.0299	0.0645	3.781
500.0	0.004764	257.1	0.5267	0.0315	0.0562	3.655
510.0	0.005164	293.1	0.5979	0.0339	0.0498	3.540
520.0	0.005548	328.1	0.6658	0.0368	0.0448	3.448
530.0	0.005915	362.2	0.7308	0.0398	0.0408	3.378
540.0	0.006267	395.7	0.7934	0.0430	0.0375	3.328
550.0	0.006603	428.8	0.8542	0.0461	0.0348	3.293
560.0	0.006927	461.6	0.9133	0.0493	0.0325	3.271
570.0	0.007239	494.3	0.9711	0.0523	0.0306	3.258
580.0	0.007541	526.8	1.0277	0.0554	0.0289	3.253
590.0	0.007834	559.4	1.0833	0.0583	0.0274	3.253
600.0	0.008119	591.9	1.1380	0.0612	0.0261	3.257

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=9.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001579	-498.3	-1.5184	1.0096	0.953	2.083
250.0	0.001603	-477.3	-1.4328	0.9358	0.895	2.124
260.0	0.001628	-456.0	-1.3491	0.8635	0.840	2.162
270.0	0.001655	-434.2	-1.2671	0.7934	0.786	2.200
280.0	0.001683	-412.0	-1.1864	0.7260	0.735	2.242
290.0	0.001712	-389.3	-1.1069	0.6616	0.686	2.287
300.0	0.001743	-366.2	-1.0285	0.6004	0.639	2.335
310.0	0.001777	-342.5	-0.9510	0.5425	0.594	2.388
320.0	0.001812	-318.3	-0.8743	0.4879	0.550	2.443
330.0	0.001851	-293.6	-0.7981	0.4365	0.509	2.501
340.0	0.001892	-268.2	-0.7225	0.3884	0.469	2.562
350.0	0.001938	-242.2	-0.6473	0.3434	0.431	2.625
360.0	0.001987	-215.6	-0.5723	0.3014	0.395	2.692
370.0	0.002041	-188.3	-0.4976	0.2625	0.360	2.762
380.0	0.002102	-160.3	-0.4229	0.2265	0.327	2.836
390.0	0.002170	-131.5	-0.3481	0.1933	0.296	2.916
400.0	0.002247	-101.9	-0.2732	0.1630	0.265	3.002
410.0	0.002336	-71.3	-0.1978	0.1355	0.237	3.096
420.0	0.002440	-39.8	-0.1219	0.1109	0.209	3.202
430.0	0.002563	-7.1	-0.0451	0.0894	0.1834	3.320
440.0	0.002713	26.8	0.0328	0.0711	0.1590	3.451
450.0	0.002897	62.1	0.1121	0.0563	0.1364	3.590
460.0	0.003124	98.7	0.1925	0.0453	0.1160	3.717
470.0	0.003399	136.4	0.2736	0.0381	0.0983	3.801
480.0	0.003720	174.6	0.3540	0.0342	0.0837	3.813
490.0	0.004072	212.6	0.4322	0.0331	0.0719	3.759
500.0	0.004438	249.8	0.5074	0.0337	0.0627	3.668
510.0	0.004805	286.0	0.5791	0.0354	0.0555	3.571
520.0	0.005163	321.3	0.6476	0.0377	0.0498	3.485
530.0	0.005509	355.8	0.7133	0.0405	0.0452	3.416
540.0	0.005842	389.7	0.7767	0.0434	0.0415	3.364
550.0	0.006163	423.1	0.8381	0.0464	0.0384	3.327
560.0	0.006472	456.3	0.8978	0.0494	0.0358	3.302
570.0	0.006771	489.2	0.9561	0.0524	0.0335	3.286
580.0	0.007060	522.1	1.0132	0.0554	0.0316	3.278
590.0	0.007341	554.8	1.0692	0.0584	0.0299	3.276
600.0	0.007614	587.6	1.1243	0.0613	0.0284	3.278

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=9.5 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT KJ/(KG.K)	CP KJ/(KG.K)
240.0	0.001578	-497.8	-1.5196	1.0219	0.961	2.082
250.0	0.001602	-476.8	-1.4340	0.9474	0.902	2.123
260.0	0.001627	-455.5	-1.3503	0.8746	0.846	2.160
270.0	0.001653	-433.8	-1.2684	0.8041	0.793	2.198
280.0	0.001681	-411.6	-1.1878	0.7363	0.741	2.239
290.0	0.001710	-388.9	-1.1084	0.6717	0.692	2.284
300.0	0.001741	-365.8	-1.0301	0.6103	0.644	2.332
310.0	0.001774	-342.2	-0.9527	0.5522	0.599	2.384
320.0	0.001809	-318.0	-0.8761	0.4974	0.556	2.439
330.0	0.001847	-293.3	-0.8001	0.4460	0.514	2.496
340.0	0.001888	-268.0	-0.7247	0.3978	0.474	2.556
350.0	0.001932	-242.1	-0.6496	0.3527	0.436	2.618
360.0	0.001981	-215.5	-0.5749	0.3108	0.400	2.683
370.0	0.002034	-188.3	-0.5004	0.2718	0.366	2.751
380.0	0.002092	-160.4	-0.4260	0.2358	0.333	2.823
390.0	0.002158	-131.8	-0.3517	0.2026	0.302	2.899
400.0	0.002232	-102.4	-0.2772	0.1723	0.272	2.980
410.0	0.002316	-72.1	-0.2025	0.1448	0.243	3.068
420.0	0.002414	-40.9	-0.1273	0.1201	0.216	3.164
430.0	0.002528	-8.6	-0.0515	0.0985	0.1908	3.270
440.0	0.002664	24.7	0.0250	0.0799	0.1669	3.384
450.0	0.002828	59.2	0.1025	0.0646	0.1447	3.504
460.0	0.003027	94.9	0.1809	0.0528	0.1246	3.616
470.0	0.003264	131.6	0.2597	0.0444	0.1068	3.701
480.0	0.003540	168.9	0.3382	0.0393	0.0917	3.737
490.0	0.003847	206.2	0.4153	0.0369	0.0792	3.718
500.0	0.004173	243.2	0.4899	0.0365	0.0693	3.660
510.0	0.004506	279.5	0.5617	0.0375	0.0613	3.584
520.0	0.004838	314.9	0.6306	0.0393	0.0549	3.510
530.0	0.005162	349.7	0.6969	0.0416	0.0498	3.446
540.0	0.005477	383.9	0.7608	0.0442	0.0456	3.395
550.0	0.005781	417.7	0.8228	0.0470	0.0421	3.357
560.0	0.006076	451.1	0.8830	0.0499	0.0391	3.330
570.0	0.006361	484.3	0.9418	0.0528	0.0366	3.312
580.0	0.006638	517.4	0.9993	0.0557	0.0344	3.301
590.0	0.006907	550.4	1.0557	0.0586	0.0325	3.297
600.0	0.007169	583.4	1.1111	0.0615	0.0309	3.298

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P=10.0 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001577	-497.3	-1.5207	1.0340	0.968	2.081
250.0	0.001601	-476.3	-1.4352	0.9589	0.909	2.122
260.0	0.001625	-455.0	-1.3516	0.8855	0.853	2.159
270.0	0.001651	-433.3	-1.2698	0.8146	0.799	2.196
280.0	0.001679	-411.1	-1.1892	0.7466	0.747	2.237
290.0	0.001708	-388.5	-1.1099	0.6817	0.697	2.281
300.0	0.001738	-365.4	-1.0317	0.6200	0.650	2.329
310.0	0.001771	-341.8	-0.9544	0.5618	0.604	2.381
320.0	0.001806	-317.7	-0.8779	0.5069	0.561	2.435
330.0	0.001843	-293.0	-0.8021	0.4553	0.519	2.491
340.0	0.001883	-267.8	-0.7268	0.4070	0.480	2.550
350.0	0.001927	-241.9	-0.6519	0.3619	0.442	2.611
360.0	0.001974	-215.5	-0.5774	0.3200	0.406	2.675
370.0	0.002026	-188.3	-0.5031	0.2810	0.371	2.741
380.0	0.002083	-160.5	-0.4291	0.2449	0.339	2.810
390.0	0.002147	-132.0	-0.3551	0.2118	0.307	2.883
400.0	0.002218	-102.8	-0.2810	0.1814	0.278	2.961
410.0	0.002298	-72.7	-0.2069	0.1539	0.250	3.043
420.0	0.002391	-41.8	-0.1324	0.1292	0.223	3.132
430.0	0.002498	-10.0	-0.0575	0.1074	0.1979	3.227
440.0	0.002623	22.9	0.0179	0.0886	0.1743	3.329
450.0	0.002771	56.8	0.0940	0.0728	0.1525	3.434
460.0	0.002947	91.7	0.1707	0.0603	0.1325	3.535
470.0	0.003155	127.5	0.2478	0.0510	0.1147	3.617
480.0	0.003396	164.0	0.3246	0.0449	0.0993	3.664
490.0	0.003666	200.8	0.4003	0.0414	0.0864	3.669
500.0	0.003957	237.4	0.4743	0.0400	0.0758	3.637
510.0	0.004258	273.5	0.5458	0.0401	0.0672	3.583
520.0	0.004563	309.1	0.6149	0.0413	0.0602	3.523
530.0	0.004865	344.1	0.6814	0.0432	0.0545	3.466
540.0	0.005161	378.5	0.7458	0.0455	0.0498	3.419
550.0	0.005449	412.5	0.8082	0.0480	0.0459	3.381
560.0	0.005730	446.2	0.8689	0.0507	0.0426	3.354
570.0	0.006002	479.6	0.9281	0.0535	0.0398	3.335
580.0	0.006267	512.9	0.9859	0.0563	0.0374	3.323
590.0	0.006524	546.1	1.0427	0.0591	0.0353	3.317
600.0	0.006775	579.3	1.0985	0.0619	0.0334	3.316



TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P = 11 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001574	-496.3	-1.5230	1.058	0.984	2.079
250.0	0.001598	-475.3	-1.4376	0.982	0.923	2.119
260.0	0.001622	-454.0	-1.3541	0.907	0.866	2.156
270.0	0.001648	-432.4	-1.2724	0.836	0.811	2.193
280.0	0.001675	-410.2	-1.1920	0.767	0.758	2.233
290.0	0.001703	-387.6	-1.1128	0.701	0.708	2.277
300.0	0.001734	-364.6	-1.0348	0.639	0.660	2.324
310.0	0.001765	-341.1	-0.9578	0.581	0.615	2.374
320.0	0.001800	-317.0	-0.8815	0.526	0.571	2.427
330.0	0.001836	-292.4	-0.8059	0.474	0.529	2.482
340.0	0.001875	-267.3	-0.7309	0.425	0.490	2.540
350.0	0.001917	-241.6	-0.6564	0.380	0.452	2.599
360.0	0.001963	-215.2	-0.5822	0.338	0.416	2.660
370.0	0.002012	-188.3	-0.5084	0.299	0.382	2.723
380.0	0.002066	-160.7	-0.4349	0.263	0.349	2.788
390.0	0.002126	-132.4	-0.3616	0.230	0.319	2.856
400.0	0.002192	-103.5	-0.2883	0.199	0.289	2.927
410.0	0.002266	-73.8	-0.2151	0.172	0.262	3.001
420.0	0.002350	-43.4	-0.1418	0.147	0.236	3.078
430.0	0.002445	-12.1	-0.0683	0.125	0.211	3.160
440.0	0.002553	19.9	0.0054	0.1055	0.1880	3.244
450.0	0.002679	52.9	0.0793	0.0891	0.1666	3.330
460.0	0.002824	86.6	0.1535	0.0755	0.1470	3.412
470.0	0.002991	121.2	0.2278	0.0649	0.1293	3.485
480.0	0.003182	156.4	0.3018	0.0570	0.1136	3.540
490.0	0.003396	192.0	0.3753	0.0516	0.1000	3.569
500.0	0.003629	227.8	0.4475	0.0484	0.0885	3.572
510.0	0.003877	263.5	0.5181	0.0470	0.0788	3.553
520.0	0.004133	298.9	0.5868	0.0469	0.0707	3.520
530.0	0.004392	333.9	0.6536	0.0477	0.0640	3.483
540.0	0.004651	368.6	0.7184	0.0491	0.0584	3.447
550.0	0.004907	402.9	0.7813	0.0510	0.0537	3.416
560.0	0.005159	436.9	0.8426	0.0533	0.0498	3.390
570.0	0.005406	470.7	0.9025	0.0557	0.0464	3.372
580.0	0.005647	504.4	0.9610	0.0582	0.0434	3.359
590.0	0.005883	538.0	1.0184	0.0608	0.0409	3.352
600.0	0.006114	571.5	1.0747	0.0634	0.0386	3.349

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P = 12 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001572	-495.3	-1.5253	1.082	0.998	2.077
250.0	0.001595	-474.4	-1.4400	1.004	0.937	2.117
260.0	0.001619	-453.1	-1.3566	0.929	0.878	2.153
270.0	0.001645	-431.4	-1.2750	0.856	0.822	2.189
280.0	0.001671	-409.3	-1.1948	0.787	0.769	2.229
290.0	0.001699	-386.8	-1.1157	0.721	0.719	2.272
300.0	0.001729	-363.8	-1.0379	0.658	0.671	2.318
310.0	0.001760	-340.3	-0.9610	0.599	0.625	2.368
320.0	0.001793	-316.3	-0.8850	0.544	0.581	2.420
330.0	0.001829	-291.8	-0.8096	0.492	0.539	2.474
340.0	0.001867	-266.8	-0.7349	0.443	0.500	2.530
350.0	0.001908	-241.2	-0.6607	0.398	0.462	2.587
360.0	0.001951	-215.0	-0.5869	0.356	0.426	2.646
370.0	0.001999	-188.2	-0.5135	0.317	0.392	2.707
380.0	0.002051	-160.7	-0.4404	0.281	0.360	2.769
390.0	0.002107	-132.7	-0.3676	0.247	0.329	2.833
400.0	0.002169	-104.0	-0.2951	0.217	0.300	2.898
410.0	0.002238	-74.6	-0.2226	0.189	0.273	2.966
420.0	0.002315	-44.6	-0.1502	0.164	0.247	3.036
430.0	0.002400	-13.8	-0.0779	0.142	0.223	3.108
440.0	0.002497	17.7	-0.0055	0.122	0.200	3.181
450.0	0.002606	49.9	0.0668	0.1051	0.1794	3.254
460.0	0.002730	82.8	0.1392	0.0907	0.1600	3.325
470.0	0.002871	116.5	0.2115	0.0790	0.1424	3.389
480.0	0.003029	150.7	0.2835	0.0698	0.1266	3.443
490.0	0.003204	185.4	0.3550	0.0630	0.1127	3.481
500.0	0.003396	220.3	0.4256	0.0583	0.1005	3.501
510.0	0.003602	255.4	0.4950	0.0555	0.0901	3.504
520.0	0.003818	290.4	0.5630	0.0540	0.0812	3.494
530.0	0.004040	325.3	0.6295	0.0537	0.0736	3.475
540.0	0.004266	360.0	0.6942	0.0543	0.0673	3.453
550.0	0.004492	394.4	0.7574	0.0554	0.0618	3.431
560.0	0.004717	428.6	0.8191	0.0570	0.0572	3.412
570.0	0.004939	462.7	0.8793	0.0589	0.0532	3.396
580.0	0.005158	496.6	0.9383	0.0611	0.0498	3.385
590.0	0.005373	530.4	0.9961	0.0634	0.0468	3.378
600.0	0.005584	564.2	1.0529	0.0658	0.0441	3.375

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P = 14 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001568	-493.2	-1.5299	1.128	1.027	2.073
250.0	0.001590	-472.3	-1.4447	1.048	0.962	2.112
260.0	0.001614	-451.1	-1.3616	0.971	0.902	2.147
270.0	0.001639	-429.5	-1.2802	0.897	0.845	2.183
280.0	0.001664	-407.5	-1.2002	0.826	0.791	2.221
290.0	0.001692	-385.0	-1.1214	0.759	0.739	2.263
300.0	0.001720	-362.1	-1.0439	0.696	0.690	2.308
310.0	0.001750	-338.8	-0.9674	0.636	0.644	2.356
320.0	0.001782	-314.9	-0.8917	0.580	0.600	2.407
330.0	0.001816	-290.6	-0.8168	0.528	0.558	2.459
340.0	0.001852	-265.7	-0.7425	0.479	0.518	2.512
350.0	0.001890	-240.2	-0.6689	0.433	0.480	2.567
360.0	0.001931	-214.3	-0.5957	0.391	0.445	2.623
370.0	0.001975	-187.7	-0.5230	0.351	0.411	2.679
380.0	0.002023	-160.6	-0.4508	0.315	0.379	2.737
390.0	0.002074	-132.9	-0.3789	0.281	0.349	2.794
400.0	0.002129	-104.6	-0.3073	0.251	0.320	2.853
410.0	0.002190	-75.8	-0.2361	0.223	0.293	2.912
420.0	0.002256	-46.3	-0.1652	0.197	0.268	2.972
430.0	0.002329	-16.2	-0.0945	0.174	0.244	3.032
440.0	0.002409	14.4	-0.0240	0.154	0.222	3.092
450.0	0.002497	45.7	0.0462	0.136	0.202	3.151
460.0	0.002595	77.5	0.1161	0.121	0.1829	3.207
470.0	0.002702	109.9	0.1857	0.1074	0.1654	3.261
480.0	0.002821	142.8	0.2549	0.0964	0.1495	3.309
490.0	0.002950	176.1	0.3236	0.0875	0.1352	3.350
500.0	0.003090	209.9	0.3917	0.0806	0.1224	3.382
510.0	0.003240	243.8	0.4590	0.0754	0.1110	3.405
520.0	0.003399	278.0	0.5253	0.0717	0.1010	3.419
530.0	0.003566	312.2	0.5905	0.0694	0.0923	3.425
540.0	0.003738	346.5	0.6545	0.0680	0.0847	3.426
550.0	0.003914	380.8	0.7174	0.0676	0.0780	3.423
560.0	0.004092	415.0	0.7791	0.0678	0.0723	3.418
570.0	0.004272	449.2	0.8395	0.0685	0.0672	3.414
580.0	0.004451	483.3	0.8989	0.0697	0.0628	3.410
590.0	0.004629	517.4	0.9572	0.0712	0.0589	3.408
600.0	0.004806	551.5	1.0145	0.0729	0.0555	3.408

TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P = 16 MPA

T DEG K	V M <sup>3</sup> /KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001563	-491.2	-1.5343	1.174	1.053	2.069
250.0	0.001586	-470.3	-1.4493	1.092	0.987	2.107
260.0	0.001609	-449.1	-1.3663	1.012	0.925	2.142
270.0	0.001633	-427.6	-1.2852	0.937	0.866	2.177
280.0	0.001658	-405.6	-1.2054	0.865	0.811	2.215
290.0	0.001684	-383.3	-1.1269	0.797	0.758	2.255
300.0	0.001712	-360.4	-1.0497	0.732	0.709	2.299
310.0	0.001741	-337.2	-0.9734	0.672	0.662	2.346
320.0	0.001771	-313.4	-0.8981	0.615	0.617	2.395
330.0	0.001804	-289.2	-0.8236	0.562	0.575	2.446
340.0	0.001838	-264.4	-0.7498	0.513	0.535	2.497
350.0	0.001874	-239.2	-0.6766	0.467	0.498	2.550
360.0	0.001913	-213.4	-0.6039	0.424	0.462	2.603
370.0	0.001954	-187.0	-0.5318	0.384	0.428	2.657
380.0	0.001998	-160.2	-0.4602	0.348	0.396	2.710
390.0	0.002045	-132.8	-0.3891	0.314	0.366	2.764
400.0	0.002096	-104.8	-0.3184	0.283	0.338	2.818
410.0	0.002150	-76.3	-0.2481	0.255	0.312	2.872
420.0	0.002209	-47.3	-0.1782	0.229	0.287	2.925
430.0	0.002273	-17.7	-0.1087	0.206	0.263	2.979
440.0	0.002342	12.3	-0.0395	0.185	0.242	3.031
450.0	0.002417	43.0	0.0292	0.166	0.221	3.082
460.0	0.002498	74.1	0.0975	0.150	0.203	3.132
470.0	0.002586	105.7	0.1654	0.136	0.1853	3.179
480.0	0.002682	137.7	0.2329	0.123	0.1693	3.222
490.0	0.002784	170.2	0.2998	0.113	0.1548	3.262
500.0	0.002895	203.0	0.3661	0.1044	0.1416	3.296
510.0	0.003012	236.1	0.4317	0.0975	0.1298	3.326
520.0	0.003137	269.5	0.4965	0.0921	0.1191	3.349
530.0	0.003267	303.1	0.5605	0.0880	0.1096	3.367
540.0	0.003403	336.9	0.6236	0.0851	0.1011	3.381
550.0	0.003543	370.8	0.6857	0.0831	0.0936	3.391
560.0	0.003686	404.8	0.7469	0.0819	0.0870	3.398
570.0	0.003832	438.8	0.8071	0.0814	0.0811	3.404
580.0	0.003979	472.9	0.8664	0.0814	0.0759	3.409
590.0	0.004127	507.0	0.9247	0.0820	0.0712	3.414
600.0	0.004276	541.2	0.9822	0.0828	0.0671	3.419



TABLE A2. (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P = 18 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001559	-489.1	-1.5386	1.219	1.079	2.065
250.0	0.001581	-468.3	-1.4538	1.134	1.010	2.103
260.0	0.001604	-447.1	-1.3710	1.053	0.946	2.137
270.0	0.001627	-425.7	-1.2901	0.976	0.886	2.171
280.0	0.001652	-403.8	-1.2105	0.903	0.830	2.208
290.0	0.001677	-381.4	-1.1322	0.833	0.777	2.248
300.0	0.001704	-358.7	-1.0552	0.768	0.726	2.291
310.0	0.001732	-335.5	-0.9793	0.707	0.679	2.337
320.0	0.001761	-311.9	-0.9043	0.650	0.634	2.385
330.0	0.001792	-287.8	-0.8301	0.596	0.592	2.434
340.0	0.001825	-263.1	-0.7567	0.546	0.552	2.484
350.0	0.001860	-238.0	-0.6839	0.500	0.514	2.535
360.0	0.001896	-212.4	-0.6117	0.457	0.478	2.586
370.0	0.001935	-186.2	-0.5401	0.417	0.444	2.637
380.0	0.001976	-159.6	-0.4690	0.380	0.413	2.689
390.0	0.002020	-132.4	-0.3985	0.346	0.383	2.740
400.0	0.002067	-104.7	-0.3285	0.314	0.355	2.790
410.0	0.002116	-76.5	-0.2589	0.286	0.328	2.840
420.0	0.002170	-47.8	-0.1898	0.260	0.304	2.890
430.0	0.002227	-18.6	-0.1212	0.236	0.281	2.939
440.0	0.002288	11.0	-0.0530	0.214	0.259	2.987
450.0	0.002354	41.2	0.0147	0.195	0.239	3.033
460.0	0.002424	71.8	0.0819	0.178	0.220	3.078
470.0	0.002499	102.8	0.1486	0.163	0.203	3.121
480.0	0.002580	134.3	0.2148	0.150	0.1869	3.162
490.0	0.002665	166.1	0.2804	0.138	0.1722	3.200
500.0	0.002757	198.3	0.3454	0.129	0.1588	3.234
510.0	0.002853	230.8	0.4098	0.121	0.1466	3.265
520.0	0.002955	263.7	0.4735	0.114	0.1355	3.293
530.0	0.003062	296.7	0.5365	0.108	0.1255	3.317
540.0	0.003173	330.0	0.5987	0.104	0.1165	3.337
550.0	0.003288	363.5	0.6601	0.101	0.1083	3.354
560.0	0.003406	397.1	0.7207	0.098	0.1010	3.369
570.0	0.003526	430.9	0.7804	0.097	0.0945	3.383
580.0	0.003649	464.8	0.8394	0.096	0.0886	3.394
590.0	0.003773	498.8	0.8975	0.095	0.0833	3.405
600.0	0.003899	532.9	0.9549	0.095	0.0786	3.416

TABLE A2.(CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ALONG ISOBARS

SUPERCRITICAL PRESSURES

P = 20 MPA

T DEG K	V M3/KG	H KJ/KG	S KJ/(KG.K)	DP/DD	DP/DT	CP KJ/(KG.K)
240.0	0.001555	-487.0	-1.5429	1.263	1.104	2.062
250.0	0.001577	-466.2	-1.4582	1.176	1.033	2.099
260.0	0.001599	-445.1	-1.3756	1.093	0.967	2.133
270.0	0.001622	-423.7	-1.2948	1.014	0.905	2.166
280.0	0.001646	-401.9	-1.2154	0.939	0.848	2.202
290.0	0.001671	-379.6	-1.1374	0.869	0.794	2.242
300.0	0.001697	-356.9	-1.0607	0.803	0.743	2.284
310.0	0.001724	-333.8	-0.9850	0.741	0.695	2.329
320.0	0.001752	-310.3	-0.9103	0.683	0.650	2.375
330.0	0.001782	-286.3	-0.8364	0.629	0.607	2.423
340.0	0.001813	-261.7	-0.7633	0.579	0.567	2.472
350.0	0.001846	-236.7	-0.6908	0.532	0.529	2.522
360.0	0.001881	-211.2	-0.6191	0.488	0.493	2.571
370.0	0.001918	-185.2	-0.5479	0.448	0.460	2.621
380.0	0.001957	-158.8	-0.4773	0.411	0.428	2.670
390.0	0.001998	-131.8	-0.4072	0.376	0.398	2.719
400.0	0.002041	-104.3	-0.3377	0.345	0.370	2.767
410.0	0.002087	-76.4	-0.2688	0.316	0.344	2.815
420.0	0.002136	-47.9	-0.2003	0.289	0.319	2.862
430.0	0.002188	-19.1	-0.1324	0.265	0.296	2.908
440.0	0.002243	10.3	-0.0650	0.243	0.275	2.953
450.0	0.002301	40.1	0.0019	0.224	0.255	2.996
460.0	0.002364	70.3	0.0682	0.206	0.236	3.038
470.0	0.002430	100.9	0.1340	0.190	0.219	3.079
480.0	0.002500	131.9	0.1993	0.176	0.203	3.117
490.0	0.002574	163.3	0.2640	0.164	0.1879	3.154
500.0	0.002652	195.1	0.3281	0.153	0.1743	3.188
510.0	0.002735	227.1	0.3916	0.144	0.1618	3.220
520.0	0.002821	259.5	0.4544	0.136	0.1505	3.249
530.0	0.002911	292.1	0.5165	0.129	0.1401	3.275
540.0	0.003005	325.0	0.5780	0.124	0.1306	3.299
550.0	0.003101	358.1	0.6387	0.120	0.1220	3.321
560.0	0.003201	391.4	0.6987	0.116	0.1142	3.340
570.0	0.003303	424.9	0.7580	0.113	0.1072	3.358
580.0	0.003408	458.6	0.8166	0.111	0.1008	3.375
590.0	0.003514	492.5	0.8745	0.110	0.0950	3.390
600.0	0.003621	526.5	0.9316	0.109	0.0897	3.405

## APPENDIX B.

### Tables of Values for the Thermodynamic Properties of the 0.1 Mole Fraction Isopentane in Isobutane Mixture in Engineering Units.

Table B1 presents properties for both the dew-points and the bubble-points and at increments of both temperature and pressure. Also shown are the concentrations and thermodynamic properties of the coexisting phase.

Table B2 presents properties along isobars at increments of temperature. Part A shows isobars in the vapor region, part B shows isobars in the liquid, and part C shows isobars at supercritical pressures. Where appropriate, the concentrations and values for the thermodynamic properties of the coexisting phase are also shown.

TABLE B1A. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY

THE DEW POINT AT INCREMENTS OF PRESSURE  
FOR THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE

P PSIA	VAPOR, X = 0.1000			COEXISTING LIQUID			
	T DEG F	V FT3/LB	H BTU/LB	X	V FT3/LB	H BTU/LB	S BTU/LB-F
4.0	-28.51	19.164	-53.75	0.3903	0.02502	-235.67	-0.36544
5.0	-20.52	15.574	-51.20	0.3784	0.02521	-231.09	-0.35599
6.0	-13.72	13.148	-49.03	0.3686	0.02538	-227.18	-0.34800
8.0	-2.46	10.060	-45.40	0.3532	0.02567	-220.66	-0.33492
10.0	6.76	8.174	-42.41	0.3413	0.02591	-215.29	-0.32433
12.0	14.62	6.897	-39.84	0.3316	0.02612	-210.68	-0.31538
14.696	23.75	5.708	-36.86	0.3209	0.02637	-205.31	-0.30509
20.0	38.43	4.2773	-32.01	0.3046	0.02680	-196.53	-0.28861
25.0	49.73	3.4679	-28.26	0.2929	0.02714	-189.68	-0.27603
30.0	59.42	2.9195	-25.04	0.2834	0.02745	-183.76	-0.26535
35.0	67.94	2.5224	-22.21	0.2754	0.02773	-178.51	-0.25603
40.0	75.58	2.2212	-19.68	0.2685	0.02800	-173.77	-0.24771
45.0	82.52	1.9844	-17.38	0.2624	0.02824	-169.43	-0.24019
50.0	88.91	1.7933	-15.27	0.2570	0.02848	-165.41	-0.23301
55.0	94.83	1.6357	-13.32	0.2521	0.02870	-161.66	-0.22694
60.0	100.36	1.5033	-11.51	0.2476	0.02892	-158.13	-0.22101
70.0	110.46	1.2932	-8.22	0.2396	0.02932	-151.63	-0.21022
80.0	119.52	1.1337	-5.28	0.2327	0.02971	-145.72	-0.20056
90.0	127.78	1.0084	-2.64	0.2266	0.03008	-140.27	-0.19179
100.0	135.39	0.9072	-0.23	0.2211	0.03044	-135.19	-0.18372
110.0	142.44	0.8236	1.99	0.2161	0.03079	-130.43	-0.17624
120.0	149.04	0.7535	4.03	0.2115	0.03113	-125.93	-0.16925
140.0	161.10	0.6421	7.70	0.2034	0.03180	-117.58	-0.15646
160.0	171.94	0.5574	10.91	0.1963	0.03245	-109.92	-0.14495
180.0	181.82	0.4907	13.75	0.1900	0.03310	-102.81	-0.13442
200.0	190.92	0.4368	16.28	0.1842	0.03375	-96.12	-0.12469
220.0	199.37	0.3922	18.53	0.1790	0.03440	-89.80	-0.11561
240.0	207.26	0.3546	20.53	0.1741	0.03507	-83.77	-0.10706
260.0	214.68	0.3224	22.32	0.1696	0.03576	-78.00	-0.09897
280.0	221.68	0.2945	23.90	0.1652	0.03647	-72.42	-0.09126
300.0	228.31	0.2700	25.29	0.1611	0.03721	-67.03	-0.08387
320.0	234.61	0.2482	26.49	0.1572	0.03799	-61.79	-0.07677
340.0	240.62	0.2288	27.50	0.1534	0.03882	-56.66	-0.06989
360.0	246.35	0.2111	28.32	0.1497	0.03970	-51.63	-0.06320
380.0	251.84	0.1950	28.94	0.1460	0.04065	-46.66	-0.05667
400.0	257.09	0.1802	29.34	0.1424	0.04169	-41.74	-0.05024
420.0	262.14	0.1663	29.50	0.1388	0.04284	-36.82	-0.04387
440.0	266.98	0.1533	29.38	0.1351	0.04415	-31.86	-0.03751
460.0	271.62	0.1408	28.92	0.1313	0.04566	-26.81	-0.03108
480.0	276.07	0.1287	28.01	0.1272	0.04749	-21.56	-0.02445
500.0	280.33	0.1166	26.50	0.1213	0.04991	-15.78	-0.01728



TABLE B1B. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY

THE DEW POINT AT INCREMENTS OF TEMPERATURE  
FOR THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE

T DEG F	VAPOR, X = 0.1000			COEXISTING LIQUID				
	P PSIA	V FT3/LB	H BTU/LB	S BTU/LB-F	X	V FT3/LB	H BTU/LB	S BTU/LB-F
-30.0	3.833	19.9402	-54.22	0.03025	0.3926	0.02498	-236.52	-0.36721
-20.0	5.071	15.3704	-51.04	0.02837	0.3776	0.02527	-230.79	-0.35537
-10.0	6.611	12.0135	-47.83	0.02689	0.3634	0.02547	-225.03	-0.34366
0.0	8.500	9.5093	-44.60	0.02579	0.3500	0.02573	-219.23	-0.33208
10.0	10.790	7.6144	-41.35	0.02503	0.3372	0.02600	-213.39	-0.32063
20.0	13.537	6.1629	-38.09	0.02459	0.3252	0.02627	-207.52	-0.30930
23.746	14.696	5.7078	-36.86	0.02449	0.3209	0.02637	-205.31	-0.30509
30.0	16.801	5.0363	-34.80	0.02443	0.3138	0.02655	-201.60	-0.29808
40.0	20.64	4.1523	-31.49	0.02455	0.3030	0.02685	-195.59	-0.28686
50.0	25.13	3.4513	-28.17	0.02491	0.2927	0.02715	-189.52	-0.27574
60.0	30.32	2.8900	-24.85	0.02547	0.2829	0.02780	-183.40	-0.26471
70.0	36.30	2.4364	-21.53	0.02621	0.2736	0.02780	-177.24	-0.25378
80.0	43.13	2.0666	-18.21	0.02710	0.2646	0.02815	-171.01	-0.24292
90.0	50.90	1.7629	-14.91	0.02813	0.2561	0.02852	-164.72	-0.23213
100.0	59.67	1.5115	-11.63	0.02927	0.2478	0.02890	-158.36	-0.22140
110.0	69.52	1.3019	-8.37	0.03051	0.2399	0.02931	-151.92	-0.21071
120.0	80.55	1.1261	-5.13	0.03184	0.2323	0.02973	-145.40	-0.20006
130.0	92.83	0.9776	-1.93	0.03323	0.2250	0.03018	-138.80	-0.18944
140.0	106.46	0.8515	1.22	0.03467	0.2178	0.03067	-132.08	-0.17883
150.0	121.51	0.7439	4.33	0.03614	0.2109	0.03118	-125.28	-0.16823
160.0	138.08	0.6514	7.37	0.03762	0.2041	0.03173	-118.35	-0.15763
170.0	156.27	0.5716	10.35	0.03909	0.1976	0.03233	-111.31	-0.14701
180.0	176.18	0.5024	13.24	0.04053	0.1911	0.03297	-104.13	-0.13637
190.0	197.90	0.4420	16.02	0.04192	0.1848	0.03368	-96.81	-0.12568
200.0	221.6	0.3890	18.69	0.04322	0.1786	0.03445	-89.32	-0.11492
210.0	247.2	0.3424	21.21	0.04439	0.1724	0.03532	-81.65	-0.10408
220.0	275.1	0.3010	23.53	0.04539	0.1663	0.03630	-73.77	-0.09311
230.0	305.3	0.2640	25.63	0.04614	0.1601	0.03742	-65.64	-0.08198
240.0	337.9	0.2307	27.41	0.04655	0.1538	0.03873	-57.19	-0.07060
250.0	373.2	0.2003	28.75	0.04647	0.1473	0.04031	-48.35	-0.05887
255.0	391.9	0.1860	29.21	0.04617	0.1439	0.04125	-43.73	-0.05282
260.0	411.4	0.1722	29.46	0.04562	0.1404	0.04233	-38.93	-0.04660
265.0	431.7	0.1586	29.47	0.04477	0.1367	0.04358	-33.92	-0.04014
270.0	452.9	0.1452	29.12	0.04347	0.1327	0.04510	-28.61	-0.03336
275.0	475.1	0.1316	28.28	0.04154	0.1283	0.04701	-22.88	-0.02610

TABLE B1C. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY  
 THE BUBBLE POINT AT INCREMENTS OF PRESSURE  
 FOR THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE

P PSIA	LIQUID, X = 0.1000			COEXISTING VAPOR				
	T DEG F	V FT3/LB	H BTU/LB	S BTU/LB-F	X	V FT3/LB	H BTU/LB	S BTU/LB-F
4.0	-38.68	0.02546	-223.76	-0.37041	0.0186	19.10730	-51.66	0.02530
5.0	-30.55	0.02565	-219.70	-0.36089	0.0196	15.5063	-49.17	0.02383
6.0	-23.64	0.02581	-216.22	-0.35285	0.0204	13.0941	-47.04	0.02280
8.0	-12.19	0.02608	-210.38	-0.33968	0.0218	10.0251	-43.48	0.02148
10.0	-2.82	0.02632	-205.54	-0.32902	0.0230	8.1480	-40.56	0.02073
12.0	5.18	0.02652	-201.38	-0.32002	0.0240	6.8771	-38.05	0.02032
14.696	14.45	0.02677	-196.51	-0.30968	0.0252	5.6938	-35.13	0.02006
20.0	29.39	0.02718	-188.54	-0.29322	0.0271	4.2688	-30.41	0.02012
25.0	40.88	0.02751	-182.29	-0.28066	0.0287	3.4619	-26.76	0.02052
30.0	50.73	0.02781	-176.86	-0.26998	0.0300	2.9151	-23.63	0.02107
35.0	59.40	0.02809	-172.02	-0.26064	0.0312	2.5191	-20.88	0.02170
40.0	67.17	0.02834	-167.63	-0.25231	0.0323	2.2185	-18.41	0.02237
45.0	74.24	0.02858	-163.60	-0.24477	0.0333	1.9822	-16.18	0.02305
50.0	80.74	0.02881	-159.85	-0.23785	0.0342	1.7915	-14.12	0.02374
55.0	86.77	0.02903	-156.34	-0.23146	0.0351	1.6341	-12.23	0.02442
60.0	92.41	0.02924	-153.04	-0.22550	0.0360	1.5020	-10.47	0.02509
70.0	102.70	0.02964	-146.93	-0.21465	0.0375	1.2922	-7.26	0.02640
80.0	111.95	0.03002	-141.35	-0.20492	0.0389	1.1329	-4.40	0.02765
90.0	120.38	0.03039	-136.20	-0.19608	0.0403	1.0077	-1.83	0.02885
100.0	128.14	0.03074	-131.38	-0.18794	0.0415	0.9066	0.53	0.02998
110.0	135.35	0.03108	-126.85	-0.18039	0.0427	0.8231	2.68	0.03105
120.0	142.09	0.03142	-122.57	-0.17333	0.0438	0.7530	4.68	0.03207
140.0	154.42	0.03207	-114.59	-0.16041	0.0460	0.6417	8.26	0.03396
160.0	165.53	0.03272	-107.24	-0.14876	0.0480	0.5570	11.39	0.03566
180.0	175.66	0.03336	-100.39	-0.13810	0.0499	0.4904	14.16	0.03717
200.0	185.00	0.03400	-93.94	-0.12823	0.0517	0.4365	16.63	0.03853
220.0	193.68	0.03465	-87.83	-0.11901	0.0535	0.3919	18.82	0.03973
240.0	201.80	0.03532	-81.99	-0.11033	0.0553	0.3543	20.78	0.04078
260.0	209.44	0.03600	-76.37	-0.10210	0.0570	0.3221	22.52	0.04168
280.0	216.66	0.03670	-70.96	-0.09426	0.0587	0.2942	24.07	0.04244
300.0	223.52	0.03744	-65.70	-0.08673	0.0604	0.2697	25.42	0.04305
320.0	230.04	0.03822	-60.59	-0.07949	0.0621	0.2479	26.59	0.04351
340.0	236.27	0.03904	-55.58	-0.07247	0.0638	0.2284	27.57	0.04381
360.0	242.24	0.03991	-50.65	-0.06564	0.0656	0.2108	28.36	0.04393
380.0	247.96	0.04086	-45.79	-0.05895	0.0674	0.1947	28.95	0.04386
400.0	253.46	0.04190	-40.95	-0.05237	0.0692	0.1798	29.33	0.04358
420.0	258.76	0.04305	-36.12	-0.04584	0.0712	0.1660	29.47	0.04304
440.0	263.87	0.04436	-31.24	-0.03930	0.0733	0.1529	29.32	0.04220
460.0	268.80	0.04588	-26.26	-0.03267	0.0756	0.1405	28.84	0.04097
480.0	273.58	0.04771	-21.08	-0.02583	0.0782	0.1283	27.90	0.03921
500.0	278.21	0.05006	-15.54	-0.01655	0.0812	0.1160	26.33	0.03670

TABLE B10. THERMODYNAMIC PROPERTIES ON THE VAPOR-LIQUID PHASE BOUNDARY  
 THE BUBBLE POINT AT INCREMENTS OF TEMPERATURE  
 FOR THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE

T DEG F	LIQUID, X = 0.1000				----- COEXISTING VAPOR -----			
	P PSIA	FT3/LB	H BTU/LB	S BTU/LB-F	X	V FT3/LB	H BTU/LB	S BTU/LB-F
-30.0	5.075	0.02566	-219.43	-0.36024	0.0196	15.2952	-49.00	0.02374
-20.0	6.587	0.02589	-214.37	-0.34864	0.0209	12.0077	-45.92	0.02232
-10.0	8.436	0.02614	-209.25	-0.33718	0.0221	9.5429	-42.80	0.02128
0.0	10.672	0.02639	-204.08	-0.32584	0.0233	7.6699	-39.67	0.02056
10.0	13.348	0.02665	-198.85	-0.31463	0.0246	6.2278	-36.53	0.02015
14.453	14.696	0.02677	-196.51	-0.30968	0.0252	5.6938	-35.13	0.02006
20.0	16.520	0.02692	-193.56	-0.30354	0.0259	5.1046	-33.38	0.02002
30.0	20.24	0.02720	-188.21	-0.29255	0.0272	4.2203	-30.21	0.02013
40.0	24.59	0.02749	-182.77	-0.28161	0.0286	3.5167	-27.04	0.02048
50.0	29.61	0.02779	-177.26	-0.27076	0.0299	2.9518	-23.86	0.02102
60.0	35.37	0.02811	-171.68	-0.25999	0.0313	2.4940	-20.69	0.02175
70.0	41.95	0.02844	-166.02	-0.24929	0.0327	2.1200	-17.52	0.02263
80.0	49.41	0.02879	-160.28	-0.23864	0.0341	1.8121	-14.36	0.02366
90.0	57.82	0.02915	-154.45	-0.22805	0.0356	1.5568	-11.22	0.02480
100.0	67.26	0.02953	-148.54	-0.21749	0.0371	1.3436	-8.10	0.02605
110.0	77.81	0.02994	-142.53	-0.20697	0.0386	1.1644	-5.00	0.02738
120.0	89.54	0.03037	-136.43	-0.19647	0.0402	1.0129	-1.94	0.02879
130.0	102.52	0.03082	-130.22	-0.18599	0.0418	0.8841	1.09	0.03025
140.0	116.83	0.03131	-123.90	-0.17552	0.0435	0.7740	4.06	0.03176
150.0	132.57	0.03183	-117.47	-0.16504	0.0452	0.6793	6.99	0.03328
160.0	149.80	0.03239	-110.91	-0.15456	0.0470	0.5975	9.84	0.03481
170.0	168.62	0.03299	-104.23	-0.14405	0.0488	0.5265	12.63	0.03633
180.0	189.11	0.03365	-97.41	-0.13351	0.0508	0.4645	15.32	0.03781
190.0	211.4	0.03437	-90.43	-0.12292	0.0528	0.4102	17.90	0.03923
200.0	235.5	0.03516	-83.29	-0.11226	0.0549	0.3623	20.35	0.04055
210.0	261.5	0.03605	-75.96	-0.10150	0.0571	0.3198	22.65	0.04174
220.0	289.6	0.03705	-68.42	-0.09061	0.0595	0.2820	24.74	0.04275
230.0	319.9	0.03821	-60.62	-0.07954	0.0621	0.2481	26.58	0.04351
240.0	352.4	0.03957	-52.52	-0.06822	0.0649	0.2173	28.08	0.04391
250.0	387.3	0.04123	-44.02	-0.05653	0.0680	0.1891	29.12	0.04379
255.0	405.7	0.04221	-39.57	-0.05049	0.0698	0.1758	29.40	0.04345
260.0	424.8	0.04335	-34.96	-0.04427	0.0717	0.1628	29.46	0.04287
265.0	444.5	0.04468	-30.12	-0.03781	0.0738	0.1501	29.25	0.04196
270.0	465.0	0.04630	-25.00	-0.03100	0.0762	0.1374	28.65	0.04059
275.0	486.1	0.04836	-19.45	-0.02368	0.0790	0.1246	27.50	0.03954



TABLE B2A. THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS IN THE VAPOR

VAPOR 1 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	75.39	-57.12	0.0680	75.1	0.00240	0.327
-30.0	77.20	-53.83	0.0757	76.9	0.00234	0.333
-20.0	79.02	-50.49	0.0834	78.8	0.00229	0.339
-10.0	80.83	-47.09	0.0910	80.6	0.00224	0.344
0.0	82.64	-43.64	0.0986	82.4	0.00219	0.350
10.0	84.45	-40.13	0.1062	84.2	0.00214	0.356
20.0	86.26	-36.56	0.1137	86.1	0.00209	0.363
30.0	88.07	-32.93	0.1212	87.9	0.00205	0.369
40.0	89.88	-29.21	0.1287	89.7	0.00201	0.375
50.0	91.69	-25.43	0.1362	91.5	0.00197	0.381
60.0	93.50	-21.59	0.1437	93.3	0.00193	0.387
70.0	95.31	-17.69	0.1511	95.1	0.00189	0.393
80.0	97.12	-13.72	0.1585	97.0	0.00186	0.399
90.0	98.93	-9.69	0.1659	98.8	0.00183	0.406
100.0	100.74	-5.60	0.1733	100.6	0.00179	0.412
110.0	102.55	-1.45	0.1806	102.4	0.00176	0.418
120.0	104.36	2.76	0.1880	104.2	0.00173	0.424
130.0	106.16	7.04	0.1953	106.0	0.00170	0.431
140.0	107.97	11.38	0.2026	107.8	0.00167	0.437
150.0	109.78	15.78	0.2099	109.6	0.00164	0.443
160.0	111.59	20.24	0.2171	111.5	0.00162	0.449
170.0	113.39	24.77	0.2244	113.3	0.00159	0.456
180.0	115.20	29.36	0.2316	115.1	0.00157	0.462
190.0	117.01	34.01	0.2388	116.9	0.00154	0.468
200.0	118.81	38.72	0.2460	118.7	0.00152	0.474
210.0	120.62	43.49	0.2532	120.5	0.00150	0.481
220.0	122.42	48.33	0.2604	122.3	0.00147	0.487
230.0	124.23	53.22	0.2675	124.1	0.00145	0.493
240.0	126.04	58.18	0.2746	125.9	0.00143	0.499
250.0	127.84	63.20	0.2818	127.7	0.00141	0.505
260.0	129.65	68.28	0.2889	129.6	0.00139	0.511
270.0	131.45	73.42	0.2960	131.4	0.00137	0.517
280.0	133.26	78.62	0.3030	133.2	0.00135	0.523
290.0	135.06	83.88	0.3101	135.0	0.00134	0.529
300.0	136.87	89.19	0.3172	136.8	0.00132	0.535
310.0	138.68	94.57	0.3242	138.6	0.00130	0.541
320.0	140.48	100.01	0.3312	140.4	0.00128	0.546
330.0	142.29	105.50	0.3382	142.2	0.00127	0.552
340.0	144.09	111.05	0.3452	144.0	0.00125	0.558
350.0	145.90	116.65	0.3521	145.8	0.00124	0.564
360.0	147.70	122.32	0.3591	147.6	0.00122	0.569
370.0	149.50	128.04	0.3660	149.4	0.00121	0.575
380.0	151.31	133.81	0.3730	151.2	0.00119	0.580
390.0	153.11	139.64	0.3799	153.1	0.00118	0.586
400.0	154.92	145.53	0.3867	154.9	0.00116	0.591
420.0	158.53	157.46	0.4005	158.5	0.00114	0.602
440.0	162.14	169.60	0.4141	162.1	0.00111	0.613
460.0	165.75	181.95	0.4277	165.7	0.00109	0.623
480.0	169.35	194.51	0.4412	169.3	0.00107	0.633
500.0	172.96	207.27	0.4546	172.9	0.00104	0.643
520.0	176.57	220.22	0.4680	176.5	0.00102	0.653
540.0	180.18	233.38	0.4813	180.1	0.00100	0.663
560.0	183.79	246.72	0.4945	183.7	0.00098	0.672
580.0	187.40	260.26	0.5076	187.4	0.00096	0.682
600.0	191.00	273.98	0.5207	191.0	0.00094	0.691



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

5 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID	H BTU/LB (X= .3784)	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-20.52	0.02521	-231.09	-0.3560	1829.	62.07	0.495
-20.52	15.574	-51.20	0.0285	76.6	0.01174	0.340
-20.0	15.597	-51.03	0.0289	76.7	0.01173	0.341
-10.0	15.968	-47.61	0.0365	78.6	0.01144	0.347
0.0	16.339	-44.14	0.0442	80.5	0.01117	0.352
10.0	16.710	-40.61	0.0518	82.4	0.01092	0.358
20.0	17.079	-37.02	0.0593	84.3	0.01068	0.364
30.0	17.448	-33.37	0.0669	86.2	0.01044	0.370
40.0	17.817	-29.64	0.0744	88.1	0.01022	0.376
50.0	18.185	-25.85	0.0819	90.0	0.01001	0.382
60.0	18.553	-21.99	0.0894	91.8	0.00981	0.388
70.0	18.920	-18.07	0.0969	93.7	0.00961	0.395
80.0	19.287	-14.09	0.1043	95.6	0.00943	0.401
90.0	19.654	-10.06	0.1117	97.4	0.00925	0.407
100.0	20.021	-5.95	0.1191	99.3	0.00907	0.413
110.0	20.387	-1.79	0.1265	101.2	0.00891	0.419
120.0	20.753	2.43	0.1339	103.0	0.00875	0.425
130.0	21.118	6.72	0.1412	104.9	0.00859	0.432
140.0	21.484	11.07	0.1485	106.7	0.00845	0.438
150.0	21.849	15.48	0.1558	108.6	0.00830	0.444
160.0	22.214	19.95	0.1631	110.4	0.00816	0.450
170.0	22.578	24.49	0.1703	112.3	0.00803	0.457
180.0	22.943	29.08	0.1776	114.1	0.00790	0.463
190.0	23.307	33.74	0.1848	116.0	0.00778	0.469
200.0	23.672	38.46	0.1920	117.8	0.00766	0.475
210.0	24.036	43.24	0.1992	119.6	0.00754	0.481
220.0	24.400	48.08	0.2064	121.5	0.00742	0.487
230.0	24.764	52.99	0.2135	123.3	0.00731	0.493
240.0	25.127	57.95	0.2207	125.1	0.00721	0.499
250.0	25.491	62.97	0.2278	127.0	0.00710	0.506
260.0	25.854	68.06	0.2349	128.8	0.00700	0.512
270.0	26.218	73.20	0.2420	130.6	0.00690	0.517
280.0	26.581	78.41	0.2491	132.5	0.00681	0.523
290.0	26.944	83.67	0.2562	134.3	0.00672	0.529
300.0	27.307	88.99	0.2632	136.1	0.00663	0.535
310.0	27.670	94.38	0.2703	137.9	0.00654	0.541
320.0	28.033	99.81	0.2773	139.8	0.00645	0.547
330.0	28.396	105.31	0.2843	141.6	0.00637	0.553
340.0	28.759	110.87	0.2913	143.4	0.00629	0.558
350.0	29.121	116.48	0.2983	145.2	0.00621	0.564
360.0	29.484	122.14	0.3052	147.1	0.00613	0.570
370.0	29.847	127.87	0.3122	148.9	0.00606	0.575
380.0	30.21	133.65	0.3191	150.7	0.00599	0.581
390.0	30.57	139.48	0.3260	152.5	0.00591	0.586
400.0	30.93	145.37	0.3329	154.4	0.00584	0.592
420.0	31.66	157.31	0.3466	158.0	0.00571	0.602
440.0	32.38	169.46	0.3603	161.6	0.00558	0.613
460.0	33.11	181.81	0.3738	165.3	0.00546	0.623
480.0	33.83	194.37	0.3874	168.9	0.00534	0.634
500.0	34.56	207.14	0.4008	172.5	0.00523	0.644
520.0	35.28	220.10	0.4142	176.2	0.00512	0.653
540.0	36.00	233.26	0.4275	179.8	0.00502	0.663
560.0	36.73	246.60	0.4407	183.4	0.00492	0.673
580.0	37.45	260.14	0.4538	187.1	0.00482	0.682
600.0	38.17	273.87	0.4669	190.7	0.00473	0.691

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

10 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
6.76	0.02591	-215.30	-0.3243	1617.4	57.31	0.514
6.76	8.174	-42.41	0.0252	79.4	0.02266	0.359
10.0	8.237	-41.25	0.0277	80.0	0.02247	0.361
20.0	8.427	-37.63	0.0353	82.0	0.02193	0.367
30.0	8.616	-33.95	0.0429	84.0	0.02141	0.373
40.0	8.805	-30.20	0.0505	86.0	0.02092	0.379
50.0	8.994	-26.38	0.0581	88.0	0.02046	0.384
60.0	9.182	-22.51	0.0656	89.9	0.02002	0.390
70.0	9.369	-18.57	0.0731	91.9	0.01960	0.396
80.0	9.556	-14.58	0.0806	93.8	0.01920	0.402
90.0	9.743	-10.52	0.0880	95.8	0.01881	0.409
100.0	9.929	-6.40	0.0955	97.7	0.01844	0.415
110.0	10.115	-2.22	0.1029	99.6	0.01809	0.421
120.0	10.301	2.02	0.1102	101.5	0.01775	0.427
130.0	10.486	6.32	0.1176	103.4	0.01743	0.433
140.0	10.672	10.68	0.1249	105.3	0.01712	0.439
150.0	10.857	15.10	0.1322	107.2	0.01682	0.445
160.0	11.041	19.58	0.1395	109.1	0.01653	0.451
170.0	11.226	24.13	0.1468	111.0	0.01625	0.458
180.0	11.410	28.74	0.1541	112.9	0.01598	0.464
190.0	11.595	33.40	0.1613	114.8	0.01572	0.470
200.0	11.779	38.13	0.1685	116.6	0.01547	0.476
210.0	11.962	42.92	0.1757	118.5	0.01522	0.482
220.0	12.146	47.77	0.1829	120.4	0.01499	0.488
230.0	12.330	52.66	0.1901	122.3	0.01476	0.494
240.0	12.513	57.66	0.1973	124.1	0.01454	0.500
250.0	12.697	62.69	0.2044	126.0	0.01432	0.506
260.0	12.880	67.78	0.2115	127.9	0.01412	0.512
270.0	13.063	72.93	0.2186	129.7	0.01391	0.518
280.0	13.246	78.14	0.2257	131.6	0.01372	0.524
290.0	13.429	83.41	0.2328	133.4	0.01353	0.530
300.0	13.612	88.74	0.2399	135.3	0.01334	0.536
310.0	13.794	94.13	0.2469	137.1	0.01316	0.542
320.0	13.977	99.58	0.2539	139.0	0.01299	0.547
330.0	14.160	105.08	0.2610	140.8	0.01282	0.553
340.0	14.342	110.64	0.2680	142.7	0.01266	0.559
350.0	14.525	116.25	0.2749	144.5	0.01249	0.564
360.0	14.707	121.93	0.2819	146.4	0.01234	0.570
370.0	14.889	127.65	0.2888	148.2	0.01218	0.576
380.0	15.071	133.44	0.2958	150.1	0.01203	0.581
390.0	15.254	139.27	0.3027	151.9	0.01189	0.587
400.0	15.436	145.17	0.3096	153.7	0.01175	0.592
420.0	15.800	157.11	0.3233	157.4	0.01147	0.603
440.0	16.164	169.27	0.3370	161.1	0.01121	0.613
460.0	16.527	181.64	0.3506	164.7	0.01096	0.624
480.0	16.891	194.20	0.3641	168.4	0.01073	0.634
500.0	17.254	206.97	0.3775	172.1	0.01050	0.644
520.0	17.617	219.94	0.3909	175.7	0.01028	0.654
540.0	17.980	233.10	0.4042	179.4	0.01007	0.663
560.0	18.343	246.46	0.4174	183.0	0.00987	0.673
580.0	18.706	260.00	0.4306	186.7	0.00968	0.682
600.0	19.069	273.73	0.4437	190.3	0.00949	0.691

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

14.696 PSIA

T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
COEXISTING LIQUID (X=.3209)						
23.75	0.02637	-205.31	-0.3051	1481.2	54.17	0.525
23.75	5.708	-36.86	0.0245	80.6	0.03280	0.372
30.0	5.792	-34.53	0.0293	81.9	0.03228	0.375
40.0	5.923	-30.75	0.0369	84.0	0.03148	0.381
50.0	6.055	-26.91	0.0445	86.0	0.03074	0.387
60.0	6.185	-23.01	0.0521	88.1	0.03003	0.393
70.0	6.316	-19.06	0.0596	90.1	0.02936	0.398
80.0	6.445	-15.04	0.0672	92.1	0.02872	0.404
90.0	6.575	-10.97	0.0746	94.1	0.02812	0.410
100.0	6.704	-6.83	0.0821	96.1	0.02754	0.416
110.0	6.832	-2.64	0.0895	98.1	0.02699	0.422
120.0	6.961	1.61	0.0959	100.1	0.02646	0.428
130.0	7.089	5.93	0.1043	102.0	0.02596	0.434
140.0	7.216	10.30	0.1116	104.0	0.02548	0.440
150.0	7.344	14.74	0.1190	105.9	0.02501	0.446
160.0	7.471	19.23	0.1263	107.9	0.02457	0.453
170.0	7.598	23.79	0.1336	109.8	0.02414	0.459
180.0	7.725	28.41	0.1409	111.7	0.02373	0.465
190.0	7.852	33.08	0.1481	113.7	0.02333	0.471
200.0	7.978	37.82	0.1554	115.6	0.02295	0.477
210.0	8.104	42.62	0.1626	117.5	0.02258	0.483
220.0	8.230	47.48	0.1698	119.4	0.02222	0.489
230.0	8.355	52.40	0.1770	121.3	0.02187	0.495
240.0	8.482	57.38	0.1841	123.2	0.02154	0.501
250.0	8.608	62.42	0.1913	125.1	0.02121	0.507
260.0	8.734	67.52	0.1984	127.0	0.02090	0.513
270.0	8.859	72.68	0.2055	128.9	0.02060	0.519
280.0	8.985	77.89	0.2127	130.7	0.02030	0.525
290.0	9.110	83.17	0.2197	132.6	0.02002	0.531
300.0	9.235	88.51	0.2268	134.5	0.01974	0.536
310.0	9.360	93.90	0.2339	136.4	0.01947	0.542
320.0	9.485	99.35	0.2409	138.2	0.01921	0.548
330.0	9.610	104.86	0.2479	140.1	0.01895	0.554
340.0	9.735	110.42	0.2549	142.0	0.01870	0.559
350.0	9.860	116.04	0.2619	143.8	0.01846	0.565
360.0	9.985	121.72	0.2689	145.7	0.01823	0.570
370.0	10.110	127.45	0.2758	147.6	0.01800	0.576
380.0	10.234	133.24	0.2827	149.4	0.01777	0.582
390.0	10.359	139.08	0.2897	151.3	0.01756	0.587
400.0	10.483	144.98	0.2966	153.1	0.01734	0.592
420.0	10.732	156.93	0.3103	156.9	0.01694	0.603
440.0	10.981	169.10	0.3240	160.6	0.01655	0.614
460.0	11.229	181.47	0.3376	164.3	0.01618	0.624
480.0	11.478	194.04	0.3511	167.9	0.01582	0.634
500.0	11.726	205.82	0.3646	171.6	0.01548	0.644
520.0	11.974	219.79	0.3779	175.3	0.01516	0.654
540.0	12.221	232.96	0.3913	179.0	0.01485	0.664
560.0	12.469	246.32	0.4045	182.7	0.01455	0.673
580.0	12.717	259.87	0.4176	186.3	0.01426	0.682
600.0	12.964	273.61	0.4307	190.0	0.01399	0.692



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

20 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID	H BTU/LB (X=.3046)	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
38.43	0.02680	-196.53	-0.2886	1363.5	51.38	0.535
38.43	4.277	-32.01	0.0245	81.2	0.04429	0.384
40.0	4.294	-31.41	0.0257	81.6	0.04410	0.384
50.0	4.393	-27.54	0.0334	83.8	0.04296	0.390
60.0	4.492	-23.61	0.0410	85.9	0.04188	0.395
70.0	4.590	-19.62	0.0486	88.1	0.04088	0.401
80.0	4.687	-15.58	0.0562	90.2	0.03993	0.407
90.0	4.784	-11.49	0.0637	92.3	0.03904	0.412
100.0	4.881	-7.33	0.0712	94.3	0.03819	0.418
110.0	4.977	-3.12	0.0786	96.4	0.03738	0.424
120.0	5.073	1.15	0.0861	98.4	0.03662	0.430
130.0	5.169	5.48	0.0935	100.4	0.03589	0.436
140.0	5.264	9.87	0.1009	102.5	0.03519	0.442
150.0	5.359	14.32	0.1082	104.5	0.03452	0.448
160.0	5.454	18.83	0.1156	106.5	0.03388	0.454
170.0	5.549	23.40	0.1229	108.4	0.03327	0.460
180.0	5.643	28.03	0.1302	110.4	0.03268	0.466
190.0	5.737	32.72	0.1375	112.4	0.03212	0.472
200.0	5.831	37.47	0.1447	114.3	0.03157	0.478
210.0	5.925	42.28	0.1519	116.3	0.03105	0.484
220.0	6.019	47.15	0.1592	118.2	0.03054	0.490
230.0	6.112	52.08	0.1664	120.2	0.03006	0.496
240.0	6.206	57.06	0.1735	122.1	0.02958	0.502
250.0	6.299	62.11	0.1807	124.0	0.02913	0.508
260.0	6.392	67.22	0.1879	126.0	0.02869	0.514
270.0	6.485	72.38	0.1950	127.9	0.02826	0.520
280.0	6.578	77.61	0.2021	129.8	0.02785	0.525
290.0	6.671	82.89	0.2092	131.7	0.02745	0.531
300.0	6.764	88.24	0.2163	133.6	0.02706	0.537
310.0	6.856	93.64	0.2233	135.5	0.02668	0.543
320.0	6.949	99.09	0.2304	137.4	0.02632	0.549
330.0	7.041	104.61	0.2374	139.3	0.02596	0.554
340.0	7.134	110.18	0.2444	141.2	0.02562	0.560
350.0	7.226	115.80	0.2514	143.1	0.02528	0.565
360.0	7.318	121.49	0.2584	145.0	0.02495	0.571
370.0	7.410	127.22	0.2653	146.8	0.02463	0.577
380.0	7.502	133.02	0.2723	148.7	0.02432	0.582
390.0	7.594	138.86	0.2792	150.6	0.02402	0.587
400.0	7.686	144.77	0.2861	152.5	0.02373	0.593
420.0	7.870	156.73	0.2999	156.2	0.02316	0.604
440.0	8.054	168.90	0.3135	160.0	0.02262	0.614
460.0	8.237	181.28	0.3271	163.7	0.02211	0.624
480.0	8.420	193.86	0.3407	167.4	0.02162	0.635
500.0	8.604	206.65	0.3541	171.1	0.02115	0.645
520.0	8.786	219.63	0.3675	174.8	0.02071	0.654
540.0	8.969	232.80	0.3808	178.6	0.02028	0.664
560.0	9.152	246.17	0.3941	182.3	0.01987	0.673
580.0	9.334	259.72	0.4072	186.0	0.01947	0.683
600.0	9.517	273.46	0.4203	189.6	0.01909	0.692



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

25 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID	H BTU/LB (X= .2929)	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
49.73	0.02714	-189.68	-0.2760	1273.9	49.22	0.543
49.73	3.468	-28.26	0.0249	81.5	0.05520	0.393
50.0	3.471	-28.15	0.0251	81.5	0.05516	0.393
60.0	3.552	-24.19	0.0328	83.8	0.05367	0.398
70.0	3.632	-20.18	0.0404	86.1	0.05228	0.404
80.0	3.712	-16.12	0.0481	88.3	0.05098	0.409
90.0	3.792	-12.00	0.0556	90.4	0.04977	0.415
100.0	3.870	-7.82	0.0631	92.6	0.04862	0.420
110.0	3.949	-3.59	0.0706	94.7	0.04754	0.426
120.0	4.027	0.70	0.0781	96.8	0.04652	0.432
130.0	4.105	5.05	0.0855	98.9	0.04555	0.438
140.0	4.182	9.46	0.0930	101.0	0.04462	0.443
150.0	4.259	13.92	0.1003	103.1	0.04374	0.449
160.0	4.336	18.45	0.1077	105.1	0.04290	0.455
170.0	4.413	23.03	0.1150	107.1	0.04210	0.461
180.0	4.489	27.67	0.1223	109.2	0.04133	0.467
190.0	4.566	32.37	0.1296	111.2	0.04059	0.473
200.0	4.642	37.13	0.1369	113.2	0.03988	0.479
210.0	4.718	41.95	0.1442	115.2	0.03920	0.485
220.0	4.793	46.83	0.1514	117.1	0.03855	0.491
230.0	4.869	51.77	0.1586	119.1	0.03792	0.497
240.0	4.944	56.76	0.1658	121.1	0.03731	0.503
250.0	5.019	61.82	0.1730	123.0	0.03672	0.509
260.0	5.095	66.93	0.1801	125.0	0.03615	0.514
270.0	5.170	72.11	0.1873	126.9	0.03560	0.520
280.0	5.244	77.34	0.1944	128.9	0.03507	0.526
290.0	5.319	82.63	0.2015	130.8	0.03456	0.532
300.0	5.394	87.98	0.2086	132.8	0.03406	0.538
310.0	5.469	93.39	0.2157	134.7	0.03358	0.543
320.0	5.543	98.85	0.2227	136.6	0.03311	0.549
330.0	5.618	104.37	0.2297	138.5	0.03265	0.555
340.0	5.692	109.95	0.2368	140.4	0.03221	0.560
350.0	5.766	115.58	0.2438	142.4	0.03178	0.566
360.0	5.840	121.27	0.2507	144.3	0.03137	0.572
370.0	5.915	127.01	0.2577	146.2	0.03096	0.577
380.0	5.989	132.81	0.2646	148.1	0.03057	0.582
390.0	6.063	138.66	0.2716	150.0	0.03018	0.588
400.0	6.137	144.56	0.2785	151.9	0.02981	0.593
420.0	6.284	156.54	0.2922	155.6	0.02909	0.604
440.0	6.432	168.72	0.3059	159.4	0.02840	0.614
460.0	6.579	181.10	0.3196	163.2	0.02775	0.625
480.0	6.726	193.69	0.3331	166.9	0.02713	0.635
500.0	6.873	206.48	0.3466	170.7	0.02654	0.645
520.0	7.020	219.47	0.3600	174.4	0.02597	0.655
540.0	7.167	232.65	0.3733	178.1	0.02543	0.664
560.0	7.314	246.02	0.3865	181.9	0.02491	0.674
580.0	7.460	259.58	0.3997	185.6	0.02442	0.683
600.0	7.607	273.33	0.4128	189.3	0.02394	0.692

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

30 PSIA

T DEG F COEXISTING LIQUID	V FT <sup>3</sup> /LB LIQUID (X=.2834)	H BTU/LB (X=.2834)	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
59.42	0.02745	-183.76	-0.2654	1196.3	47.37	0.550
59.42	2.920	-25.04	0.0254	81.5	0.06624	0.401
60.0	2.924	-24.81	0.0259	81.6	0.06612	0.402
70.0	2.993	-20.76	0.0336	84.0	0.06427	0.407
80.0	3.061	-16.67	0.0413	86.3	0.06256	0.412
90.0	3.129	-12.52	0.0489	88.6	0.06097	0.417
100.0	3.196	-8.32	0.0564	90.8	0.05948	0.423
110.0	3.263	-4.06	0.0640	93.0	0.05808	0.428
120.0	3.329	0.25	0.0715	95.2	0.05676	0.434
130.0	3.395	4.61	0.0789	97.4	0.05552	0.439
140.0	3.460	9.03	0.0864	99.5	0.05434	0.445
150.0	3.526	13.52	0.0938	101.6	0.05323	0.451
160.0	3.591	18.05	0.1012	103.7	0.05216	0.457
170.0	3.655	22.65	0.1085	105.8	0.05115	0.462
180.0	3.720	27.30	0.1159	107.9	0.05018	0.468
190.0	3.784	32.02	0.1232	109.9	0.04926	0.474
200.0	3.848	36.79	0.1305	112.0	0.04837	0.480
210.0	3.912	41.62	0.1377	114.0	0.04752	0.486
220.0	3.976	46.51	0.1450	116.0	0.04671	0.492
230.0	4.039	51.45	0.1522	118.1	0.04592	0.498
240.0	4.103	56.46	0.1594	120.1	0.04517	0.504
250.0	4.166	61.53	0.1666	122.1	0.04444	0.509
260.0	4.229	66.65	0.1738	124.0	0.04374	0.515
270.0	4.292	71.83	0.1809	126.0	0.04306	0.521
280.0	4.355	77.07	0.1881	128.0	0.04240	0.527
290.0	4.418	82.37	0.1952	130.0	0.04177	0.533
300.0	4.481	87.72	0.2023	131.9	0.04116	0.538
310.0	4.543	93.14	0.2093	133.9	0.04056	0.544
320.0	4.606	98.61	0.2164	135.8	0.03999	0.550
330.0	4.668	104.13	0.2234	137.8	0.03943	0.555
340.0	4.731	109.71	0.2305	139.7	0.03889	0.561
350.0	4.793	115.35	0.2375	141.6	0.03836	0.567
360.0	4.855	121.04	0.2445	143.6	0.03785	0.572
370.0	4.917	126.79	0.2514	145.5	0.03736	0.578
380.0	4.979	132.59	0.2584	147.4	0.03687	0.583
390.0	5.041	138.45	0.2653	149.3	0.03640	0.588
400.0	5.103	144.36	0.2722	151.2	0.03595	0.594
420.0	5.227	156.34	0.2860	155.0	0.03507	0.604
440.0	5.351	168.53	0.2997	158.8	0.03424	0.615
460.0	5.474	180.93	0.3133	162.6	0.03344	0.625
480.0	5.597	193.52	0.3269	166.4	0.03269	0.635
500.0	5.720	206.32	0.3404	170.2	0.03197	0.645
520.0	5.843	219.31	0.3538	174.0	0.03128	0.655
540.0	5.966	232.50	0.3671	177.7	0.03062	0.665
560.0	6.088	245.88	0.3803	181.5	0.02999	0.674
580.0	6.211	259.44	0.3935	185.2	0.02939	0.683
600.0	6.333	273.19	0.4066	188.9	0.02881	0.692

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

40 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
75.58	0.02800	-173.77	-0.2477	1075.0	44.27	0.562
75.58	2.221	-19.68	0.0267	81.1	0.08874	0.416
80.0	2.245	-17.83	0.0301	82.2	0.08753	0.418
90.0	2.299	-13.62	0.0379	84.7	0.08496	0.423
100.0	2.351	-9.36	0.0455	87.1	0.08261	0.428
110.0	2.404	-5.06	0.0532	89.5	0.08042	0.433
120.0	2.455	-0.70	0.0607	91.9	0.07839	0.438
130.0	2.507	3.70	0.0683	94.2	0.07650	0.443
140.0	2.557	8.16	0.0758	96.5	0.07472	0.449
150.0	2.608	12.68	0.0832	98.7	0.07305	0.454
160.0	2.658	17.25	0.0907	100.9	0.07147	0.460
170.0	2.708	21.88	0.0981	103.1	0.06997	0.465
180.0	2.758	26.56	0.1055	105.3	0.06855	0.471
190.0	2.807	31.30	0.1128	107.5	0.06721	0.477
200.0	2.856	36.09	0.1201	109.6	0.06592	0.482
210.0	2.905	40.94	0.1274	111.7	0.06469	0.488
220.0	2.954	45.86	0.1347	113.8	0.06352	0.494
230.0	3.003	50.82	0.1420	115.9	0.06240	0.500
240.0	3.051	55.85	0.1492	118.0	0.06132	0.505
250.0	3.099	60.93	0.1564	120.0	0.06028	0.511
260.0	3.148	66.07	0.1636	122.1	0.05929	0.517
270.0	3.196	71.27	0.1708	124.1	0.05833	0.523
280.0	3.244	76.52	0.1779	126.2	0.05740	0.528
290.0	3.291	81.84	0.1851	128.2	0.05651	0.534
300.0	3.339	87.21	0.1922	130.2	0.05565	0.540
310.0	3.387	92.63	0.1993	132.2	0.05482	0.545
320.0	3.434	98.11	0.2064	134.2	0.05402	0.551
330.0	3.482	103.65	0.2134	136.2	0.05324	0.557
340.0	3.529	109.25	0.2205	138.2	0.05248	0.562
350.0	3.576	114.89	0.2275	140.2	0.05175	0.568
360.0	3.624	120.60	0.2345	142.1	0.05104	0.573
370.0	3.671	126.36	0.2415	144.1	0.05036	0.579
380.0	3.718	132.17	0.2484	146.1	0.04969	0.584
390.0	3.765	138.04	0.2554	148.0	0.04904	0.589
400.0	3.812	143.96	0.2623	150.0	0.04841	0.595
420.0	3.905	155.95	0.2761	153.9	0.04720	0.605
440.0	3.999	168.16	0.2898	157.7	0.04605	0.616
460.0	4.092	180.57	0.3034	161.6	0.04496	0.626
480.0	4.185	193.18	0.3170	165.4	0.04393	0.636
500.0	4.278	205.99	0.3305	169.3	0.04294	0.646
520.0	4.371	218.99	0.3439	173.1	0.04200	0.656
540.0	4.464	232.19	0.3573	176.9	0.04110	0.665
560.0	4.556	245.58	0.3705	180.7	0.04024	0.675
580.0	4.649	259.16	0.3837	184.5	0.03942	0.684
600.0	4.741	272.92	0.3968	188.3	0.03863	0.693

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

50 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID	H BTU/LB (X=.2570)	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
88.91	0.02848	-165.41	-0.2333	976.6	41.73	0.573
88.91	1.793	-15.27	0.0280	80.3	0.1119	0.430
90.0	1.798	-14.80	0.0289	80.6	0.1115	0.430
100.0	1.843	-10.48	0.0367	83.3	0.1079	0.434
110.0	1.887	-6.11	0.0444	85.9	0.1047	0.438
120.0	1.930	-1.70	0.0521	88.4	0.1018	0.443
130.0	1.972	2.75	0.0597	90.9	0.09902	0.448
140.0	2.015	7.26	0.0673	93.3	0.09648	0.453
150.0	2.056	11.81	0.0748	95.7	0.09412	0.458
160.0	2.098	16.42	0.0823	98.1	0.09191	0.463
170.0	2.139	21.08	0.0897	100.4	0.08983	0.469
180.0	2.180	25.79	0.0972	102.7	0.08787	0.474
190.0	2.220	30.56	0.1046	104.9	0.08602	0.479
200.0	2.261	35.38	0.1119	107.2	0.08427	0.485
210.0	2.301	40.26	0.1193	109.4	0.08261	0.491
220.0	2.341	45.19	0.1266	111.6	0.08102	0.496
230.0	2.380	50.18	0.1339	113.7	0.07951	0.502
240.0	2.420	55.22	0.1411	115.9	0.07807	0.507
250.0	2.459	60.33	0.1484	118.0	0.07668	0.513
260.0	2.498	65.48	0.1556	120.1	0.07536	0.519
270.0	2.537	70.70	0.1628	122.3	0.07409	0.524
280.0	2.576	75.97	0.1700	124.3	0.07287	0.530
290.0	2.615	81.30	0.1771	126.4	0.07169	0.536
300.0	2.654	86.68	0.1843	128.5	0.07056	0.541
310.0	2.693	92.12	0.1914	130.6	0.06947	0.547
320.0	2.731	97.62	0.1985	132.6	0.06841	0.552
330.0	2.770	103.17	0.2055	134.6	0.06739	0.558
340.0	2.808	108.77	0.2126	136.7	0.06641	0.563
350.0	2.846	114.44	0.2196	138.7	0.06546	0.569
360.0	2.885	120.15	0.2266	140.7	0.06453	0.574
370.0	2.923	125.92	0.2336	142.7	0.06364	0.580
380.0	2.961	131.74	0.2406	144.7	0.06277	0.585
390.0	2.999	137.62	0.2476	146.7	0.06193	0.590
400.0	3.037	143.55	0.2545	148.7	0.06112	0.596
420.0	3.112	155.56	0.2683	152.7	0.05955	0.606
440.0	3.188	167.79	0.2821	156.6	0.05807	0.616
460.0	3.263	180.21	0.2957	160.5	0.05667	0.627
480.0	3.338	192.84	0.3093	164.4	0.05534	0.637
500.0	3.413	205.66	0.3228	168.3	0.05408	0.646
520.0	3.488	218.68	0.3362	172.2	0.05287	0.656
540.0	3.563	231.89	0.3496	176.1	0.05172	0.666
560.0	3.637	245.29	0.3628	179.9	0.05062	0.675
580.0	3.711	258.88	0.3760	183.7	0.04958	0.684
600.0	3.786	272.65	0.3892	187.6	0.04857	0.693



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

60 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.2476)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
100.36	0.02392	-158.13	-0.2210	894.8	39.57	0.584
100.36	1.503	-11.51	0.0293	79.3	0.1357	0.442
110.0	1.540	-7.23	0.0369	82.0	0.1313	0.445
120.0	1.578	-2.76	0.0447	84.8	0.1271	0.449
130.0	1.615	1.75	0.0524	87.5	0.1233	0.453
140.0	1.652	6.31	0.0600	90.1	0.1198	0.458
150.0	1.688	10.91	0.0677	92.6	0.1166	0.462
160.0	1.724	15.55	0.0752	95.1	0.1136	0.467
170.0	1.759	20.25	0.0827	97.6	0.1108	0.472
180.0	1.794	25.00	0.0902	100.0	0.1082	0.477
190.0	1.829	29.80	0.0977	102.4	0.1058	0.482
200.0	1.863	34.65	0.1051	104.7	0.1035	0.488
210.0	1.897	39.55	0.1125	107.0	0.1013	0.493
220.0	1.931	44.51	0.1198	109.3	0.09926	0.499
230.0	1.965	49.52	0.1271	111.5	0.09731	0.504
240.0	1.999	54.59	0.1344	113.8	0.09545	0.509
250.0	2.032	59.71	0.1417	116.0	0.09368	0.515
260.0	2.065	64.89	0.1489	118.2	0.09198	0.521
270.0	2.098	70.12	0.1562	120.3	0.09036	0.526
280.0	2.131	75.41	0.1634	122.5	0.08881	0.532
290.0	2.164	80.75	0.1705	124.6	0.08732	0.537
300.0	2.197	86.15	0.1777	126.8	0.08589	0.543
310.0	2.230	91.61	0.1848	128.9	0.08451	0.548
320.0	2.262	97.12	0.1919	131.0	0.08319	0.554
330.0	2.295	102.38	0.1990	133.1	0.08191	0.559
340.0	2.327	108.30	0.2061	135.2	0.08067	0.564
350.0	2.360	113.97	0.2131	137.2	0.07946	0.570
360.0	2.392	119.70	0.2202	139.3	0.07833	0.575
370.0	2.424	125.48	0.2272	141.3	0.07721	0.581
380.0	2.456	131.31	0.2342	143.4	0.07613	0.586
390.0	2.488	137.20	0.2411	145.4	0.07509	0.591
400.0	2.520	143.14	0.2481	147.5	0.07407	0.597
420.0	2.584	155.17	0.2619	151.5	0.07213	0.607
440.0	2.647	167.41	0.2757	155.5	0.07030	0.617
460.0	2.710	179.85	0.2893	159.5	0.06857	0.627
480.0	2.773	192.49	0.3029	163.4	0.06693	0.637
500.0	2.836	205.33	0.3165	167.4	0.06537	0.647
520.0	2.899	218.36	0.3299	171.3	0.06389	0.657
540.0	2.962	231.58	0.3433	175.2	0.06248	0.666
560.0	3.024	244.99	0.3565	179.1	0.06114	0.676
580.0	3.087	258.59	0.3698	183.0	0.05985	0.685
600.0	3.149	272.37	0.3829	186.9	0.05862	0.694

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

70 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.2396)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
110.46	0.02931	-151.60	-0.2104	824.9	37.69	0.593
110.46	1.293	-8.22	0.0306	78.2	0.1603	0.453
120.0	1.326	-3.88	0.0381	81.0	0.1548	0.456
130.0	1.359	0.70	0.0460	83.9	0.1497	0.459
140.0	1.392	5.31	0.0537	86.7	0.1450	0.463
150.0	1.424	9.97	0.0614	89.5	0.1407	0.467
160.0	1.456	14.66	0.0690	92.1	0.1367	0.471
170.0	1.487	19.40	0.0766	94.7	0.1331	0.476
180.0	1.518	24.18	0.0842	97.3	0.1297	0.481
190.0	1.548	29.01	0.0917	99.7	0.1266	0.486
200.0	1.579	33.90	0.0991	102.2	0.1237	0.491
210.0	1.609	38.83	0.1065	104.6	0.1209	0.496
220.0	1.639	43.81	0.1139	107.0	0.1183	0.501
230.0	1.668	48.85	0.1213	109.3	0.1158	0.506
240.0	1.698	53.94	0.1286	111.6	0.1135	0.512
250.0	1.727	59.09	0.1359	113.9	0.1113	0.517
260.0	1.756	64.28	0.1432	116.2	0.1092	0.522
270.0	1.785	69.54	0.1504	118.4	0.1072	0.528
280.0	1.814	74.84	0.1577	120.7	0.1053	0.533
290.0	1.842	80.20	0.1649	122.9	0.1034	0.539
300.0	1.871	85.62	0.1720	125.0	0.1017	0.544
310.0	1.899	91.09	0.1792	127.2	0.09998	0.550
320.0	1.927	96.61	0.1863	129.4	0.09835	0.555
330.0	1.956	102.19	0.1934	131.5	0.09679	0.560
340.0	1.984	107.82	0.2005	133.6	0.09529	0.566
350.0	2.012	113.51	0.2076	135.8	0.09384	0.571
360.0	2.040	119.24	0.2146	137.9	0.09244	0.576
370.0	2.068	125.03	0.2216	140.0	0.09109	0.582
380.0	2.095	130.88	0.2286	142.0	0.08978	0.587
390.0	2.123	136.78	0.2356	144.1	0.08851	0.592
400.0	2.151	142.72	0.2426	146.2	0.08729	0.598
420.0	2.206	154.78	0.2564	150.3	0.08495	0.608
440.0	2.261	167.04	0.2702	154.4	0.08275	0.618
460.0	2.316	179.49	0.2839	158.4	0.08067	0.628
480.0	2.370	192.15	0.2975	162.5	0.07870	0.638
500.0	2.424	205.00	0.3111	166.5	0.07684	0.648
520.0	2.479	218.04	0.3245	170.4	0.07507	0.657
540.0	2.533	231.28	0.3379	174.4	0.07338	0.667
560.0	2.587	244.70	0.3512	178.3	0.07178	0.676
580.0	2.640	258.31	0.3644	182.3	0.07025	0.685
600.0	2.694	272.10	0.3775	186.2	0.06879	0.694

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

80 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID	H BTU/LB (X= .2327)	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
119.52	0.02971	-145.72	-0.2006	763.9	36.01	0.602
119.52	1.134	-5.28	0.0318	76.9	0.1857	0.464
120.0	1.135	-5.06	0.0322	77.1	0.1854	0.464
130.0	1.166	-0.41	0.0401	80.2	0.1784	0.466
140.0	1.196	4.27	0.0480	83.3	0.1722	0.469
150.0	1.225	8.98	0.0558	86.2	0.1666	0.473
160.0	1.254	13.73	0.0635	89.0	0.1614	0.476
170.0	1.282	18.51	0.0712	91.8	0.1568	0.480
180.0	1.310	23.34	0.0788	94.4	0.1525	0.485
190.0	1.338	28.21	0.0863	97.1	0.1485	0.489
200.0	1.365	33.13	0.0938	99.6	0.1448	0.494
210.0	1.392	38.09	0.1013	102.2	0.1414	0.499
220.0	1.419	43.10	0.1087	104.6	0.1382	0.504
230.0	1.445	48.17	0.1161	107.1	0.1351	0.509
240.0	1.472	53.28	0.1235	109.5	0.1323	0.514
250.0	1.498	58.45	0.1308	111.8	0.1296	0.519
260.0	1.524	63.67	0.1381	114.2	0.1270	0.525
270.0	1.549	68.94	0.1454	116.5	0.1246	0.530
280.0	1.575	74.27	0.1527	118.8	0.1222	0.535
290.0	1.600	79.65	0.1599	121.1	0.1200	0.540
300.0	1.626	85.08	0.1671	123.3	0.1179	0.546
310.0	1.651	90.56	0.1743	125.5	0.1159	0.551
320.0	1.676	96.10	0.1814	127.7	0.1139	0.556
330.0	1.701	101.69	0.1885	129.9	0.1121	0.562
340.0	1.726	107.34	0.1956	132.1	0.1103	0.567
350.0	1.751	113.03	0.2027	134.3	0.1085	0.572
360.0	1.776	118.78	0.2098	136.4	0.1069	0.578
370.0	1.800	124.59	0.2168	138.6	0.1053	0.583
380.0	1.825	130.44	0.2238	140.7	0.1037	0.588
390.0	1.849	136.35	0.2308	142.8	0.1022	0.593
400.0	1.874	142.31	0.2378	144.9	0.1008	0.598
420.0	1.923	154.38	0.2517	149.1	0.09800	0.609
440.0	1.971	166.66	0.2655	153.3	0.09541	0.619
460.0	2.019	179.13	0.2792	157.4	0.09296	0.629
480.0	2.067	191.80	0.2928	161.5	0.09065	0.639
500.0	2.115	204.66	0.3063	165.5	0.08847	0.648
520.0	2.163	217.72	0.3198	169.5	0.08640	0.658
540.0	2.211	230.97	0.3332	173.6	0.08443	0.667
560.0	2.258	244.40	0.3465	177.6	0.08256	0.677
580.0	2.306	258.02	0.3597	181.5	0.08077	0.686
600.0	2.353	271.83	0.3729	185.5	0.07907	0.695

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

100 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID	H BTU/LB (X=.2211)	S - BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
135.39	0.03044	-135.19	-0.1837	661.6	33.11	0.620
135.39	0.907	-0.23	0.0340	74.2	0.2389	0.485
140.0	0.919	2.01	0.0378	75.8	0.2341	0.485
150.0	0.945	6.87	0.0458	79.2	0.2248	0.486
160.0	0.970	11.74	0.0537	82.5	0.2165	0.488
170.0	0.995	16.64	0.0616	85.6	0.2090	0.491
180.0	1.019	21.56	0.0693	88.6	0.2023	0.494
190.0	1.042	26.52	0.0770	91.5	0.1962	0.498
200.0	1.065	31.52	0.0846	94.4	0.1906	0.502
210.0	1.088	36.55	0.0922	97.1	0.1855	0.506
220.0	1.111	41.63	0.0997	99.8	0.1807	0.510
230.0	1.133	46.76	0.1072	102.5	0.1763	0.515
240.0	1.155	51.93	0.1147	105.0	0.1721	0.519
250.0	1.176	57.14	0.1221	107.6	0.1682	0.524
260.0	1.198	62.41	0.1294	110.1	0.1646	0.529
270.0	1.219	67.72	0.1368	112.6	0.1611	0.534
280.0	1.241	73.09	0.1441	115.0	0.1579	0.539
290.0	1.262	78.51	0.1514	117.4	0.1548	0.544
300.0	1.283	83.97	0.1586	119.8	0.1518	0.549
310.0	1.303	89.49	0.1658	122.1	0.1490	0.554
320.0	1.324	95.06	0.1730	124.5	0.1463	0.559
330.0	1.345	100.68	0.1802	126.8	0.1438	0.565
340.0	1.365	106.36	0.1873	129.0	0.1413	0.570
350.0	1.386	112.08	0.1944	131.3	0.1390	0.575
360.0	1.406	117.86	0.2015	133.6	0.1367	0.580
370.0	1.426	123.68	0.2086	135.8	0.1346	0.585
380.0	1.446	129.56	0.2156	138.0	0.1325	0.590
390.0	1.466	135.49	0.2226	140.2	0.1305	0.595
400.0	1.486	141.47	0.2296	142.4	0.1285	0.601
420.0	1.526	153.58	0.2436	146.7	0.1249	0.611
440.0	1.565	165.89	0.2574	151.0	0.1214	0.621
460.0	1.605	178.40	0.2711	155.3	0.1182	0.631
480.0	1.644	191.10	0.2848	159.5	0.1151	0.640
500.0	1.683	203.99	0.2984	163.6	0.1122	0.650
520.0	1.722	217.08	0.3119	167.8	0.1095	0.659
540.0	1.760	230.35	0.3253	171.9	0.1070	0.669
560.0	1.799	243.81	0.3386	176.0	0.1045	0.678
580.0	1.837	257.45	0.3519	180.1	0.1022	0.687
600.0	1.875	271.28	0.3650	184.1	0.1000	0.696



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

120 PSIA						
T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
149.04	0.03111	-125.9	-0.1693	578.	30.67	0.636
149.04	0.754	4.0	0.0360	71.3	0.2954	0.505
150.0	0.756	4.5	0.0368	71.7	0.2940	0.504
160.0	0.779	9.6	0.0450	75.5	0.2808	0.504
170.0	0.801	14.6	0.0531	79.0	0.2693	0.504
180.0	0.823	19.6	0.0610	82.5	0.2591	0.506
190.0	0.844	24.7	0.0689	85.7	0.2500	0.508
200.0	0.864	29.8	0.0767	88.9	0.2417	0.511
210.0	0.884	34.9	0.0844	91.9	0.2343	0.514
220.0	0.904	40.1	0.0920	94.8	0.2275	0.517
230.0	0.924	45.3	0.0996	97.7	0.2212	0.521
240.0	0.943	50.5	0.1071	100.5	0.2154	0.525
250.0	0.962	55.8	0.1146	103.3	0.2100	0.530
260.0	0.981	61.1	0.1221	105.9	0.2050	0.534
270.0	0.999	66.5	0.1295	108.6	0.2003	0.539
280.0	1.017	71.9	0.1368	111.2	0.1959	0.543
290.0	1.036	77.3	0.1442	113.7	0.1917	0.548
300.0	1.054	82.8	0.1515	116.2	0.1878	0.553
310.0	1.071	88.4	0.1587	118.7	0.1841	0.558
320.0	1.089	94.0	0.1659	121.1	0.1805	0.563
330.0	1.107	99.7	0.1732	123.6	0.1772	0.568
340.0	1.124	105.4	0.1803	126.0	0.1740	0.573
350.0	1.142	111.1	0.1875	128.3	0.1709	0.578
360.0	1.159	116.9	0.1946	130.7	0.1680	0.583
370.0	1.176	122.8	0.2017	133.0	0.1652	0.588
380.0	1.194	128.7	0.2088	135.3	0.1625	0.593
390.0	1.211	134.6	0.2158	137.6	0.1599	0.598
400.0	1.228	140.6	0.2228	139.8	0.1574	0.603
420.0	1.261	152.8	0.2368	144.3	0.1527	0.613
440.0	1.295	165.1	0.2507	148.8	0.1483	0.622
460.0	1.328	177.7	0.2645	153.2	0.1442	0.632
480.0	1.361	190.4	0.2782	157.5	0.1403	0.642
500.0	1.394	203.3	0.2918	161.8	0.1367	0.651
520.0	1.427	216.4	0.3053	166.0	0.1333	0.661
540.0	1.460	229.7	0.3187	170.2	0.1301	0.670
560.0	1.492	243.2	0.3321	174.4	0.1270	0.679
580.0	1.525	256.9	0.3454	178.6	0.1241	0.688
600.0	1.557	270.7	0.3586	182.7	0.1213	0.697

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

140 PSIA

T DEG F	V FT <sup>3</sup> /LB LIQUID (X=.2034)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
161.10	0.03178	-117.6	-0.1566	508.	28.54	0.652
161.10	0.642	7.7	0.0378	68.3	0.3554	0.524
170.0	0.661	12.4	0.0452	72.0	0.3398	0.522
180.0	0.681	17.6	0.0534	75.9	0.3245	0.520
190.0	0.701	22.8	0.0615	79.6	0.3111	0.520
200.0	0.720	28.0	0.0695	83.1	0.2992	0.522
210.0	0.738	33.2	0.0773	86.5	0.2887	0.523
220.0	0.756	38.5	0.0851	89.7	0.2792	0.526
230.0	0.774	43.7	0.0928	92.8	0.2705	0.529
240.0	0.791	49.0	0.1005	95.9	0.2626	0.532
250.0	0.808	54.4	0.1080	98.8	0.2553	0.536
260.0	0.825	59.8	0.1156	101.7	0.2486	0.540
270.0	0.841	65.2	0.1230	104.5	0.2424	0.544
280.0	0.858	70.6	0.1305	107.2	0.2366	0.548
290.0	0.874	76.1	0.1379	110.0	0.2311	0.552
300.0	0.890	81.7	0.1452	112.6	0.2260	0.557
310.0	0.906	87.3	0.1525	115.2	0.2212	0.562
320.0	0.921	92.9	0.1598	117.8	0.2167	0.566
330.0	0.937	98.6	0.1671	120.3	0.2124	0.571
340.0	0.952	104.3	0.1743	122.8	0.2083	0.576
350.0	0.968	110.1	0.1815	125.3	0.2044	0.581
360.0	0.983	116.0	0.1886	127.8	0.2007	0.585
370.0	0.998	121.8	0.1957	130.2	0.1971	0.590
380.0	1.013	127.8	0.2028	132.6	0.1937	0.595
390.0	1.028	133.7	0.2099	134.9	0.1905	0.600
400.0	1.043	139.8	0.2170	137.3	0.1874	0.605
420.0	1.072	152.0	0.2310	141.9	0.1815	0.615
440.0	1.102	164.3	0.2449	146.5	0.1761	0.624
460.0	1.131	176.9	0.2587	151.0	0.1710	0.634
480.0	1.160	189.7	0.2725	155.5	0.1663	0.643
500.0	1.188	202.6	0.2861	159.9	0.1619	0.653
520.0	1.217	215.8	0.2997	164.3	0.1577	0.662
540.0	1.245	229.1	0.3131	168.6	0.1538	0.671
560.0	1.273	242.6	0.3265	172.9	0.1500	0.680
580.0	1.302	256.3	0.3398	177.1	0.1465	0.689
600.0	1.330	270.2	0.3530	181.4	0.1432	0.698

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

160 PSIA

T DEG F	V FT <sup>3</sup> /LB LIQUID (X=.1963)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
171.94	0.03243	-109.9	-0.1450	448.	26.66	0.667
171.94	0.5574	10.9	0.0394	65.3	0.4193	0.544
180.0	0.5732	15.3	0.0462	68.9	0.4011	0.539
190.0	0.5920	20.7	0.0546	73.1	0.3815	0.536
200.0	0.610	26.0	0.0628	77.0	0.3646	0.535
210.0	0.627	31.4	0.0708	80.8	0.3498	0.535
220.0	0.644	36.7	0.0788	84.3	0.3367	0.536
230.0	0.660	42.1	0.0866	87.8	0.3249	0.538
240.0	0.676	47.5	0.0944	91.0	0.3143	0.540
250.0	0.692	52.9	0.1021	94.2	0.3046	0.543
260.0	0.707	58.3	0.1097	97.3	0.2958	0.546
270.0	0.723	63.8	0.1172	100.3	0.2877	0.550
280.0	0.737	69.3	0.1247	103.3	0.2802	0.553
290.0	0.752	74.9	0.1322	106.1	0.2732	0.557
300.0	0.767	80.5	0.1396	108.9	0.2667	0.561
310.0	0.781	86.1	0.1470	111.7	0.2606	0.566
320.0	0.795	91.8	0.1543	114.4	0.2549	0.570
330.0	0.809	97.5	0.1616	117.1	0.2495	0.575
340.0	0.823	103.3	0.1689	119.7	0.2444	0.579
350.0	0.837	109.1	0.1761	122.3	0.2395	0.584
360.0	0.850	115.0	0.1833	124.8	0.2349	0.588
370.0	0.864	120.9	0.1905	127.3	0.2306	0.593
380.0	0.877	126.8	0.1976	129.8	0.2264	0.598
390.0	0.891	132.8	0.2047	132.3	0.2224	0.603
400.0	0.904	138.9	0.2118	134.7	0.2186	0.607
420.0	0.931	151.1	0.2258	139.6	0.2115	0.617
440.0	0.957	163.6	0.2398	144.3	0.2049	0.626
460.0	0.983	176.2	0.2537	148.9	0.1988	0.636
480.0	1.008	189.0	0.2674	153.5	0.1931	0.645
500.0	1.034	202.0	0.2811	158.1	0.1877	0.654
520.0	1.059	215.1	0.2947	162.5	0.1828	0.663
540.0	1.084	228.5	0.3082	167.0	0.1781	0.672
560.0	1.109	242.0	0.3216	171.3	0.1736	0.681
580.0	1.134	255.7	0.3349	175.7	0.1695	0.690
600.0	1.159	269.6	0.3482	180.0	0.1655	0.699

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

180 PSIA						
T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
COEXISTING	LIQUID (X=.1900)					
181.82	0.03308	-102.8	-0.1345	396.	24.97	0.683
181.82	0.4907	13.8	0.0408	62.2	0.4870	0.564
190.0	0.5059	18.3	0.0479	66.1	0.4640	0.557
200.0	0.5234	23.9	0.0564	70.6	0.4398	0.552
210.0	0.5401	29.4	0.0647	74.8	0.4191	0.549
220.0	0.5562	34.9	0.0728	78.7	0.4011	0.548
230.0	0.5717	40.4	0.0808	82.5	0.3853	0.548
240.0	0.5858	45.9	0.0887	86.1	0.3712	0.549
250.0	0.601	51.4	0.0965	89.5	0.3585	0.551
260.0	0.616	56.9	0.1042	92.9	0.3471	0.553
270.0	0.630	62.4	0.1119	96.1	0.3366	0.556
280.0	0.644	68.0	0.1195	99.2	0.3270	0.559
290.0	0.657	73.6	0.1270	102.3	0.3182	0.563
300.0	0.671	79.3	0.1345	105.2	0.3100	0.566
310.0	0.684	85.0	0.1419	108.1	0.3024	0.570
320.0	0.697	90.7	0.1493	111.0	0.2953	0.574
330.0	0.710	96.4	0.1567	113.8	0.2886	0.578
340.0	0.722	102.2	0.1640	116.5	0.2823	0.583
350.0	0.735	108.1	0.1713	119.2	0.2764	0.587
360.0	0.747	114.0	0.1785	121.9	0.2708	0.591
370.0	0.760	119.9	0.1857	124.5	0.2655	0.596
380.0	0.772	125.9	0.1929	127.1	0.2605	0.601
390.0	0.784	131.9	0.2000	129.7	0.2557	0.605
400.0	0.796	138.0	0.2071	132.2	0.2511	0.610
420.0	0.820	150.3	0.2212	137.2	0.2425	0.619
440.0	0.844	162.8	0.2352	142.0	0.2346	0.628
460.0	0.867	175.4	0.2491	146.8	0.2274	0.637
480.0	0.891	188.3	0.2630	151.5	0.2206	0.647
500.0	0.914	201.3	0.2767	156.2	0.2144	0.656
520.0	0.936	214.5	0.2903	160.8	0.2085	0.665
540.0	0.959	227.9	0.3038	165.3	0.2030	0.674
560.0	0.982	241.4	0.3172	169.8	0.1978	0.683
580.0	1.004	255.2	0.3306	174.2	0.1929	0.691
600.0	1.026	269.1	0.3438	178.6	0.1883	0.700



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

200 PSIA

T DEG F COEXISTING	V FT <sup>3</sup> /LB LIQUID (X=.1842)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
190.92	0.03373	-96.1	-0.1248	349.	23.43	0.699
190.92	0.4369	16.3	0.0420	59.0	0.5591	0.585
200.0	0.4528	21.5	0.0501	63.7	0.5278	0.575
210.0	0.4693	27.2	0.0587	68.4	0.4988	0.568
220.0	0.4850	32.9	0.0671	72.9	0.4741	0.563
230.0	0.5000	38.5	0.0753	77.0	0.4528	0.561
240.0	0.5145	44.1	0.0833	80.9	0.4342	0.560
250.0	0.5285	49.7	0.0913	84.7	0.4177	0.561
260.0	0.5421	55.4	0.0991	88.3	0.4029	0.562
270.0	0.5554	61.0	0.1069	91.7	0.3896	0.564
280.0	0.5683	66.6	0.1146	95.1	0.3775	0.566
290.0	0.5810	72.3	0.1222	98.3	0.3664	0.569
300.0	0.5935	78.0	0.1298	101.5	0.3562	0.572
310.0	0.606	83.7	0.1373	104.5	0.3468	0.575
320.0	0.618	89.5	0.1447	107.5	0.3381	0.579
330.0	0.630	95.3	0.1521	110.5	0.3299	0.583
340.0	0.642	101.2	0.1595	113.3	0.3223	0.587
350.0	0.653	107.1	0.1668	116.2	0.3152	0.591
360.0	0.665	113.0	0.1741	118.9	0.3084	0.595
370.0	0.676	119.0	0.1813	121.7	0.3020	0.599
380.0	0.688	125.0	0.1885	124.3	0.2960	0.603
390.0	0.699	131.0	0.1957	127.0	0.2903	0.608
400.0	0.710	137.1	0.2028	129.6	0.2848	0.612
420.0	0.732	149.5	0.2170	134.8	0.2747	0.621
440.0	0.754	162.0	0.2311	139.8	0.2654	0.630
460.0	0.775	174.7	0.2450	144.7	0.2569	0.639
480.0	0.796	187.5	0.2589	149.6	0.2490	0.648
500.0	0.817	200.6	0.2726	154.3	0.2417	0.657
520.0	0.838	213.8	0.2863	159.0	0.2349	0.666
540.0	0.859	227.2	0.2998	163.7	0.2285	0.675
560.0	0.880	240.8	0.3133	168.3	0.2226	0.684
580.0	0.900	254.6	0.3266	172.8	0.2169	0.693
600.0	0.920	268.5	0.3399	177.3	0.2116	0.701

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

220 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
COEXISTING 199.37	LIQUID (X=.1790) 0.03439	-89.8	-0.1157	309.	22.02	0.716
199.37	0.3922	18.5	0.0431	55.8	0.6358	0.606
200.0	0.3933	18.9	0.0437	56.2	0.6329	0.605
210.0	0.4101	24.9	0.0527	61.7	0.5917	0.591
220.0	0.4258	30.8	0.0614	66.6	0.5577	0.582
230.0	0.4406	36.6	0.0699	71.3	0.5291	0.577
240.0	0.4547	42.3	0.0782	75.6	0.5045	0.573
250.0	0.4683	48.0	0.0863	79.7	0.4830	0.572
260.0	0.4813	53.7	0.0943	83.6	0.4641	0.571
270.0	0.4940	59.5	0.1022	87.3	0.4472	0.572
280.0	0.5064	65.2	0.1100	90.8	0.4320	0.573
290.0	0.5185	70.9	0.1177	94.3	0.4182	0.575
300.0	0.5303	76.7	0.1253	97.6	0.4057	0.578
310.0	0.5419	82.5	0.1329	100.9	0.3941	0.581
320.0	0.5533	88.3	0.1404	104.0	0.3835	0.584
330.0	0.5645	94.2	0.1479	107.1	0.3737	0.587
340.0	0.5755	100.1	0.1553	110.1	0.3645	0.591
350.0	0.5864	106.0	0.1626	113.1	0.3559	0.594
360.0	0.5972	112.0	0.1700	115.9	0.3478	0.598
370.0	0.608	118.0	0.1773	118.8	0.3403	0.602
380.0	0.618	124.0	0.1845	121.6	0.3331	0.606
390.0	0.629	130.1	0.1917	124.3	0.3264	0.611
400.0	0.639	136.2	0.1989	127.0	0.3200	0.615
420.0	0.660	148.6	0.2131	132.4	0.3081	0.624
440.0	0.680	161.2	0.2272	137.5	0.2973	0.632
460.0	0.700	173.9	0.2412	142.6	0.2874	0.641
480.0	0.719	186.8	0.2551	147.6	0.2783	0.650
500.0	0.739	199.9	0.2689	152.5	0.2699	0.659
520.0	0.758	213.2	0.2826	157.3	0.2620	0.668
540.0	0.777	226.6	0.2961	162.1	0.2547	0.677
560.0	0.796	240.2	0.3096	166.8	0.2479	0.685
580.0	0.815	254.0	0.3230	171.4	0.2415	0.694
600.0	0.833	267.9	0.3363	176.0	0.2354	0.702

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

240 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.1741)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
207.26	0.03506	-83.8	-0.1071	272.	20.71	0.734
207.26	0.3546	20.5	0.0441	52.6	0.7174	0.630
210.0	0.3593	22.3	0.0467	54.3	0.7025	0.624
220.0	0.3753	28.4	0.0558	60.0	0.6550	0.607
230.0	0.3902	34.4	0.0646	65.2	0.6161	0.596
240.0	0.4042	40.3	0.0731	70.0	0.5835	0.589
250.0	0.4175	46.2	0.0814	74.5	0.5556	0.585
260.0	0.4303	52.1	0.0896	78.7	0.5314	0.583
270.0	0.4426	57.9	0.0976	82.7	0.5100	0.582
280.0	0.4545	63.7	0.1055	86.5	0.4911	0.582
290.0	0.4661	69.5	0.1134	90.2	0.4740	0.583
300.0	0.4774	75.4	0.1211	93.7	0.4586	0.584
310.0	0.4884	81.2	0.1288	97.2	0.4446	0.586
320.0	0.4992	87.1	0.1363	100.5	0.4318	0.589
330.0	0.5099	93.0	0.1439	103.7	0.4199	0.592
340.0	0.5203	98.9	0.1513	106.9	0.4090	0.595
350.0	0.5306	104.9	0.1588	109.9	0.3986	0.599
360.0	0.5408	110.9	0.1661	113.0	0.3892	0.602
370.0	0.5508	117.0	0.1735	115.9	0.3803	0.606
380.0	0.5607	123.0	0.1807	118.8	0.3719	0.610
390.0	0.5705	129.1	0.1880	121.7	0.3640	0.614
400.0	0.5802	135.3	0.1952	124.5	0.3566	0.618
420.0	0.5993	147.7	0.2095	130.0	0.3428	0.626
440.0	0.618	160.4	0.2237	135.3	0.3303	0.635
460.0	0.637	173.1	0.2377	140.5	0.3189	0.643
480.0	0.655	186.1	0.2516	145.6	0.3084	0.652
500.0	0.673	199.2	0.2654	150.7	0.2988	0.661
520.0	0.691	212.5	0.2791	155.6	0.2899	0.669
540.0	0.709	226.0	0.2928	160.5	0.2816	0.678
560.0	0.726	239.6	0.3063	165.2	0.2738	0.687
580.0	0.744	253.4	0.3197	170.0	0.2666	0.695
600.0	0.761	267.4	0.3330	174.6	0.2597	0.703

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

260 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.1696)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
214.68	0.03575	-78.0	-0.0990	239.	19.49	0.754
214.68	0.3224	22.3	0.0449	49.4	0.8045	0.655
220.0	0.3312	25.8	0.0500	52.8	0.7705	0.641
230.0	0.3465	32.1	0.0592	58.7	0.7169	0.621
240.0	0.3607	38.2	0.0680	64.1	0.6733	0.609
250.0	0.3740	44.3	0.0766	69.0	0.6369	0.601
260.0	0.3866	50.3	0.0850	73.6	0.6059	0.596
270.0	0.3986	56.2	0.0932	78.0	0.5790	0.593
280.0	0.4103	62.1	0.1013	82.1	0.5553	0.591
290.0	0.4215	68.0	0.1092	86.0	0.5344	0.591
300.0	0.4324	74.0	0.1171	89.8	0.5156	0.592
310.0	0.4430	79.9	0.1248	93.4	0.4986	0.593
320.0	0.4534	85.8	0.1325	96.9	0.4831	0.595
330.0	0.4635	91.8	0.1401	100.3	0.4690	0.597
340.0	0.4735	97.8	0.1476	103.6	0.4559	0.600
350.0	0.4833	103.8	0.1551	106.8	0.4439	0.603
360.0	0.4929	109.8	0.1625	109.9	0.4327	0.606
370.0	0.5024	115.9	0.1699	113.0	0.4222	0.610
380.0	0.5118	122.0	0.1772	116.0	0.4125	0.613
390.0	0.5211	128.2	0.1845	119.0	0.4033	0.617
400.0	0.5303	134.4	0.1917	121.9	0.3946	0.621
420.0	0.5483	146.9	0.2061	127.6	0.3787	0.629
440.0	0.5660	159.5	0.2203	133.1	0.3644	0.637
460.0	0.5834	172.4	0.2344	138.4	0.3514	0.645
480.0	0.601	185.3	0.2484	143.7	0.3395	0.654
500.0	0.618	198.5	0.2622	148.8	0.3286	0.662
520.0	0.634	211.8	0.2760	153.9	0.3185	0.671
540.0	0.651	225.3	0.2896	158.9	0.3091	0.679
560.0	0.667	239.0	0.3031	163.7	0.3004	0.688
580.0	0.684	252.8	0.3166	168.6	0.2922	0.696
600.0	0.700	266.8	0.3299	173.3	0.2845	0.705



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR  
280°PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.1652)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
221.68	0.03646	-72.4	-0.0913	209.	18.35	0.775
221.68	0.2945	23.9	0.0455	46.1	0.8977	0.683
230.0	0.3079	29.5	0.0537	51.8	0.8361	0.656
240.0	0.3225	35.9	0.0629	57.9	0.7769	0.634
250.0	0.3360	42.2	0.0718	63.4	0.7290	0.621
260.0	0.3486	48.4	0.0805	68.4	0.6890	0.612
270.0	0.3606	54.4	0.0889	73.1	0.6550	0.606
280.0	0.3720	60.5	0.0971	77.5	0.6256	0.603
290.0	0.3830	66.5	0.1052	81.7	0.5998	0.601
300.0	0.3936	72.5	0.1131	85.7	0.5769	0.600
310.0	0.4039	78.5	0.1210	89.6	0.5564	0.600
320.0	0.4139	84.5	0.1287	93.3	0.5378	0.601
330.0	0.4237	90.6	0.1364	96.8	0.5210	0.603
340.0	0.4332	96.6	0.1440	100.3	0.5056	0.605
350.0	0.4426	102.7	0.1516	103.6	0.4915	0.608
360.0	0.4519	108.8	0.1590	106.9	0.4784	0.610
370.0	0.4609	114.9	0.1665	110.1	0.4662	0.614
380.0	0.4699	121.0	0.1738	113.2	0.4548	0.617
390.0	0.4787	127.2	0.1811	116.3	0.4442	0.620
400.0	0.4874	133.4	0.1884	119.3	0.4343	0.624
420.0	0.5045	146.0	0.2029	125.2	0.4160	0.631
440.0	0.5213	158.7	0.2171	130.8	0.3997	0.639
460.0	0.5378	171.6	0.2313	136.4	0.3849	0.647
480.0	0.5540	184.6	0.2453	141.8	0.3714	0.656
500.0	0.5700	197.8	0.2592	147.0	0.3591	0.664
520.0	0.5858	211.1	0.2730	152.2	0.3478	0.672
540.0	0.6014	224.7	0.2866	157.3	0.3373	0.681
560.0	0.6168	238.4	0.3002	162.2	0.3275	0.689
580.0	0.6321	252.2	0.3137	167.2	0.3184	0.697
600.0	0.6473	266.3	0.3270	172.0	0.3099	0.706

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

300 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.1611)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
228.31	0.03720	-67.0	-0.0839	182.	17.27	0.798
228.31	0.2700	25.3	0.0460	42.9	0.9976	0.714
230.0	0.2729	26.5	0.0478	44.2	0.9811	0.705
240.0	0.2884	33.4	0.0577	51.2	0.8986	0.669
250.0	0.3023	39.9	0.0670	57.3	0.8345	0.646
260.0	0.3152	46.3	0.0759	62.9	0.7826	0.631
270.0	0.3272	52.6	0.0846	68.1	0.7394	0.622
280.0	0.3385	58.8	0.0930	72.8	0.7027	0.616
290.0	0.3493	64.9	0.1012	77.3	0.6709	0.612
300.0	0.3597	71.0	0.1093	81.6	0.6431	0.609
310.0	0.3698	77.1	0.1173	85.7	0.6184	0.608
320.0	0.3795	83.2	0.1251	89.6	0.5963	0.609
330.0	0.3890	89.3	0.1329	93.3	0.5764	0.609
340.0	0.3982	95.4	0.1406	96.9	0.5582	0.611
350.0	0.4073	101.5	0.1482	100.5	0.5416	0.613
360.0	0.4162	107.6	0.1557	103.9	0.5264	0.615
370.0	0.4249	113.8	0.1632	107.2	0.5123	0.618
380.0	0.4334	120.0	0.1706	110.4	0.4992	0.621
390.0	0.4419	126.2	0.1780	113.6	0.4870	0.624
400.0	0.4502	132.5	0.1853	116.7	0.4755	0.627
420.0	0.4665	145.1	0.1998	122.8	0.4547	0.634
440.0	0.4825	157.9	0.2141	128.6	0.4362	0.642
460.0	0.4982	170.8	0.2283	134.3	0.4195	0.650
480.0	0.5136	183.8	0.2424	139.8	0.4043	0.658
500.0	0.5287	197.1	0.2563	145.2	0.3905	0.666
520.0	0.5437	210.5	0.2701	150.5	0.3778	0.674
540.0	0.5584	224.0	0.2838	155.7	0.3661	0.682
560.0	0.5730	237.8	0.2974	160.8	0.3553	0.691
580.0	0.5875	251.6	0.3109	165.8	0.3452	0.699
600.0	0.6018	265.7	0.3243	170.7	0.3357	0.707

TABLE B2A (CONT) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

320 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
COEXISTING LIQUID (X=.1572)						
234.61	0.03798	-61.8	-0.0768	158.	16.24	0.825
234.61	0.2483	26.5	0.0464	39.6	1.1050	0.749
240.0	0.2572	30.4	0.0521	43.9	1.0454	0.718
250.0	0.2719	37.4	0.0620	50.9	0.9575	0.679
260.0	0.2852	44.1	0.0713	57.2	0.8892	0.656
270.0	0.2974	50.6	0.0802	62.8	0.8340	0.641
280.0	0.3088	56.9	0.0889	68.0	0.7880	0.631
290.0	0.3196	63.2	0.0973	72.8	0.7488	0.624
300.0	0.3299	69.4	0.1056	77.4	0.7149	0.620
310.0	0.3398	75.6	0.1137	81.7	0.6852	0.618
320.0	0.3493	81.8	0.1216	85.8	0.6589	0.616
330.0	0.3585	88.0	0.1295	89.8	0.6353	0.616
340.0	0.3675	94.1	0.1372	93.6	0.6140	0.617
350.0	0.3763	100.3	0.1449	97.3	0.5946	0.618
360.0	0.3849	106.5	0.1525	100.8	0.5769	0.620
370.0	0.3933	112.7	0.1601	104.3	0.5606	0.622
380.0	0.4015	119.0	0.1675	107.6	0.5456	0.625
390.0	0.4096	125.2	0.1749	110.9	0.5316	0.628
400.0	0.4176	131.5	0.1823	114.1	0.5185	0.631
420.0	0.4333	144.2	0.1969	120.4	0.4949	0.637
440.0	0.4486	157.0	0.2113	126.4	0.4739	0.644
460.0	0.4635	170.0	0.2255	132.2	0.4552	0.652
480.0	0.4782	183.1	0.2396	137.9	0.4382	0.660
500.0	0.4926	196.4	0.2536	143.4	0.4228	0.668
520.0	0.5068	209.8	0.2675	148.8	0.4087	0.676
540.0	0.5209	223.4	0.2812	154.1	0.3957	0.684
560.0	0.5347	237.1	0.2948	159.3	0.3837	0.692
580.0	0.5485	251.0	0.3083	164.4	0.3725	0.700
600.0	0.5620	265.1	0.3217	169.4	0.3621	0.708

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

340 PSIA

T DEG F COEXISTING	V FT <sup>3</sup> /LB LIQUID (X=.1534)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
240.61	0.03880	-56.7	-0.0699	135.	15.27	0.855
240.61	0.2288	27.5	0.0466	36.3	1.2211	0.790
250.0	0.2440	34.6	0.0566	44.0	1.1045	0.727
260.0	0.2580	41.7	0.0665	51.1	1.0126	0.688
270.0	0.2706	48.4	0.0758	57.3	0.9409	0.665
280.0	0.2822	55.0	0.0848	63.0	0.8829	0.649
290.0	0.2930	61.4	0.0934	68.2	0.8344	0.639
300.0	0.3033	67.8	0.1019	73.1	0.7931	0.632
310.0	0.3131	74.1	0.1101	77.7	0.7574	0.628
320.0	0.3225	80.4	0.1182	82.0	0.7260	0.625
330.0	0.3315	86.6	0.1262	86.2	0.6982	0.624
340.0	0.3403	92.9	0.1340	90.2	0.6732	0.624
350.0	0.3488	99.1	0.1418	94.0	0.6507	0.624
360.0	0.3572	105.3	0.1494	97.7	0.6302	0.625
370.0	0.3653	111.6	0.1570	101.3	0.6114	0.627
380.0	0.3733	117.9	0.1646	104.8	0.5942	0.629
390.0	0.3811	124.2	0.1720	108.2	0.5782	0.632
400.0	0.3889	130.5	0.1794	111.6	0.5634	0.634
420.0	0.4039	143.3	0.1941	118.0	0.5366	0.640
440.0	0.4186	156.2	0.2086	124.2	0.5130	0.647
460.0	0.4329	169.2	0.2229	130.2	0.4920	0.654
480.0	0.4470	182.3	0.2370	136.0	0.4731	0.662
500.0	0.4608	195.6	0.2510	141.6	0.4560	0.670
520.0	0.4744	209.1	0.2649	147.2	0.4403	0.677
540.0	0.4877	222.7	0.2787	152.6	0.4260	0.685
560.0	0.5010	236.5	0.2923	157.8	0.4127	0.693
580.0	0.5140	250.5	0.3059	163.0	0.4004	0.701
600.0	0.5269	264.6	0.3193	168.1	0.3890	0.709



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR  
360 PSIA

T DEG F COEXISTING LIQUID (X=.1497)	V FT <sup>3</sup> /LB LIQUID (X=.1497)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
246.35	0.03968	-51.6	-0.0632	115.	14.33	0.892
246.35	0.2112	28.3	0.0456	33.0	1.347	0.838
250.0	0.2175	31.3	0.0508	36.4	1.287	0.799
260.0	0.2329	38.9	0.0615	44.6	1.158	0.733
270.0	0.2461	46.1	0.0713	51.6	1.064	0.695
280.0	0.2581	52.9	0.0806	57.8	0.9895	0.672
290.0	0.2691	59.6	0.0895	63.5	0.9292	0.657
300.0	0.2794	66.1	0.0982	68.7	0.8787	0.646
310.0	0.2891	72.5	0.1066	73.6	0.8356	0.640
320.0	0.2984	78.9	0.1148	78.2	0.7983	0.635
330.0	0.3074	85.2	0.1229	82.6	0.7654	0.632
340.0	0.3160	91.5	0.1308	86.8	0.7362	0.631
350.0	0.3243	97.8	0.1387	90.8	0.7100	0.631
360.0	0.3325	104.2	0.1464	94.7	0.6864	0.631
370.0	0.3404	110.5	0.1541	98.4	0.6648	0.632
380.0	0.3482	116.8	0.1617	102.0	0.6451	0.634
390.0	0.3558	123.2	0.1692	105.5	0.6269	0.636
400.0	0.3632	129.5	0.1766	109.0	0.6101	0.638
420.0	0.3778	142.4	0.1914	115.6	0.5799	0.644
440.0	0.3919	155.3	0.2059	122.0	0.5535	0.650
460.0	0.4057	168.4	0.2203	128.1	0.5300	0.657
480.0	0.4192	181.6	0.2345	134.1	0.5090	0.664
500.0	0.4325	194.9	0.2485	139.9	0.4901	0.672
520.0	0.4455	208.4	0.2625	145.5	0.4728	0.679
540.0	0.4583	222.1	0.2763	151.0	0.4570	0.687
560.0	0.4709	235.9	0.2900	156.4	0.4424	0.695
580.0	0.4834	249.9	0.3035	161.7	0.4290	0.703
600.0	0.4958	264.0	0.3170	166.9	0.4164	0.711

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

380 PSIA

T DEG F	V FT <sup>3</sup> /LB COEXISTING LIQUID (X=.1460)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
251.83	0.04063	-46.7	-0.0567	96.	13.43	0.936
251.83	0.1951	28.9	0.0464	29.6	1.485	0.896
260.0	0.2091	35.8	0.0560	37.4	1.336	0.798
270.0	0.2234	43.5	0.0666	45.4	1.207	0.736
280.0	0.2360	50.6	0.0763	52.3	1.111	0.701
290.0	0.2473	57.5	0.0856	58.5	1.035	0.678
300.0	0.2577	64.2	0.0945	64.2	0.9728	0.663
310.0	0.2675	70.8	0.1031	69.4	0.9208	0.653
320.0	0.2768	77.3	0.1115	74.3	0.8762	0.646
330.0	0.2856	83.8	0.1197	78.9	0.8375	0.642
340.0	0.2941	90.2	0.1277	83.3	0.8034	0.639
350.0	0.3023	96.6	0.1357	87.5	0.7730	0.638
360.0	0.3103	102.9	0.1435	91.5	0.7457	0.637
370.0	0.3181	109.3	0.1512	95.4	0.7210	0.638
380.0	0.3256	115.7	0.1589	99.2	0.6985	0.639
390.0	0.3330	122.1	0.1664	102.9	0.6779	0.640
400.0	0.3403	128.5	0.1740	106.4	0.6589	0.642
420.0	0.3544	141.4	0.1888	113.3	0.6249	0.647
440.0	0.3681	154.4	0.2034	119.8	0.5954	0.653
460.0	0.3814	167.5	0.2178	126.1	0.5693	0.659
480.0	0.3944	180.8	0.2321	132.2	0.5460	0.666
500.0	0.4071	194.2	0.2462	138.1	0.5251	0.674
520.0	0.4196	207.7	0.2601	143.9	0.5061	0.681
540.0	0.4319	221.4	0.2740	149.5	0.4887	0.689
560.0	0.4441	235.3	0.2877	155.0	0.4728	0.696
580.0	0.4560	249.3	0.3013	160.4	0.4581	0.704
600.0	0.4679	263.4	0.3148	165.6	0.4444	0.712

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

400 PSIA

T DEG F	V FT <sup>3</sup> /LB LIQUID (X=.1424)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
257.09	0.04167	-41.8	-0.0503	79.	12.56	0.990
257.09	0.1802	29.3	0.0460	26.2	1.636	0.969
260.0	0.1858	32.1	0.0493	29.5	1.563	0.909
270.0	0.2020	40.5	0.0514	38.9	1.378	0.794
280.0	0.2154	48.2	0.0718	46.6	1.250	0.738
290.0	0.2272	55.4	0.0815	53.4	1.154	0.704
300.0	0.2379	62.3	0.0907	59.5	1.077	0.683
310.0	0.2478	69.1	0.0995	65.1	1.014	0.669
320.0	0.2571	75.7	0.1081	70.3	0.9607	0.659
330.0	0.2659	82.3	0.1165	75.2	0.9149	0.653
340.0	0.2743	88.8	0.1247	79.8	0.8750	0.648
350.0	0.2825	95.2	0.1327	84.2	0.8398	0.646
360.0	0.2903	101.7	0.1405	88.4	0.8084	0.644
370.0	0.2979	108.1	0.1484	92.5	0.7802	0.644
380.0	0.3053	114.6	0.1561	96.4	0.7546	0.644
390.0	0.3125	121.0	0.1638	100.2	0.7312	0.645
400.0	0.3196	127.5	0.1713	103.8	0.7098	0.647
420.0	0.3333	140.5	0.1862	110.9	0.6717	0.651
440.0	0.3466	153.5	0.2009	117.6	0.6387	0.656
460.0	0.3595	166.7	0.2154	124.1	0.6098	0.662
480.0	0.3720	180.0	0.2297	130.3	0.5841	0.669
500.0	0.3843	193.4	0.2439	136.4	0.5611	0.676
520.0	0.3964	207.0	0.2579	142.2	0.5402	0.683
540.0	0.4082	220.8	0.2716	148.0	0.5212	0.690
560.0	0.4199	234.6	0.2855	153.6	0.5036	0.696
580.0	0.4314	248.7	0.2991	159.0	0.4878	0.705
600.0	0.4428	262.8	0.3126	164.4	0.4730	0.713

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR  
420 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
COEXISTING LIQUID (X=.1388)						
262.13	0.04283	-36.8	-0.0439	64.	11.71	1.061
262.13	0.1664	29.5	0.0453	22.9	1.805	1.063
270.0	0.1812	37.1	0.0557	31.6	1.592	0.886
280.0	0.1960	45.4	0.0671	40.6	1.415	0.789
290.0	0.2085	53.0	0.0773	48.1	1.290	0.738
300.0	0.2196	60.2	0.0869	54.7	1.193	0.707
310.0	0.2297	67.2	0.0960	60.7	1.116	0.687
320.0	0.2391	74.0	0.1048	66.3	1.052	0.674
330.0	0.2479	80.7	0.1133	71.4	0.9984	0.664
340.0	0.2563	87.3	0.1216	76.3	0.9517	0.658
350.0	0.2644	93.9	0.1298	80.9	0.9109	0.654
360.0	0.2721	100.4	0.1378	85.3	0.8748	0.652
370.0	0.2796	106.9	0.1457	89.5	0.8425	0.650
380.0	0.2869	113.4	0.1535	93.6	0.8135	0.650
390.0	0.2939	119.9	0.1612	97.5	0.7870	0.650
400.0	0.3008	126.4	0.1688	101.3	0.7629	0.651
420.0	0.3142	139.5	0.1838	108.5	0.7203	0.655
440.0	0.3271	152.6	0.1986	115.5	0.6836	0.659
460.0	0.3396	165.9	0.2131	122.1	0.6516	0.665
480.0	0.3518	179.2	0.2275	128.5	0.6233	0.671
500.0	0.3637	192.7	0.2417	134.6	0.5980	0.678
520.0	0.3753	206.3	0.2557	140.6	0.5752	0.685
540.0	0.3868	220.1	0.2696	146.5	0.5545	0.692
560.0	0.3980	234.0	0.2834	152.2	0.5356	0.699
580.0	0.4091	248.1	0.2970	157.7	0.5182	0.707
600.0	0.4200	262.3	0.3106	163.2	0.5021	0.714



TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR  
440 PSIA

T DEG F COEXISTING	V FT <sup>3</sup> /LB LIQUID (X=.1351)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
266.97	0.04413	-31.9	-0.0375	50.	10.87	1.157
266.97	0.1533	29.4	0.0443	19.4	1.995	1.189
270.0	0.1601	32.8	0.0490	23.4	1.876	1.058
280.0	0.1773	42.2	0.0618	34.0	1.614	0.864
290.0	0.1909	50.4	0.0729	42.5	1.447	0.782
300.0	0.2025	58.0	0.0829	49.8	1.325	0.737
310.0	0.2130	65.2	0.0924	56.2	1.230	0.709
320.0	0.2225	72.2	0.1014	62.2	1.153	0.691
330.0	0.2314	79.1	0.1101	67.6	1.089	0.678
340.0	0.2398	85.8	0.1186	72.7	1.034	0.669
350.0	0.2478	92.5	0.1269	77.6	0.9867	0.663
360.0	0.2555	99.1	0.1350	82.1	0.9452	0.660
370.0	0.2629	105.7	0.1430	86.5	0.9084	0.657
380.0	0.2700	112.3	0.1508	90.7	0.8753	0.656
390.0	0.2770	118.8	0.1586	94.8	0.8455	0.656
400.0	0.2838	125.4	0.1663	98.7	0.8184	0.656
420.0	0.2968	138.5	0.1814	106.2	0.7708	0.658
440.0	0.3094	151.7	0.1962	113.3	0.7301	0.663
460.0	0.3216	165.0	0.2109	120.1	0.6948	0.668
480.0	0.3334	178.4	0.2253	126.6	0.6636	0.674
500.0	0.3449	192.0	0.2395	132.9	0.6360	0.680
520.0	0.3562	205.6	0.2536	139.0	0.6111	0.687
540.0	0.3673	219.4	0.2676	145.0	0.5886	0.694
560.0	0.3782	233.4	0.2814	150.8	0.5680	0.701
580.0	0.3889	247.5	0.2950	156.5	0.5492	0.708
600.0	0.3994	261.7	0.3086	162.0	0.5318	0.716

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

## 460 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
COEXISTING LIQUID (X=.1313)						
271.62	0.04565	-26.8	-0.0311	38.	10.04	1.296
271.62	0.1409	28.9	0.0429	16.0	2.213	1.368
280.0	0.1588	38.4	0.0559	26.9	1.867	0.988
290.0	0.1741	47.5	0.0681	36.6	1.632	0.844
300.0	0.1865	55.6	0.0788	44.6	1.474	0.775
310.0	0.1974	63.1	0.0886	51.6	1.356	0.736
320.0	0.2072	70.4	0.0980	58.0	1.263	0.710
330.0	0.2162	77.4	0.1069	63.8	1.187	0.694
340.0	0.2246	84.3	0.1156	69.1	1.122	0.682
350.0	0.2326	91.0	0.1240	74.2	1.068	0.674
360.0	0.2403	97.7	0.1322	79.0	1.020	0.668
370.0	0.2476	104.4	0.1403	83.5	0.9779	0.665
380.0	0.2546	111.1	0.1483	87.9	0.9405	0.663
390.0	0.2615	117.7	0.1561	92.1	0.9069	0.661
400.0	0.2681	124.3	0.1638	96.1	0.8764	0.661
420.0	0.2810	137.5	0.1791	103.9	0.8233	0.663
440.0	0.2932	150.8	0.1940	111.2	0.7782	0.666
460.0	0.3051	164.2	0.2087	118.1	0.7393	0.671
480.0	0.3166	177.6	0.2232	124.8	0.7052	0.676
500.0	0.3278	191.2	0.2374	131.2	0.6749	0.682
520.0	0.3388	204.9	0.2516	137.5	0.6479	0.689
540.0	0.3495	218.8	0.2656	143.5	0.6234	0.695
560.0	0.3600	232.7	0.2794	149.4	0.6012	0.702
580.0	0.3704	246.9	0.2931	155.2	0.5808	0.710
600.0	0.3806	261.1	0.3067	160.8	0.5621	0.717

## 480 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
COEXISTING LIQUID (X=.1272)						
276.07	0.04749	-21.6	-0.0245	27.	9.20	1.515
276.07	0.1287	28.0	0.0410	12.6	2.470	1.646
280.0	0.1393	33.6	0.0485	18.7	2.217	1.245
290.0	0.1576	44.1	0.0628	30.3	1.859	0.936
300.0	0.1713	52.9	0.0744	39.3	1.648	0.826
310.0	0.1827	60.9	0.0848	46.9	1.498	0.769
320.0	0.1928	68.4	0.0945	53.7	1.384	0.734
330.0	0.2020	75.6	0.1037	59.9	1.293	0.711
340.0	0.2106	82.6	0.1125	65.5	1.218	0.696
350.0	0.2186	89.5	0.1211	70.8	1.154	0.685
360.0	0.2262	96.4	0.1295	75.8	1.099	0.678
370.0	0.2335	103.1	0.1377	80.6	1.051	0.673
380.0	0.2405	109.8	0.1457	85.1	1.009	0.670
390.0	0.2472	116.5	0.1536	89.4	0.9712	0.668
400.0	0.2538	123.2	0.1614	93.6	0.9371	0.667
420.0	0.2664	136.5	0.1768	101.5	0.8779	0.667
440.0	0.2784	149.9	0.1918	109.0	0.8281	0.670
460.0	0.2900	163.3	0.2065	116.2	0.7853	0.674
480.0	0.3012	176.8	0.2211	123.0	0.7480	0.679
500.0	0.3121	190.5	0.2354	129.6	0.7150	0.684
520.0	0.3228	204.2	0.2496	135.9	0.6856	0.691
540.0	0.3332	218.1	0.2636	142.1	0.6591	0.697
560.0	0.3434	232.1	0.2775	148.1	0.6350	0.704
580.0	0.3534	246.2	0.2912	153.9	0.6131	0.711
600.0	0.3633	260.5	0.3049	159.7	0.5929	0.718

TABLE B2A (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE VAPOR

500 PSIA

T DEG F	V FT <sup>3</sup> /LB LIQUID (X=.1213)	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
COEXISTING 280.33	0.05001	-15.7	-0.0171	17.	8.28	1.956
280.33	0.1165	26.5	0.0363	9.2	2.785	2.133
290.0	0.1410	40.1	0.0566	23.5	2.150	1.092
300.0	0.1566	49.9	0.0696	33.7	1.853	0.896
310.0	0.1688	58.4	0.0807	42.1	1.660	0.810
320.0	0.1794	66.2	0.0908	49.4	1.520	0.762
330.0	0.1889	73.7	0.1004	55.9	1.410	0.732
340.0	0.1975	80.9	0.1094	61.9	1.321	0.712
350.0	0.2056	87.7	0.1182	67.4	1.247	0.698
360.0	0.2132	94.9	0.1267	72.7	1.184	0.689
370.0	0.2205	101.8	0.1350	77.6	1.129	0.682
380.0	0.2274	108.6	0.1432	82.3	1.081	0.677
390.0	0.2341	115.3	0.1512	86.8	1.039	0.674
400.0	0.2406	122.1	0.1591	91.1	1.000	0.672
420.0	0.2530	135.5	0.1745	99.2	0.9348	0.672
440.0	0.2648	149.0	0.1896	106.9	0.8797	0.673
460.0	0.2761	162.5	0.2045	114.2	0.8328	0.677
480.0	0.2871	176.0	0.2191	121.2	0.7920	0.681
500.0	0.2977	189.7	0.2335	127.9	0.7561	0.687
520.0	0.3080	203.5	0.2477	134.4	0.7242	0.693
540.0	0.3182	217.4	0.2617	140.7	0.6955	0.699
560.0	0.3281	231.5	0.2757	146.8	0.6696	0.706
580.0	0.3379	245.6	0.2894	152.7	0.6460	0.713
600.0	0.3475	260.0	0.3031	158.5	0.6244	0.720

520 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
290.0	0.12324	34.8	0.0489	15.9	2.56	1.424
300.0	0.14207	46.4	0.0643	27.8	2.10	1.001
310.0	0.15556	55.7	0.0764	37.1	1.85	0.865
320.0	0.16671	64.0	0.0871	44.9	1.67	0.797
330.0	0.17648	71.7	0.0970	51.9	1.54	0.757
340.0	0.18532	79.2	0.1063	58.2	1.43	0.730
350.0	0.19349	86.4	0.1153	64.0	1.35	0.713
360.0	0.2011	93.4	0.1240	69.5	1.27	0.700
370.0	0.2084	100.4	0.1324	74.6	1.21	0.691
380.0	0.2153	107.3	0.1407	79.5	1.16	0.685
390.0	0.2219	114.1	0.1488	84.1	1.11	0.681
400.0	0.2283	120.9	0.1567	88.6	1.07	0.679
420.0	0.2406	134.5	0.1723	97.0	0.994	0.677
440.0	0.2522	148.0	0.1875	104.9	0.933	0.677
460.0	0.2633	161.6	0.2024	112.3	0.882	0.680
480.0	0.2740	175.2	0.2171	119.4	0.837	0.684
500.0	0.2844	188.9	0.2315	126.	0.798	0.689
520.0	0.2945	202.8	0.2458	133.	0.764	0.695
540.0	0.3043	216.7	0.2599	139.	0.733	0.701
560.0	0.3140	230.8	0.2739	145.	0.705	0.707
580.0	0.3235	245.0	0.2877	152.	0.680	0.714
600.0	0.3328	259.4	0.3013	157.	0.656	0.721

TABLE B2B. THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS IN THE LIQUID.

5 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02543	-224.4	-0.3720	1890.	65.8	0.495
-30.55	0.02564	-219.7	-0.3609	1818.	64.1	0.502
COEXISTING VAPOR (X=0.0196)						
-30.55	15.508	-49.2	0.0238	76.2	0.0120	0.335

10 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02543	-224.4	-0.3720	1892.	65.9	0.495
-30.0	0.02565	-219.4	-0.3603	1817.	64.0	0.502
-20.0	0.02589	-214.3	-0.3487	1739.	62.1	0.509
-10.0	0.02613	-209.2	-0.3372	1659.	60.2	0.515
-2.82	0.02631	-205.5	-0.3291	1602.	58.7	0.519
COEXISTING VAPOR (X=0.0230)						
-2.82	8.149	-40.6	0.0207	79.0	0.0232	0.354

14.696 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02542	-224.4	-0.3721	1894.	65.9	0.495
-30.0	0.02565	-219.4	-0.3603	1819.	64.1	0.502
-20.0	0.02589	-214.3	-0.3487	1741.	62.2	0.509
-10.0	0.02613	-209.2	-0.3373	1661.	60.2	0.515
0.0	0.02638	-204.0	-0.3259	1581.	58.2	0.521
10.0	0.02664	-198.8	-0.3147	1501.	56.2	0.526
14.45	0.02676	-196.5	-0.3097	1465.	55.3	0.529
COEXISTING VAPOR (X=0.0252)						
14.45	5.694	-35.1	0.0201	80.2	0.0335	0.367

20 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02542	-224.3	-0.3721	1897.	66.0	0.495
-30.0	0.02565	-219.4	-0.3604	1821.	64.1	0.502
-20.0	0.02588	-214.3	-0.3488	1743.	62.2	0.509
-10.0	0.02613	-209.2	-0.3373	1664.	60.3	0.515
0.0	0.02638	-204.0	-0.3259	1583.	58.3	0.521
10.0	0.02664	-198.8	-0.3147	1503.	56.2	0.526
20.0	0.02691	-193.5	-0.3036	1422.	54.2	0.532
29.39	0.02717	-188.5	-0.2933	1347.	52.3	0.538
COEXISTING VAPOR (X=0.0271)						
29.39	4.269	-30.4	0.0201	80.9	0.0452	0.379



TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

25 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02542	-224.3	-0.3721	1899.	66.1	0.495
-30.0	0.02565	-219.3	-0.3604	1823.	64.2	0.502
-20.0	0.02588	-214.3	-0.3488	1745.	62.3	0.509
-10.0	0.02613	-209.2	-0.3373	1666.	60.3	0.515
0.0	0.02638	-204.0	-0.3260	1586.	58.3	0.521
10.0	0.02664	-198.8	-0.3147	1505.	56.3	0.526
20.0	0.02691	-193.5	-0.3036	1424.	54.3	0.532
30.0	0.02719	-188.2	-0.2926	1344.	52.2	0.539
40.0	0.02748	-182.8	-0.2817	1265.	50.2	0.545
40.88	0.02751	-182.3	-0.2807	1258.	50.0	0.546
COEXISTING	VAPOR (X=0.287)					
40.88	3.462	-26.8	0.0205	81.2	0.0563	0.389

30 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02542	-224.3	-0.3721	1902.	66.1	0.495
-30.0	0.02565	-219.3	-0.3604	1826.	64.3	0.502
-20.0	0.02588	-214.3	-0.3488	1748.	62.3	0.509
-10.0	0.02612	-209.2	-0.3373	1668.	60.4	0.515
0.0	0.02637	-204.0	-0.3260	1588.	58.4	0.521
10.0	0.02663	-198.8	-0.3148	1507.	56.4	0.526
20.0	0.02690	-193.5	-0.3037	1426.	54.3	0.532
30.0	0.02719	-188.2	-0.2926	1346.	52.3	0.539
40.0	0.02748	-182.7	-0.2817	1267.	50.2	0.545
50.0	0.02778	-177.2	-0.2708	1188.	48.22	0.552
50.73	0.02781	-176.8	-0.2700	1182.	48.07	0.553
COEXISTING	VAPOR (X=0.300)					
50.73	2.915	-23.6	0.0211	81.2	0.0676	0.397

40 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02542	-224.3	-0.3722	1906.	66.3	0.495
-30.0	0.02564	-219.3	-0.3604	1830.	64.4	0.502
-20.0	0.02588	-214.2	-0.3488	1752.	62.4	0.509
-10.0	0.02612	-209.1	-0.3374	1672.	60.5	0.515
0.0	0.02637	-204.0	-0.3260	1592.	58.5	0.520
10.0	0.02663	-198.8	-0.3148	1511.	56.4	0.526
20.0	0.02690	-193.5	-0.3037	1430.	54.4	0.532
30.0	0.02718	-188.1	-0.2927	1350.	52.4	0.538
40.0	0.02747	-182.7	-0.2817	1270.	50.4	0.545
50.0	0.02778	-177.2	-0.2709	1192.	48.31	0.552
60.0	0.02810	-171.7	-0.2601	1115.	46.29	0.559
67.17	0.02834	-167.6	-0.2524	1060.	44.84	0.565
COEXISTING	VAPOR (X=0.323)					
67.17	2.219	-18.4	0.0224	80.8	0.0905	0.412

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## 50 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02541	-224.2	-0.3722	1911.	66.4	0.495
-30.0	0.02564	-219.3	-0.3605	1835.	64.5	0.502
-20.0	0.02587	-214.2	-0.3489	1757.	62.6	0.509
-10.0	0.02612	-209.1	-0.3374	1677.	60.6	0.515
0.0	0.02637	-203.9	-0.3261	1596.	58.6	0.520
10.0	0.02662	-198.7	-0.3149	1515.	56.6	0.526
20.0	0.02689	-193.5	-0.3038	1434.	54.5	0.532
30.0	0.02717	-188.1	-0.2928	1354.	52.5	0.538
40.0	0.02747	-182.7	-0.2818	1274.	50.4	0.545
50.0	0.02777	-177.2	-0.2709	1196.	48.40	0.552
60.0	0.02809	-171.6	-0.2601	1119.	46.37	0.559
70.0	0.02843	-166.0	-0.2494	1043.	44.36	0.567
80.0	0.02878	-160.3	-0.2387	968.	42.35	0.575
80.74	0.02881	-159.8	-0.2379	963.	42.20	0.576
COEXISTING VAPOR (X=.0342)						
80.74	1.792	-14.1	0.0237	80.0	0.1141	0.426

## 60 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02541	-224.2	-0.3722	1916.	66.5	0.495
-30.0	0.02564	-219.2	-0.3605	1840.	64.6	0.502
-20.0	0.02587	-214.2	-0.3489	1761.	62.7	0.509
-10.0	0.02611	-209.1	-0.3375	1681.	60.7	0.515
0.0	0.02636	-203.9	-0.3261	1600.	58.7	0.520
10.0	0.02662	-198.7	-0.3149	1519.	56.6	0.526
20.0	0.02689	-193.4	-0.3038	1438.	54.6	0.532
30.0	0.02717	-188.1	-0.2928	1358.	52.6	0.538
40.0	0.02746	-182.7	-0.2819	1278.	50.5	0.545
50.0	0.02777	-177.2	-0.2710	1200.	48.49	0.552
60.0	0.02808	-171.6	-0.2602	1122.	46.46	0.559
70.0	0.02842	-166.0	-0.2494	1046.	44.45	0.567
80.0	0.02877	-160.2	-0.2388	972.	42.44	0.575
90.0	0.02914	-154.4	-0.2281	899.	40.45	0.584
92.41	0.02924	-153.0	-0.2255	862.	39.97	0.586
COEXISTING VAPOR (X=.0360)						
92.41	1.502	-10.5	0.0251	79.0	0.1384	0.438

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## 80 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02540	-224.2	-0.3723	1925.	66.8	0.495
-30.0	0.02563	-219.2	-0.3606	1849.	64.9	0.502
-20.0	0.02586	-214.1	-0.3490	1770.	62.9	0.509
-10.0	0.02610	-209.0	-0.3376	1690.	60.9	0.514
0.0	0.02635	-203.9	-0.3262	1609.	58.9	0.520
10.0	0.02661	-198.7	-0.3150	1527.	56.8	0.526
20.0	0.02688	-193.4	-0.3039	1446.	54.8	0.532
30.0	0.02716	-188.0	-0.2929	1366.	52.8	0.538
40.0	0.02745	-182.6	-0.2820	1286.	50.7	0.545
50.0	0.02775	-177.1	-0.2711	1207.	48.7	0.551
60.0	0.02807	-171.6	-0.2603	1130.	46.6	0.559
70.0	0.02840	-165.9	-0.2496	1054.	44.6	0.567
80.0	0.02875	-160.2	-0.2389	980.	42.6	0.575
90.0	0.02912	-154.4	-0.2282	907.	40.6	0.584
100.0	0.02951	-148.5	-0.2176	836.	38.6	0.593
110.0	0.02993	-142.5	-0.2070	766.	36.7	0.603
111.95	0.03002	-141.3	-0.2050	753.	36.3	0.605
COEXISTING VAPOR (X= 0.389)						
111.95	1.133	-4.4	0.0277	76.6	0.1891	0.461

## 100 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02540	-224.1	-0.3724	1935.	67.0	0.495
-30.0	0.02562	-219.1	-0.3607	1858.	65.1	0.502
-20.0	0.02585	-214.1	-0.3491	1779.	63.1	0.508
-10.0	0.02609	-209.0	-0.3376	1698.	61.1	0.514
0.0	0.02634	-203.8	-0.3263	1617.	59.1	0.520
10.0	0.02660	-198.6	-0.3151	1535.	57.0	0.526
20.0	0.02687	-193.3	-0.3040	1454.	55.0	0.532
30.0	0.02715	-188.0	-0.2930	1373.	52.9	0.538
40.0	0.02744	-182.6	-0.2821	1294.	50.9	0.544
50.0	0.02774	-177.1	-0.2712	1215.	48.8	0.551
60.0	0.02806	-171.5	-0.2604	1137.	46.8	0.559
70.0	0.02839	-165.9	-0.2497	1061.	44.8	0.566
80.0	0.02874	-160.2	-0.2390	987.	42.8	0.575
90.0	0.02910	-154.4	-0.2284	914.	40.8	0.583
100.0	0.02949	-148.5	-0.2178	843.	38.8	0.593
110.0	0.02991	-142.5	-0.2072	773.	36.9	0.602
120.0	0.03035	-136.4	-0.1966	706.	34.9	0.613
128.14	0.03073	-131.4	-0.1880	652.	33.3	0.622
COEXISTING VAPOR (X= 0.415)						
128.14	0.9066	0.5	0.0300	73.9	0.2431	0.482

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## 120 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02539	-224.0	-0.3725	1944.	67.3	0.494
-30.0	0.02561	-219.1	-0.3608	1867.	65.3	0.502
-20.0	0.02585	-214.0	-0.3492	1788.	63.3	0.508
-10.0	0.02609	-208.9	-0.3377	1707.	61.3	0.514
0.0	0.02634	-203.8	-0.3264	1625.	59.3	0.520
10.0	0.02659	-198.5	-0.3152	1544.	57.2	0.526
20.0	0.02686	-193.3	-0.3041	1462.	55.2	0.531
30.0	0.02714	-187.9	-0.2931	1381.	53.1	0.538
40.0	0.02743	-182.5	-0.2822	1301.	51.1	0.544
50.0	0.02773	-177.0	-0.2713	1223.	49.0	0.551
60.0	0.02804	-171.5	-0.2605	1145.	47.0	0.558
70.0	0.02837	-165.9	-0.2498	1069.	45.0	0.566
80.0	0.02872	-160.1	-0.2392	994.	43.0	0.574
90.0	0.02909	-154.4	-0.2285	922.	41.0	0.583
100.0	0.02947	-148.5	-0.2179	850.	39.0	0.592
110.0	0.02988	-142.5	-0.2073	781.	37.0	0.602
120.0	0.03032	-136.4	-0.1968	713.	35.1	0.612
130.0	0.03079	-130.2	-0.1862	647.	33.2	0.624
140.0	0.03130	-123.9	-0.1756	582.	31.2	0.636
142.09	0.03141	-122.6	-0.1734	569.	30.8	0.639
COEXISTING VAPOR (X = .0438)						
142.09	0.7530	4.68	0.0321	71.0	0.3005	0.503

## 140 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02538	-224.0	-0.3726	1954.	67.5	0.494
-30.0	0.02561	-219.0	-0.3609	1876.	65.6	0.502
-20.0	0.02584	-214.0	-0.3493	1796.	63.6	0.508
-10.0	0.02608	-208.9	-0.3378	1715.	61.5	0.514
0.0	0.02633	-203.7	-0.3265	1634.	59.5	0.520
10.0	0.02658	-198.5	-0.3153	1552.	57.4	0.525
20.0	0.02685	-193.2	-0.3042	1470.	55.4	0.531
30.0	0.02713	-187.9	-0.2932	1389.	53.3	0.537
40.0	0.02741	-182.5	-0.2823	1309.	51.3	0.544
50.0	0.02771	-177.0	-0.2714	1230.	49.2	0.551
60.0	0.02803	-171.4	-0.2607	1153.	47.2	0.558
70.0	0.02836	-165.8	-0.2500	1076.	45.1	0.566
80.0	0.02870	-160.1	-0.2393	1002.	43.1	0.574
90.0	0.02907	-154.3	-0.2287	929.	41.1	0.582
100.0	0.02945	-148.4	-0.2181	858.	39.2	0.592
110.0	0.02986	-142.5	-0.2075	788.	37.2	0.601
120.0	0.03030	-136.4	-0.1969	720.	35.3	0.612
130.0	0.03076	-130.2	-0.1864	654.	33.3	0.623
140.0	0.03127	-123.9	-0.1758	590.	31.4	0.635
150.0	0.03181	-117.5	-0.1652	527.	29.5	0.648
154.42	0.03207	-114.6	-0.1604	500.	28.7	0.655
COEXISTING VAPOR (X = .0460)						
154.42	0.6417	8.26	0.0340	68.0	0.3614	0.523



TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

160 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02538	-223.9	-0.3727	1963.	67.8	0.494
-30.0	0.02560	-218.9	-0.3610	1885.	65.8	0.502
-20.0	0.02583	-213.9	-0.3494	1805.	63.8	0.508
-10.0	0.02607	-208.8	-0.3379	1724.	61.8	0.514
0.0	0.02632	-203.6	-0.3266	1642.	59.7	0.520
10.0	0.02657	-198.4	-0.3154	1560.	57.6	0.525
20.0	0.02684	-193.2	-0.3043	1478.	55.6	0.531
30.0	0.02712	-187.8	-0.2933	1397.	53.5	0.537
40.0	0.02740	-182.4	-0.2824	1317.	51.4	0.544
50.0	0.02770	-177.0	-0.2716	1238.	49.4	0.550
60.0	0.02801	-171.4	-0.2608	1160.	47.3	0.558
70.0	0.02834	-165.8	-0.2501	1084.	45.3	0.565
80.0	0.02869	-160.1	-0.2394	1009.	43.3	0.573
90.0	0.02905	-154.3	-0.2288	936.	41.3	0.582
100.0	0.02943	-148.4	-0.2182	865.	39.3	0.591
110.0	0.02984	-142.4	-0.2077	796.	37.4	0.601
120.0	0.03027	-136.4	-0.1971	728.	35.4	0.611
130.0	0.03073	-130.2	-0.1865	662.	33.5	0.622
140.0	0.03123	-123.9	-0.1760	597.	31.6	0.634
150.0	0.03177	-117.5	-0.1654	535.	29.7	0.647
160.0	0.03236	-110.9	-0.1547	474.	27.8	0.662
165.53	0.03271	-107.2	-0.1488	441.	26.8	0.670
COEXISTING VAPOR (X= .0480)						
165.53	0.5570	11.39	0.0357	64.9	0.4261	0.543

180 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02537	-223.9	-0.3727	1973.	68.0	0.494
-30.0	0.02559	-218.9	-0.3610	1894.	66.0	0.502
-20.0	0.02582	-213.8	-0.3495	1814.	64.0	0.508
-10.0	0.02606	-208.7	-0.3380	1732.	62.0	0.514
0.0	0.02631	-203.6	-0.3267	1650.	59.9	0.519
10.0	0.02656	-198.4	-0.3155	1568.	57.8	0.525
20.0	0.02683	-193.1	-0.3044	1486.	55.7	0.531
30.0	0.02710	-187.8	-0.2934	1405.	53.7	0.537
40.0	0.02739	-182.4	-0.2825	1324.	51.6	0.543
50.0	0.02769	-176.9	-0.2717	1245.	49.6	0.550
60.0	0.02800	-171.4	-0.2609	1167.	47.5	0.557
70.0	0.02833	-165.7	-0.2502	1091.	45.5	0.565
80.0	0.02867	-160.0	-0.2396	1017.	43.5	0.573
90.0	0.02903	-154.3	-0.2289	944.	41.5	0.582
100.0	0.02941	-148.4	-0.2184	872.	39.5	0.591
110.0	0.02982	-142.4	-0.2078	803.	37.6	0.600
120.0	0.03025	-136.4	-0.1973	735.	35.6	0.610
130.0	0.03071	-130.2	-0.1867	669.	33.7	0.621
140.0	0.03120	-123.9	-0.1762	605.	31.8	0.633
150.0	0.03173	-117.5	-0.1656	542.	29.9	0.646
160.0	0.03232	-111.0	-0.1549	481.	28.0	0.660
170.0	0.03296	-104.3	-0.1442	422.	26.1	0.676
175.66	0.03335	-100.4	-0.1381	389.	25.1	0.686
COEXISTING VAPOR (X= .0499)						
175.66	0.4904	14.16	0.0372	61.6	0.4948	0.564

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## 200 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02536	-223.8	-0.3728	1982.	68.3	0.494
-30.0	0.02559	-218.8	-0.3611	1903.	66.3	0.501
-20.0	0.02582	-213.8	-0.3495	1822.	64.2	0.508
-10.0	0.02606	-208.7	-0.3381	1741.	62.2	0.514
0.0	0.02630	-203.5	-0.3268	1658.	60.1	0.519
10.0	0.02656	-198.3	-0.3156	1576.	58.0	0.525
20.0	0.02682	-193.1	-0.3045	1494.	55.9	0.531
30.0	0.02709	-187.7	-0.2935	1412.	53.9	0.537
40.0	0.02738	-182.3	-0.2826	1332.	51.8	0.543
50.0	0.02768	-176.9	-0.2718	1253.	49.7	0.550
60.0	0.02799	-171.3	-0.2610	1175.	47.7	0.557
70.0	0.02831	-165.7	-0.2503	1099.	45.7	0.565
80.0	0.02865	-160.0	-0.2397	1024.	43.6	0.573
90.0	0.02901	-154.2	-0.2291	951.	41.7	0.581
100.0	0.02939	-148.4	-0.2185	880.	39.7	0.590
110.0	0.02979	-142.4	-0.2080	810.	37.7	0.600
120.0	0.03022	-136.3	-0.1974	742.	35.8	0.610
130.0	0.03068	-130.2	-0.1869	677.	33.9	0.621
140.0	0.03117	-123.9	-0.1764	612.	32.0	0.632
150.0	0.03170	-117.5	-0.1659	550.	30.1	0.645
160.0	0.03227	-111.0	-0.1552	489.	28.2	0.659
170.0	0.03291	-104.3	-0.1445	430.	26.3	0.675
180.0	0.03361	-97.4	-0.1337	372.	24.5	0.693
185.00	0.03399	-93.9	-0.1283	344.	23.5	0.703
COEXISTING VAPOR (X=.0517)						
185.00	0.4365	16.63	0.0385	58.6	0.5678	0.585

## 220 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02536	-223.7	-0.3729	1991.	68.5	0.494
-30.0	0.02558	-218.8	-0.3612	1912.	66.5	0.501
-20.0	0.02581	-213.7	-0.3496	1831.	64.4	0.508
-10.0	0.02605	-208.6	-0.3382	1749.	62.4	0.514
0.0	0.02629	-203.5	-0.3269	1666.	60.3	0.519
10.0	0.02655	-198.3	-0.3157	1584.	58.2	0.525
20.0	0.02681	-193.0	-0.3046	1502.	56.1	0.531
30.0	0.02708	-187.7	-0.2936	1420.	54.0	0.537
40.0	0.02737	-182.3	-0.2827	1339.	52.0	0.543
50.0	0.02766	-176.8	-0.2719	1260.	49.9	0.550
60.0	0.02797	-171.3	-0.2611	1182.	47.8	0.557
70.0	0.02830	-165.7	-0.2504	1106.	45.8	0.564
80.0	0.02864	-160.0	-0.2398	1031.	43.8	0.572
90.0	0.02900	-154.2	-0.2292	958.	41.8	0.581
100.0	0.02937	-148.3	-0.2187	887.	39.8	0.590
110.0	0.02977	-142.4	-0.2081	817.	37.9	0.599
120.0	0.03020	-136.3	-0.1976	750.	36.0	0.609
130.0	0.03065	-130.2	-0.1871	684.	34.1	0.620
140.0	0.03114	-123.9	-0.1765	620.	32.2	0.631
150.0	0.03166	-117.5	-0.1660	557.	30.3	0.644
160.0	0.03223	-111.0	-0.1554	497.	28.4	0.658
170.0	0.03286	-104.3	-0.1447	437.	26.5	0.673
180.0	0.03355	-97.5	-0.1340	380.	24.7	0.691
190.0	0.03433	-90.5	-0.1231	324.	22.8	0.712
193.68	0.03464	-87.8	-0.1190	303.	22.1	0.720
COEXISTING VAPOR (X=.0535)						
193.68	0.3919	18.83	0.0397	55.4	0.6454	0.607

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## 240 PSIA

T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
-40.0	0.02535	-223.7	-0.3730	2001.	68.7	0.494
-30.0	0.02557	-218.7	-0.3613	1921.	66.7	0.501
-20.0	0.02580	-213.7	-0.3497	1840.	64.7	0.508
-10.0	0.02604	-208.6	-0.3383	1757.	62.6	0.513
0.0	0.02628	-203.4	-0.3270	1675.	60.5	0.519
10.0	0.02654	-198.2	-0.3158	1592.	58.4	0.525
20.0	0.02680	-193.0	-0.3047	1509.	56.3	0.530
30.0	0.02707	-187.6	-0.2937	1428.	54.2	0.536
40.0	0.02736	-182.2	-0.2828	1347.	52.1	0.543
50.0	0.02765	-176.8	-0.2720	1268.	50.1	0.549
60.0	0.02796	-171.2	-0.2613	1190.	48.0	0.557
70.0	0.02826	-165.6	-0.2506	1113.	46.0	0.564
80.0	0.02862	-159.9	-0.2399	1038.	44.0	0.572
90.0	0.02898	-154.2	-0.2294	965.	42.0	0.580
100.0	0.02935	-148.3	-0.2188	894.	40.0	0.588
110.0	0.02975	-142.4	-0.2083	825.	38.1	0.599
120.0	0.03017	-136.3	-0.1978	757.	36.1	0.609
130.0	0.03062	-130.2	-0.1872	691.	34.2	0.619
140.0	0.03110	-123.9	-0.1767	627.	32.3	0.631
150.0	0.03162	-117.5	-0.1662	565.	30.3	0.643
160.0	0.03219	-111.0	-0.1556	504.	28.6	0.657
170.0	0.03281	-104.4	-0.1450	445.	26.7	0.672
180.0	0.03349	-97.5	-0.1342	388.	24.9	0.689
190.0	0.03426	-90.5	-0.1234	332.	23.0	0.709
200.0	0.03514	-83.3	-0.1124	277.	21.1	0.733
201.80	0.03531	-82.0	-0.1104	267.	20.8	0.739
COEXISTING VAPOR (X=.0553)						
201.80	0.3543	20.78	0.0408	52.2	0.7281	0.631

## 250 PSIA

T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
-40.0	0.02534	-223.6	-0.3731	2010.	69.0	0.494
-30.0	0.02557	-218.7	-0.3614	1930.	66.9	0.501
-20.0	0.02580	-213.6	-0.3496	1848.	64.9	0.507
-10.0	0.02603	-208.5	-0.3384	1766.	62.8	0.513
0.0	0.02628	-203.4	-0.3271	1683.	60.7	0.519
10.0	0.02653	-198.2	-0.3159	1600.	58.6	0.524
20.0	0.02679	-192.9	-0.3048	1517.	56.5	0.530
30.0	0.02706	-187.6	-0.2938	1435.	54.4	0.536
40.0	0.02735	-182.2	-0.2829	1353.	52.3	0.542
50.0	0.02764	-176.7	-0.2721	1275.	50.2	0.549
60.0	0.02795	-171.2	-0.2614	1197.	48.2	0.556
70.0	0.02827	-165.6	-0.2507	1120.	46.2	0.564
80.0	0.02861	-159.9	-0.2401	1046.	44.1	0.572
90.0	0.02896	-154.1	-0.2295	973.	42.1	0.580
100.0	0.02933	-148.3	-0.2189	901.	40.2	0.589
110.0	0.02973	-142.3	-0.2084	832.	38.2	0.598
120.0	0.03015	-136.3	-0.1979	764.	36.3	0.608
130.0	0.03060	-130.1	-0.1874	698.	34.4	0.619
140.0	0.03107	-123.9	-0.1769	634.	32.5	0.630
150.0	0.03159	-117.5	-0.1664	572.	30.6	0.642
160.0	0.03215	-111.0	-0.1558	512.	28.6	0.655
170.0	0.03276	-104.4	-0.1452	453.	26.9	0.670
180.0	0.03343	-97.6	-0.1345	395.	25.1	0.687
190.0	0.03419	-90.6	-0.1237	340.	23.2	0.706
200.0	0.03505	-83.4	-0.1127	285.	21.3	0.730
209.44	0.03599	-76.4	-0.1021	235.	19.5	0.758
COEXISTING VAPOR (X=.0570)						
209.44	0.3221	22.53	0.0417	48.9	0.6162	0.657

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## LIQUID 280 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02534	-223.6	-0.3732	2019.	69.2	0.494
-30.0	0.02556	-218.6	-0.3615	1939.	67.2	0.501
-20.0	0.02579	-213.6	-0.3499	1857.	65.1	0.507
-10.0	0.02602	-208.5	-0.3385	1774.	63.0	0.513
0.0	0.02627	-203.3	-0.3272	1691.	60.9	0.519
10.0	0.02652	-198.1	-0.3160	1608.	58.8	0.524
20.0	0.02678	-192.9	-0.3049	1525.	56.7	0.530
30.0	0.02705	-187.5	-0.2940	1443.	54.6	0.536
40.0	0.02733	-182.2	-0.2831	1362.	52.5	0.542
50.0	0.02763	-176.7	-0.2722	1282.	50.4	0.549
60.0	0.02793	-171.2	-0.2615	1204.	48.4	0.556
70.0	0.02825	-165.5	-0.2508	1128.	46.3	0.563
80.0	0.02859	-159.9	-0.2402	1053.	44.3	0.571
90.0	0.02894	-154.1	-0.2296	980.	42.3	0.580
100.0	0.02932	-148.2	-0.2191	908.	40.3	0.588
110.0	0.02971	-142.3	-0.2086	839.	38.4	0.598
120.0	0.03012	-136.3	-0.1981	771.	36.5	0.607
130.0	0.03057	-130.1	-0.1876	706.	34.6	0.618
140.0	0.03104	-123.9	-0.1771	642.	32.7	0.629
150.0	0.03155	-117.5	-0.1666	579.	30.8	0.641
160.0	0.03211	-111.0	-0.1560	519.	29.0	0.654
170.0	0.03271	-104.4	-0.1454	460.	27.1	0.669
180.0	0.03338	-97.6	-0.1348	403.	25.3	0.685
190.0	0.03412	-90.7	-0.1240	347.	23.4	0.704
200.0	0.03496	-83.5	-0.1130	293.	21.6	0.727
210.0	0.03594	-76.1	-0.1019	240.	19.7	0.755
216.66	0.03670	-71.0	-0.0943	205.	18.4	0.780
COEXISTING VAPOR (X=0.0587)						
216.66	0.2942	24.07	0.0424	45.7	0.9103	0.686



TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 300 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02533	-223.5	-0.3732	2028.	69.5	0.494
-30.0	0.02555	-218.5	-0.3615	1948.	67.4	0.501
-20.0	0.02578	-213.5	-0.3500	1866.	65.3	0.507
-10.0	0.02602	-208.4	-0.3385	1783.	63.2	0.513
0.0	0.02626	-203.3	-0.3272	1699.	61.1	0.519
10.0	0.02651	-198.1	-0.3161	1616.	59.0	0.524
20.0	0.02677	-192.8	-0.3050	1533.	56.8	0.530
30.0	0.02704	-187.5	-0.2941	1451.	54.7	0.536
40.0	0.02732	-182.1	-0.2832	1370.	52.6	0.542
50.0	0.02762	-176.6	-0.2723	1290.	50.6	0.549
60.0	0.02792	-171.1	-0.2616	1212.	48.5	0.556
70.0	0.02824	-165.5	-0.2509	1135.	46.5	0.563
80.0	0.02858	-159.8	-0.2403	1060.	44.5	0.571
90.0	0.02893	-154.1	-0.2298	987.	42.5	0.579
100.0	0.02930	-148.2	-0.2192	916.	40.5	0.588
110.0	0.02969	-142.3	-0.2087	846.	38.6	0.597
120.0	0.03010	-136.2	-0.1982	778.	36.6	0.607
130.0	0.03054	-130.1	-0.1878	713.	34.7	0.617
140.0	0.03101	-123.9	-0.1773	649.	32.9	0.628
150.0	0.03152	-117.5	-0.1668	587.	31.0	0.640
160.0	0.03207	-111.0	-0.1562	526.	29.1	0.653
170.0	0.03266	-104.4	-0.1457	468.	27.3	0.667
180.0	0.03332	-97.7	-0.1350	411.	25.5	0.683
190.0	0.03405	-90.7	-0.1243	355.	23.6	0.702
200.0	0.03488	-83.6	-0.1134	301.	21.8	0.723
210.0	0.03583	-76.2	-0.1023	248.	19.9	0.751
220.0	0.03697	-68.5	-0.0909	197.	18.0	0.788
223.52	0.03743	-65.7	-0.0868	179.	17.3	0.804
COEXISTING VAPOR (X=.0604)						
223.52	0.2697	25.42	0.0431	42.4	1.0112	0.718

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 320 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DF/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02532	-223.4	-0.3733	2038.	69.7	0.493
-30.0	0.02555	-218.5	-0.3616	1957.	67.6	0.501
-20.0	0.02577	-213.4	-0.3501	1874.	65.5	0.507
-10.0	0.02601	-208.4	-0.3386	1791.	63.4	0.513
0.0	0.02625	-203.2	-0.3273	1707.	61.3	0.518
10.0	0.02650	-198.0	-0.3162	1624.	59.1	0.524
20.0	0.02676	-192.8	-0.3051	1540.	57.0	0.530
30.0	0.02703	-187.4	-0.2942	1458.	54.9	0.536
40.0	0.02731	-182.1	-0.2833	1377.	52.8	0.542
50.0	0.02760	-176.6	-0.2725	1297.	50.7	0.548
60.0	0.02791	-171.1	-0.2617	1219.	48.7	0.555
70.0	0.02823	-165.5	-0.2511	1142.	46.6	0.563
80.0	0.02856	-159.8	-0.2405	1067.	44.6	0.571
90.0	0.02891	-154.0	-0.2299	994.	42.6	0.579
100.0	0.02928	-148.2	-0.2194	923.	40.7	0.588
110.0	0.02967	-142.3	-0.2089	853.	38.7	0.597
120.0	0.03008	-136.2	-0.1984	786.	36.8	0.606
130.0	0.03052	-130.1	-0.1879	720.	34.9	0.617
140.0	0.03098	-123.9	-0.1775	656.	33.0	0.627
150.0	0.03149	-117.5	-0.1670	594.	31.2	0.639
160.0	0.03203	-111.1	-0.1565	534.	29.3	0.652
170.0	0.03262	-104.5	-0.1459	475.	27.5	0.666
180.0	0.03327	-97.7	-0.1353	418.	25.7	0.682
190.0	0.03399	-90.8	-0.1246	363.	23.9	0.699
200.0	0.03480	-83.7	-0.1137	309.	22.0	0.720
210.0	0.03573	-76.3	-0.1027	257.	20.2	0.747
220.0	0.03684	-68.7	-0.0913	205.	18.26	0.781
230.0	0.03820	-60.6	-0.0796	155.	16.26	0.831
230.04	0.03821	-60.6	-0.0795	154.	16.25	0.831
COEXISTING VAPOR (X=.0621)						
230.04	0.2479	26.59	0.0435	39.1	1.1197	0.754

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 340 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02532	-223.4	-0.3734	2047.	69.9	0.493
-30.0	0.02554	-218.4	-0.3617	1966.	67.8	0.501
-20.0	0.02577	-213.4	-0.3501	1883.	65.7	0.507
-10.0	0.02600	-208.3	-0.3387	1799.	63.6	0.513
0.0	0.02624	-203.2	-0.3274	1715.	61.5	0.518
10.0	0.02649	-198.0	-0.3163	1631.	59.3	0.524
20.0	0.02675	-192.7	-0.3052	1548.	57.2	0.529
30.0	0.02702	-187.4	-0.2943	1466.	55.1	0.535
40.0	0.02730	-182.0	-0.2834	1385.	53.0	0.542
50.0	0.02759	-176.5	-0.2726	1305.	50.9	0.548
60.0	0.02790	-171.0	-0.2618	1226.	48.8	0.555
70.0	0.02821	-165.4	-0.2512	1149.	46.8	0.563
80.0	0.02854	-159.7	-0.2406	1074.	44.8	0.570
90.0	0.02889	-154.0	-0.2300	1001.	42.8	0.578
100.0	0.02926	-148.2	-0.2195	930.	40.8	0.587
110.0	0.02965	-142.2	-0.2090	860.	38.9	0.596
120.0	0.03005	-136.2	-0.1986	793.	37.0	0.606
130.0	0.03049	-130.1	-0.1881	727.	35.1	0.616
140.0	0.03095	-123.9	-0.1776	663.	33.2	0.627
150.0	0.03145	-117.5	-0.1672	601.	31.3	0.638
160.0	0.03199	-111.1	-0.1567	541.	29.5	0.651
170.0	0.03257	-104.5	-0.1461	482.	27.7	0.665
180.0	0.03321	-97.7	-0.1355	426.	25.9	0.680
190.0	0.03392	-90.9	-0.1248	371.	24.1	0.697
200.0	0.03472	-83.8	-0.1140	317.	22.2	0.718
210.0	0.03563	-76.5	-0.1030	265.	20.4	0.743
220.0	0.03671	-68.9	-0.0918	214.	18.52	0.775
230.0	0.03802	-60.9	-0.0801	164.	16.56	0.821
236.27	0.03903	-55.6	-0.0725	132.	15.27	0.863
COEXISTING VAPOR (X=.0638)						
236.27	0.2285	27.57	0.0438	35.8	1.2368	0.796

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 360 PSIA						
T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
-40.0	0.02531	-223.3	-0.3735	2056.	70.2	0.493
-30.0	0.02553	-218.4	-0.3618	1974.	68.1	0.501
-20.0	0.02576	-213.3	-0.3502	1891.	65.9	0.507
-10.0	0.02599	-208.2	-0.3388	1807.	63.8	0.513
0.0	0.02624	-203.1	-0.3275	1723.	61.6	0.518
10.0	0.02649	-197.9	-0.3164	1639.	59.5	0.524
20.0	0.02674	-192.7	-0.3053	1556.	57.4	0.529
30.0	0.02701	-187.3	-0.2944	1473.	55.3	0.535
40.0	0.02729	-182.0	-0.2835	1392.	53.2	0.541
50.0	0.02758	-176.5	-0.2727	1312.	51.1	0.548
60.0	0.02788	-171.0	-0.2620	1233.	49.0	0.555
70.0	0.02820	-165.4	-0.2513	1157.	47.0	0.562
80.0	0.02853	-159.7	-0.2407	1082.	44.9	0.570
90.0	0.02888	-154.0	-0.2302	1008.	43.0	0.578
100.0	0.02924	-148.1	-0.2196	937.	41.0	0.587
110.0	0.02963	-142.2	-0.2092	867.	39.0	0.596
120.0	0.03003	-136.2	-0.1987	800.	37.1	0.605
130.0	0.03046	-130.1	-0.1883	734.	35.2	0.615
140.0	0.03093	-123.9	-0.1778	670.	33.4	0.626
150.0	0.03142	-117.5	-0.1674	608.	31.5	0.637
160.0	0.03195	-111.1	-0.1569	548.	29.7	0.650
170.0	0.03253	-104.5	-0.1464	490.	27.9	0.663
180.0	0.03316	-97.8	-0.1358	433.	26.1	0.678
190.0	0.03386	-90.9	-0.1251	378.	24.3	0.695
200.0	0.03465	-83.8	-0.1143	325.	22.5	0.715
210.0	0.03554	-76.6	-0.1034	273.	20.6	0.739
220.0	0.03658	-69.0	-0.0922	222.	18.78	0.769
230.0	0.03784	-61.1	-0.0807	172.	16.86	0.812
240.0	0.03946	-52.7	-0.0685	123.	14.81	0.879
242.24	0.03990	-50.7	-0.0657	112.	14.33	0.900
COEXISTING VAPOR (X= .0656)						
242.24	0.2108	28.36	0.0439	32.5	1.3640	0.846



TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 380 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02530	-223.3	-0.3736	2065.	70.4	0.493
-30.0	0.02553	-218.3	-0.3619	1983.	68.3	0.500
-20.0	0.02575	-213.3	-0.3503	1900.	66.1	0.507
-10.0	0.02599	-208.2	-0.3389	1816.	64.0	0.513
0.0	0.02623	-203.0	-0.3276	1731.	61.8	0.518
10.0	0.02648	-197.9	-0.3164	1647.	59.7	0.524
20.0	0.02673	-192.6	-0.3054	1564.	57.6	0.529
30.0	0.02700	-187.3	-0.2945	1481.	55.4	0.535
40.0	0.02728	-181.9	-0.2836	1399.	53.3	0.541
50.0	0.02757	-176.5	-0.2728	1319.	51.2	0.548
60.0	0.02787	-170.9	-0.2621	1241.	49.2	0.555
70.0	0.02819	-165.3	-0.2514	1164.	47.1	0.562
80.0	0.02851	-159.7	-0.2408	1089.	45.1	0.570
90.0	0.02886	-153.9	-0.2303	1015.	43.1	0.578
100.0	0.02922	-148.1	-0.2198	944.	41.1	0.586
110.0	0.02960	-142.2	-0.2093	874.	39.2	0.595
120.0	0.03001	-136.2	-0.1989	807.	37.3	0.605
130.0	0.03044	-130.1	-0.1884	741.	35.4	0.615
140.0	0.03090	-123.8	-0.1780	677.	33.5	0.625
150.0	0.03139	-117.5	-0.1675	615.	31.7	0.637
160.0	0.03192	-111.1	-0.1571	555.	29.9	0.649
170.0	0.03249	-104.5	-0.1466	497.	28.0	0.662
180.0	0.03311	-97.8	-0.1360	441.	26.2	0.677
190.0	0.03380	-91.0	-0.1254	386.	24.5	0.693
200.0	0.03457	-83.9	-0.1146	332.	22.7	0.712
210.0	0.03545	-76.7	-0.1037	281.	20.9	0.735
220.0	0.03646	-69.2	-0.0926	230.	19.03	0.764
230.0	0.03768	-61.3	-0.0812	181.	17.14	0.803
240.0	0.03922	-53.0	-0.0692	133.	15.15	0.863
247.96	0.04085	-45.8	-0.0590	94.	13.42	0.946
COEXISTING VAPOR (X=0.0674)						
247.96	0.1947	28.96	0.0439	29.1	1.5028	0.907

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 400 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02530	-223.2	-0.3736	2074.	70.6	0.493
-30.0	0.02552	-218.2	-0.3620	1992.	68.5	0.500
-20.0	0.02575	-213.2	-0.3504	1908.	66.3	0.507
-10.0	0.02598	-208.1	-0.3390	1824.	64.2	0.512
0.0	0.02622	-203.0	-0.3277	1739.	62.0	0.518
10.0	0.02647	-197.8	-0.3165	1655.	59.9	0.523
20.0	0.02673	-192.6	-0.3055	1571.	57.7	0.529
30.0	0.02699	-187.2	-0.2946	1488.	55.6	0.535
40.0	0.02727	-181.9	-0.2837	1407.	53.5	0.541
50.0	0.02756	-176.4	-0.2729	1327.	51.4	0.548
60.0	0.02786	-170.9	-0.2622	1248.	49.3	0.554
70.0	0.02817	-165.3	-0.2515	1171.	47.3	0.562
80.0	0.02850	-159.6	-0.2410	1096.	45.3	0.569
90.0	0.02884	-153.9	-0.2304	1022.	43.3	0.577
100.0	0.02920	-148.1	-0.2199	951.	41.3	0.586
110.0	0.02958	-142.1	-0.2095	881.	39.4	0.595
120.0	0.02999	-136.1	-0.1990	814.	37.4	0.604
130.0	0.03041	-130.0	-0.1886	748.	35.6	0.614
140.0	0.03087	-123.8	-0.1782	684.	33.7	0.625
150.0	0.03136	-117.5	-0.1677	622.	31.8	0.636
160.0	0.03188	-111.1	-0.1573	562.	30.0	0.648
170.0	0.03245	-104.5	-0.1468	504.	28.2	0.661
180.0	0.03306	-97.8	-0.1363	448.	26.4	0.675
190.0	0.03374	-91.0	-0.1257	393.	24.7	0.691
200.0	0.03450	-84.0	-0.1149	340.	22.9	0.710
210.0	0.03536	-76.8	-0.1041	289.	21.1	0.732
220.0	0.03635	-69.3	-0.0930	239.	19.27	0.759
230.0	0.03753	-61.5	-0.0817	190.	17.41	0.796
240.0	0.03900	-53.3	-0.0698	142.	15.47	0.850
250.0	0.04098	-44.3	-0.0571	94.	13.35	0.945
253.46	0.04189	-41.0	-0.0524	77.	12.54	1.002
COEXISTING VAPOR (X= .0692)						
253.46	0.1799	29.34	0.0436	25.8	1.6554	0.982

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 420 PSIA						
T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
-40.0	0.02529	-223.1	-0.3737	2083.	70.9	0.493
-30.0	0.02551	-218.2	-0.3620	2001.	68.7	0.500
-20.0	0.02574	-213.2	-0.3505	1917.	66.5	0.507
-10.0	0.02597	-208.1	-0.3391	1832.	64.4	0.512
0.0	0.02621	-202.9	-0.3278	1747.	62.2	0.518
10.0	0.02646	-197.7	-0.3166	1663.	60.1	0.523
20.0	0.02672	-192.5	-0.3056	1579.	57.9	0.529
30.0	0.02698	-187.2	-0.2947	1496.	55.8	0.535
40.0	0.02726	-181.8	-0.2838	1414.	53.7	0.541
50.0	0.02755	-176.4	-0.2730	1334.	51.6	0.547
60.0	0.02785	-170.8	-0.2623	1255.	49.5	0.554
70.0	0.02816	-165.3	-0.2517	1178.	47.4	0.561
80.0	0.02848	-159.6	-0.2411	1103.	45.4	0.569
90.0	0.02883	-153.9	-0.2305	1029.	43.4	0.577
100.0	0.02919	-148.0	-0.2201	958.	41.5	0.585
110.0	0.02956	-142.1	-0.2096	888.	39.5	0.594
120.0	0.02996	-136.1	-0.1992	821.	37.6	0.604
130.0	0.03039	-130.0	-0.1888	755.	35.7	0.613
140.0	0.03084	-123.8	-0.1783	691.	33.9	0.624
150.0	0.03132	-117.5	-0.1679	630.	32.0	0.635
160.0	0.03184	-111.1	-0.1575	570.	30.2	0.647
170.0	0.03240	-104.6	-0.1470	511.	28.4	0.660
180.0	0.03301	-97.9	-0.1365	455.	26.6	0.674
190.0	0.03369	-91.1	-0.1259	401.	24.8	0.690
200.0	0.03443	-84.1	-0.1152	348.	23.1	0.708
210.0	0.03527	-76.9	-0.1044	296.	21.3	0.729
220.0	0.03624	-69.4	-0.0934	247.	19.51	0.755
230.0	0.03738	-61.7	-0.0821	198.	17.68	0.789
240.0	0.03879	-53.6	-0.0704	151.	15.77	0.838
250.0	0.04064	-44.8	-0.0580	104.	13.73	0.920
258.76	0.04304	-36.1	-0.0459	62.	11.69	1.076
COEXISTING VAPOR (X=.0712)						
258.76	0.1660	29.47	0.0431	22.4	1.8254	1.079

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## LIQUID 440 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02529	-223.1	-0.3738	2092.	71.1	0.493
-30.0	0.02551	-218.1	-0.3621	2009.	68.9	0.500
-20.0	0.02573	-213.1	-0.3506	1925.	66.8	0.506
-10.0	0.02596	-208.0	-0.3392	1840.	64.6	0.512
0.0	0.02620	-202.9	-0.3279	1755.	62.4	0.518
10.0	0.02645	-197.7	-0.3167	1670.	60.2	0.523
20.0	0.02671	-192.5	-0.3057	1586.	58.1	0.529
30.0	0.02697	-187.1	-0.2948	1503.	55.9	0.534
40.0	0.02725	-181.8	-0.2839	1421.	53.8	0.541
50.0	0.02753	-176.3	-0.2731	1341.	51.7	0.547
60.0	0.02783	-170.8	-0.2624	1262.	49.6	0.554
70.0	0.02814	-165.2	-0.2518	1185.	47.6	0.561
80.0	0.02847	-159.6	-0.2412	1110.	45.6	0.569
90.0	0.02881	-153.8	-0.2307	1036.	43.6	0.577
100.0	0.02917	-148.0	-0.2202	965.	41.6	0.585
110.0	0.02955	-142.1	-0.2097	895.	39.7	0.594
120.0	0.02994	-136.1	-0.1993	828.	37.8	0.603
130.0	0.03036	-130.0	-0.1889	762.	35.9	0.613
140.0	0.03081	-123.8	-0.1785	698.	34.0	0.623
150.0	0.03129	-117.5	-0.1681	637.	32.2	0.634
160.0	0.03181	-111.1	-0.1577	577.	30.4	0.646
170.0	0.03236	-104.6	-0.1472	519.	28.6	0.659
180.0	0.03297	-97.9	-0.1367	462.	26.8	0.672
190.0	0.03363	-91.1	-0.1262	408.	25.0	0.688
200.0	0.03436	-84.1	-0.1155	355.	23.3	0.705
210.0	0.03519	-77.0	-0.1047	304.	21.5	0.726
220.0	0.03614	-69.6	-0.0938	254.	19.74	0.751
230.0	0.03724	-61.9	-0.0826	206.	17.93	0.783
240.0	0.03859	-53.8	-0.0710	159.	16.07	0.827
250.0	0.04034	-45.2	-0.0588	113.	14.09	0.899
260.0	0.04289	-35.5	-0.0453	67.	11.86	1.048
263.87	0.04435	-31.3	-0.0393	49.	10.85	1.176
COEXISTING VAPOR (X=.0733)						
263.87	0.1530	29.3	0.0422	19.	2.017	1.210



TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 460 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02528	-223.0	-0.3739	2101.	71.3	0.493
-30.0	0.02550	-218.1	-0.3622	2018.	69.1	0.500
-20.0	0.02572	-213.0	-0.3507	1934.	67.0	0.506
-10.0	0.02596	-208.0	-0.3393	1848.	64.8	0.512
0.0	0.02620	-202.8	-0.3280	1763.	62.6	0.517
10.0	0.02644	-197.6	-0.3168	1678.	60.4	0.523
20.0	0.02670	-192.4	-0.3058	1594.	58.3	0.528
30.0	0.02696	-187.1	-0.2949	1511.	56.1	0.534
40.0	0.02724	-181.7	-0.2840	1429.	54.0	0.540
50.0	0.02752	-176.3	-0.2732	1348.	51.9	0.547
60.0	0.02782	-170.8	-0.2625	1269.	49.8	0.554
70.0	0.02813	-165.2	-0.2519	1192.	47.8	0.561
80.0	0.02845	-159.5	-0.2413	1117.	45.7	0.568
90.0	0.02879	-153.8	-0.2308	1043.	43.7	0.576
100.0	0.02915	-148.0	-0.2203	972.	41.8	0.585
110.0	0.02953	-142.1	-0.2099	902.	39.8	0.593
120.0	0.02992	-136.1	-0.1995	835.	37.9	0.603
130.0	0.03034	-130.0	-0.1891	769.	36.0	0.612
140.0	0.03079	-123.8	-0.1787	705.	34.2	0.623
150.0	0.03126	-117.5	-0.1683	644.	32.3	0.633
160.0	0.03177	-111.1	-0.1579	584.	30.5	0.645
170.0	0.03232	-104.6	-0.1474	526.	28.7	0.657
180.0	0.03292	-97.9	-0.1370	470.	27.0	0.671
190.0	0.03357	-91.1	-0.1264	415.	25.2	0.686
200.0	0.03430	-84.2	-0.1158	363.	23.5	0.703
210.0	0.03511	-77.0	-0.1051	312.	21.7	0.723
220.0	0.03603	-69.7	-0.0942	262.	19.97	0.747
230.0	0.03711	-62.0	-0.0830	214.	18.18	0.777
240.0	0.03841	-54.1	-0.0715	168.	16.35	0.818
250.0	0.04006	-45.6	-0.0595	122.	14.42	0.881
260.0	0.04238	-36.2	-0.0464	77.	12.30	1.001
268.80	0.04587	-26.3	-0.0327	37.	10.02	1.321
COEXISTING VAPOR (X=.0756)						
268.80	0.1405	28.8	0.0410	16.	2.236	1.399

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 480 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S -BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02527	-223.0	-0.3740	2110.	71.5	0.493
-30.0	0.02549	-218.0	-0.3623	2027.	69.4	0.500
-20.0	0.02572	-213.0	-0.3507	1942.	67.2	0.506
-10.0	0.02595	-207.9	-0.3393	1857.	65.0	0.512
0.0	0.02619	-202.8	-0.3281	1771.	62.8	0.517
10.0	0.02643	-197.6	-0.3169	1686.	60.6	0.523
20.0	0.02669	-192.3	-0.3059	1602.	58.4	0.528
30.0	0.02695	-187.0	-0.2950	1518.	56.3	0.534
40.0	0.02723	-181.7	-0.2841	1436.	54.1	0.540
50.0	0.02751	-176.2	-0.2733	1356.	52.0	0.547
60.0	0.02781	-170.7	-0.2626	1277.	50.0	0.553
70.0	0.02812	-165.1	-0.2520	1199.	47.9	0.561
80.0	0.02844	-159.5	-0.2414	1124.	45.9	0.568
90.0	0.02878	-153.7	-0.2309	1050.	43.9	0.576
100.0	0.02913	-147.9	-0.2205	979.	41.9	0.584
110.0	0.02951	-142.0	-0.2100	909.	40.0	0.593
120.0	0.02990	-136.1	-0.1996	842.	38.1	0.602
130.0	0.03032	-130.0	-0.1892	776.	36.2	0.612
140.0	0.03076	-123.8	-0.1789	712.	34.3	0.622
150.0	0.03123	-117.5	-0.1685	651.	32.5	0.633
160.0	0.03174	-111.1	-0.1581	591.	30.7	0.644
170.0	0.03228	-104.6	-0.1477	533.	28.9	0.656
180.0	0.03287	-98.0	-0.1372	477.	27.2	0.670
190.0	0.03352	-91.2	-0.1267	423.	25.4	0.685
200.0	0.03423	-84.2	-0.1161	370.	23.7	0.701
210.0	0.03503	-77.1	-0.1054	319.	21.9	0.720
220.0	0.03594	-69.8	-0.0945	270.	20.2	0.743
230.0	0.03699	-62.2	-0.0835	222.	18.42	0.772
240.0	0.03824	-54.3	-0.0721	176.	16.62	0.810
250.0	0.03981	-45.9	-0.0602	131.	14.74	0.866
260.0	0.04194	-36.8	-0.0474	87.	12.70	0.966
270.0	0.04545	-26.0	-0.0326	42.8	10.29	1.235
273.58	0.04771	-21.1	-0.0258	26.1	9.18	1.550
COEXISTING VAPOR (X=.0782)						
273.58	0.1283	27.9	0.0392	12.2	2.495	1.692

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

LIQUID 500 PSIA						
T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
-40.0	0.02527	-222.9	-0.3740	2119.	71.8	0.493
-30.0	0.02549	-217.9	-0.3624	2035.	69.6	0.500
-20.0	0.02571	-212.9	-0.3508	1950.	67.4	0.506
-10.0	0.02594	-207.8	-0.3394	1865.	65.2	0.512
0.0	0.02618	-202.7	-0.3282	1779.	63.0	0.517
10.0	0.02643	-197.5	-0.3170	1694.	60.8	0.523
20.0	0.02668	-192.3	-0.3060	1609.	58.6	0.528
30.0	0.02694	-187.0	-0.2951	1526.	56.4	0.534
40.0	0.02722	-181.6	-0.2842	1443.	54.3	0.540
50.0	0.02750	-176.2	-0.2734	1363.	52.2	0.546
60.0	0.02780	-170.7	-0.2627	1284.	50.1	0.553
70.0	0.02810	-165.1	-0.2521	1206.	48.1	0.560
80.0	0.02843	-159.4	-0.2416	1131.	46.0	0.568
90.0	0.02876	-153.7	-0.2311	1057.	44.0	0.576
100.0	0.02912	-147.9	-0.2206	986.	42.1	0.584
110.0	0.02949	-142.0	-0.2102	916.	40.1	0.593
120.0	0.02988	-136.0	-0.1998	848.	38.2	0.602
130.0	0.03029	-130.0	-0.1894	783.	36.3	0.611
140.0	0.03073	-123.8	-0.1790	719.	34.5	0.621
150.0	0.03120	-117.5	-0.1686	657.	32.7	0.632
160.0	0.03170	-111.1	-0.1583	598.	30.9	0.643
170.0	0.03224	-104.6	-0.1479	540.	29.1	0.655
180.0	0.03283	-98.0	-0.1374	484.	27.3	0.669
190.0	0.03347	-91.2	-0.1269	430.	25.6	0.683
200.0	0.03417	-84.3	-0.1164	377.	23.9	0.699
210.0	0.03495	-77.2	-0.1057	327.	22.1	0.718
220.0	0.03584	-69.9	-0.0949	278.	20.4	0.740
230.0	0.03686	-62.4	-0.0839	230.	18.66	0.767
240.0	0.03808	-54.5	-0.0726	184.	16.89	0.803
250.0	0.03957	-46.2	-0.0608	140.	15.04	0.853
260.0	0.04156	-37.3	-0.0483	97.	13.08	0.938
270.0	0.04460	-27.1	-0.0342	53.7	10.84	1.131
278.21	0.05006	-15.5	-0.0186	16.8	8.31	1.967
COEXISTING VAPOR (X=.0812)						
278.21	0.1161	26.3	0.0367	8.8	2.812	2.207

TABLE B2B (CONT.) THERMODYNAMIC PROPERTIES ALONG ISOBARS IN THE LIQUID

## LIQUID 520 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02526	-222.8	-0.3741	2128.	72.0	0.493
-30.0	0.02548	-217.9	-0.3625	2044.	69.8	0.500
-20.0	0.02570	-212.9	-0.3509	1959.	67.6	0.506
-10.0	0.02593	-207.8	-0.3395	1873.	65.3	0.512
0.0	0.02617	-202.7	-0.3282	1787.	63.1	0.517
10.0	0.02642	-197.5	-0.3171	1701.	60.9	0.522
20.0	0.02667	-192.2	-0.3061	1617.	58.8	0.528
30.0	0.02693	-186.9	-0.2952	1533.	56.6	0.534
40.0	0.02721	-181.6	-0.2843	1451.	54.5	0.540
50.0	0.02749	-176.1	-0.2735	1370.	52.4	0.546
60.0	0.02778	-170.6	-0.2629	1291.	50.3	0.553
70.0	0.02809	-165.0	-0.2522	1213.	48.2	0.560
80.0	0.02841	-159.4	-0.2417	1138.	46.2	0.568
90.0	0.02875	-153.7	-0.2312	1064.	44.2	0.575
100.0	0.02910	-147.9	-0.2207	993.	42.2	0.584
110.0	0.02947	-142.0	-0.2103	923.	40.3	0.592
120.0	0.02986	-136.0	-0.1999	855.	38.4	0.601
130.0	0.03027	-129.9	-0.1895	790.	36.5	0.611
140.0	0.03071	-123.8	-0.1792	726.	34.6	0.621
150.0	0.03117	-117.5	-0.1688	664.	32.8	0.631
160.0	0.03167	-111.1	-0.1585	605.	31.0	0.642
170.0	0.03221	-104.6	-0.1481	547.	29.3	0.654
180.0	0.03278	-98.0	-0.1376	491.	27.5	0.667
190.0	0.03342	-91.3	-0.1272	437.	25.8	0.682
200.0	0.03411	-84.3	-0.1166	385.	24.0	0.697
210.0	0.03488	-77.3	-0.1060	334.	22.3	0.715
220.0	0.03575	-70.0	-0.0952	285.	20.6	0.737
230.0	0.03675	-62.5	-0.0843	238.	18.9	0.762
240.0	0.03792	-54.7	-0.0730	193.	17.1	0.796
250.0	0.03936	-46.5	-0.0614	148.	15.3	0.842
260.0	0.04122	-37.7	-0.0492	105.6	13.4	0.915
270.0	0.04393	-27.9	-0.0356	63.8	11.3	1.063
280.0	0.04942	-15.1	-0.0182	21.6	8.58	1.695



TABLE B2C. THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

540 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02526	-222.8	-0.3742	2137.	72.2	0.493
-30.0	0.02547	-217.8	-0.3625	2053.	70.0	0.500
-20.0	0.02570	-212.8	-0.3510	1967.	67.8	0.506
-10.0	0.02593	-207.7	-0.3396	1881.	65.5	0.512
0.0	0.02616	-202.6	-0.3283	1795.	63.3	0.517
10.0	0.02641	-197.4	-0.3172	1709.	61.1	0.522
20.0	0.02666	-192.2	-0.3062	1624.	58.9	0.528
30.0	0.02692	-186.9	-0.2953	1540.	56.8	0.534
40.0	0.02720	-181.5	-0.2844	1458.	54.6	0.540
50.0	0.02748	-176.1	-0.2737	1377.	52.5	0.546
60.0	0.02777	-170.6	-0.2630	1298.	50.4	0.553
70.0	0.02808	-165.0	-0.2524	1220.	48.4	0.560
80.0	0.02840	-159.4	-0.2418	1145.	46.3	0.567
90.0	0.02873	-153.6	-0.2313	1071.	44.3	0.575
100.0	0.02908	-147.8	-0.2209	999.	42.4	0.583
110.0	0.02945	-142.0	-0.2105	930.	40.4	0.592
120.0	0.02984	-136.0	-0.2001	862.	38.5	0.601
130.0	0.03025	-129.9	-0.1897	796.	36.6	0.610
140.0	0.03068	-123.8	-0.1794	733.	34.8	0.620
150.0	0.03114	-117.5	-0.1690	671.	33.0	0.630
160.0	0.03164	-111.1	-0.1586	612.	31.2	0.641
170.0	0.03217	-104.6	-0.1483	554.	29.4	0.653
180.0	0.03274	-98.0	-0.1379	498.	27.7	0.666
190.0	0.03336	-91.3	-0.1274	444.	25.9	0.680
200.0	0.03405	-84.4	-0.1169	392.	24.2	0.696
210.0	0.03481	-77.3	-0.1063	342.	22.5	0.713
220.0	0.03566	-70.1	-0.0956	293.	20.8	0.734
230.0	0.03664	-62.6	-0.0847	246.	19.1	0.758
240.0	0.03778	-54.9	-0.0735	201.	17.4	0.789
250.0	0.03915	-46.8	-0.0620	157.	15.6	0.832
260.0	0.04091	-38.1	-0.0499	114.5	13.8	0.896
270.0	0.04337	-28.6	-0.0368	73.4	11.7	1.015
280.0	0.04767	-17.1	-0.0211	33.2	9.33	1.367
* 290.0	0.10074	26.2	0.0368	7.1	3.29	2.730
300.0	0.12739	42.3	0.0582	21.7	2.42	1.173
310.0	0.14268	52.6	0.0717	32.0	2.07	0.940
320.0	0.15462	61.5	0.0832	40.5	1.84	0.840
330.0	0.16481	69.6	0.0935	47.9	1.68	0.786
340.0	0.17389	77.3	0.1032	54.5	1.56	0.751
350.0	0.18218	84.7	0.1124	60.6	1.45	0.729
360.0	0.18989	91.9	0.1212	66.3	1.37	0.713
370.0	0.19715	99.0	0.1298	71.6	1.30	0.702
380.0	0.2040	106.0	0.1382	76.7	1.24	0.694
390.0	0.2106	112.9	0.1464	81.5	1.18	0.689
400.0	0.2170	119.8	0.1544	86.1	1.14	0.685
420.0	0.2291	133.4	0.1701	94.7	1.06	0.682
440.0	0.2405	147.1	0.1854	102.8	0.989	0.681
460.0	0.2514	160.7	0.2004	110.4	0.932	0.683
480.0	0.2619	174.4	0.2152	117.7	0.884	0.687
500.0	0.2720	188.2	0.2297	125.	0.842	0.692
520.0	0.2819	202.1	0.2440	131.	0.804	0.697
540.0	0.2915	216.1	0.2581	138.	0.771	0.703
560.0	0.3010	230.2	0.2721	144.	0.741	0.709
580.0	0.3102	244.4	0.2860	150.	0.714	0.716
600.0	0.3193	258.8	0.2996	156.	0.689	0.722

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

560 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02525	-222.7	-0.3743	2146.	72.4	0.492
-30.0	0.02547	-217.8	-0.3626	2061.	70.2	0.500
-20.0	0.02569	-212.7	-0.3511	1975.	68.0	0.506
-10.0	0.02592	-207.7	-0.3397	1889.	65.7	0.511
0.0	0.02616	-202.5	-0.3284	1803.	63.5	0.517
10.0	0.02640	-197.4	-0.3173	1717.	61.3	0.522
20.0	0.02665	-192.1	-0.3063	1632.	59.1	0.528
30.0	0.02692	-186.8	-0.2954	1548.	56.9	0.533
40.0	0.02719	-181.5	-0.2845	1465.	54.8	0.539
50.0	0.02747	-176.0	-0.2738	1384.	52.7	0.546
60.0	0.02776	-170.5	-0.2631	1305.	50.6	0.552
70.0	0.02807	-165.0	-0.2525	1227.	48.5	0.560
80.0	0.02838	-159.3	-0.2419	1152.	46.5	0.567
90.0	0.02872	-153.6	-0.2314	1078.	44.5	0.575
100.0	0.02906	-147.8	-0.2210	1006.	42.5	0.583
110.0	0.02943	-141.9	-0.2106	937.	40.6	0.591
120.0	0.02982	-136.0	-0.2002	869.	38.7	0.600
130.0	0.03022	-129.9	-0.1899	803.	36.8	0.610
140.0	0.03065	-123.7	-0.1795	740.	35.0	0.619
150.0	0.03111	-117.5	-0.1692	678.	33.1	0.630
160.0	0.03160	-111.1	-0.1588	618.	31.3	0.641
170.0	0.03213	-104.6	-0.1485	561.	29.6	0.652
180.0	0.03270	-98.0	-0.1381	505.	27.8	0.665
190.0	0.03331	-91.3	-0.1277	451.	26.1	0.679
200.0	0.03399	-84.4	-0.1172	399.	24.4	0.694
210.0	0.03474	-77.4	-0.1066	349.	22.7	0.711
220.0	0.03557	-70.2	-0.0959	300.	21.0	0.731
230.0	0.03653	-62.8	-0.0850	254.	19.3	0.754
240.0	0.03764	-55.1	-0.0740	208.	17.6	0.784
250.0	0.03896	-47.0	-0.0626	165.	15.9	0.823
260.0	0.04063	-38.5	-0.0507	123.	14.1	0.880
270.0	0.04289	-29.2	-0.0379	82.7	12.1	0.979
280.0	0.04650	-18.4	-0.0232	43.7	9.93	1.216
* 290.0	0.05798	-0.3	0.0011	6.1	6.49	3.806
300.0	0.07157	33.9	0.0506	15.2	2.86	1.506
310.0	0.08750	49.2	0.0666	26.7	2.33	1.046
320.0	0.10603	58.8	0.0790	35.9	2.04	0.896
330.0	0.12757	67.4	0.0899	43.8	1.84	0.821
340.0	0.15252	75.3	0.0999	50.8	1.69	0.776
350.0	0.17157	82.9	0.1094	57.3	1.57	0.747
360.0	0.17937	90.3	0.1185	63.2	1.47	0.727
370.0	0.18666	97.5	0.1272	68.7	1.39	0.714
380.0	0.19356	104.6	0.1357	73.9	1.32	0.704
390.0	0.2001	111.6	0.1440	78.9	1.26	0.697
400.0	0.2064	118.6	0.1521	83.6	1.21	0.692
420.0	0.2184	132.4	0.1680	92.5	1.12	0.687
440.0	0.2296	146.1	0.1834	100.8	1.05	0.686
460.0	0.2403	159.8	0.1985	108.6	0.985	0.687
480.0	0.2506	173.6	0.2133	116.0	0.932	0.690
500.0	0.2606	187.4	0.2278	123.	0.886	0.694
520.0	0.2702	201.3	0.2422	130.	0.846	0.699
540.0	0.2797	215.4	0.2564	137.	0.810	0.705
560.0	0.2888	229.5	0.2704	143.	0.778	0.711
580.0	0.2978	243.8	0.2843	149.	0.749	0.717
600.0	0.3067	258.2	0.2980	155.	0.722	0.724

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

580 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02524	-222.7	-0.3744	2155.	72.7	0.492
-30.0	0.02546	-217.7	-0.3627	2070.	70.4	0.500
-20.0	0.02568	-212.7	-0.3512	1984.	68.2	0.506
-10.0	0.02591	-207.6	-0.3398	1897.	65.9	0.511
0.0	0.02615	-202.5	-0.3285	1810.	63.7	0.517
10.0	0.02639	-197.3	-0.3174	1724.	61.5	0.522
20.0	0.02665	-192.1	-0.3064	1639.	59.3	0.528
30.0	0.02691	-186.8	-0.2955	1555.	57.1	0.533
40.0	0.02718	-181.4	-0.2846	1472.	55.0	0.539
50.0	0.02746	-176.0	-0.2739	1391.	52.8	0.546
60.0	0.02775	-170.5	-0.2632	1312.	50.7	0.552
70.0	0.02805	-164.9	-0.2526	1234.	48.7	0.559
80.0	0.02837	-159.3	-0.2421	1159.	46.6	0.567
90.0	0.02870	-153.6	-0.2316	1085.	44.6	0.574
100.0	0.02905	-147.8	-0.2211	1013.	42.7	0.582
110.0	0.02941	-141.9	-0.2107	943.	40.7	0.591
120.0	0.02980	-135.9	-0.2004	876.	38.8	0.600
130.0	0.03020	-129.9	-0.1900	810.	37.0	0.609
140.0	0.03063	-123.7	-0.1797	746.	35.1	0.619
150.0	0.03109	-117.5	-0.1694	685.	33.3	0.629
160.0	0.03157	-111.1	-0.1590	625.	31.5	0.640
170.0	0.03209	-104.7	-0.1487	568.	29.7	0.651
180.0	0.03266	-98.1	-0.1383	512.	28.0	0.664
190.0	0.03327	-91.3	-0.1279	458.	26.3	0.677
200.0	0.03393	-84.5	-0.1174	406.	24.6	0.692
210.0	0.03467	-77.5	-0.1069	356.	22.9	0.709
220.0	0.03549	-70.3	-0.0962	308.	21.2	0.728
230.0	0.03642	-62.9	-0.0854	261.	19.6	0.750
240.0	0.03750	-55.2	-0.0744	216.	17.9	0.778
250.0	0.03878	-47.3	-0.0631	173.	16.2	0.815
260.0	0.04037	-38.8	-0.0513	132.	14.4	0.866
270.0	0.04247	-29.8	-0.0388	91.6	12.5	0.950
280.0	0.04562	-19.5	-0.0248	53.5	10.4	1.125
290.0	0.05236	-5.6	-0.0062	17.6	7.76	1.864
300.0	0.09387	29.3	0.0400	8.9	3.55	2.331
310.0	0.11729	45.1	0.0607	21.5	2.66	1.208
320.0	0.13180	55.8	0.0745	31.4	2.27	0.968
330.0	0.14320	64.9	0.0862	39.8	2.02	0.863
340.0	0.15293	73.3	0.0966	47.2	1.84	0.804
350.0	0.16159	81.1	0.1064	53.9	1.70	0.768
360.0	0.16950	88.7	0.1157	60.0	1.59	0.743
370.0	0.17684	96.0	0.1246	65.8	1.49	0.726
380.0	0.18375	103.2	0.1332	71.2	1.41	0.714
390.0	0.19030	110.3	0.1416	76.3	1.35	0.706
400.0	0.19657	117.4	0.1498	81.1	1.29	0.700
420.0	0.2084	131.3	0.1658	90.3	1.19	0.693
440.0	0.2195	145.1	0.1814	98.7	1.11	0.690
460.0	0.2301	158.9	0.1965	106.7	1.04	0.691
480.0	0.2402	172.7	0.2114	114.3	0.981	0.693
500.0	0.2499	186.6	0.2261	122.	0.932	0.697
520.0	0.2594	200.6	0.2405	128.	0.889	0.701
540.0	0.2686	214.7	0.2547	135.	0.850	0.707
560.0	0.2776	228.9	0.2688	142.	0.816	0.713
580.0	0.2864	243.2	0.2827	148.	0.784	0.719
600.0	0.2950	257.6	0.2964	154.	0.756	0.725



TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

600 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02524	-222.6	-0.3744	2164.	72.9	0.492
-30.0	0.02545	-217.7	-0.3628	2078.	70.6	0.499
-20.0	0.02568	-212.6	-0.3513	1992.	68.4	0.506
-10.0	0.02591	-207.6	-0.3399	1905.	66.1	0.511
0.0	0.02614	-202.4	-0.3286	1818.	63.9	0.517
10.0	0.02639	-197.3	-0.3175	1732.	61.6	0.522
20.0	0.02664	-192.0	-0.3065	1647.	59.4	0.527
30.0	0.02690	-186.7	-0.2956	1562.	57.3	0.533
40.0	0.02717	-181.4	-0.2847	1480.	55.1	0.539
50.0	0.02745	-175.9	-0.2740	1398.	53.0	0.545
60.0	0.02774	-170.4	-0.2633	1319.	50.9	0.552
70.0	0.02804	-164.9	-0.2527	1241.	48.8	0.559
80.0	0.02836	-159.2	-0.2422	1165.	46.8	0.566
90.0	0.02869	-153.5	-0.2317	1092.	44.8	0.574
100.0	0.02903	-147.7	-0.2213	1020.	42.8	0.582
110.0	0.02939	-141.9	-0.2109	950.	40.9	0.591
120.0	0.02978	-135.9	-0.2005	882.	39.0	0.599
130.0	0.03018	-129.9	-0.1902	817.	37.1	0.609
140.0	0.03060	-123.7	-0.1798	753.	35.3	0.618
150.0	0.03106	-117.5	-0.1695	692.	33.4	0.628
160.0	0.03154	-111.1	-0.1592	632.	31.7	0.639
170.0	0.03206	-104.7	-0.1489	575.	29.9	0.650
180.0	0.03261	-98.1	-0.1385	519.	28.2	0.663
190.0	0.03322	-91.4	-0.1281	465.	26.5	0.676
200.0	0.03388	-84.5	-0.1177	413.	24.8	0.690
210.0	0.03460	-77.5	-0.1072	363.	23.1	0.707
220.0	0.03541	-70.4	-0.0965	315.	21.4	0.725
230.0	0.03632	-63.0	-0.0858	269.	19.8	0.747
240.0	0.03737	-55.4	-0.0748	224.	18.1	0.773
250.0	0.03861	-47.5	-0.0636	181.	16.4	0.807
260.0	0.04013	-39.2	-0.0520	140.	14.7	0.854
270.0	0.04209	-30.3	-0.0397	100.3	12.9	0.927
280.0	0.04491	-20.4	-0.0262	62.8	10.9	1.064
290.0	0.05000	-8.1	-0.0098	27.9	8.54	1.464
300.0	0.07245	17.2	0.0236	5.3	4.84	3.811
310.0	0.10427	40.2	0.0538	16.4	3.09	1.468
320.0	0.12084	52.5	0.0697	26.9	2.54	1.065
330.0	0.13310	62.3	0.0822	35.8	2.22	0.915
340.0	0.14326	71.1	0.0932	43.5	2.00	0.838
350.0	0.15217	79.2	0.1033	50.5	1.83	0.791
360.0	0.16021	87.0	0.1128	56.9	1.70	0.761
370.0	0.16762	94.5	0.1219	62.9	1.60	0.740
380.0	0.17456	101.8	0.1307	68.5	1.51	0.726
390.0	0.18111	109.0	0.1392	73.7	1.43	0.715
400.0	0.18735	116.1	0.1476	78.7	1.37	0.708
420.0	0.19910	130.2	0.1637	88.1	1.26	0.699
440.0	0.2101	144.1	0.1794	96.8	1.17	0.695
460.0	0.2205	158.0	0.1947	104.9	1.09	0.694
480.0	0.2304	171.9	0.2096	112.6	1.03	0.696
500.0	0.2400	185.9	0.2243	120.	0.979	0.699
520.0	0.2493	199.9	0.2388	127.	0.932	0.704
540.0	0.2583	214.0	0.2530	134.	0.891	0.709
560.0	0.2671	228.2	0.2671	140.	0.854	0.714
580.0	0.2757	242.6	0.2811	147.	0.821	0.720
600.0	0.2841	257.1	0.2948	153.	0.791	0.727



TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

620 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02523	-222.5	-0.3745	2173.	73.1	0.492
-30.0	0.02545	-217.6	-0.3629	2087.	70.8	0.499
-20.0	0.02567	-212.6	-0.3513	2000.	68.6	0.505
-10.0	0.02590	-207.5	-0.3399	1913.	66.3	0.511
0.0	0.02613	-202.4	-0.3287	1826.	64.0	0.516
10.0	0.02638	-197.2	-0.3176	1740.	61.8	0.522
20.0	0.02663	-192.0	-0.3066	1654.	59.6	0.527
30.0	0.02689	-186.7	-0.2957	1570.	57.4	0.533
40.0	0.02716	-181.3	-0.2848	1487.	55.3	0.539
50.0	0.02744	-175.9	-0.2741	1405.	53.1	0.545
60.0	0.02773	-170.4	-0.2634	1326.	51.0	0.552
70.0	0.02803	-164.8	-0.2528	1248.	49.0	0.559
80.0	0.02834	-159.2	-0.2423	1172.	46.9	0.566
90.0	0.02867	-153.5	-0.2318	1098.	44.9	0.574
100.0	0.02901	-147.7	-0.2214	1027.	43.0	0.582
110.0	0.02938	-141.8	-0.2110	957.	41.0	0.590
120.0	0.02976	-135.9	-0.2007	889.	39.1	0.599
130.0	0.03016	-129.8	-0.1903	824.	37.2	0.608
140.0	0.03058	-123.7	-0.1800	760.	35.4	0.618
150.0	0.03103	-117.5	-0.1697	698.	33.6	0.628
160.0	0.03151	-111.1	-0.1594	639.	31.8	0.638
170.0	0.03202	-104.7	-0.1491	581.	30.1	0.650
180.0	0.03257	-98.1	-0.1387	526.	28.3	0.662
190.0	0.03317	-91.4	-0.1284	472.	26.6	0.675
200.0	0.03382	-84.6	-0.1179	420.	24.9	0.689
210.0	0.03454	-77.6	-0.1074	370.	23.3	0.705
220.0	0.03533	-70.5	-0.0969	322.	21.6	0.723
230.0	0.03623	-63.1	-0.0861	276.	20.0	0.744
240.0	0.03725	-55.5	-0.0752	232.	18.3	0.769
250.0	0.03845	-47.7	-0.0641	189.	16.7	0.801
260.0	0.03991	-39.5	-0.0526	148.	14.9	0.844
270.0	0.04175	-30.7	-0.0405	108.8	13.2	0.907
280.0	0.04431	-21.1	-0.0275	71.8	11.3	1.019
290.0	0.04849	-9.8	-0.0123	37.4	9.15	1.282
300.0	0.05971	7.6	0.0107	10.1	6.28	2.535
310.0	0.09074	34.1	0.0454	12.0	3.67	1.883
320.0	0.11005	48.7	0.0643	22.6	2.86	1.197
330.0	0.12337	59.5	0.0780	31.9	2.45	0.980
340.0	0.13406	68.7	0.0896	40.0	2.18	0.878
350.0	0.14324	77.2	0.1002	47.2	1.98	0.818
360.0	0.15145	85.2	0.1100	53.9	1.83	0.781
370.0	0.15895	92.9	0.1193	60.0	1.71	0.756
380.0	0.16593	100.3	0.1282	65.8	1.61	0.738
390.0	0.17249	107.7	0.1369	71.2	1.52	0.725
400.0	0.17871	114.9	0.1453	76.3	1.45	0.716
420.0	0.19038	129.1	0.1616	85.9	1.33	0.705
440.0	0.2013	143.1	0.1774	94.8	1.23	0.700
460.0	0.2115	157.1	0.1928	103.1	1.15	0.698
480.0	0.2213	171.1	0.2078	111.0	1.08	0.699
500.0	0.2307	185.1	0.2226	118.5	1.03	0.702
520.0	0.2398	199.2	0.2371	126.	0.977	0.706
540.0	0.2486	213.3	0.2514	133.	0.933	0.711
560.0	0.2572	227.6	0.2655	139.	0.893	0.716
580.0	0.2656	242.0	0.2795	146.	0.858	0.722
600.0	0.2739	256.5	0.2933	152.	0.826	0.728

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

640 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02523	-222.5	-0.3746	2182.	73.3	0.492
-30.0	0.02544	-217.5	-0.3629	2095.	71.0	0.499
-20.0	0.02566	-212.5	-0.3514	2008.	68.7	0.505
-10.0	0.02589	-207.4	-0.3400	1921.	66.5	0.511
0.0	0.02613	-202.3	-0.3288	1834.	64.2	0.516
10.0	0.02637	-197.2	-0.3177	1747.	62.0	0.522
20.0	0.02662	-191.9	-0.3067	1662.	59.8	0.527
30.0	0.02688	-186.6	-0.2958	1577.	57.6	0.533
40.0	0.02715	-181.3	-0.2849	1494.	55.4	0.539
50.0	0.02742	-175.8	-0.2742	1413.	53.3	0.545
60.0	0.02771	-170.4	-0.2635	1333.	51.2	0.552
70.0	0.02801	-164.8	-0.2529	1255.	49.1	0.559
80.0	0.02833	-159.2	-0.2424	1179.	47.1	0.566
90.0	0.02866	-153.5	-0.2319	1105.	45.1	0.573
100.0	0.02900	-147.7	-0.2215	1033.	43.1	0.581
110.0	0.02936	-141.8	-0.2111	964.	41.2	0.590
120.0	0.02974	-135.8	-0.2008	896.	39.3	0.598
130.0	0.03013	-129.8	-0.1905	830.	37.4	0.608
140.0	0.03055	-123.7	-0.1802	767.	35.6	0.617
150.0	0.03100	-117.4	-0.1699	705.	33.7	0.627
160.0	0.03148	-111.1	-0.1596	646.	32.0	0.638
170.0	0.03199	-104.7	-0.1493	588.	30.2	0.649
180.0	0.03253	-98.1	-0.1389	533.	28.5	0.661
190.0	0.03312	-91.4	-0.1286	479.	26.8	0.673
200.0	0.03377	-84.6	-0.1182	427.	25.1	0.687
210.0	0.03447	-77.7	-0.1077	377.	23.5	0.703
220.0	0.03525	-70.5	-0.0972	329.	21.8	0.720
230.0	0.03613	-63.2	-0.0865	283.	20.2	0.740
240.0	0.03713	-55.7	-0.0756	239.	18.5	0.765
250.0	0.03830	-47.9	-0.0646	197.	16.9	0.795
260.0	0.03970	-39.7	-0.0532	156.	15.2	0.834
270.0	0.04145	-31.1	-0.0413	117.1	13.5	0.891
280.0	0.04380	-21.7	-0.0285	80.5	11.7	0.984
290.0	0.04739	-11.0	-0.0142	46.6	9.66	1.175
300.0	0.05483	3.2	0.0046	18.0	7.23	1.793
310.0	0.07743	26.7	0.0354	9.7	4.46	2.322
320.0	0.09941	44.4	0.0583	18.8	3.25	1.374
330.0	0.11397	56.4	0.0735	28.1	2.71	1.061
340.0	0.12526	66.3	0.0859	36.5	2.38	0.924
350.0	0.13478	75.1	0.0969	44.0	2.15	0.849
360.0	0.14317	83.4	0.1071	50.9	1.97	0.803
370.0	0.15077	91.2	0.1166	57.2	1.83	0.772
380.0	0.15780	98.8	0.1257	63.2	1.72	0.751
390.0	0.16438	106.3	0.1345	68.7	1.62	0.736
400.0	0.17060	113.6	0.1431	74.0	1.54	0.725
420.0	0.18221	127.9	0.1596	83.8	1.40	0.711
440.0	0.19298	142.1	0.1755	92.9	1.30	0.705
460.0	0.2031	156.2	0.1910	101.4	1.21	0.702
480.0	0.2128	170.2	0.2061	109.4	1.14	0.703
500.0	0.2220	184.3	0.2209	117.0	1.08	0.705
520.0	0.2309	198.4	0.2355	124.	1.02	0.709
540.0	0.2396	212.6	0.2498	131.	0.975	0.713
560.0	0.2480	226.9	0.2640	138.	0.933	0.718
580.0	0.2563	241.4	0.2780	145.	0.895	0.724
600.0	0.2643	255.9	0.2918	151.	0.861	0.730

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

660 PSIA

T	V	H	S	DP/DD	DP/DT	CP
DEG F	FT <sup>3</sup> /LB	BTU/LB	BTU/(LB-F)			BTU/(LB-F)
-40.0	0.02522	-222.4	-0.3747	2190.	73.5	0.492
-30.0	0.02544	-217.5	-0.3630	2104.	71.2	0.499
-20.0	0.02566	-212.5	-0.3515	2017.	68.9	0.505
-10.0	0.02588	-207.4	-0.3401	1929.	66.7	0.511
0.0	0.02612	-202.3	-0.3289	1842.	64.4	0.516
10.0	0.02636	-197.1	-0.3177	1755.	62.2	0.521
20.0	0.02661	-191.9	-0.3067	1669.	59.9	0.527
30.0	0.02687	-186.6	-0.2959	1584.	57.7	0.533
40.0	0.02714	-181.2	-0.2850	1501.	55.6	0.539
50.0	0.02741	-175.8	-0.2743	1420.	53.4	0.545
60.0	0.02770	-170.3	-0.2636	1340.	51.3	0.551
70.0	0.02800	-164.7	-0.2530	1262.	49.3	0.558
80.0	0.02831	-159.1	-0.2425	1186.	47.2	0.566
90.0	0.02864	-153.4	-0.2321	1112.	45.2	0.573
100.0	0.02898	-147.6	-0.2217	1040.	43.3	0.581
110.0	0.02934	-141.8	-0.2113	970.	41.3	0.589
120.0	0.02972	-135.8	-0.2009	903.	39.4	0.598
130.0	0.03011	-129.8	-0.1906	837.	37.5	0.607
140.0	0.03053	-123.7	-0.1803	773.	35.7	0.616
150.0	0.03097	-117.4	-0.1700	712.	33.9	0.626
160.0	0.03145	-111.1	-0.1598	652.	32.1	0.637
170.0	0.03195	-104.7	-0.1495	595.	30.4	0.648
180.0	0.03249	-98.1	-0.1392	539.	28.7	0.660
190.0	0.03308	-91.5	-0.1288	486.	27.0	0.672
200.0	0.03371	-84.7	-0.1184	434.	25.3	0.686
210.0	0.03441	-77.7	-0.1080	385.	23.6	0.701
220.0	0.03518	-70.6	-0.0975	337.	22.0	0.718
230.0	0.03604	-63.3	-0.0868	291.	20.4	0.737
240.0	0.03702	-55.8	-0.0760	246.	18.8	0.760
250.0	0.03815	-48.1	-0.0650	204.	17.1	0.789
260.0	0.03950	-40.0	-0.0537	164.	15.5	0.826
270.0	0.04116	-31.5	-0.0420	125.	13.8	0.877
280.0	0.04334	-22.3	-0.0295	68.9	12.0	0.956
290.0	0.04651	-12.1	-0.0153	55.4	10.1	1.104
300.0	0.05219	0.6	0.0009	26.4	7.94	1.477
310.0	0.06693	19.7	0.0259	10.8	5.37	2.277
320.0	0.08905	39.6	0.0516	15.7	3.73	1.585
330.0	0.10489	53.0	0.0687	24.7	3.01	1.160
340.0	0.11685	63.6	0.0821	33.2	2.60	0.979
350.0	0.12673	72.9	0.0936	40.9	2.33	0.884
360.0	0.13533	81.4	0.1041	48.0	2.12	0.828
370.0	0.14305	89.5	0.1139	54.5	1.96	0.791
380.0	0.15014	97.3	0.1232	60.6	1.83	0.765
390.0	0.15675	104.9	0.1322	66.3	1.72	0.747
400.0	0.16297	112.3	0.1408	71.7	1.63	0.734
420.0	0.17453	126.8	0.1575	81.8	1.48	0.718
440.0	0.18520	141.1	0.1736	91.0	1.37	0.710
460.0	0.19523	155.2	0.1891	99.7	1.27	0.707
480.0	0.2047	169.4	0.2043	107.8	1.19	0.706
500.0	0.2139	183.5	0.2192	115.6	1.13	0.708
520.0	0.2226	197.7	0.2338	123.	1.07	0.711
540.0	0.2311	211.9	0.2482	130.	1.02	0.715
560.0	0.2394	226.3	0.2625	137.	0.974	0.720
580.0	0.2475	240.7	0.2765	144.	0.934	0.725
600.0	0.2554	255.3	0.2904	150.	0.898	0.731



TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

680 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02521	-222.4	-0.3748	2199.	73.8	0.492
-30.0	0.02543	-217.4	-0.3631	2112.	71.4	0.499
-20.0	0.02565	-212.4	-0.3516	2025.	69.1	0.505
-10.0	0.02588	-207.3	-0.3402	1937.	66.8	0.511
0.0	0.02611	-202.2	-0.3290	1849.	64.6	0.516
10.0	0.02635	-197.0	-0.3178	1762.	62.3	0.521
20.0	0.02660	-191.8	-0.3068	1676.	60.1	0.527
30.0	0.02686	-186.5	-0.2960	1592.	57.9	0.532
40.0	0.02713	-181.2	-0.2851	1508.	55.7	0.538
50.0	0.02740	-175.7	-0.2744	1427.	53.6	0.545
60.0	0.02769	-170.3	-0.2637	1347.	51.5	0.551
70.0	0.02799	-164.7	-0.2532	1269.	49.4	0.558
80.0	0.02830	-159.1	-0.2426	1193.	47.4	0.565
90.0	0.02863	-153.4	-0.2322	1119.	45.4	0.573
100.0	0.02897	-147.6	-0.2218	1047.	43.4	0.581
110.0	0.02932	-141.7	-0.2114	977.	41.5	0.589
120.0	0.02970	-135.8	-0.2011	909.	39.6	0.598
130.0	0.03009	-129.8	-0.1908	844.	37.7	0.607
140.0	0.03051	-123.6	-0.1805	780.	35.9	0.616
150.0	0.03095	-117.4	-0.1702	719.	34.0	0.626
160.0	0.03142	-111.1	-0.1599	659.	32.3	0.636
170.0	0.03192	-104.7	-0.1497	602.	30.5	0.647
180.0	0.03245	-98.1	-0.1394	546.	28.8	0.659
190.0	0.03303	-91.5	-0.1290	493.	27.1	0.671
200.0	0.03366	-84.7	-0.1187	441.	25.5	0.684
210.0	0.03435	-77.8	-0.1083	391.	23.8	0.699
220.0	0.03511	-70.7	-0.0978	344.	22.2	0.716
230.0	0.03595	-63.4	-0.0872	298.	20.6	0.735
240.0	0.03691	-55.9	-0.0764	254.	19.0	0.757
250.0	0.03801	-48.2	-0.0655	212.	17.4	0.784
260.0	0.03931	-40.2	-0.0543	171.	15.7	0.818
270.0	0.04090	-31.8	-0.0427	133.	14.1	0.864
280.0	0.04294	-22.8	-0.0304	97.2	12.4	0.933
290.0	0.04579	-12.9	-0.0172	63.9	10.5	1.052
300.0	0.05044	-1.3	-0.0017	34.7	8.52	1.307
310.0	0.06046	14.6	0.0190	15.0	6.22	1.909
320.0	0.07946	34.3	0.0445	14.2	4.31	1.768
330.0	0.09618	49.3	0.0636	21.8	3.37	1.273
340.0	0.10881	60.8	0.0780	30.2	2.86	1.042
350.0	0.11907	70.6	0.0902	38.0	2.52	0.924
360.0	0.12789	79.4	0.1011	45.2	2.28	0.855
370.0	0.13575	87.8	0.1111	51.9	2.10	0.811
380.0	0.14291	95.7	0.1207	58.1	1.95	0.781
390.0	0.14955	103.4	0.1298	64.0	1.83	0.760
400.0	0.15578	110.9	0.1386	69.5	1.73	0.745
420.0	0.16730	125.6	0.1555	79.8	1.57	0.725
440.0	0.17789	140.0	0.1717	89.2	1.44	0.715
460.0	0.18781	154.3	0.1874	98.0	1.34	0.711
480.0	0.19720	168.5	0.2026	106.3	1.25	0.710
500.0	0.2062	182.7	0.2176	114.2	1.18	0.711
520.0	0.2148	196.9	0.2323	122.	1.12	0.713
540.0	0.2232	211.2	0.2467	129.	1.06	0.717
560.0	0.2313	225.6	0.2610	136.	1.02	0.722
580.0	0.2392	240.1	0.2750	143.	0.973	0.727
600.0	0.2469	254.7	0.2889	149.	0.935	0.733



TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION  
ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

700 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02521	-222.3	-0.3748	2208.	74.0	0.492
-30.0	0.02542	-217.4	-0.3632	2121.	71.6	0.499
-20.0	0.02564	-212.3	-0.3517	2033.	69.3	0.505
-10.0	0.02587	-207.3	-0.3403	1945.	67.0	0.511
0.0	0.02610	-202.2	-0.3290	1857.	64.7	0.516
10.0	0.02635	-197.0	-0.3179	1770.	62.5	0.521
20.0	0.02659	-191.8	-0.3069	1684.	60.3	0.527
30.0	0.02685	-186.5	-0.2960	1599.	58.1	0.532
40.0	0.02712	-181.1	-0.2852	1515.	55.9	0.538
50.0	0.02739	-175.7	-0.2745	1434.	53.7	0.544
60.0	0.02768	-170.2	-0.2638	1354.	51.6	0.551
70.0	0.02798	-164.7	-0.2533	1276.	49.6	0.558
80.0	0.02829	-159.0	-0.2428	1200.	47.5	0.565
90.0	0.02861	-153.3	-0.2323	1126.	45.5	0.573
100.0	0.02895	-147.6	-0.2219	1054.	43.5	0.580
110.0	0.02930	-141.7	-0.2116	984.	41.6	0.589
120.0	0.02968	-135.8	-0.2012	916.	39.7	0.597
130.0	0.03007	-129.7	-0.1909	850.	37.8	0.606
140.0	0.03048	-123.6	-0.1806	787.	36.0	0.615
150.0	0.03092	-117.4	-0.1704	725.	34.2	0.625
160.0	0.03139	-111.1	-0.1601	666.	32.4	0.635
170.0	0.03188	-104.7	-0.1499	608.	30.7	0.646
180.0	0.03242	-98.2	-0.1396	553.	29.0	0.658
190.0	0.03299	-91.5	-0.1293	499.	27.3	0.670
200.0	0.03361	-84.7	-0.1189	448.	25.6	0.683
210.0	0.03429	-77.8	-0.1085	398.	24.0	0.697
220.0	0.03504	-70.7	-0.0981	351.	22.4	0.714
230.0	0.03587	-63.5	-0.0875	305.	20.8	0.732
240.0	0.03680	-56.1	-0.0768	261.	19.2	0.753
250.0	0.03788	-48.4	-0.0659	219.	17.6	0.779
260.0	0.03913	-40.4	-0.0548	179.	16.0	0.811
270.0	0.04066	-32.1	-0.0433	141.	14.3	0.853
280.0	0.04258	-23.3	-0.0313	105.2	12.7	0.914
290.0	0.04518	-13.7	-0.0184	72.1	10.9	1.012
300.0	0.04915	-2.7	-0.0038	42.9	9.03	1.201
310.0	0.05658	11.2	0.0143	21.0	6.93	1.610
320.0	0.07139	29.3	0.0376	14.4	4.94	1.820
330.0	0.08799	45.4	0.0582	19.7	3.77	1.390
340.0	0.10116	57.8	0.0738	27.5	3.14	1.113
350.0	0.11180	68.1	0.0866	35.3	2.74	0.968
360.0	0.12084	77.4	0.0980	42.6	2.46	0.885
370.0	0.12883	85.9	0.1084	49.4	2.25	0.833
380.0	0.13607	94.1	0.1181	55.7	2.08	0.797
390.0	0.14275	101.9	0.1274	61.7	1.94	0.773
400.0	0.14899	109.6	0.1364	67.3	1.83	0.755
420.0	0.16048	124.5	0.1535	77.8	1.65	0.733
440.0	0.17100	139.0	0.1698	87.4	1.51	0.721
460.0	0.18082	153.4	0.1856	96.4	1.40	0.715
480.0	0.19009	167.6	0.2009	104.8	1.31	0.713
500.0	0.19895	181.9	0.2160	112.8	1.23	0.714
520.0	0.2075	196.2	0.2307	120.	1.17	0.716
540.0	0.2157	210.6	0.2452	128.	1.11	0.719
560.0	0.2236	225.0	0.2595	135.	1.06	0.724
580.0	0.2314	239.5	0.2736	142.	1.01	0.729
600.0	0.2390	254.1	0.2875	148.	0.972	0.734

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

750 PSIA

T DEG F	V FT3/LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02519	-222.2	-0.3750	2230.	74.5	0.492
-30.0	0.02541	-217.2	-0.3634	2142.	72.1	0.499
-20.0	0.02563	-212.2	-0.3519	2053.	69.8	0.505
-10.0	0.02585	-207.1	-0.3405	1965.	67.5	0.510
0.0	0.02609	-202.0	-0.3293	1876.	65.2	0.516
10.0	0.02633	-196.9	-0.3182	1789.	62.9	0.521
20.0	0.02657	-191.6	-0.3072	1702.	60.7	0.526
30.0	0.02683	-186.4	-0.2963	1617.	58.5	0.532
40.0	0.02709	-181.0	-0.2855	1533.	56.3	0.538
50.0	0.02737	-175.6	-0.2748	1451.	54.1	0.544
60.0	0.02765	-170.1	-0.2641	1371.	52.0	0.550
70.0	0.02795	-164.6	-0.2536	1293.	49.9	0.557
80.0	0.02825	-158.9	-0.2431	1216.	47.9	0.564
90.0	0.02857	-153.2	-0.2326	1142.	45.9	0.572
100.0	0.02891	-147.5	-0.2222	1070.	43.9	0.580
110.0	0.02926	-141.6	-0.2119	1000.	42.0	0.588
120.0	0.02963	-135.7	-0.2016	932.	40.1	0.596
130.0	0.03002	-129.7	-0.1913	867.	38.2	0.605
140.0	0.03042	-123.6	-0.1810	803.	36.4	0.614
150.0	0.03086	-117.4	-0.1708	742.	34.6	0.624
160.0	0.03131	-111.1	-0.1606	682.	32.8	0.634
170.0	0.03180	-104.7	-0.1503	625.	31.1	0.644
180.0	0.03232	-98.2	-0.1401	570.	29.4	0.655
190.0	0.03288	-91.6	-0.1298	516.	27.7	0.667
200.0	0.03349	-84.8	-0.1195	465.	26.0	0.680
210.0	0.03414	-77.9	-0.1092	416.	24.4	0.693
220.0	0.03486	-70.9	-0.0988	368.	22.8	0.709
230.0	0.03566	-63.7	-0.0883	323.	21.2	0.726
240.0	0.03655	-56.4	-0.0777	279.	19.7	0.745
250.0	0.03756	-48.8	-0.0670	237.	18.1	0.768
260.0	0.03873	-41.0	-0.0560	198.	16.5	0.795
270.0	0.04011	-32.8	-0.0448	160.	15.0	0.830
280.0	0.04180	-24.3	-0.0332	125.	13.4	0.877
290.0	0.04396	-15.2	-0.0209	92.0	11.8	0.944
300.0	0.04693	-5.2	-0.0077	62.7	10.1	1.052
310.0	0.05146	6.2	0.0072	38.3	8.30	1.238
320.0	0.05923	20.0	0.0250	22.7	6.48	1.506
330.0	0.07127	35.6	0.0448	19.2	4.96	1.527
340.0	0.08413	49.7	0.0626	23.3	3.98	1.286
350.0	0.09530	61.6	0.0774	29.9	3.37	1.091
360.0	0.10481	71.9	0.0900	36.9	2.96	0.970
370.0	0.11312	81.2	0.1013	43.7	2.66	0.894
380.0	0.12055	89.9	0.1117	50.2	2.44	0.844
390.0	0.12733	98.1	0.1214	56.4	2.26	0.809
400.0	0.13360	106.1	0.1308	62.2	2.11	0.785
420.0	0.14505	121.4	0.1484	73.2	1.88	0.753
440.0	0.15541	136.3	0.1652	83.2	1.71	0.736
460.0	0.16501	151.0	0.1812	92.5	1.57	0.727
480.0	0.17403	165.5	0.1968	101.2	1.46	0.723
500.0	0.18260	179.9	0.2120	109.5	1.37	0.722
520.0	0.19080	194.3	0.2269	117.4	1.29	0.723
540.0	0.19870	208.8	0.2415	125.	1.23	0.725
560.0	0.2064	223.3	0.2559	132.	1.17	0.729
580.0	0.2138	238.0	0.2701	139.	1.12	0.733
600.0	0.2210	252.7	0.2841	146.	1.07	0.738

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION  
ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

800 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02518	-222.0	-0.3752	2252.	75.0	0.491
-30.0	0.02539	-217.1	-0.3636	2163.	72.6	0.499
-20.0	0.02561	-212.1	-0.3521	2074.	70.3	0.505
-10.0	0.02584	-207.0	-0.3407	1984.	67.9	0.510
0.0	0.02607	-201.9	-0.3295	1895.	65.6	0.515
10.0	0.02631	-196.7	-0.3184	1807.	63.3	0.521
20.0	0.02655	-191.5	-0.3074	1720.	61.1	0.526
30.0	0.02681	-186.2	-0.2965	1635.	58.8	0.531
40.0	0.02707	-180.9	-0.2857	1551.	56.6	0.537
50.0	0.02734	-175.5	-0.2750	1469.	54.5	0.543
60.0	0.02762	-170.0	-0.2644	1388.	52.4	0.550
70.0	0.02792	-164.4	-0.2538	1310.	50.3	0.557
80.0	0.02822	-158.8	-0.2434	1233.	48.2	0.564
90.0	0.02854	-153.1	-0.2329	1159.	46.2	0.571
100.0	0.02887	-147.4	-0.2226	1087.	44.2	0.579
110.0	0.02922	-141.5	-0.2122	1017.	42.3	0.587
120.0	0.02958	-135.6	-0.2019	949.	40.4	0.595
130.0	0.02996	-129.6	-0.1917	883.	38.5	0.604
140.0	0.03037	-123.5	-0.1814	820.	36.7	0.613
150.0	0.03079	-117.3	-0.1712	758.	34.9	0.622
160.0	0.03124	-111.1	-0.1610	699.	33.2	0.632
170.0	0.03172	-104.7	-0.1508	641.	31.4	0.642
180.0	0.03223	-98.2	-0.1406	586.	29.7	0.653
190.0	0.03278	-91.6	-0.1303	533.	28.1	0.664
200.0	0.03337	-84.9	-0.1201	482.	26.4	0.677
210.0	0.03401	-78.0	-0.1098	433.	24.8	0.690
220.0	0.03470	-71.1	-0.0995	385.	23.3	0.704
230.0	0.03547	-63.9	-0.0891	340.	21.7	0.720
240.0	0.03632	-56.6	-0.0786	297.	20.1	0.738
250.0	0.03728	-49.1	-0.0679	255.	18.6	0.758
260.0	0.03837	-41.4	-0.0571	216.	17.1	0.783
270.0	0.03964	-33.4	-0.0461	178.	15.6	0.812
280.0	0.04115	-25.1	-0.0348	143.	14.0	0.850
290.0	0.04302	-16.3	-0.0230	111.0	12.5	0.900
300.0	0.04543	-7.0	-0.0106	81.6	10.9	0.972
310.0	0.04876	3.3	0.0028	56.2	9.34	1.080
320.0	0.05370	14.9	0.0177	36.8	7.72	1.238
330.0	0.06125	28.1	0.0346	26.0	6.19	1.381
340.0	0.07122	42.0	0.0520	24.1	4.97	1.347
350.0	0.08160	54.7	0.0679	27.6	4.13	1.196
360.0	0.09108	66.0	0.0817	33.2	3.56	1.059
370.0	0.09951	76.1	0.0940	39.4	3.15	0.962
380.0	0.10705	85.4	0.1051	45.7	2.85	0.896
390.0	0.11390	94.1	0.1154	51.9	2.61	0.850
400.0	0.12021	102.4	0.1252	57.8	2.42	0.817
420.0	0.13160	118.3	0.1434	69.0	2.14	0.776
440.0	0.14184	133.6	0.1606	79.3	1.92	0.753
460.0	0.15125	148.5	0.1770	88.9	1.76	0.740
480.0	0.16004	163.2	0.1928	97.9	1.63	0.733
500.0	0.16836	177.9	0.2082	106.5	1.52	0.730
520.0	0.17630	192.5	0.2233	114.6	1.43	0.729
540.0	0.18392	207.1	0.2380	122.	1.35	0.731
560.0	0.19129	221.7	0.2525	130.	1.28	0.734
580.0	0.19843	236.4	0.2668	137.	1.22	0.738
600.0	0.2054	251.2	0.2809	144.	1.17	0.742



TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

850 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02517	-221.9	-0.3754	2273.	75.6	0.491
-30.0	0.02538	-216.9	-0.3638	2184.	73.1	0.498
-20.0	0.02560	-211.9	-0.3523	2094.	70.7	0.504
-10.0	0.02582	-206.8	-0.3409	2004.	68.4	0.510
0.0	0.02605	-201.7	-0.3297	1915.	66.0	0.515
10.0	0.02629	-196.6	-0.3186	1826.	63.7	0.520
20.0	0.02653	-191.4	-0.3076	1739.	61.5	0.526
30.0	0.02678	-186.1	-0.2968	1653.	59.2	0.531
40.0	0.02705	-180.7	-0.2860	1568.	57.0	0.537
50.0	0.02732	-175.3	-0.2753	1486.	54.9	0.543
60.0	0.02760	-169.9	-0.2647	1405.	52.7	0.549
70.0	0.02789	-164.3	-0.2541	1327.	50.6	0.556
80.0	0.02819	-158.7	-0.2436	1250.	48.6	0.563
90.0	0.02850	-153.0	-0.2332	1176.	46.6	0.570
100.0	0.02883	-147.3	-0.2229	1103.	44.6	0.578
110.0	0.02918	-141.5	-0.2125	1033.	42.6	0.586
120.0	0.02954	-135.6	-0.2023	965.	40.7	0.594
130.0	0.02991	-129.6	-0.1920	899.	38.9	0.603
140.0	0.03031	-123.5	-0.1818	836.	37.1	0.612
150.0	0.03073	-117.3	-0.1716	774.	35.3	0.621
160.0	0.03117	-111.0	-0.1614	715.	33.5	0.630
170.0	0.03164	-104.7	-0.1512	658.	31.8	0.640
180.0	0.03214	-98.2	-0.1411	603.	30.1	0.651
190.0	0.03268	-91.6	-0.1309	549.	28.5	0.662
200.0	0.03325	-84.9	-0.1207	498.	26.8	0.674
210.0	0.03387	-78.1	-0.1104	449.	25.2	0.686
220.0	0.03455	-71.2	-0.1001	402.	23.7	0.700
230.0	0.03529	-64.1	-0.0898	357.	22.1	0.715
240.0	0.03610	-56.9	-0.0794	314.	20.6	0.731
250.0	0.03701	-49.4	-0.0688	273.	19.1	0.750
260.0	0.03804	-41.8	-0.0582	233.	17.6	0.772
270.0	0.03922	-34.0	-0.0473	196.	16.1	0.798
280.0	0.04060	-25.8	-0.0363	162.	14.7	0.829
290.0	0.04226	-17.3	-0.0249	129.	13.2	0.869
300.0	0.04431	-8.3	-0.0130	99.8	11.7	0.922
310.0	0.04698	1.2	-0.0004	73.9	10.2	0.995
320.0	0.05060	11.7	0.0130	52.5	8.72	1.094
330.0	0.05573	23.3	0.0278	37.5	7.27	1.208
340.0	0.06277	35.8	0.0435	30.0	5.99	1.271
350.0	0.07120	48.4	0.0592	29.1	4.98	1.225
360.0	0.07984	60.2	0.0736	32.1	4.25	1.122
370.0	0.08799	70.9	0.0867	37.0	3.72	1.024
380.0	0.09544	80.8	0.0985	42.6	3.32	0.948
390.0	0.10226	90.0	0.1094	48.5	3.02	0.892
400.0	0.10854	98.7	0.1196	54.3	2.78	0.852
420.0	0.11986	115.2	0.1385	65.4	2.42	0.800
440.0	0.12996	130.8	0.1561	75.9	2.16	0.770
460.0	0.13919	146.1	0.1729	85.7	1.96	0.753
480.0	0.14778	161.0	0.1889	95.0	1.81	0.743
500.0	0.15587	175.8	0.2045	103.7	1.68	0.738
520.0	0.16357	190.6	0.2197	112.0	1.57	0.737
540.0	0.17094	205.3	0.2346	120.0	1.48	0.737
560.0	0.17805	220.1	0.2492	128.	1.40	0.739
580.0	0.18494	234.9	0.2636	135.	1.34	0.742
600.0	0.19163	249.7	0.2778	142.	1.28	0.746



TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

900 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02515	-221.7	-0.3756	2295.	76.1	0.491
-30.0	0.02536	-216.8	-0.3640	2204.	73.6	0.498
-20.0	0.02558	-211.8	-0.3525	2114.	71.2	0.504
-10.0	0.02580	-206.7	-0.3411	2023.	68.8	0.510
0.0	0.02603	-201.6	-0.3299	1933.	66.5	0.515
10.0	0.02627	-196.4	-0.3188	1844.	64.1	0.520
20.0	0.02651	-191.2	-0.3079	1757.	61.9	0.525
30.0	0.02676	-186.0	-0.2970	1670.	59.6	0.531
40.0	0.02702	-180.6	-0.2862	1586.	57.4	0.536
50.0	0.02729	-175.2	-0.2755	1503.	55.2	0.542
60.0	0.02757	-169.7	-0.2649	1422.	53.1	0.549
70.0	0.02786	-164.2	-0.2544	1343.	51.0	0.555
80.0	0.02816	-158.6	-0.2439	1267.	48.9	0.562
90.0	0.02847	-152.9	-0.2335	1192.	46.9	0.570
100.0	0.02879	-147.2	-0.2232	1120.	44.9	0.577
110.0	0.02913	-141.4	-0.2129	1049.	43.0	0.585
120.0	0.02949	-135.5	-0.2026	981.	41.1	0.593
130.0	0.02986	-129.5	-0.1924	916.	39.2	0.602
140.0	0.03026	-123.4	-0.1822	852.	37.4	0.610
150.0	0.03067	-117.3	-0.1720	790.	35.6	0.620
160.0	0.03110	-111.0	-0.1618	731.	33.9	0.629
170.0	0.03157	-104.7	-0.1517	674.	32.1	0.639
180.0	0.03206	-98.2	-0.1415	619.	30.5	0.649
190.0	0.03258	-91.7	-0.1314	566.	28.8	0.660
200.0	0.03314	-85.0	-0.1212	515.	27.2	0.671
210.0	0.03375	-78.2	-0.1110	466.	25.6	0.683
220.0	0.03440	-71.3	-0.1008	419.	24.1	0.696
230.0	0.03512	-64.3	-0.0905	374.	22.5	0.710
240.0	0.03590	-57.1	-0.0801	331.	21.0	0.726
250.0	0.03677	-49.7	-0.0697	290.	19.6	0.743
260.0	0.03774	-42.2	-0.0592	251.	18.1	0.763
270.0	0.03885	-34.4	-0.0485	214.	16.7	0.785
280.0	0.04012	-26.4	-0.0376	179.	15.2	0.812
290.0	0.04162	-18.1	-0.0264	147.	13.8	0.845
300.0	0.04342	-9.4	-0.0150	117.5	12.4	0.887
310.0	0.04566	-0.3	-0.0030	91.1	11.0	0.940
320.0	0.04855	9.5	0.0096	68.7	9.56	1.009
330.0	0.05239	20.0	0.0230	51.2	8.20	1.091
340.0	0.05750	31.3	0.0372	39.7	6.94	1.163
350.0	0.06393	43.1	0.0519	34.5	5.85	1.183
360.0	0.07119	54.8	0.0663	34.2	4.99	1.139
370.0	0.07858	65.9	0.0797	37.0	4.34	1.064
380.0	0.08565	76.2	0.0920	41.3	3.85	0.992
390.0	0.09227	85.8	0.1034	46.4	3.47	0.932
400.0	0.09844	94.9	0.1140	51.7	3.17	0.886
420.0	0.10958	111.9	0.1336	62.6	2.72	0.824
440.0	0.11952	128.0	0.1517	73.0	2.41	0.788
460.0	0.12857	143.6	0.1688	83.0	2.18	0.766
480.0	0.13696	158.8	0.1851	92.3	1.99	0.754
500.0	0.14485	173.8	0.2009	101.2	1.85	0.747
520.0	0.15233	188.7	0.2163	109.7	1.72	0.744
540.0	0.15948	203.5	0.2313	117.8	1.62	0.743
560.0	0.16636	218.4	0.2461	126.	1.53	0.744
580.0	0.17300	233.3	0.2605	133.	1.45	0.747
600.0	0.17946	248.3	0.2748	140.	1.39	0.750

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

950 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02514	-221.6	-0.3758	2316.	76.6	0.491
-30.0	0.02535	-216.6	-0.3642	2225.	74.1	0.498
-20.0	0.02557	-211.6	-0.3527	2134.	71.7	0.504
-10.0	0.02579	-206.6	-0.3413	2043.	69.3	0.509
0.0	0.02601	-201.5	-0.3301	1952.	66.9	0.514
10.0	0.02625	-196.3	-0.3191	1863.	64.5	0.520
20.0	0.02649	-191.1	-0.3081	1775.	62.2	0.525
30.0	0.02674	-185.8	-0.2972	1688.	60.0	0.530
40.0	0.02700	-180.5	-0.2865	1603.	57.8	0.536
50.0	0.02727	-175.1	-0.2758	1520.	55.6	0.542
60.0	0.02754	-169.6	-0.2652	1439.	53.4	0.548
70.0	0.02783	-164.1	-0.2547	1360.	51.3	0.555
80.0	0.02813	-158.5	-0.2442	1283.	49.3	0.562
90.0	0.02844	-152.8	-0.2338	1208.	47.2	0.569
100.0	0.02876	-147.1	-0.2235	1136.	45.3	0.577
110.0	0.02909	-141.3	-0.2132	1065.	43.3	0.584
120.0	0.02945	-135.4	-0.2029	997.	41.4	0.592
130.0	0.02982	-129.4	-0.1927	932.	39.6	0.601
140.0	0.03020	-123.4	-0.1826	868.	37.7	0.609
150.0	0.03061	-117.2	-0.1724	806.	35.9	0.618
160.0	0.03104	-111.0	-0.1623	747.	34.2	0.627
170.0	0.03149	-104.6	-0.1521	690.	32.5	0.637
180.0	0.03198	-98.2	-0.1420	635.	30.8	0.647
190.0	0.03249	-91.7	-0.1319	582.	29.2	0.658
200.0	0.03304	-85.0	-0.1217	531.	27.6	0.669
210.0	0.03363	-78.3	-0.1116	482.	26.0	0.680
220.0	0.03426	-71.4	-0.1014	435.	24.5	0.693
230.0	0.03496	-64.4	-0.0912	390.	23.0	0.706
240.0	0.03571	-57.3	-0.0809	347.	21.5	0.721
250.0	0.03654	-50.0	-0.0705	306.	20.0	0.737
260.0	0.03747	-42.5	-0.0601	267.	18.6	0.755
270.0	0.03851	-34.8	-0.0495	231.	17.1	0.775
280.0	0.03969	-27.0	-0.0388	196.	15.7	0.799
290.0	0.04106	-18.8	-0.0279	164.	14.4	0.827
300.0	0.04268	-10.4	-0.0167	135.	13.0	0.860
310.0	0.04463	-1.5	-0.0052	108.0	11.6	0.902
320.0	0.04705	7.8	0.0068	84.8	10.3	0.953
330.0	0.05012	17.6	0.0194	65.7	9.01	1.013
340.0	0.05405	28.1	0.0326	51.6	7.78	1.074
350.0	0.05900	39.1	0.0462	42.9	6.68	1.115
360.0	0.06484	50.3	0.0600	39.3	5.75	1.114
370.0	0.07120	61.3	0.0733	39.4	5.00	1.074
380.0	0.07763	71.8	0.0859	42.0	4.41	1.018
390.0	0.08385	81.7	0.0976	45.9	3.96	0.963
400.0	0.08977	91.1	0.1086	50.5	3.59	0.916
420.0	0.10062	108.7	0.1288	60.6	3.06	0.848
440.0	0.11034	125.2	0.1474	70.8	2.68	0.806
460.0	0.11920	141.1	0.1648	80.7	2.41	0.780
480.0	0.12740	156.5	0.1814	90.1	2.19	0.765
500.0	0.13508	171.7	0.1974	99.1	2.02	0.756
520.0	0.14235	186.8	0.2130	107.7	1.88	0.751
540.0	0.14929	201.8	0.2281	116.0	1.76	0.749
560.0	0.15596	216.8	0.2430	124.	1.66	0.750
580.0	0.16239	231.8	0.2576	132.	1.58	0.751
600.0	0.16863	246.8	0.2719	139.	1.50	0.754

TABLE B2C (CONT.) THERMODYNAMIC PROPERTIES OF THE 0.1 MOLE FRACTION  
ISOPENTANE IN ISOBUTANE MIXTURE ON ISOBARS AT SUPERCRITICAL PRESSURES

1000 PSIA

T DEG F	V FT <sup>3</sup> /LB	H BTU/LB	S BTU/(LB-F)	DP/DD	DP/DT	CP BTU/(LB-F)
-40.0	0.02512	-221.4	-0.3760	2337.	77.1	0.491
-30.0	0.02533	-216.5	-0.3644	2245.	74.6	0.498
-20.0	0.02555	-211.5	-0.3529	2153.	72.1	0.504
-10.0	0.02577	-206.4	-0.3416	2062.	69.7	0.509
0.0	0.02600	-201.3	-0.3303	1971.	67.3	0.514
10.0	0.02623	-196.2	-0.3193	1881.	64.9	0.519
20.0	0.02647	-191.0	-0.3083	1793.	62.6	0.525
30.0	0.02672	-185.7	-0.2975	1706.	60.3	0.530
40.0	0.02698	-180.4	-0.2867	1620.	58.1	0.536
50.0	0.02724	-175.0	-0.2760	1537.	55.9	0.542
60.0	0.02752	-169.5	-0.2654	1456.	53.8	0.548
70.0	0.02780	-164.0	-0.2549	1376.	51.7	0.554
80.0	0.02810	-158.4	-0.2445	1299.	49.6	0.561
90.0	0.02840	-152.7	-0.2341	1225.	47.6	0.568
100.0	0.02872	-147.0	-0.2238	1152.	45.6	0.576
110.0	0.02906	-141.2	-0.2135	1082.	43.6	0.584
120.0	0.02940	-135.3	-0.2033	1013.	41.7	0.591
130.0	0.02977	-129.4	-0.1931	947.	39.9	0.600
140.0	0.03015	-123.3	-0.1829	884.	38.1	0.608
150.0	0.03055	-117.2	-0.1728	822.	36.3	0.617
160.0	0.03098	-110.9	-0.1627	763.	34.5	0.626
170.0	0.03142	-104.6	-0.1526	706.	32.8	0.636
180.0	0.03190	-98.2	-0.1425	651.	31.2	0.645
190.0	0.03240	-91.7	-0.1324	598.	29.5	0.656
200.0	0.03294	-85.1	-0.1223	547.	27.9	0.666
210.0	0.03351	-78.3	-0.1121	498.	26.4	0.677
220.0	0.03413	-71.5	-0.1020	451.	24.8	0.689
230.0	0.03480	-64.5	-0.0918	406.	23.3	0.702
240.0	0.03553	-57.4	-0.0816	364.	21.9	0.716
250.0	0.03633	-50.2	-0.0713	323.	20.4	0.731
260.0	0.03721	-42.8	-0.0610	284.	19.0	0.748
270.0	0.03820	-35.2	-0.0505	247.	17.6	0.766
280.0	0.03931	-27.4	-0.0399	213.	16.2	0.787
290.0	0.04058	-19.4	-0.0292	181.	14.9	0.811
300.0	0.04205	-11.2	-0.0182	151.	13.6	0.840
310.0	0.04379	-2.6	-0.0070	125.	12.3	0.874
320.0	0.04588	6.4	0.0045	100.8	11.0	0.914
330.0	0.04844	15.8	0.0165	80.6	9.73	0.960
340.0	0.05162	25.7	0.0289	64.7	8.54	1.009
350.0	0.05556	36.0	0.0418	53.4	7.44	1.051
360.0	0.06026	46.6	0.0548	46.8	6.48	1.070
370.0	0.06557	57.3	0.0678	44.3	5.66	1.059
380.0	0.07121	67.8	0.0803	44.7	5.00	1.025
390.0	0.07689	77.8	0.0922	47.1	4.47	0.981
400.0	0.08243	87.4	0.1034	50.7	4.05	0.938
420.0	0.09283	105.5	0.1242	59.6	3.42	0.869
440.0	0.10227	122.4	0.1432	69.3	2.98	0.823
460.0	0.11091	138.6	0.1609	78.9	2.65	0.794
480.0	0.11890	154.2	0.1778	88.3	2.41	0.776
500.0	0.12639	169.7	0.1940	97.4	2.21	0.765
520.0	0.13346	184.9	0.2098	106.0	2.05	0.759
540.0	0.14020	200.0	0.2251	114.4	1.92	0.756
560.0	0.14667	215.1	0.2400	122.	1.80	0.755
580.0	0.15290	230.2	0.2547	130.	1.70	0.756
600.0	0.15894	245.4	0.2691	138.	1.62	0.758



APPENDIX C  
 FORTRAN Programs for the Generation of  
 Thermodynamic Properties of the Mixture

```

C THIS IS A MAIN PROGRAM TO CALCULATE THE THERMODYNAMIC PROPERTIES OF AN
C ISOBUTANE-ISOPENTANE MIXTURE ON AN ISOBAR. THE USER IS QUERIED AS TO
C CHOICE OF UNITS AND THEN ASKED FOR X, P, INITIAL T, FINAL T AND INCREMENT
C OF T. THE OUTPUT WILL CONTAIN X, DENS, TEMPERATURE, PRESSURE, DP/DT,
C DP/DD, CV, CP, S, H AND U.
  IMPLICIT REAL*8(A-H,G-Z)
  COMMON /PROPS/ P,A,G,H,U,S,CV,CP,DPDD,DPDT,W
  COMMON /CRITC / PC4,PC5,DC4,DC5,TC4,TC5,PI4,PI5,DI4,DI5,TI4,TI5
  COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VX,TX
  COMMON /DERIVS/ DADT,CVR,DPDTR,D2P
  COMMON /QQQQ/ Q,ARES,QAB,Q10,Q20,Q11,QUB,QSB,CVB,DPDTB,DPDDB
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX,WMR
  CHARACTER*6 ND,NH
  COMMON /UNITS/ IX,IT,ID,IP,IH,NT,ND,NP,NH,FT,FD,FP,FH,IFLAG
  CHARACTER*1 IFLAG
  CALL SETUP
1  READ(5,*,END=9) XX,PIN,T1,T2,TI
  X=XX
  IF(IX.NE.1) X=XX/(XX+(1.-XX)*WMR)
  TT=T1-TI
  CALL FACTOR(X,1.DO,1.DO)
  FDD=FD
  IF(ID.NE.3) FDD=FD/WMX
  FHH=FH
  IF(ID.NE.3) FHH=FX*WMX
  PP = PIN*FP/PR/QX
  DDD = 3.
2  TT=TT+TI
  IF(TT.GT.T2) GO TO 1
  T=TTT(TT)/FX
  PSAT=PS(T)
  IF(DDD.GT.1. .AND. PP.LT.PSAT) DDD=PP/RSS/T
  CALL BB(T)
  CALL DFIND(D,PP,DDD,T,DQ)
  DDD=D
  CALL FACTOR(X,D,T)
  T=TTT(TT)/FX
  PP = PIN*FP/PR/QX
  CALL DFIND(D,PP,DDD,T,DQ)
  DDD=D
  CALL THERM(D,T,X)
  PPP = P/FP *PR
  DD = D*DR/FDD/HX
  DPDT = DPDT*FT/FP *PR/TR
  DPDD = DPDD*FDD/FP *PR/DR
  CV = CV*FT/FHH *SR
  CP = CP*FT/FHH *SR
  S = S*FT/FHH *SR
  H = H/FHH *AR
  U = U/FHH *AR
  A=A/FHH *AR
  G=G/FHH *AR
  WRITE(6,3) IFLAG,X,DD,TT,PPP,DPDT,DPDD,CV,CP,S,H,U
3  FORMAT(1X,A1,F5.2,F9.3,F8.2,F10.5,2F10.6,3F10.6,4F12.5)
  GO TO 2
9  STOP
  END

```



```

BLOCK DATA
C ALL COEFFICIENTS AND PARAMETERS OF THE HELMHOLTZ FUNCTION ARE
C CONTAINED HERE.
  IMPLICIT REAL*8(A-H,O-Z)
  REAL*4 TBT,A5BT,S5BT, CV5BT, TCT, G5CT, S5CT, CP5CT
  COMMON /RCONST/ TR, PR, DR, AR, SR, WR, R, RSS, WM4, WM5, WMX, WMR
  COMMON /NCONST/ G(25), AA, MM(25), NN(25), NC
  COMMON /BCONST/ B1(12), B2(12)
  COMMON /CRITC / PC4, PC5, DC4, DC5, TC4, TC5, P14, P15, D14, D15, T14, T15
  COMMON /IDEAL5/ TBT(16), A5BT(16), S5BT(16), CV5BT(16), TCT(16)
  1, G5CT(16), S5CT(16), CP5CT(16)
  COMMON /IDEAL4/ C4C(11)
  COMMON /CONVRT/ FFP(6), FFD(6), FFT(6), FFH(6)
  DATA PR, DR, TR/3.629D6, 3879.6D0, 407.84D0/
C THE CONVERSION FACTORS FOR DIFFERENT SYSTEMS OF UNITS ARE AS
C RECOMMENDED BY THE ASTM IN THEIR 'STANDARD FOR METRIC PRACTICE'
C (STANDARD E380-79).
  DATA FFP/1.D6, 1.D5, 1.01325D5, 6894.757D0, 2*1.D0/
  DATA FFD/1.D0, 2*1.D3, 16.01846D0, 2*0.D0/
  DATA FFH/2*1.D3, 4.184D3, 2.324444D3, 2*1.D0/
C THE ABOVE CONVERSION FACTORS FOR THE CAL AND BTU ARE THE
C 'THERMOCHEMICAL' CAL AND BTU.
  DATA T14, P14, D14/407.84D0, 3.629D6, 3879.6D0/
  DATA T15, P15, D15/460.51D0, 3.3707D6, 3247.3D0/
  DATA C4C/-5.0937093D-2, 2.5252496D0, 346.6523555D0, 2.551551D0
  1, -53.012165D0, 3.3434600D0, -.11945060D0, -38.124442D0
  2, 7.9688113D0, 27.849029D0, 58.1382356D0/
  *, WM4, WM5, R/58.1242D-3, 72.1512D-3, 8.31441D0/, AA/.38796166D0/
C THE VALUES USED FOR M4, M5 AND R ARE THOSE RECOMMENDED BY COHEN AND
C TAYLOR IN 'THE 1973 LEAST-SQUARES ADJUSTMENT OF THE FUNDAMENTAL
C CONSTANTS', JPCRD VOL 2 P 663 (1973).
C THE FOLLOWING TABLE OF THE IDEAL GAS PROPERTIES FOR ISOPENTANE ARE FROM
C SCOTT, BUR OF MINES BULLETIN 666 (1974).
  DATA TCT/.01, 2.E2, 273.15, 3.E2, 4.E2, 5.E2, 6.E2, 7.E2, 8.E2, 9.E2
  1, 1.E3, 1.1E3, 1.2E3, 1.3E3, 1.4E3, 1.5E3/
  DATA G5CT/0., -58.16, -62.98, -64.59, -70.20, -75.38, -80.3
  1, -85.0, -89.5, -93.9, -98.1, -102.2, -106.1, -109.9, -113.6, -117.1/
  DATA S5CT/0., 72.50, 79.72, 82.30, 91.63, 100.57, 109.1
  1, 117.3, 125.0, 132.4, 139.4, 146.1, 152.4, 158.5
  2, 164.3, 169.8/, CP5CT/0., 20.30, 26.38, 28.56, 36.54
  3, 43.80, 50.2, 55.7, 60.5, 64.7, 68.4, 71.6, 74.4, 77., 79., 81./
  DATA G/ -.96153074D1, .27935713D2, -.12569635D3, .54406550D3
  *, -.47948565D3, .14134133D3, -.12372626D2, -.34731447D2
  *, -.57569010D3, .53210066D3, .41502454D3, -.42359614D3
  *, .58118955D2, -.50009149D2, .23153999D3, -.38080769D3
  *, .26120687D3, -.22934154D2, -.14503027D2, -.10167777D2
  *, .30142576D2, -.33549797D2, .25502886D2, -.53441617D0
  *, .37213690D-1/, NC/25/
  DATA MM/1, 2, 4, 5, 6, 8, 1, 3, 5, 6, 7, 8, 1, 2, 4, 6, 8, 1, 6, 1, 2, 5, 8, 2, 8/
  DATA NN/2, 2, 2, 2, 2, 2, 3, 3, 3, 3, 3, 3, 4, 4, 4, 4, 4, 5, 5, 6, 6, 6, 6, 7, 7/
  DATA B1/.15388314D0, -.03916987D0, 3*0.D0, -2.5198404D-4, 3*0.D0
  *, 9.8801205D-7, 2*0.D0/, B2/3.0020353D0, 0.D0, -6.1529971D0, 0.D0
  *, -1.4570002D0, 0.D0, .13342155D0, 4*0.D0, -9.004371D-5/
END

```

```

SUBROUTINE SETUP
C THIS SUBROUTINE QUERIES THE USER FOR CHOICE OF UNITS AND SETS UP THE
C CONVERSION FACTORS, AND ALSO CALCULATES SOME DERIVED PARAMETERS.
  IMPLICIT REAL*8 (A-H,O-Z)
  COMMON /UNITS/ IX,IT,ID,IP,IH,NT,ND,NP,NH,FT,FD,FP,FH
  COMMON /CRITC / PC4,PC5,DC4,DC5,TC4,TC5,PI4,PI5,DI4,DI5,TI4,TI5
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX,WMR
  COMMON /CONVRT/ FFP(6),FFD(6),FFT(6),FFH(6)
  CHARACTER*6 NND(4),ND,NH
  DIMENSION NNT(4),NNP(4)
  DATA NNT/1HK,1HC,1HR,1HF/
  DATA NND/6HKG/M3 ,6HG/CM3 ,6HMOL/L ,6HLB/FT3/
  DATA NNP/3HMPA,3HBAR,3HATM,3HPSI/
  WRITE(6,12)
  READ(5,*) IT
  IF(IT-3) 102,105,105
102 WRITE(6,13)
  READ(5,*) ID
  WRITE(6,14)
  READ(5,*) IP
  WRITE(6,15)
  READ(5,*) IH
  GO TO 109
105 ID=4
  IP=4
  IH=4
109 NP=NNP(IP)
  FP=FFP(IP)
  NT=NNT(IT)
  ND=NND(ID)
  FD=FFD(ID)
  FH=FFH(IH)
  IX=1
  IF(ID.EQ.3) GO TO 110
  WRITE(6,16)
  READ(5,*) IX
110 WMR = WM5/WM4
  AR = PR/DR
  SR = AR/TR
  WR = (1.D3*AR)**(.5)
  RSS = R/SR
  CALL FZ5GEN
  PC4 = PI4/PR
  DC4 = DI4/DR
  TC4 = TI4/TR
  PC5 = PI5/PR
  DC5 = DC4 * TI4/TI5 *PI5/PI4
  TC5 = TI5/TR
  RETURN
11 FORMAT(' ENTER UNITS CHOSEN FOR ',2A6)
12 FORMAT(' CHOOSE FROM 1=DEG K, 2=DEG C, 3=DEG R, 4=DEG F')
13 FORMAT(' CHOOSE FROM 1=KG/M3, 2=G/CM3, 3=MOL/L, 4=LB/FT3')
14 FORMAT(' CHOOSE FROM 1=MPA, 2=BAR, 3=ATM, 4=PSIA')
15 FORMAT(' CHOOSE FROM 1=KJ/KG, 2=J/G, 3=CAL/G, 4=BTU/LB')
16 FORMAT(' CONCENTRATIONS IN: 1 MOLE FRAC, OR 2 WEIGHT FRAC?')
END

```

```

FUNCTION TTT(T)
C FUNCTION TO CONVERT INPUT TEMPERATURES IN EXTERNAL UNITS TO DEG K
  IMPLICIT REAL*8(A-H,O-Z)
  COMMON /RCONST/ TR, PR, DR, AR, SR, WR, R, RSS, WM4, WM5, WMX
  CHARACTER*6 ND, NH
  COMMON /UNITS/ IX, IT, ID, IP, IH, NT, ND, NP, NH, FT, FD, FP, FH
  GO TO (1,2,3,4), IT
1  TTT=T/TR
  FT=1.DO
  RETURN
2  TTT=T+273.15DO
  FT=1.DO
  TTT=TTT/TR
  RETURN
3  TTT=T/1.8DO
  FT=5.DO/9.DO
  TTT=TTT/TR
4  TTT=(T+459.67DO)/1.8DO
  FT=5.DO/9.DO
  TTT=TTT/TR
  RETURN
END

```

CC

```

FUNCTION TTI(T)
C FUNCTION TO CONVERT INTERNAL TEMPERATURES IN DEG K TO EXTERNAL UNITS
  IMPLICIT REAL*8(A-H,O-Z)
  COMMON /RCONST/ TR, PR, DR, AR, SR, WR, R, RSS, WM4, WM5, WMX
  CHARACTER*6 ND, NH
  COMMON /UNITS/ IX, IT, ID, IP, IH, NT, ND, NP, NH, FH
  GO TO (5,6,7,8), IT
5  TTI = T*TR
  RETURN
6  TTI = T*TR-273.15
  RETURN
7  TTI = T*TR*1.8DO
  RETURN
8  TTI = T*TR*1.8DO - 459.67
  RETURN
END

```

CC

```

SUBROUTINE BB(T)
  IMPLICIT REAL*8 (A-H,O-Z)
  COMMON /ELLCON/ BB1, BB2, BB1T, BB2T, BB1TT, BB2TT
  COMMON /BCONST/ P(12), Q(12), NVIR, NVOL
  DIMENSION V(12)
  V(1)=1.
1  DO 2 I=2, 12
2  V(I)=V(I-1)/T
  BB1=P(1)-P(2)*DLOG(V(2))
  BB2=Q(1)
  BB1T=P(2)
  BB2T=0.
  BB1TT=-P(2)
  BB2TT=0.
  DO 4 I=3, 12
  BB1=BB1+P(I)*V(I-1)
  BB2=BB2+Q(I)*V(I-1)
  BB1T=BB1T-(I-2)*P(I)*V(I-1)
  BB2T=BB2T-(I-2)*Q(I)*V(I-1)
  BB1TT=BB1TT+P(I)*(I-2)*(I-1)*V(I-1)
4  BB2TT=BB2TT+Q(I)*(I-2)*(I-1)*V(I-1)
  END

```

CC

FUNCTION PBASE(D,T)

C HERE THE CONTRIBUTIONS OF THE A1 AND A2 PARTS OF THE REFERENCE FUNCTION  
C ARE COMPUTED, ALONG WITH DERIVATIVES NEEDED IN OTHER FUNCTIONS.

IMPLICIT REAL\*8 (A-H,O-Z)

COMMON /QQQQ/ Q0,Q1,QAB,Q3,Q4,Q5,QUB,QSB,QCVB,DPDTB,DPDDB

COMMON/ELLCGN/ B1,B2,B1T,B2T,B1TT,B2TT

COMMON /RCONST/ TRR,PRR,DRR,ARR,SRR,WRR,R,RSS,WM4,WM5,WMX

Y=B1\*D

X=1.-Y

DPDDB = RSS\*T\*(9.\*Y\*Y/X\*\*4 + Y/X/X - 1./X)

QAB = D\*T\*B2 + RSS\*T\*(DLOG(D/X)+1.5/X/X-4.\*D\*B1)

PBASE = T\*B2 + RSS\*T/D\*(1./X+3.\*Y/X\*\*3-4.\*Y)

PBASE = PBASE\*D\*D

QSB = -QAB/T - D\*B2T - RSS\*D\*B1T\*(1./X+3./X\*\*3-4.)

QUB = QAB + T\*QSB

QCVB = -2.\*D\*B2T -D\*B2TT -RSS\*D\*((1./X+3./X\*\*3-4.)\*(2.\*B1T+B1TT)

1 +D\*(1./X/X+9./X\*\*4)\*B1T\*B1T)

DPDTB = PBASE/T + D\*D\*(B2T+RSS\*(1./X/X+3./X\*\*3+9.\*Y/X\*\*4-4.)\*B1T)

RETURN

END

CC

SUBROUTINE QQ(T,D)

C THIS SUBROUTINE COMPUTES THE CONTRIBUTIONS OF THE A4 PART OF THE  
C REFERENCE FUNCTION AND ITS DERIVATIVES.

IMPLICIT REAL\*8 (A-H,O-Z)

COMMON /QQQQ/ Q,ARES,Q02,Q10,Q20,Q11,Q7,Q8,Q9,Q010,DPDDB

COMMON /NCONST/ A(25),AA,II(25),JJ(25),N

COMMON /RCONST/ TRR,PRR,DRR,ARR,SRR,WRR,R,RSS,WM4,WM5,WMX

COMMON/DERIVS/ DADT,D2A,DPDT,D2P

DADT=0.

D2P=0.

D2A=0.

DPDT=0.

Q=0.DO

ARES=0.DO

Q11=0.DO

E=DEXP(-AA\*D)

Q10=D\*D\*E

Q20=1.DO-E

XX=DABS(AA\*D)

IF(XX.LT.1.D-5) Q20=AA\*D

DO 10 I=1,N

K=II(I)

L=JJ(I)

ZZ=K+1

FCT=AA\*ZZ\*Q10\*Q20\*\*K\*T\*\*(1-L)

DFCT=AA\*AA\*Q10\*T\*\*(1-L)\*ZZ\*Q20\*\*(K-1)\*(K-ZZ\*Q20)

DFDT=Q20\*\*(K+1)\*(1-L)\*T\*\*(-L)

D2F=L\*DFDT

DPT=DFDT\*Q10\*AA\*ZZ/Q20

D2PA=L\*DPT

DADT=DADT+A(I)\*DFDT

DPDT=DPDT+A(I)\*DPT

D2A=D2A+A(I)\*D2F

D2P=D2P+A(I)\*D2PA

B=A(I)\*FCT

Q11 = Q11 + A(I)\*DFCT

Q = Q + B

Y=Q20/AA/Q10/ZZ

ARES = ARES + B\*Y

10 CONTINUE

RETURN

END



```

CC
  SUBROUTINE FZ4(TT,AZ,SZ,CVZ)
C THIS IS THE AO FUNCTION FOR PURE ISOBUTANE AND ITS DERIVATIVES.
  IMPLICIT REAL*8 (A-H,O-Z)
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX,WMR
  COMMON /IDEAL4/ C(11)
  U=C(9)/TT
  Y=DEXP(U)
  SZ=C(8)*(U*Y/(Y-1.))-DLOG(Y-1.))-C(10)/TT-C(11)*(DLOG(TT)+1.)
  AZ=C(8)*TT*DLOG(Y-1.)+(C(10)+C(11)*TT)*DLOG(TT)
  CVZ = C(10)/TT-C(11)+C(8)*U*U*Y/(Y-1.))*2
  DO 8 I=1,7
  CVZ=CVZ-C(I)*(1-3)*(1-4)*TT**(1-4)
  AZ=AZ+C(I)*TT**(1-3)
  7 SZ=SZ-C(I)*TT**(1-4)*(1-3)
  8 CONTINUE
  RETURN
  END

C
  SUBROUTINE FZ5(TT,AZ,SZ,CVZ)
C THIS IS THE AO FUNCTION FOR PURE ISOPENTANE AND ITS DERIVATIVES.
  REAL*8 TT,AZ,SZ,CVZ
  COMMON /IDEAL5/ TBT(16),A5BT(16),S5BT(16),CV5BT(16),CALTAB(64)
  TK=TT
  IB=1
  DO 2 I=3,14
  IF(TT.LT.TBT(I)) GO TO 3
  2 IB=IB+1
  3 CALL INTRPL(TBT(IB),A5BT(IB),4,TK,AI)
  CALL INTRPL(TBT(IB),S5BT(IB),4,TK,SI)
  CALL INTRPL(TBT(IB),CV5BT(IB),4,TK,CVI)
  AZ = AI - 35.1874288D0 + TK*145.188298D0
  SZ = SI - 145.188298D0
  CVZ = CVI
  RETURN
  END

C
  SUBROUTINE FZ5GEN
C THIS SUBROUTINE CONVERTS THE ORIGINAL SCOTT TABLE OF ISOPENTANE
C IDEAL GAS FUNCTIONS TO DIMENSIONLESS UNITS.
  REAL*8 TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
  COMMON/IDEAL5/TB(16),AB(16),SB(16),CVB(16),T(16),G(16),S(16),C(16)
  Q = 4.184
  RC = R/Q
  DO 8 I=1,16
  AB(I) = (G(I)-RC*(1.-ALOG(T(I))))*T(I)*Q/AR
  SB(I) = (S(I)-RC*ALOG(T(I)))*Q/SR
  CVB(I) = (C(I)*Q-R)/SR
  8 TB(I) = T(I)/TR
  RETURN
  END

C
  SUBROUTINE IDEALF(TT,X)
C HERE THE AO FUNCTION FOR THE MIXTURE IS COMPUTED FROM THE FZ4 AND
C FZ5 VALUES OBTAINED EARLIER.
  IMPLICIT REAL*8(A-H,O-Z)
  COMMON /IDEAL/ AZ,SZ,CVZ
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
  COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
  COMMON /XDERIV/ AXX,PXX,FXX,HXX,QXX,VXX,TXX,AZXX
  T = TT*FX
  CALL FZ4(T,AZ4,SZ4,CVZ4)
  CALL FZ5(T,AZ5,SZ5,CVZ5)
  TERM = 0.
  IF(X.GT.0. .AND. X .LT. 1.) TERM = X*DLOG(X)+(1.-X)*DLOG(1.-X)
  IF(X.GT.0. .AND. X .LT. 1.) TERMX = 2.+DLOG(X)-DLOG(1.-X)
  AZ = (X*AZ5 + (1.-X)*AZ4) + RSS*T*TERM
  SZ = (X*SZ5 + (1.-X)*SZ4) - RSS*TERM
  CVZ = (X*CVZ5 + (1.-X)*CVZ4)
  AZXX = AZ5-AZ4 + RSS*T*TERMX
  RETURN
  END

```

```

C
  SUBROUTINE INTRPL(X,Y,K,XO,YO)
C LAGRANGIAN INTERPOLATION ROUTINE FOR USE WITH THE ISOPENTANE IDEAL
C GAS PROPERTY TABLES.
  DIMENSION X(100),Y(100),XLAG(30)
  YO=0.
  DO 1220 I=1,K
    XLAG(I)=1.0
  DO 1215 J=1,K
    IF(J-I) 1210,1215,1210
1210 XLAG(I)=XLAG(I)*(XO-X(J))/(X(I)-X(J))
1215 CONTINUE
1220 YO=YO+(XLAG(I)*Y(I))
  RETURN
  END

```

```

C
  SUBROUTINE CONFML(D,T)
C COMPUTE THE CONFIGURATIONAL PORTION OF THE REFERENCE FUNCTION AND
C ITS DERIVATIVES.
  IMPLICIT REAL*8(A-H,O-Z)
  COMMON /DERIVS/ DADT,CVR,DPDTR,D2P
  COMMON /QQQQ/ Q,ARES,QAB,Q10,Q20,Q11,QUB,QSB,CVB,DPDTB,DPDB
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
  COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
  COMMON /CONF/ PCF,ZCF,ACF,SCF,CVCF,DPDD,DPDT
  HL = -DLOG(HX)
  CALL QQ(T,D)
  PCF = PBASE(D,T)+Q
  ZCF = PCF/D/T/RSS
  ACF = (QAB+ARES)/T/RSS + HL
  SCF = (QSB-DADT)/RSS - HL
  CVCF = (CVB+CVR)/RSS
  DPDD = (DPDB+Q11)/T/RSS + ZCF
  DPDT = (DPDTB+DPDTR)/D/RSS - ZCF
  RETURN
  END

```

```

C
  SUBROUTINE FACTOR(X,D,T)
C THE SHAPE FACTORS AND THE FX, HX AND QX ARE COMPUTED HERE.
  IMPLICIT REAL*8(A-H,O-Z)
  CALL MIXRUL(X)
  CALL SHAPE(X,D,T)
  RETURN
  END

```

```

C
  SUBROUTINE SHAPE(X,D,T)
  IMPLICIT REAL*8(A-H,O-Z)
  COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
  COMMON /CRITC / PC4,PC5,DC4,DC5,TC4,TC5,P14,P15,D14,D15,T14,T15
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
  COMMON /XDERIV/ AXX,PXX,FXX,HXX,QXX,VXX,TXX,AZXX
  WMX = (1.-X)*WM4 + X*WM5
  CALL THPHI(D,T)
  FX = TCX/TC4 *(1.+X*(TH-1.))
  HX = VCX*DC4 *(1.+X*(PH-1.))
  QX = FX/HX
  FXX = TXX/TC4 *(1.+X*(TH-1.))
  HXX = VXX*DC4 *(1.+X*(PH-1.))
  QXX = FXX/HX - FX*HXX/HX/HX
  RETURN
  END

```

```

C
SUBROUTINE MIXRUL(X)
IMPLICIT REAL*8 (A-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
COMMON /CRITC / PC4,PC5,DC4,DC5,TC4,TC5,P14,P15,D14,D15,T14,T15
COMMON /XDERIV/ AXX,PXX,FXX,HXX,QXX,VXX,TXX,AZXX
CALL COMRUL
VCX = (1.-X)**2/DC4 + 2.*X*(1.-X)*V45 + X*X/DC5
TCX = (1.-X)**2*TC4 + 2.*X*(1.-X)*T45 + X*X*TC5
VXX=2.*(X-1.)/DC4+(1.-2.*X)*V45+X/DC5)
TXX=2.*(X-1.)*TC4+(1.-2.*X)*T45+X*TC5)
RETURN
END

```

```

C
SUBROUTINE COMRUL
IMPLICIT REAL*8 (A-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
COMMON /CRITC / PC4,PC5,DC4,DC5,TC4,TC5,P14,P15,D14,D15,T14,T15
CALL CLPARM
T45 = FFT*(TC4*TC5)**(.5)
V45 = FFV*(.5*DC4**(-.3333) + .5*DC5**(-.3333))**3
RETURN
END

```

```

C
SUBROUTINE CLPARM
IMPLICIT REAL*8 (A-H,O-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
FFT = 1.002
FFV = .995
RETURN
END

```

```

C
SUBROUTINE THPHI(D,T)
IMPLICIT REAL*8 (A-H,O-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
TT=T-1.
DD=D-1.
TH = 1. + .0065*DD - .015*TT
PH = 1. - .065*TT - .021*DD
RETURN
END

```

```

C
SUBROUTINE THERM(D,T,X)

```

```

C ALL FUNCTIONS FOR THE MIXTURE ASSEMBLED HERE.

```

```

IMPLICIT REAL*8(A-H,O-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
COMMON /UNITS/ IX,IT,ID,IP,IH,NT,ND,NP,NH,FT,FD,FP,FH,IFLAG
COMMON /IDEAL / AZ,SZ,CVZ
COMMON /CONF / PCF,ZCF,ACF,SCF,CVCF,DPDDCF,DPDTCF
COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
COMMON /PROPS / P,A,G,H,U,S,CV,CP,DPDD,DPDT,W
COMMON /XDERIV/ AXX,PXX,FXX,HXX,QXX,VXX,TXX,AZXX
CHARACTER*6 ND,NH
CHARACTER*1 IFLAG,IFB,IFA
DATA IFB,IFA/1H,1H*/
IFLAG=IFB
IF(D.GT..7D0 .AND. D.LT.1.3D0 .AND. T.GT..99D0 .AND. T.LT.1.02D0)

```

```

1 IFLAG=IFA
CALL IDEALF(T,X)
CALL CONFML(D,T)
P = PCF * QX
A = AZ + RSS*T*FX*ACF
G = A + P/D *HX
S = SZ + RSS*SCF
U = A + T*S*FX
H = G + T*S*FX

```

```

CV = CVZ + RSS*CVCF
DPDT = (DPDTCF+ZCF)*D*RSS/HX
DPDD = (DPDDCF+ZCF)*T*RSS*FX
CP = CV + FX*HX*HX*T*DPDT**2/DPDD/D/D
C PXX = PCF*QXX + DPDD*D*QX*HXX/HX - DPDT*T*QX*FXX/FX
S1=PCF*QXX
S2=D*DPDD*QX*HXX/HX
S3=T*DPDT*QX*FXX/FX
PXX = S1+S2-S3
RETURN
END

C
SUBROUTINE MU(XMU1,XMU2,D2ADX2,D,T,X)
C CALCULATION OF THE CHEMICAL POTENTIALS
IMPLICIT REAL*8(A-H,O-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
COMMON /UNITS/ IX,IT,ID,IP,IH,NT,ND,NP,NH,FT,FD,FP,FH
COMMON /IDEAL / AZ,SZ,CVZ
COMMON /CONF / PCF,ZCF,ACF,SCF,CVCF,DPDDCF,DPDTCF
COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
COMMON /PROPS / P,A,G,H,U,S,CV,CP,DPDD,DPDT,W
COMMON /INX/ DELX
CALL FACTOR(X,D,T)
HXO=HX
FXO=FX
QXO=QX
CALL BB(T)
CALL XTHERM(D,T,X)
AO=A
GO=G
PO = P
DELX=5.D-4
IF(X.GT..9995D0) DELX=1.D0-X
IF(X.LT.5.D-4) DELX=X
X1=X+DELX
IF(X.EQ.0.) X1=1.D-6
CALL FACTOR(X1,D,T)
D1=D*HX/HXO
T1=T*FXO/FX
CALL BB(T1)
CALL XTHERM(D1,T1,X1)
P1=P
A1 = A
X2=X-DELX
IF(X.EQ.1.) X2=.999999D0
CALL FACTOR(X2,D,T)
D2=D*HX/HXO
T2=T*FXO/FX
CALL BB(T2)
CALL XTHERM(D2,T2,X2)
P2=P
A2 = A
IF(DELX.EQ.0.D0) DELX=5.D-7
DADX = (A1-A2)/(X1-X2)
D2ADX2 = ((A1-AO)/(X1-X) - (AO-A2)/(X-X2))*2./(X1-X2)
XMU1 = GO - X*DADX
XMU2 = GO + (1.-X)*DADX
RETURN
END

```



```

FUNCTION XBASE(D,T)
C THE SUBROUTINES WITH NAMES BEGINNING WITH X ARE THE SAME AS THE
C PREVIOUS ONES OF THE SAME NAME WITHOUT THE X, BUT FOR INCREASED
C SPEED OF CALCULATION ONLY P, A, G AND DP/DD ARE CALCULATED.
  IMPLICIT REAL*8 (A-H,O-Z)
  COMMON /QQQQ/ Q0,Q1,QAB,Q3,Q4,Q5,QUB,QSB,QCVB,DPDTB,DPDDB
  COMMON/ELLCON/ B1,B2,B1T,B2T,B1TT,B2TT
  COMMON /RCONST/ TRR,PRR,DRR,ARR,SRR,WRR,R,RSS,WM4,WM5,WMX
  Y=B1*D
  X=1.-Y
  DPDDB = RSS*T*(9.*Y*Y/X**4 + Y/X/X - 1./X)
  QAB = D*T*B2 + RSS*T*(DLOG(D/X)+1.5/X/X-4.*D*B1)
  XBASE = D*D*(T*B2 + RSS*T/D*(1./X+3.*Y/X**3-4.*Y))
  RETURN
END

```

```

CC
SUBROUTINE XQQ(T,D)
  IMPLICIT REAL*8 (A-H,O-Z)
  COMMON /QQQQ/ Q,ARES,Q02,Q10,Q20,Q11,Q7,Q8,Q9,Q010,DPDDB
  COMMON/DERIVS/ DADT,D2A,DPDT,D2P
  COMMON /NCONST/ A(25),AA,II(25),JJ(25),N
  COMMON /RCONST/ TRR,PRR,DRR,ARR,SRR,WRR,R,RSS,WM4,WM5,WMX
  Q=0.00
  ARES=0.00
  Q11=0.00
  DPDT=0.
  E=DEXP(-AA*D)
  Q10=D*D*E
  Q20=1.00-E
  XX=DABS(AA*D)
  IF(XX.LT.1.D-5) Q20=AA*D
  DO 10 I=1,N
  K=II(I)
  L=JJ(I)
  ZZ=K+1
  FCT=AA*ZZ*Q10*Q20**K*T**(1-L)
  DFCT=AA*AA*Q10*T**(1-L)*ZZ*Q20**(K-1)*(K-ZZ*Q20)
  B=A(I)*FCT
  Q11 = Q11 + A(I)*DFCT
  Q = Q + B
  Y=Q20/AA/Q10/ZZ
  ARES = ARES + B*Y
10 CONTINUE
  RETURN
END

```

```

CC
SUBROUTINE XCONF(D,T)
  IMPLICIT REAL*8(A-H,O-Z)
  COMMON /DERIVS/ DADT,CVR,DPDTR,D2P
  COMMON /QQQQ/ Q,ARES,QAB,Q10,Q20,Q11,QUB,QSB,CVB,DPDTB,DPOB
  COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
  COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
  COMMON /CONF/ PCF,ZCF,ACF,SCF,CVCF,DPDD,DPDT
  HL = -DLOG(HX)
  CALL XQQ(T,D)
  PCF = XBASE(D,T)+Q
  ZCF = PCF/D/T/RSS
  ACF = (QAB+ARES)/T/RSS + HL
  DPDD = (DPOB+Q11)/T/RSS + ZCF
  DPDT = (DPDTB+DPDTR)/D/RSS - ZCF
  RETURN
END

```

```

SUBROUTINE XTHERM(D,T,X)
IMPLICIT REAL*8(A-H,O-Z)
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
COMMON /UNITS/ IX,IT,ID,IP,IH,NT,ND,NP,NH,FT,FD,FP,FH,IFLAG
COMMON /IDEAL / AZ,SZ,CVZ
COMMON /CONF / PCF,ZCF,ACF,SCF,CVCF,DPDDCF,DPDTCF
COMMON /RCONST/ TR,PR,DR,AR,SR,WR,R,RSS,WM4,WM5,WMX
COMMON /PROPS / P,A,G,H,U,S,CV,CP,DPDD,DPDT,W
CHARACTER*6 ND,NH
CHARACTER*1 IFLAG,IFB,IFA
DATA IFB,IFA/1H ,1H*/
IFLAG=IFB
IF(D.GT..7D0 .AND. D.LT.1.3D0 .AND. T.GT..99D0 .AND. T.LT.1.02D0)
1 IFLAG=IFA
CALL IDEALF(T,X)
CALL XCONF(D,T)
P = PCF*QX
A = AZ + RSS*T*FX*ACF
G = A + P/D *HX
DPDD = (DPDDCF+ZCF)*T*RSS*FX
DPDT = (DPDTCF+ZCF)*D*RSS/HX
RETURN
END

```

C  
C AN INITIAL GUESS FOR THE XL AND XV IS CALCULATED HERE AS THE STARTING  
C POINT IN SOLVING THE EQUATIONS FOR COEXISTING PHASES.

```

IMPLICIT REAL*8 (A-H,O-Z)
COMMON /CRITC / PC4,PC5,DC4,DC5,TC4,TC5,PI4,PI5,DI4,DI5,TI4,TI5
COMMON /MIXFAC/ FX,HX,QX,TH,PH,FFT,FFV,V45,T45,VCX,TCX
P4S=PS(T)
TX=T*TI4/TI5
P5S=PS(TX)*PI5/PI4
IF(P4S.EQ.0.D0) GO TO 10
X=(P-P4S)/(P5S-P4S)
Y=1.-(1.-X)*P4S/P
RETURN

```

```

10 IF(P5S.EQ.0.D0) GO TO 20
XS=(T-TC4)/(TC5-TC4)
CALL FACTOR(XS,1.D0,1.D0)
PXS = QX
X = XS + (1.-XS)*(P-PXS)/(P5S-PXS)
Y = 1.-(1.-X)*(1.-XS)*PXS/P
IF(X.LT..001) X=.001
IF(X.GT..999) X=.999
IF(Y.GT.X) Y=.9*X
IF (Y.LT..001) Y=.001
RETURN

```

```

20 X=-1.
Y=-1.
RETURN
END

```

C  
C THIS IS AN EQUATION APPROXIMATING THE ISOBUTANE VAPOR PRESSURE CURVE.  
IMPLICIT DOUBLE PRECISION (A-H,O-Z)

```

PS=0.
IF(T.GE.1.) RETURN

```

```

100 Y=1.-T
A1=-6.83796
A2=1.25220
A5=-2.3406
XN2=1.5
X=(A1*Y+A2*Y**XN2+A5*Y**3)/T
PS=DEXP(X)
END

```

```

SUBROUTINE DFIND(DOUT,P,D,T,DPD)
C THIS SUBROUTINE COMPUTES ITERATIVELY THE DENSITY AS A FUNCTION OF
C TEMPERATURE AND PRESSURE. AN INITIAL GUESS FOR THE DENSITY IS REQUIRED.
  IMPLICIT REAL*8 (A-H,O-Z)
  COMMON /QQQQ/ Q0,Q1,Q2,Q10,Q20,Q11,Q7,Q8,Q9,Q010,DPDDB
  TOL=1.0D-06
  DD=D
  L=0
  9 L=L+1
  IF(DD.LE.0.) DD=1.D-6
  IF(DD.GT.3.6) DD=3.6
  CALL BB(T)
  CALL XQQ(T,DD)
  PP=XBASE(DD,T)+Q0
  DPD = 2.*PP/DD + DPDDB + Q11
  DPDX=DPD
  10 X1=D
  XX=DD
  IF(DPDX.GT.1.D1) TOL=1.0D-5
  IF(DPDX.GT.1.D2) TOL=1.0D-4
  IF(DPDX.GT.1.D3) TOL=1.0D-3
  IF(DABS(1.-PP/P).LT.TOL) GO TO 20
  X2=(P-PP)/DPDX
  15 DD=DD+X
  IF(DD.LE.0.) DD=1.D-8
  IF(L.LE.40) GO TO 9
  DD=DD-X
  X2=X2/DD
  WRITE(6,1000)P,PP,X1,XX,T,X2,DPD
  20 CONTINUE
  DOUT=DD
  1000 FORMAT(' 40 ITERATIONS IN DFIND PIN PCALC DIN DCALC T FRAC
1DPD',4D13.6/3D13.6)
  RETURN
  END

```






U.S. DEPT. OF COMM. <b>BIBLIOGRAPHIC DATA SHEET</b> <i>(See instructions)</i>	1. PUBLICATION OR REPORT NO. NBSIR 84-2971	2. Performing Organ. Report No.	3. Publication Date November 1984
4. TITLE AND SUBTITLE  "Thermodynamic Properties of Isobutane-Isopentane Mixtures from 240 to 600 K and up to 20 MPa (with Supplemental Tables from -40 to +600°F and up to 1000 psia)"			
5. AUTHOR(S)  J.S. Gallagher, J.M.H. Levelt Sengers, G. Morrision and J.V. Sengers			
6. PERFORMING ORGANIZATION <i>(If joint or other than NBS, see instructions)</i>  NATIONAL BUREAU OF STANDARDS DEPARTMENT OF COMMERCE WASHINGTON, D.C. 20234		7. Contract/Grant No.  8. Type of Report & Period Covered	
9. SPONSORING ORGANIZATION NAME AND COMPLETE ADDRESS <i>(Street, City, State, ZIP)</i>			
10. SUPPLEMENTARY NOTES  <input type="checkbox"/> Document describes a computer program; SF-185, FIPS Software Summary, is attached.			
11. ABSTRACT <i>(A 200-word or less factual summary of most significant information. If document includes a significant bibliography or literature survey, mention it here)</i>  The Helmholtz function for pure isobutane from a recent correlation has been converted to a dimensionless form and a pressure-enthalpy chart based on this function has been generated by computer. A Helmholtz function for mixtures of isobutane and isopentane has been formed based upon the dimensionless isobutane Helmholtz function as the reference fluid by means of an extended corresponding-states principle. Scarce literature data for saturation properties of isopentane, and new data for its vapor pressure and for the critical line of the mixture were used. The accuracy of the surface was checked by comparing with literature enthalpy data and with new VLE data for the mixture. Tables of thermodynamic properties have been generated from this Helmholtz function for the 0.1 mole fraction isopentane-in-isobutane mixture in the single-phase region and on the dew- and bubble-point curves, together with properties of the coexisting phase. A pressure-enthalpy chart for this mixture has also been generated.			
12. KEY WORDS <i>(Six to twelve entries; alphabetical order; capitalize only proper names; and separate key words by semicolons)</i> critical line, corresponding states, generalized, isobutane, isopentane, mixtures, phase boundary, P-H chart, thermodynamic tables, VLE data			
13. AVAILABILITY <input checked="" type="checkbox"/> Unlimited <input type="checkbox"/> For Official Distribution. Do Not Release to NTIS <input type="checkbox"/> Order From Superintendent of Documents, U.S. Government Printing Office, Washington, D.C. 20402. <input checked="" type="checkbox"/> Order From National Technical Information Service (NTIS), Springfield, VA. 22161		14. NO. OF PRINTED PAGES 182  15. Price  \$17.50	



# THERMODYNAMIC PROPERTIES OF ISOBUTANE

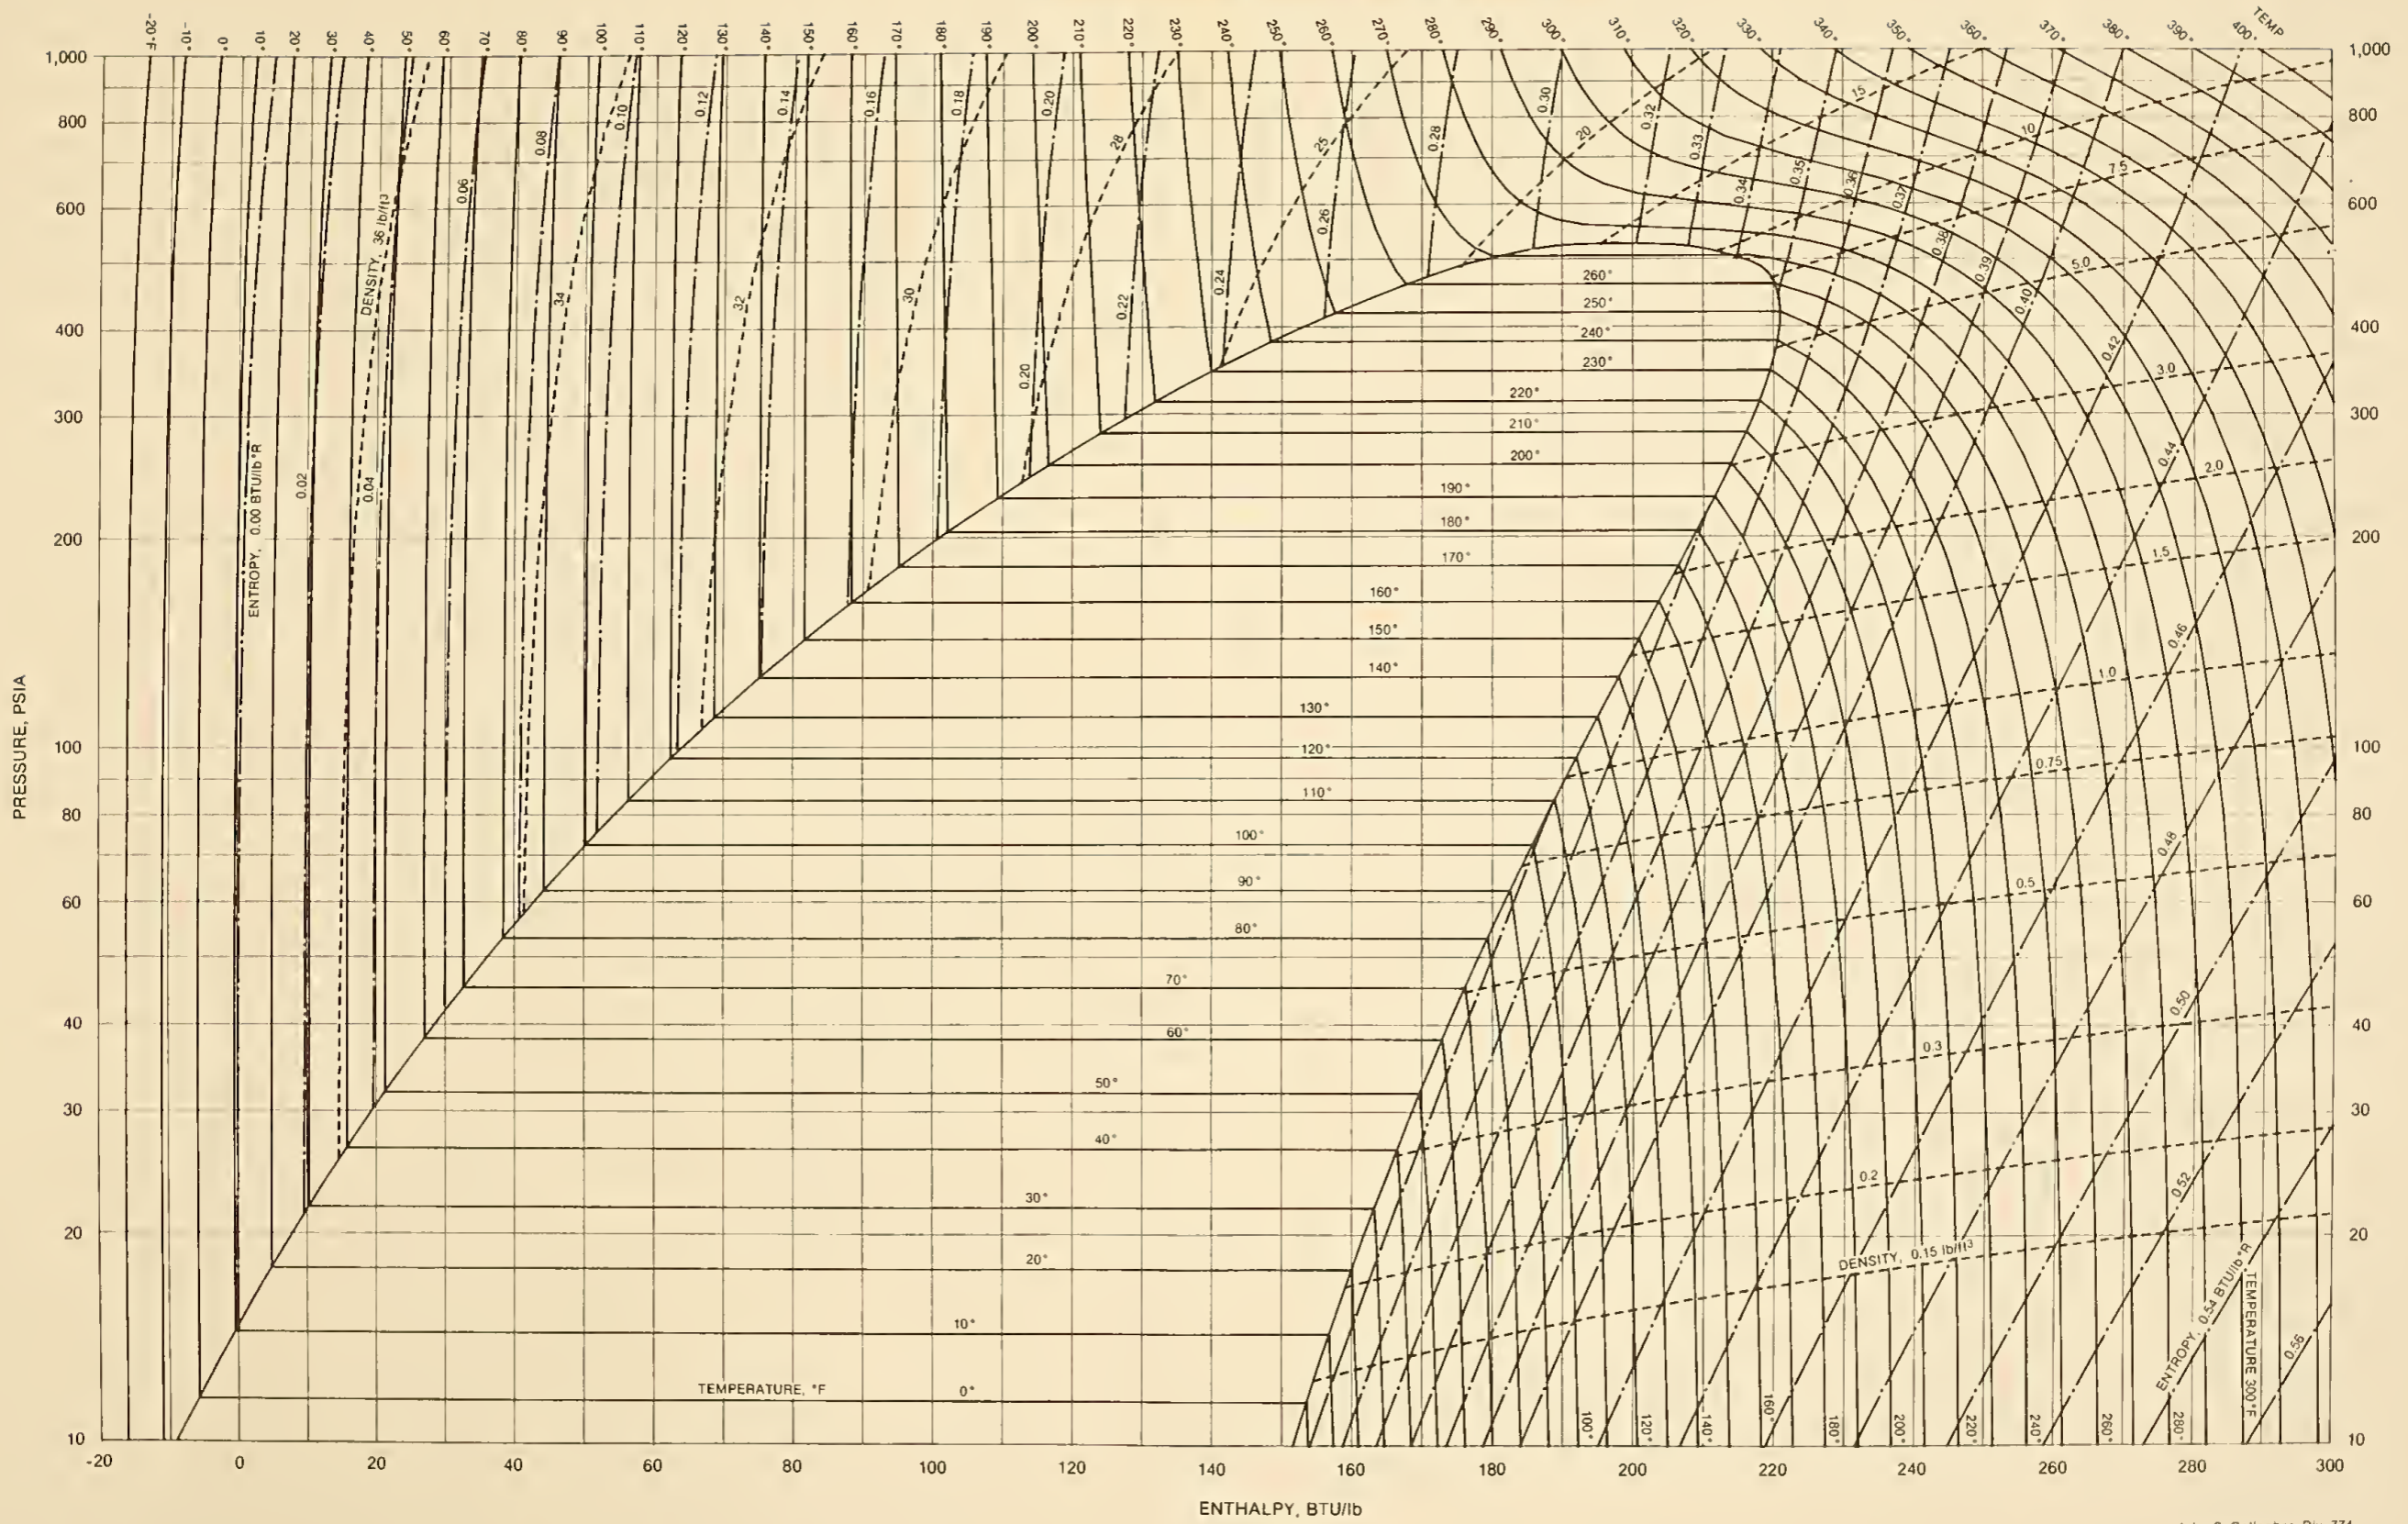







# THERMODYNAMIC PROPERTIES OF 90% ISOBUTANE — 10% ISOPENTANE MIXTURE

