

NATIONAL BUREAU OF STANDARDS REPORT

3730

PERFORMANCE TESTS OF AN AAF CO.
MULTI-DUTY SELF-CLEANING AIR FILTER

by

Henry E. Robinson
Thomas W. Watson

Report to
General Services Administration
Public Buildings Service
Washington 25, D.C.



U. S. DEPARTMENT OF COMMERCE
NATIONAL BUREAU OF STANDARDS

U. S. DEPARTMENT OF COMMERCE

Sinclair Weeks, *Secretary*

NATIONAL BUREAU OF STANDARDS

A. V. Astin, *Director*



THE NATIONAL BUREAU OF STANDARDS

The scope of activities of the National Bureau of Standards is suggested in the following listing of the divisions and sections engaged in technical work. In general, each section is engaged in specialized research, development, and engineering in the field indicated by its title. A brief description of the activities, and of the resultant reports and publications, appears on the inside of the back cover of this report.

Electricity. Resistance and Reactance Measurements. Electrical Instruments. Magnetic Measurements. Electrochemistry.

Optics and Metrology. Photometry and Colorimetry. Optical Instruments. Photographic Technology. Length. Engineering Metrology.

Heat and Power. Temperature Measurements. Thermodynamics. Cryogenic Physics. Engines and Lubrication. Engine Fuels. Cryogenic Engineering.

Atomic and Radiation Physics. Spectroscopy. Radiometry. Mass Spectrometry. Solid State Physics. Electron Physics. Atomic Physics. Neutron Measurements. Infrared Spectroscopy. Nuclear Physics. Radioactivity. X-Ray. Betatron. Nucleonic Instrumentation. Radiological Equipment. Atomic Energy Commission Radiation Instruments Branch.

Chemistry. Organic Coatings. Surface Chemistry. Organic Chemistry. Analytical Chemistry. Inorganic Chemistry. Electrodeposition. Gas Chemistry. Physical Chemistry. Thermochemistry. Spectrochemistry. Pure Substances.

Mechanics. Sound. Mechanical Instruments. Fluid Mechanics. Engineering Mechanics. Mass and Scale. Capacity, Density, and Fluid Meters. Combustion Control.

Organic and Fibrous Materials. Rubber. Textiles. Paper. Leather. Testing and Specifications. Polymer Structure. Organic Plastics. Dental Research.

Metallurgy. Thermal Metallurgy. Chemical Metallurgy. Mechanical Metallurgy. Corrosion.

Mineral Products. Porcelain and Pottery. Glass. Refractories. Enameled Metals. Concreting Materials. Constitution and Microstructure.

Building Technology. Structural Engineering. Fire Protection. Heating and Air Conditioning. Floor, Roof, and Wall Coverings. Codes and Specifications.

Applied Mathematics. Numerical Analysis. Computation. Statistical Engineering.

Electronics. Engineering Electronics. Electron Tubes. Electronic Computers. Electronic Instrumentation. Process Technology.

Radio Propagation. Upper Atmosphere Research. Ionospheric Research. Regular Propagation Services. Frequency Utilization Research. Tropospheric Propagation Research. High Frequency Standards. Microwave Standards.

●Office of Basic Instrumentation

●Office of Weights and Measures.

PERFORMANCE TESTS OF AN AAF CO.
MODEL B SELF-CLEANING AUTOMATIC AIR FILTER

1. INTRODUCTION

At the request of the Public Buildings Service, General Services Administration, the performance characteristics of self-cleaning automatic oil-type air filters were determined to provide information to assist in the preparation of new air filter specifications.

The test results presented herein were obtained on a specimen automatic oil-type air filter submitted by its manufacturer at the request of the Public Buildings Service and included determinations of dust arresting efficiency with two aerosols (atmospheric air and Cottrell precipitate), pressure drop, dirt load and cleanability of the specimen.

2. DESCRIPTION OF THE FILTER SPECIMEN

The filter was manufactured by the American Air Filter Co., Inc., Louisville 8, Kentucky, and was of the self-cleaning automatic oil-type. It was identified by nameplate as an AAF Multi-Duty Self-Cleaning Air Filter Model B, size 30 x 54", Capacity 1980 cfm. The drive motor current characteristics were as follows: 110 volts; 3.4 amps; 60 cyc; 1 ph.

The test unit had a housing with actual outside dimensions of 31 inches in width, 54 inches in height and 15 inches in length. The exposed face of the curtain media on the upstream side was 26-3/4 inches wide by 21-5/16 inches high (3.96 sq. ft. face area). The unit was rated at 1980 cfm air delivery at 500 fpm face velocity. Special upstream and downstream transitions, 11-1/8 inches and 6-1/2 inches in length, respectively, with flanges 30 inches square matching those of the duct of the test apparatus, were used to adapt the unit for test. The openings formed by these transitions at the flanges were 24 inches square both upstream and downstream. The downstream curtain face had an exposed transverse area 26-3/4 inches wide and 25-3/4 inches high (4.78 sq. ft.)

The filter consisted of Type MS' panel sections 29-1/4 inches in width and about 8-1/2 inches in height, overlapped about 2 inches and attached to two endless chains approximately 78 inches in length, forming an endless curtain that rotated over sprockets on horizontal shafts located in the top and reservoir assemblies. The curtain rotated upward on the upstream face and downward on the downstream face, and in passing around the lower sprocket dipped into a reservoir of oil for cleaning and re-oiling the media.

The endless curtain was shifted intermittently by a timer-controlled motor and gear box. The synchronous electric timer was set by the factory to actuate the drive motor for a period of 12 seconds every 12 minutes, resulting in a curtain movement of approximately 4 inches per hour. For the dirt-loading tests the timer was re-adjusted for a curtain movement of 2-1/2 inches per shift, or 12-1/2 inches per hour.

The manufacturer furnished an adhesive designated as "Viscosine SH". Approximately 22 gallons were required to fill the reservoir to the indicated level.

3. TEST METHOD AND PROCEDURE

Efficiency determinations were made by the NBS "Dust-Spot Method" using the following aerosols: (a) outdoor atmospheric air drawn through the laboratory without addition of other dust or contaminant; and (b) Cottrell precipitate, dispersed in the outdoor atmospheric air. The test method is described in the paper "A Test Method for Air Filters" by R. S. Dill (ASHVE Transactions, Vol. 44, P. 379, 1938). The test duct and arrangement are shown in Figure 1. A baffle made of two 3-inch wide slats at right angles to each other was located in the duct about 3-1/2 ft. downstream of the test assembly to intermix the air discharged from it.

For these tests, the unit was installed in the test duct and its exterior housing was carefully sealed to prevent inleakage of air. The desired rate of air flow through the air cleaner was established and samples of air were drawn from the center of the test duct, at points one foot upstream and eight feet downstream of the air cleaner assembly, at equal rates for equal times, and passed through known areas of Whatman No. 41 filter paper. The filter papers used in the upstream and downstream positions were selected to have the same light transmission readings when clean, as determined by means of a photometer using transmitted light. Using filter paper sampling areas downstream equal to 30 percent of the filter paper area upstream, an efficiency of 70 percent would be indicated if the upstream and downstream dust-spots on the papers had the same opacity, as indicated by the change in the light transmissions of the dust-spot areas before and after the sample was drawn. If the opacities of the dust-spots differed, the efficiency was calculated by means of the formula

$$\text{Efficiency, percent} = 100 \left[1 - \frac{A_2}{A_1} \cdot \frac{O_2}{O_1} \right]$$

where A_1 and A_2 were the areas of the dust-spots upstream and downstream, respectively, and O_1 and O_2 were the opacities of the dust-spots upstream and downstream respectively.

In testing the unit, it was desirable to subject it to a dirt-loading condition that would simulate a service condition and that would allow the results to be applicable for a wide range of unit sizes.

In service, a unit having an upstream exposed curtain height of H ft, and receiving air containing a dust concentration of C grams per 1000 cf, at face velocity V , shifts its curtain periodically or uniformly at an average rate of S inches per hour. Under these conditions, the curtain, when it leaves the air stream entering the front face of the unit, will have received a "burden" of

$$\frac{12H \times 60V \times C}{S \times 1000} \quad \text{or} \quad \frac{0.72 \text{ HVC}}{S} \quad \text{grams of dust}$$

per square foot. The average pressure drop of a unit and to some extent its efficiency, regardless of its size provided the face velocity is the same, depend on the average dirtiness of its curtain, and therefore on the magnitude of the "burden" as defined above. On this basis, a test of a small-sized unit can be expected to be reasonably representative for a much larger unit, if the "burdens" are the same.

To evaluate a burden reasonably representative of what might be experienced in actual service, the following in-service conditions were assumed: $H = 7$ ft; $S = 7$ inches/hour; $C = 0.065$ grams per 1000 cf (1 grain per 1000 cf); $V = 500$ fpm. Using these values, a representative service burden was computed to be

$$B = \frac{0.72 \times 7 \times 500 \times 0.65}{7} = 23.4 \text{ grams/sq.ft.}$$

In selecting conditions for the test it was desirable to increase the curtain shifting speed S to 12.5 inches/hr, to shorten the time required for several revolutions of the curtain. Assuming that the test should be conducted with a burden $B = 23.4$ grams/sq.ft., and that for the unit tested the height of exposed face = 1.78 ft.; width = 2.23 ft.; curtain shifting speed $S = 12.5$ inches/hour; and velocity $V = 500$ fpm: then

$$23.4 = \frac{0.72 \text{ HVC}}{S}$$

$$\text{or} \quad C = \frac{23.4 \times 12.5}{0.72 \times 1.78 \times 500} = 0.456 \text{ gram per 1000 cf.}$$

The air flow capacity of the unit was $1.78 \times 2.23 \times 500 = 1980$ cfm, and the rate of dust feed to the unit should therefore be 0.90 gram per minute. Actually, 0.95 gram per minute was fed to compensate for a slight settlement of dust in the upstream duct of the test apparatus.

The following procedure was employed in these tests. The clean unit was installed in the test duct, its oil reservoir was filled to the indicated level, and all discoverable air leaks into its housing were sealed. The timer control was adjusted to shift the curtain 12.5 inches per hour. During a period of 18 hours immediately prior to the tests the curtain was allowed to shift automatically for a total of approximately 3 revolutions through the oil reservoir, with no air flow, to saturate the curtain media. The initial resistance of the clean filter at various rates of air flow was then measured. Next, three determinations of the efficiency of the clean unit were made at rated velocity, using as the aerosol outdoor air drawn into the test duct through a nearby open window.

Following these, three efficiency determinations were made at rated velocity, using as the aerosol outdoor air in which was dispersed Cottrell precipitate at a concentration of approximately 0.83 gram per thousand cubic feet of air, i.e., a net dust feed rate of 1.65 grams per minute. The sampling times for the efficiency test with Cottrell precipitate as the aerosol were 12 minutes each and the curtain made one shift during each test. When these had been obtained, the process was begun of loading the unit with a mixture of 4 percent cotton lint, and 96 percent Cottrell precipitate, by weight, separately dispersed into the air stream. The lint used for this purpose was No. 7 cotton linters previously ground in a Wiley mill with a 4 - millimeter screen; the lint was dispersed into the air stream every 12 minutes (immediately after each curtain movement) through an aspirator operating at approximately 35 psi inlet air pressure. At suitable periods as loading progressed, the efficiency of the unit was determined using 100 percent Cottrell precipitate in outdoor air. The pressure drop was recorded at intervals during the tests.

In order that the dirt-loading process simulate continuous operation of the unit in service at the desired burden, the curtain-shifting timer mechanism was deenergized during all periods when the air flow through the unit was stopped -- e.g., overnight, or at lunch periods. Similarly, the increased rate of dust feed occurring during efficiency determinations was in effect reduced to the desired average net rate of feed (0.90 gram per minute) by operating the unit without dust feed for ten minutes following each 12-minute efficiency determination.

The dirt-loading process was continued until the curtain had made two or more revolutions under the imposed dust burden conditions. Although some variation of pressure drop occurred as a result of the periodic changes of curtain position, an equilibrium of efficiency and pressure drop appeared to have been substantially attained at this stage of the test.

At the conclusion of the dirt-loading tests the efficiency was determined again using laboratory air as the aerosol. In order to ascertain the self-cleaning performance of the unit, the timer control was then adjusted to give a curtain movement of 4 inches per hour and left running intermittently for a period of 68 hours with no air flow through the unit. The resistance of the cleaned filter at various air flows was then observed.

4. TEST RESULTS

Tabulated in Table 1 are measurements, at four different face velocities, of the pressure drops through the filter when it was clean, and when it had been allowed to clean itself after the dirt-loading test. In each case, the observed values apply for a particular position of the curtain. As may be seen from the pressure drop data in Table 2 for the clean unit tested with atmospheric air (which could have caused no significant change in curtain resistance) the pressure drop of the clean unit was observed to vary from 0.394 to 0.431 inch W.G., depending upon curtain position.

The operating performance of the unit at 500 fpm face velocity is summarized in Table 2. The table gives data on the efficiency of the unit in arresting Cottrell precipitate, and on its pressure drop, as the curtain was progressively loaded, from a clean condition to an operating equilibrium condition corresponding to a "dirt burden" of 24.7 grams per sq. ft., with a mixture of approximately 4 percent lint and 96 percent Cottrell precipitate by weight. It is believed that the unit was operating substantially at the equilibrium condition for this burden after the curtain had turned more than 1.5 revolutions. This is indicated by the trend of the efficiency and pressure drop curves plotted from the data of Table 2, as shown in Figure 2. Also, the efficiency of the unit in filtering atmospheric air is given for the clean unit, and for the unit when its media was loaded with a dirt deposit corresponding to a "dirt burden" of 24.7 grams per sq. ft.

5. SUMMARY

A. Performance

Due to the self-cleaning feature of the unit, which occurs periodically during operation, the performance of the unit depends on, and must be related to, the dirt deposit on the curtain, expressed in this report by means of the "dirt burden" on the curtain as it leaves the airstream on the upstream side. On this basis, at 500 fpm face velocity, the efficiency of the unit in arresting Cottrell precipitate was about 83 percent for equilibrium operation at a dirt burden of 24.7 grams per sq. ft. The corresponding pressure drop averaged 0.50 inch W.G., with a plus or minus variation of about 0.03 inch depending upon the curtain position.

The effect of the magnitude of the burden is shown by the corresponding figures obtained when the curtain was practically clean, even though the rate of dirt feed was the same, i.e., at the start of the dirt-loading test. The efficiency and pressure drop of the unit at this stage were about 75 percent and 0.42 inch W. G., respectively. As the deposit on the curtain increased to the equilibrium condition, the efficiency and pressure drop rose to the values given in the preceding paragraph.

The efficiency of the unit in arresting the dust in the atmospheric air at the test laboratory was on the order of 10 percent, individual values ranging from 7 to 14 percent. Its efficiency appeared to be approximately the same with the curtain clean, and with a dirt burden of 24.7 grams per sq. ft.

At conclusion of the tests, examination of the test duct downstream of the unit showed no evidence of oil carry-over, even though the unit had been operated at approximately three times the shift speed recommended by the manufacturer. Early in the tests, before significant dust had been received on the curtain, a few droplets of oil were caught on a cellophane tape stretched across the test duct just downstream of the unit; no droplets were caught later in the tests when the curtain had received a moderate dirt deposit. From this evidence, it is concluded that oil carry-over would be negligible for a unit operated at the recommended curtain shift speed (4 inches per hour).

It was observed during the dirt-loading test that a few large wads of oil-wet lint and dirt were dislodged from the curtain on

the downstream face as it passed the top and bottom seals outlining the exposed curtain area. These were all too heavy to be carried in the air stream, and were all found deposited on the bottom of the transition immediately adjacent to the downstream face. It is considered that such wads are not of importance as regards the performance of the unit, except that their removal occasionally may be desirable.

B. Self-Cleaning

Automatic self-cleaning of the curtain by its intermittent motion through the oil reservoir appeared to be effective. At the conclusion of the dirt-loading test, the curtain was allowed to move intermittently through the oil at a rate of 4 inches per hour for 68 hours with no air flow, for a total of 3.5 revolutions. The pressure drop of the unit, at 500 fpm face velocity, was reduced from its value when dirty (about 0.50) to a value of 0.412 inch W. G., as compared with the initial average value of 0.409 for the clean filter as indicated in Table 2. On inspection of the unit after the test and this self-cleaning operation, the curtain appeared to be quite clean except that at the outer vertical edges of the curtain, approximately in line with the edge-seals, some dirt deposits remained on the armor strips of the media. The wads of lint and dust previously referred to were also observed clinging to parts of the horizontal seals. Neither of these types of deposit seemed of a kind to add to the pressure drop of the curtain, and they are considered to be of little practical importance.

The lint and dust removed from the filter curtain settled to the bottom of the oil reservoir as a heavy sludge, leaving the oil substantially clear. The sludge was readily removed from the reservoir using a suitable scraper.

C. General

The following observations were made concerning particulate matter downstream of the test unit.

(1) Cellophane tapes stretched across the duct 15" downstream of the unit with the adhesive side facing upstream and exposed for several hours each during the dirt-loading test, showed on examination under the microscope that many particles from 15 to 5 microns, and smaller, in size were caught. Relatively few larger particles,

ranging from 20 to 200 microns, were found on the tapes. No lint fibres were observed; early in the tests 4 or 5 small droplets of what appeared to be oil were found on a tape, but none were observed on later tapes as the loading process was continued.

(2) A cellophane tape exposed at the downstream dust sampling station 8 ft. from the test unit throughout the entire test showed many fine particles, and relatively few large particles of dust; no lint was observed.

(3) Examination by microscope of the downstream filter papers from efficiency determinations showed that almost all of the particles on the paper were under 20 microns, with most under 5 microns; a few up to 50 microns were observed.

(4) Examination of the downstream duct of the test apparatus after the tests indicated no observable oiliness of the duct. Upon careful sweeping of the downstream duct, no observable quantity of dust was obtained from it. A few wads of oil-wet dirt were found just downstream of the test unit, as mentioned previously.

A cloth was wetted with the oil submitted with the unit, and taken outdoors and ignited with a wooden safety match. The cloth did not ignite readily, but once ignited it burned strongly with a smokey flame.

The curtain-shifting timer adjustment of the unit was "sealed" at the factory-set position when received, by means of a plastic cement. When the seal was broken, no difficulty was experienced in setting the adjustment as desired. The intermittent shifting action of the curtain occurred smoothly and without objectionable noise.

Table 1

<u>Face Velocity</u> fpm	<u>Air Flow</u> cfm	<u>Pressure Drop*</u> inch W.G.	<u>Pressure Drop**</u> inch W.G.
253	1000	0.117	0.126
379	1500	.242	.253
500	1980	.398	.412
632	2500	.610	.628

*Initial resistance of the clean filter

**Resistance of the unit after the dirt-loading test and 68 hours of intermittent self-cleaning action (approximately 3.5 turns) without air flow.




Table 2

<u>Face Velocity</u> fpm	<u>Inlet Aero-sol*</u>	<u>Total Time</u> Minutes	<u>Curtain Move-ment</u> Revolutions	<u>Total Dirt Fed**</u> Grams	<u>Pressure Drop</u> inch WG	<u>Effic-iency</u> Percent
500	A	-	-	0	0.394	7
		-	-	0	.403	14
		-	-	0	.431	12
					<u>0.409</u> avg.	
500	C	22	0.06	20	.429	74.8
		44	.12	42	.420	75.8
		66	.18	62	.424	76.8
		184	.50	174	.481	77.8 (PM)
		206	.56	195	.458	78.5 (AM)
		302	.82	289	.467	--
		444	1.20	424	.508	79.2 (PM)
		466	1.26	522	.471	81.3 (AM)
		560	1.51	522	.515	82.6
		654	1.77	624	.499	82.8
		772	2.09	738	.530	83.2 (PM)
		A	--	738	.475	11 (AM)
		A	--	738	.466	8

*A = Particulate matter in atmospheric air at NBS.

C = Cottrell precipitate in atmospheric air.

**Average mixture: 3.9 percent lint, 96.1 percent Cottrell precipitate by weight. (The dirt fed corresponds to a "dirt burden" on the curtain of 24.7 grams per sq. ft. on leaving the airstream).

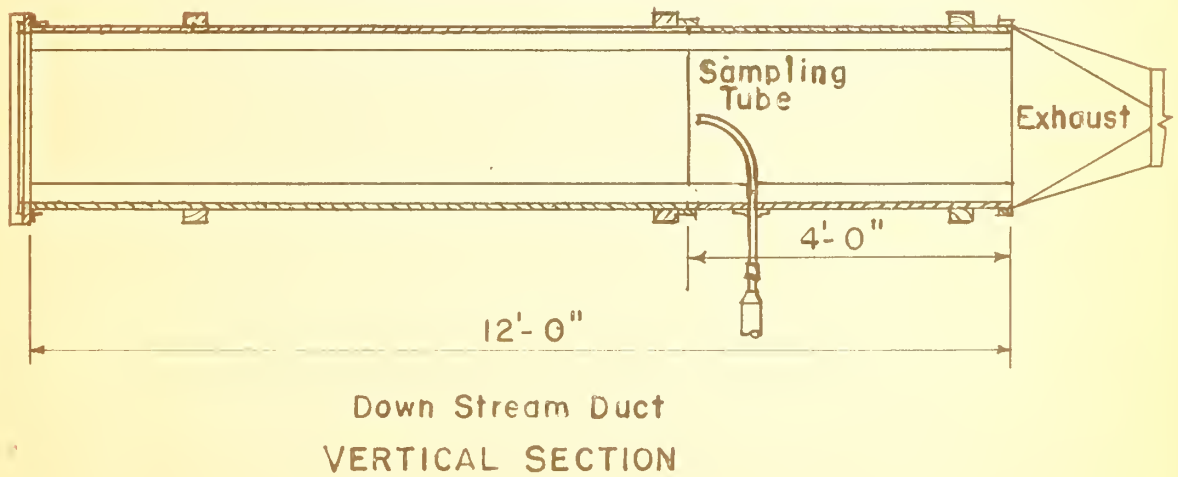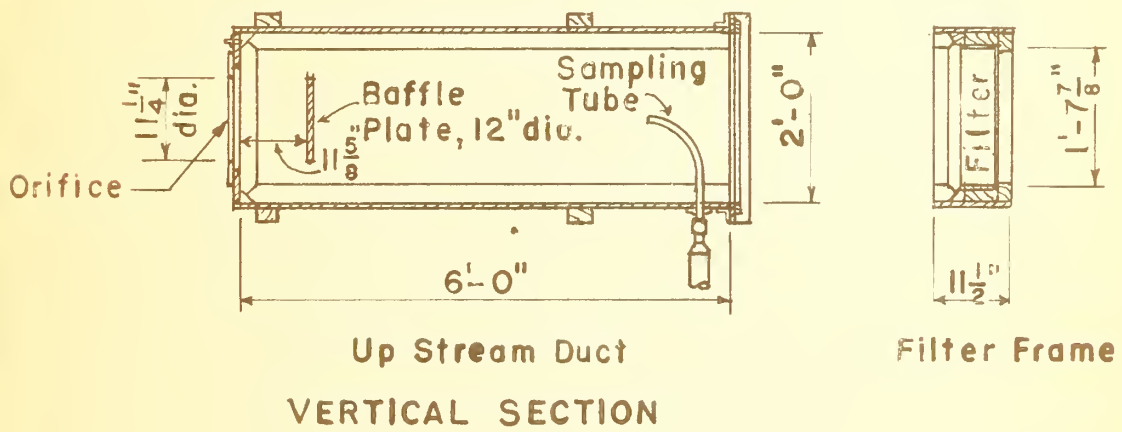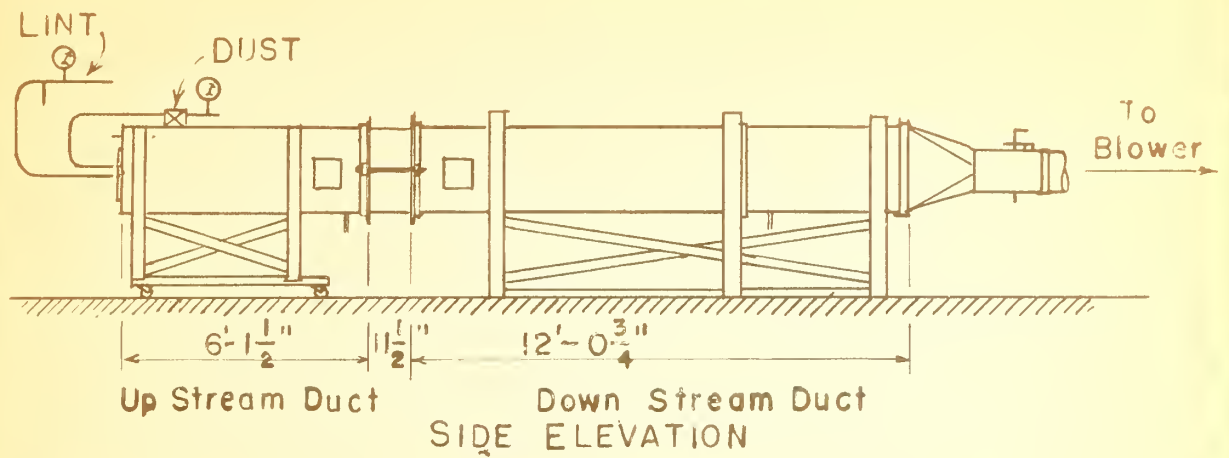

Air Filter Test Apparatus



Figure 1

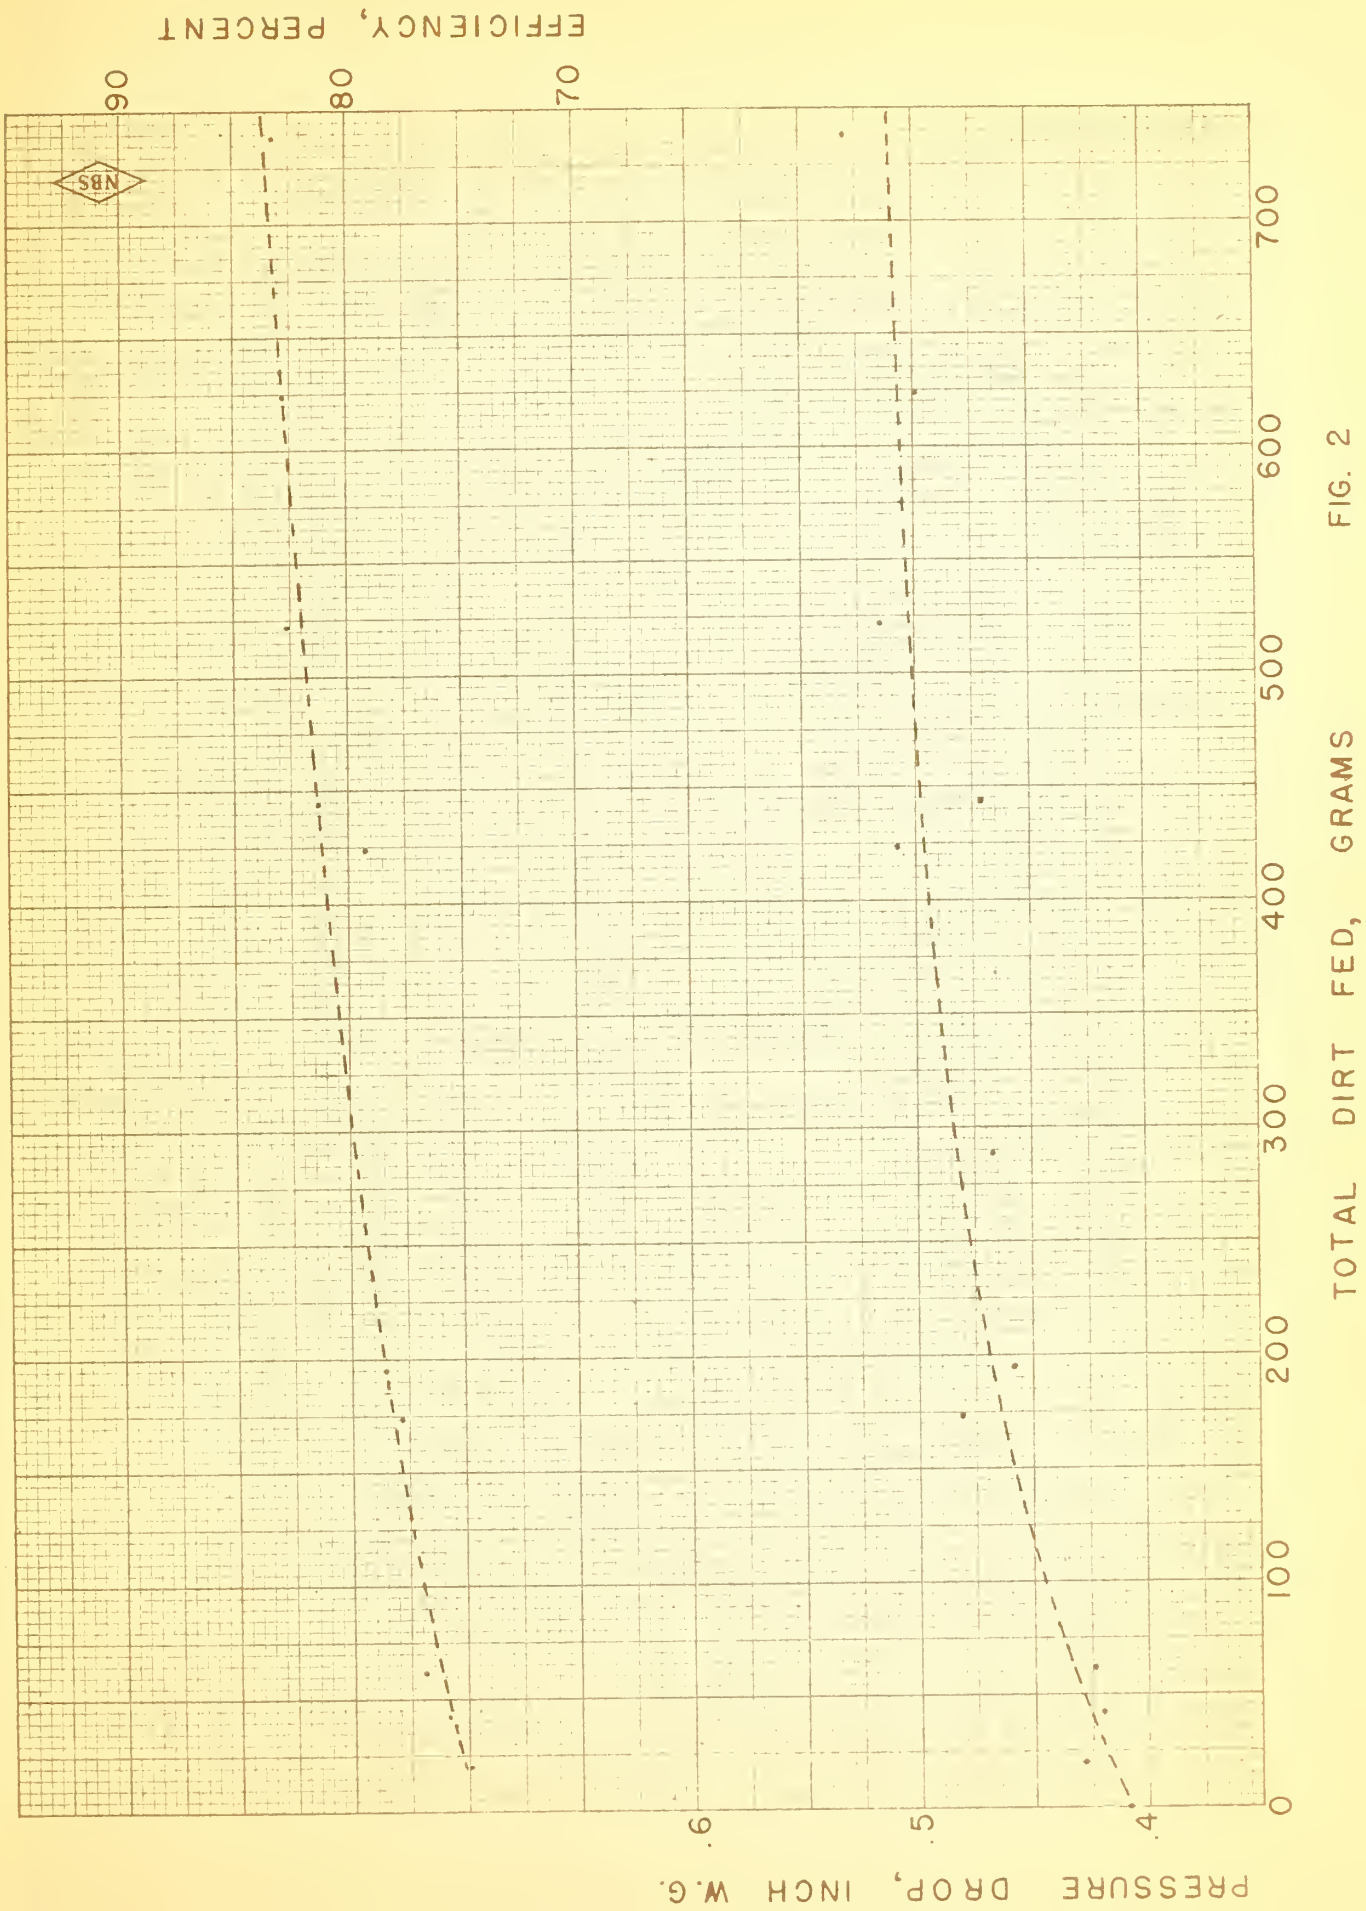


FIG. 2

THE NATIONAL BUREAU OF STANDARDS

Functions and Activities

The functions of the National Bureau of Standards are set forth in the Act of Congress, March 3, 1901, as amended by Congress in Public Law 619, 1950. These include the development and maintenance of the national standards of measurement and the provision of means and methods for making measurements consistent with these standards; the determination of physical constants and properties of materials; the development of methods and instruments for testing materials, devices, and structures; advisory services to Government Agencies on scientific and technical problems; invention and development of devices to serve special needs of the Government; and the development of standard practices, codes, and specifications. The work includes basic and applied research, development, engineering, instrumentation, testing, evaluation, calibration services, and various consultation and information services. A major portion of the Bureau's work is performed for other Government Agencies, particularly the Department of Defense and the Atomic Energy Commission. The scope of activities is suggested by the listing of divisions and sections on the inside of the front cover.

Reports and Publications

The results of the Bureau's work take the form of either actual equipment and devices or published papers and reports. Reports are issued to the sponsoring agency of a particular project or program. Published papers appear either in the Bureau's own series of publications or in the journals of professional and scientific societies. The Bureau itself publishes three monthly periodicals, available from the Government Printing Office: The Journal of Research, which presents complete papers reporting technical investigations; the Technical News Bulletin, which presents summary and preliminary reports on work in progress; and Basic Radio Propagation Predictions, which provides data for determining the best frequencies to use for radio communications throughout the world. There are also five series of nonperiodical publications: The Applied Mathematics Series, Circulars, Handbooks, Building Materials and Structures Reports, and Miscellaneous Publications.

Information on the Bureau's publications can be found in NBS Circular 460, Publications of the National Bureau of Standards (\$1.25) and its Supplement (\$0.75), available from the Superintendent of Documents, Government Printing Office. Inquiries regarding the Bureau's reports and publications should be addressed to the Office of Scientific Publications, National Bureau of Standards, Washington 25, D. C.

