

421.00

RECEIVED FEB 23 1955

NATIONAL BUREAU OF STANDARDS REPORT

4433

PERFORMANCE TESTS OF AN AAF CO. "ROLL-O-MATIC"
AUTOMATIC RENEWABLE MEDIA AIR FILTER

by

Henry E. Robinson
Thomas W. Watson

Report to
General Services Administration
Public Buildings Service
Washington 25, D. C.



U. S. DEPARTMENT OF COMMERCE
NATIONAL BUREAU OF STANDARDS

FILE COPY - DO NOT REMOVE

U. S. DEPARTMENT OF COMMERCE

Sinclair Weeks, *Secretary*

NATIONAL BUREAU OF STANDARDS

A. V. Astin, *Director*



THE NATIONAL BUREAU OF STANDARDS

The scope of activities of the National Bureau of Standards is suggested in the following listing of the divisions and sections engaged in technical work. In general, each section is engaged in specialized research, development, and engineering in the field indicated by its title. A brief description of the activities, and of the resultant reports and publications, appears on the inside of the back cover of this report.

Electricity and Electronics. Resistance and Reactance. Electron Tubes. Electrical Instruments. Magnetic Measurements. Process Technology. Engineering Electronics. Electronic Instrumentation. Electrochemistry.

Optics and Metrology. Photometry and Colorimetry. Optical Instruments. Photographic Technology. Length. Engineering Metrology.

Heat and Power. Temperature Measurements. Thermodynamics. Cryogenic Physics. Engines and Lubrication. Engine Fuels.

Atomic and Radiation Physics. Spectroscopy. Radiometry. Mass Spectrometry. Solid State Physics. Electron Physics. Atomic Physics. Nuclear Physics. Radioactivity. X-rays. Betatron. Nucleonic Instrumentation. Radiological Equipment. AEC Radiation Instruments.

Chemistry. Organic Coatings. Surface Chemistry. Organic Chemistry. Analytical Chemistry. Inorganic Chemistry. Electrodeposition. Gas Chemistry. Physical Chemistry. Thermochemistry. Spectrochemistry. Pure Substances.

Mechanics. Sound. Mechanical Instruments. Fluid Mechanics. Engineering Mechanics. Mass and Scale. Capacity, Density, and Fluid Meters. Combustion Controls.

Organic and Fibrous Materials. Rubber. Textiles. Paper. Leather. Testing and Specifications. Polymer Structure. Organic Plastics. Dental Research.

Metallurgy. Thermal Metallurgy. Chemical Metallurgy. Mechanical Metallurgy. Corrosion.

Mineral Products. Porcelain and Pottery. Glass. Refractories. Enameled Metals. Concrete Materials. Constitution and Microstructure.

Building Technology. Structural Engineering. Fire Protection. Heating and Air Conditioning. Floor, Roof, and Wall Coverings. Codes and Specifications.

Applied Mathematics. Numerical Analysis. Computation. Statistical Engineering. Mathematical Physics.

Data Processing Systems. Components and Techniques. Digital Circuitry. Digital Systems. Analogue Systems.

Cryogenic Engineering. Cryogenic Equipment. Cryogenic Processes. Properties of Materials. Gas Liquefaction.

Radio Propagation Physics. Upper Atmosphere Research. Ionospheric Research. Regular Propagation Services.

Radio Propagation Engineering. Frequency Utilization Research. Tropospheric Propagation Research.

Radio Standards. High Frequency Standards. Microwave Standards.

● Office of Basic Instrumentation

● Office of Weights and Measures

NATIONAL BUREAU OF STANDARDS REPORT

NBS PROJECT

NBS REPORT

1000-30-4830

December 5, 1955

4433

PERFORMANCE TESTS OF AN AAF CO. "ROLL-O-MATIC" AUTOMATIC RENEWABLE MEDIA AIR FILTER

by

Henry E. Robinson

Thomas W. Watson

Heating and Air Conditioning Section
Building Technology Division

to

General Services Administration
Public Buildings Service
Washington 25, D. C.


NBS

U. S. DEPARTMENT OF COMMERCE NATIONAL BUREAU OF STANDARDS

The publication
unless permitted
25, D. C. Suc-
cessfully prepared

Approved for public release by the
Director of the National Institute of
Standards and Technology (NIST)
on October 9, 2015.

Reproduction in whole or in part, is prohibited
without the written permission of the
National Institute of Standards, Washington
if a report has been specifically
prepared for its own use.

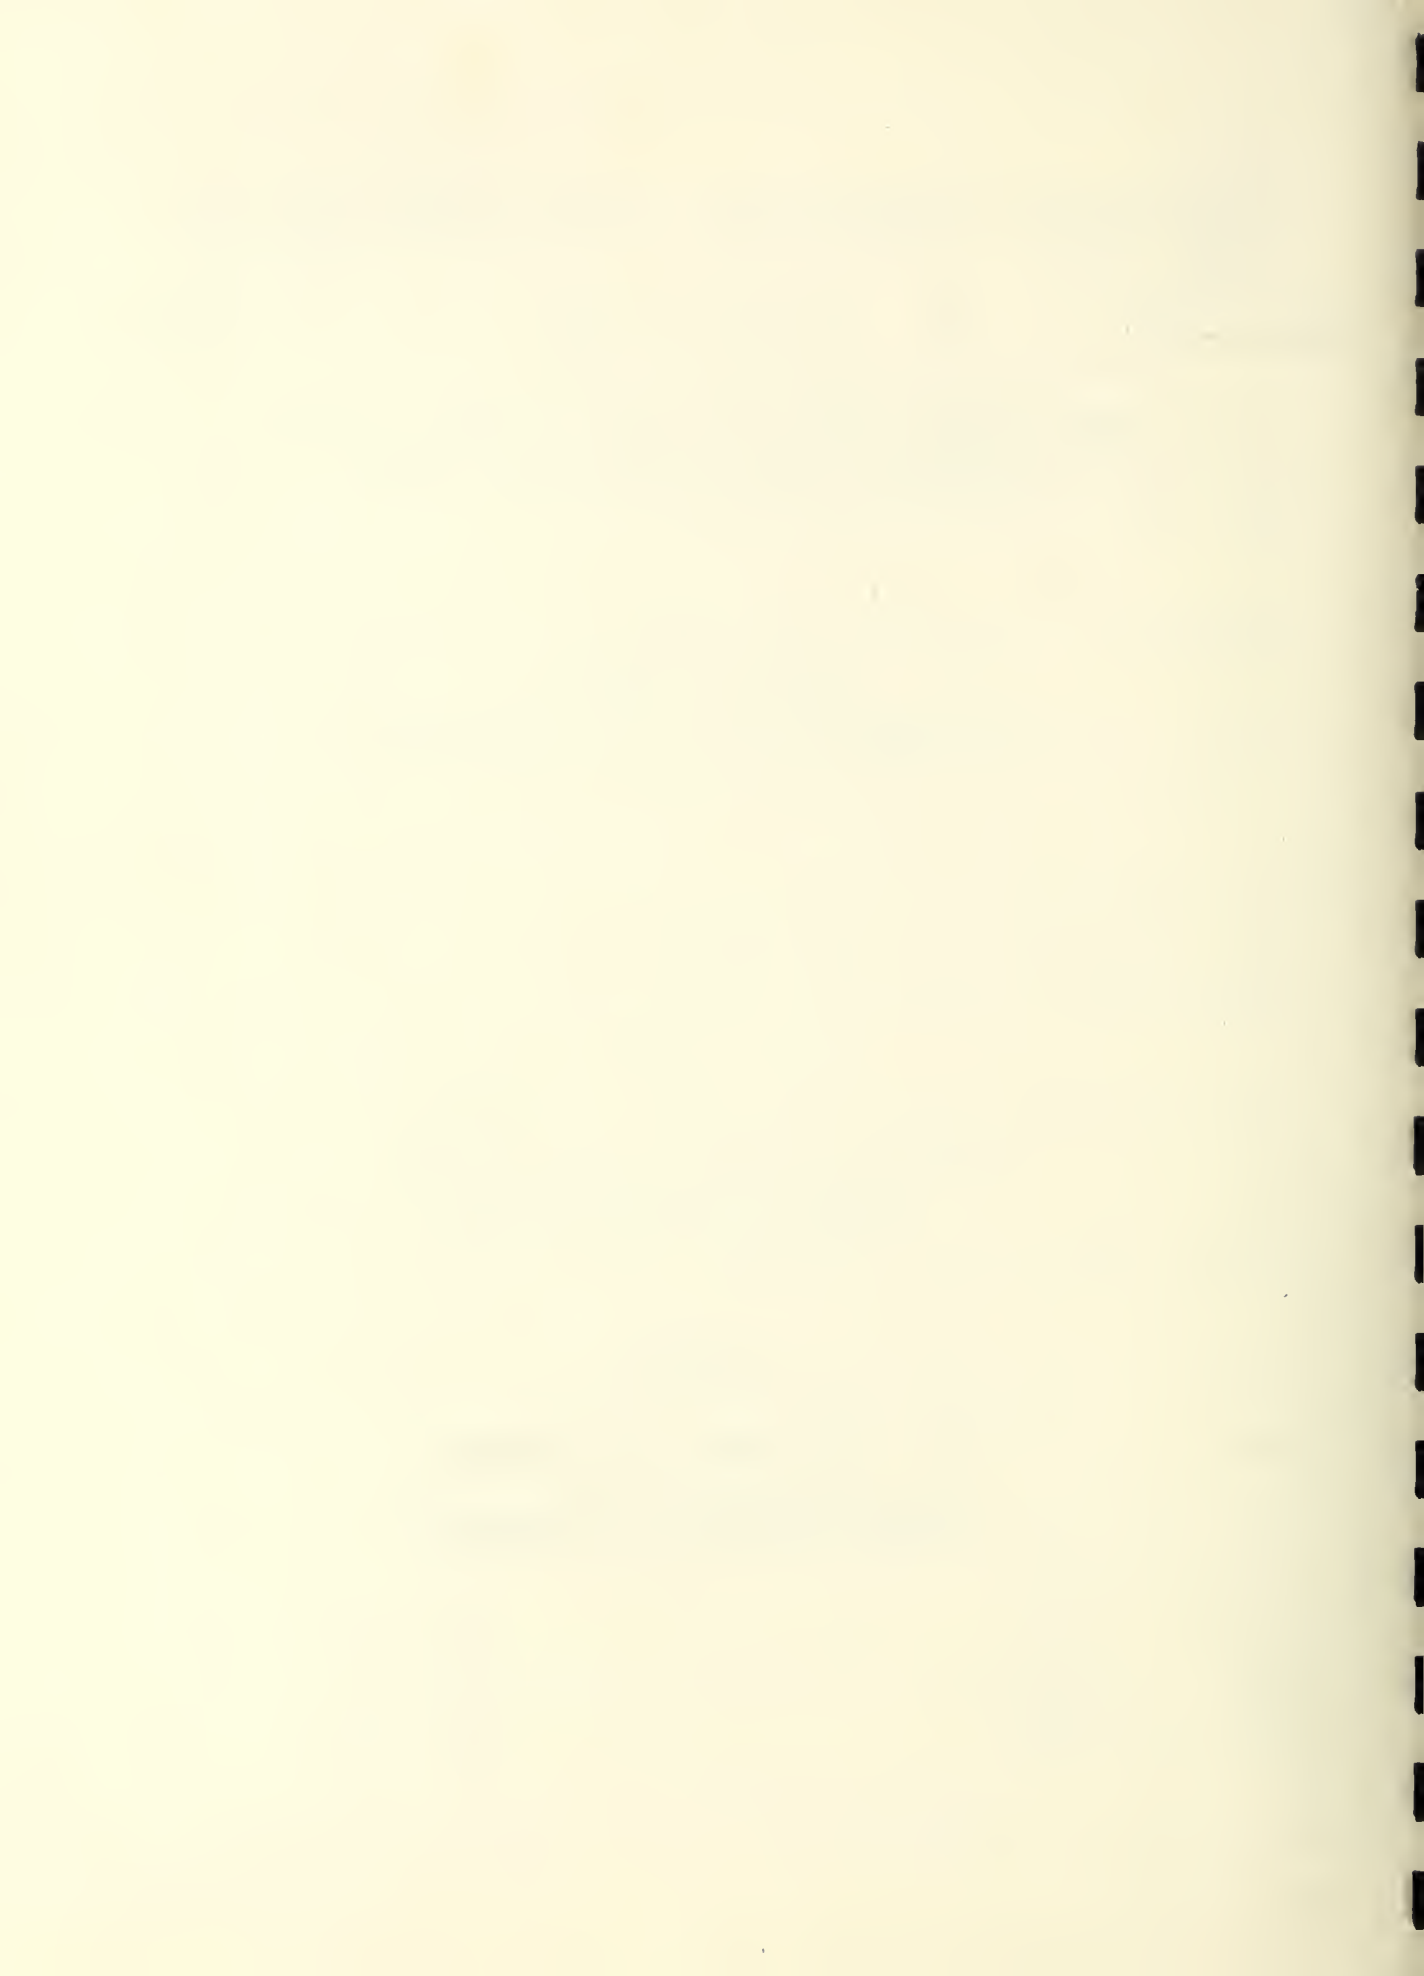

PERFORMANCE TESTS OF AN AAF CO.
"ROLL-O-MATIC" AUTOMATIC RENEWABLE MEDIA AIR FILTER

1. INTRODUCTION*

At the request of the Public Buildings Service, General Services Administration, the performance characteristics of automatic renewable media type air filters were determined to provide information to assist in the preparation of new air filter specifications.


The test results presented herein were obtained on a specimen renewable media type air filter submitted by its manufacturer at the request of the Public Buildings Service and included determinations of dust arresting efficiency with two aerosols (atmospheric air and Cottrell precipitate), pressure drop, dirt load and renewability of the specimen.

2. DESCRIPTION OF THE FILTER SPECIMEN

The filter was manufactured by the American Air Filter Co., Inc., Louisville 8, Kentucky, and was of the automatic renewable media type. It was identified by nameplate as an AAF "Roll-O-Matic" Air Filter, Size 3-50 (3 ft. wide x 5.0 ft. high) Capacity 2000 cfm at 500 fpm face velocity.

The test unit had a housing with actual outside dimensions of 36 inches in width, 52 inches in height and 49 inches in length. The exposed face of the curtain media on the upstream side was 24 inches wide x 26 inches high, but the media was supported on the downstream side by a strip of metal across the top which reduced the actual area through which air could flow to 24 inches x 24 inches (4.0 sq. ft.). The unit was rated at 2000 cfm air delivery at 500 fpm face velocity. Special upstream and downstream transitions, with flanges 30 inches square matching those of the duct of the test apparatus, were used to adapt the unit for test. The openings formed by these transitions at the flanges were 24 inches square both upstream and downstream.

*This report is submitted for information only, and is not released for use in connection with advertising or sales promotion.

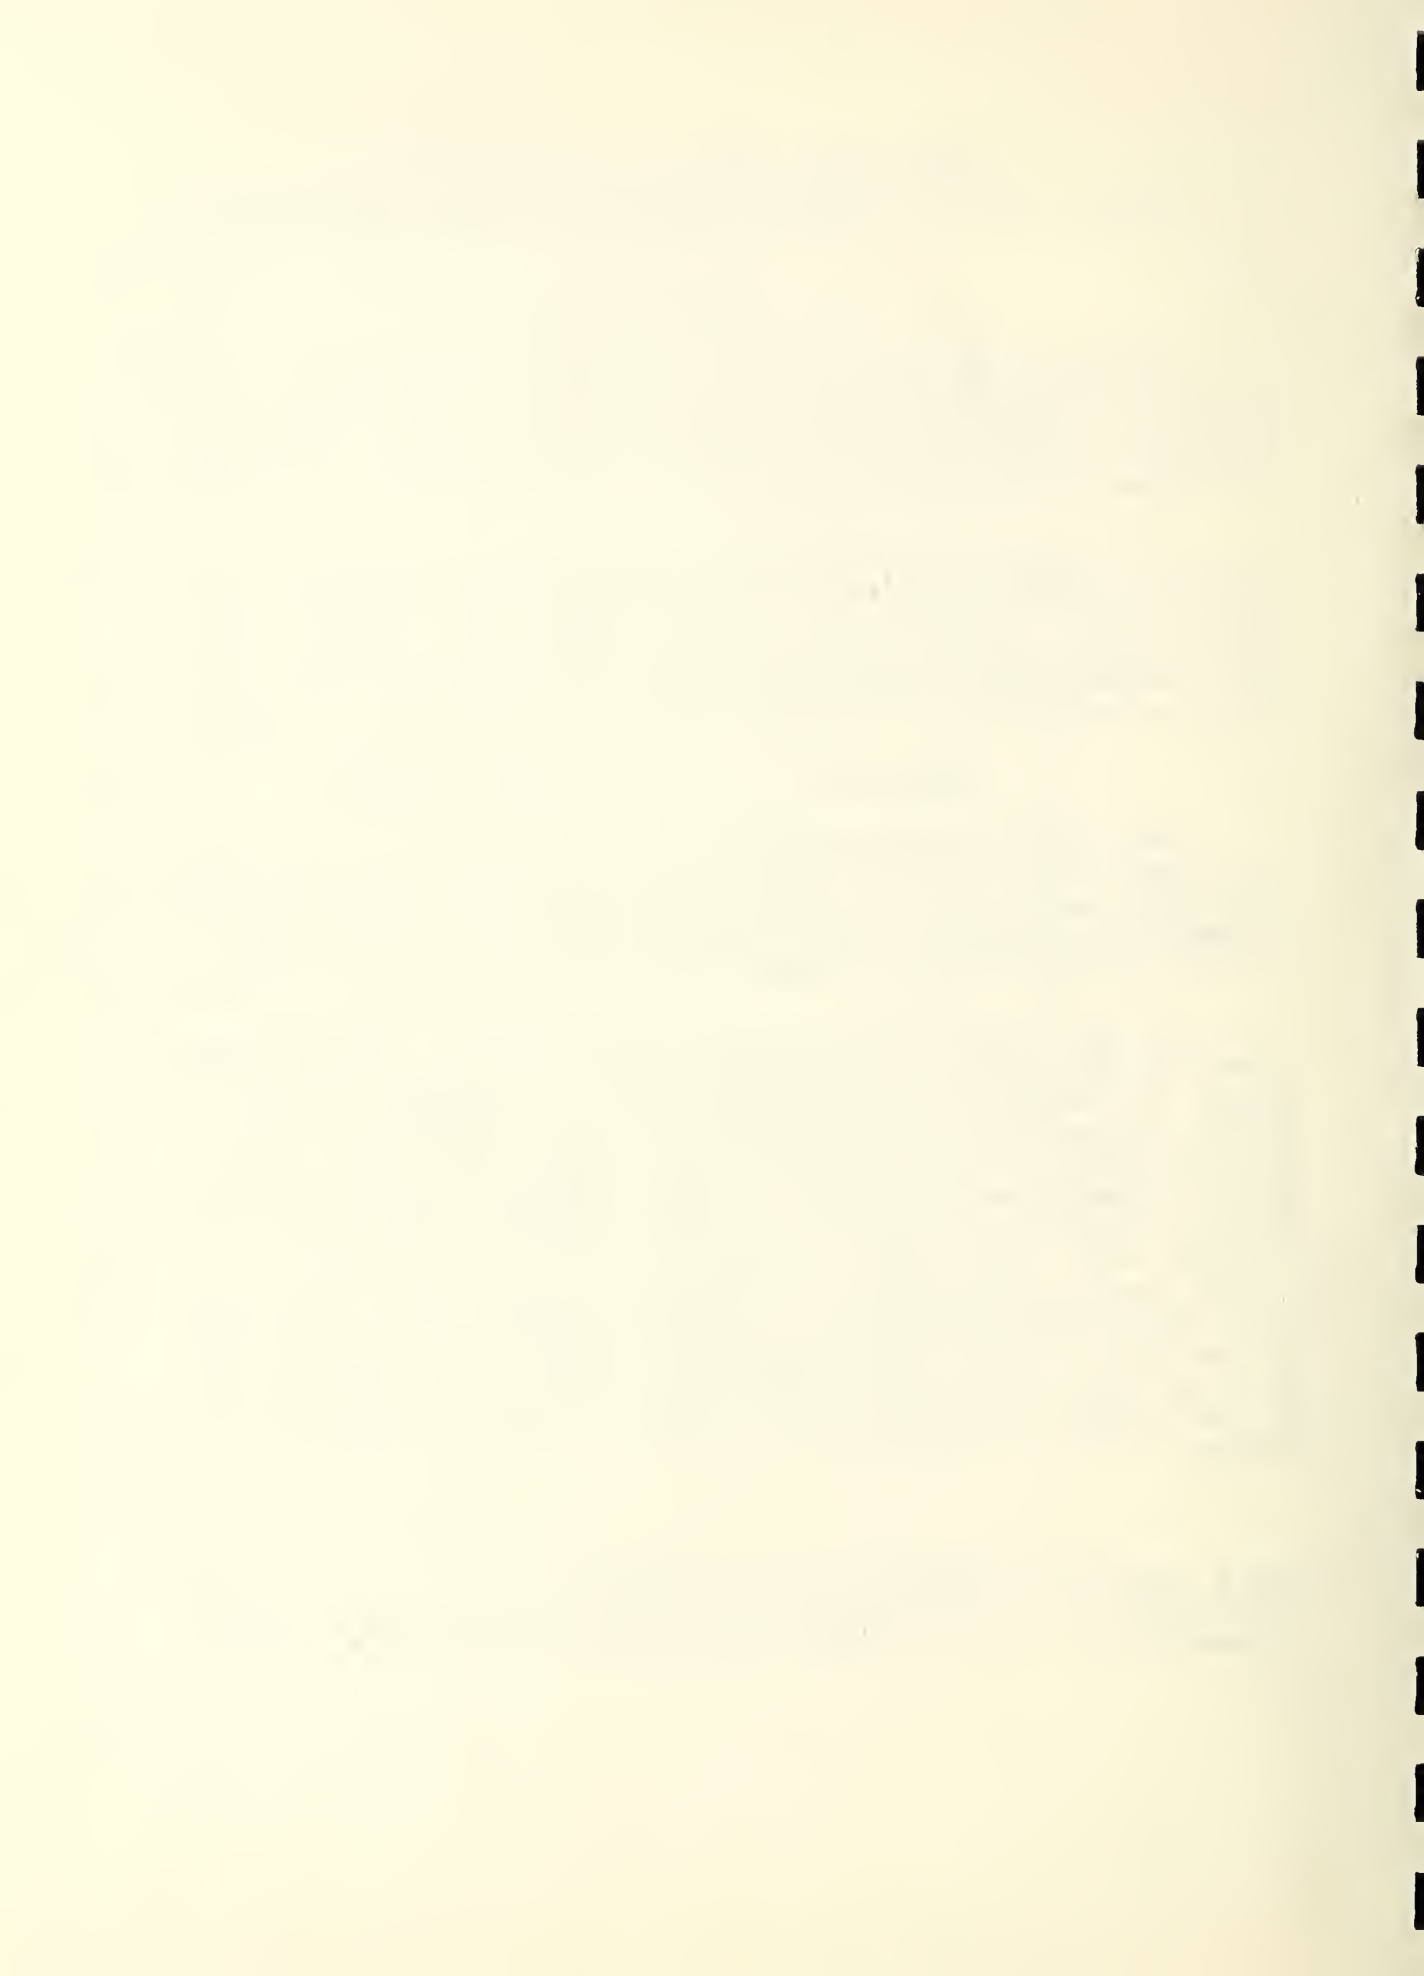

The Roll-O-Matic filter is designed to move a long blanket or strip of filtering media across the air flow opening in the housing, in a manner similar to that in which strip film is moved in a box camera. A roll of the clean blanket media is held at the top of the housing, from which the media is unrolled as needed by a wind-up roller or spool at the bottom of the housing driven through a friction clutch by an electric motor. In passing from the top to the bottom roller, the media is supported on the downstream side against the pressure drop of the air passing through it by an endless curtain of small horizontal rods, which turns on sprockets at the top and bottom of the housing. The bottom sprocket of the curtain, and the lower media wind-up spool are turned by the same drive motor and speed reducer mechanism. The drive motor characteristics are given as 1/6 H.P., 115 volts, 60 cycle, 1 phase.

The filtering media, designated as "Roll-O-Mat", consists of a long strip or blanket (2 inches thick when uncompressed) of interlaced matted fine glass fibers bonded together at points of contact by a thermo-setting resin. The fibers are adhesively-coated with a tricresyl-phosphate thixotropic gel designated as "TCP-jell Roll-O-Mat Adhesive" before shipment. As furnished on a spool, the blanket is tightly rolled and compressed in thickness, but expands upon being unrolled for use.

The unit is designed so that the shift drive mechanism is intermittently energized by means of either an adjustable timer-clock or a differential pressure switch actuated by the pressure drop through the filtering media. As initially submitted for these tests, the unit was equipped with a timer control. It was found however that because of variability in the operation of the friction-clutch, the media failed to move satisfactorily in accordance with the schedule imposed by the timer mechanism. Consequently, a new friction clutch was installed, and at the same time, a Dwyer differential pressure control was installed in place of the timer, for the tests reported here. The pressure control was adjusted to energize the drive motor when the pressure drop reached a value of about 0.48 inches W.G. and to open the drive motor circuit when the movement of clean media into the air stream lowered the pressure drop to about 0.41 inches W. G. Motion of the media during periods of shift occurred at the rate of about 83 ft. per hour.

3. TEST METHOD AND PROCEDURE

Efficiency determinations were made by the NBS "Dust-Spot Method" using the following aerosols: (a) outdoor atmospheric air drawn through the laboratory without addition of other dust or contaminant; and (b) Cottrell precipitate, dispersed in the outdoor atmospheric air. The test method is described in the paper "A Test Method for Air Filters" by R. S. Dill (ASHVE Transactions, Vol. 44, P. 379, 1938). The test duct and arrangement are shown in Figure 1. A baffle made of two 3-inch wide slats at right angles to each other was located in the duct about 3-1/2 ft. downstream of the test assembly to intermix the air discharged from it.

For these tests, the unit was installed in the test duct and its exterior housing was carefully sealed to prevent inleakage of air. The desired rate of air flow through the air cleaner was established and samples of air were drawn from the center of the test duct, at points one foot upstream and eight feet downstream of the air cleaner assembly, at equal rates for equal times, and passed through known areas of Whatman No. 41 filter paper. The filter papers used in the upstream and downstream positions were selected to have the same light transmission readings when clean, as determined by means of a photometer using transmitted light. Using filter paper sampling areas downstream equal to 30 percent of the filter paper area upstream, an efficiency of 70 percent would be indicated if the upstream and downstream dust-spots on the papers had the same opacity, as indicated by the change in the light transmissions of the dust-spot areas before and after the sample was drawn. If the opacities of the dust-spots differed, the efficiency was calculated by means of the formula

$$\text{Efficiency, percent} = 100 \left[1 - \frac{A_2}{A_1} \cdot \frac{O_2}{O_1} \right]$$

where A_1 and A_2 were the areas of the dust-spots upstream and downstream, respectively, and O_1 and O_2 were the opacities of the dust-spots upstream and downstream respectively.

An air filter of this kind equipped with a differential pressure switch to actuate the media shift mechanism operates at a sort of "steady-state" condition, in which the pressure drop slowly increases to an upper limit as dust is received,

and is then rapidly reduced to a somewhat lower limit as clean media is moved into the air stream due to action of the pressure switch. An average pressure drop is thus maintained by intermittent shifting of the media as the pressure drop through the filter changes within these limits. It is evident that the dirtiness of the filter media as it is moved out of the air stream is dependent on the magnitude of the average pressure drop at which the unit is adjusted to operate, and that the rate of usage of media therefore depends on it. Further, since dust-arresting efficiency of this type of media increases slightly as the media becomes choked with dirt, the efficiency of the unit may be affected by the operating pressure drop. In order that the tests represent conditions reasonably appropriate for service applications, the differential pressure control was adjusted to yield an average pressure drop of the magnitude commonly experienced with automatic self-cleaning air filters (about 0.45 inch W.G.).

The following procedure was used in these tests. The clean unit was installed in tandem between the upstream and downstream sections of the test duct, and all discoverable air leaks were sealed. The differential pressure control was adjusted to actuate the media shift drive-motor when the pressure drop across the media increased to 0.48 inch W.G.; its operating differential was such that the control opened the drive-motor circuit when the pressure drop decreased to 0.41 inch W.G.

With the filtering media in the air stream all clean, the pressure drop was measured at several face velocities, and the efficiency of the filter on atmospheric air was determined at rated face velocity. Next, the efficiency was determined with 100% Cottrell precipitate. The process of dirt-loading the filter at rated face velocity was then begun, using a mixture of 96% Cottrell precipitate and 4% cotton lint by weight, separately dispersed into the air stream at a concentration of 1.0 gram of mixture per 1000 cf of air. The lint used for this purpose was No. 7 cotton linters previously ground in a Wiley mill with a 4-millimeter screen; the required weight of lint was dispersed into the air stream every 12 minutes through an aspirator operating at approximately 35 psi gage inlet air pressure.

When the pressure drop of the filter reached the upper limit of the differential pressure switch, and thereafter fluctuated about the average value established by the control

setting, the filter operation became substantially "steady-state". Readings of pressure drop just before and after the shifts of the media, and of the media travel as indicated by a mark on the curtain, were recorded from this point on; occasional measurements of dust-arresting efficiency were also made as this condition was continued. Some of these determinations were made so that a shift of the media occurred during the air-sampling period, and some were made without such a shift.

After the filter had been operated at 1.0 gram per 1000 cf dirt concentration for a period in which approximately 400 grams per foot width of filter were fed at substantially "steady-state" conditions, the efficiency of the unit was determined with atmospheric air as the aerosol.

Following this test, the dirt-loading process was resumed, but with the 96% Cottrell precipitate 4% cotton lint mixture fed at a concentration of 0.5 gram per 1000 cf, with occasional efficiency measurements being made with Cottrell precipitate. This was continued until an additional 280 grams of mixture per foot width of filter had been fed, at which time the test was terminated, in part because of increasing and erratic slippage of the friction clutch driven by the shift mechanism.

During the tests, at appropriate times, strips of 3/4 inch cellophane adhesive tape were stretched across the test duct with the adhesive side facing upstream to catch samples of dust particles approaching in the air stream. The tapes were placed in the duct at a position 15 inches downstream of the downstream flange of the test unit, or about 40 inches downstream of the filtering media of the unit.

4. TEST RESULTS AND DISCUSSION

Tabulated in Table 1 are measurements, at four face velocities, of the pressure drop through the filter when the media was clean, and average values of the efficiency of the unit on atmospheric air and on Cottrell precipitate for the filter when clean and when dirt-loaded to the "steady-state" condition corresponding to an average pressure drop of about 0.45 inch W.G. at rated face velocity.

The operating performance of the unit at 500 fpm face velocity is summarized in Table 2 and in Figure 2. Referring to Figure 2, it is seen that the pressure drop increased gradually from its initial value, as dirt was fed to the filter, to a value of about 0.485 inch W.G. At this point the differential pressure control caused about five inches of new clean media to be shifted into the air stream, which lowered the pressure drop to about 0.41 inch W.G. Thereafter, the unit operated automatically in a "steady-state" condition with the pressure drop varying between maximum and minimum values of 0.49 and 0.41 inches W.G. respectively. The travel of the media as this process continued is also shown; it is seen that the plotted points describe a substantially straight line having constant slope, i.e., that the use of media per gram of dust received per foot of filter width was substantially constant. The efficiency of the filter on Cottrell precipitate in atmospheric air is shown at the top of Figure 2. It increased from an initial value of 75% to an approximately steady value of 79% for the "steady-state" operating condition.

The results above were obtained with the filter being loaded with a dirt mixture at a concentration of 1.0 gram per 1000 cf of air. When the test was continued with the dirt concentration reduced to 0.5 gram per 1000 cf, substantially the same results were obtained, as shown on the right-hand portion of Figure 2, although the time required to feed a given quantity of dirt was doubled because of the halved concentration. During this later test, the friction clutch through which the media wind-up spool was driven failed at times to transmit enough torque to turn the spool when the differential pressure switch called for a shift of the media. (The low value of pressure drop occurring at about 650 grams of dust per foot of filter width was caused accidentally when a window in the side of the test duct was opened to allow the wind-up spool to be manually started.) Although the cyclic operation of the unit was not as regular in this test as in the earlier test because of the erratic action of the friction clutch, the overall results, as shown in Figure 2, were practically the same.

For a filter of this type, with a filter curtain H feet from top to bottom of the air-passing area, receiving at a face velocity of V fpm an aerosol having a dust concentration of C grams per 1000 cf, the rate of dirt-loading, S , is given by



$$S = \frac{60VHC}{1000} = 0.06 \text{ VHC grams/hr per foot of media width (a)}$$

If T is the average rate of travel of media in feet per hour, the "burden", B, or weight of dust received by a square foot of the media by the time it leaves the air stream, is given by

$$B = \frac{60VHC}{1000T} = 0.06 \frac{VHC}{T} = \frac{S}{T} \quad (b)$$

For the "steady-state" operating condition shown in Figure 2, S/T is given in effect by the inverse slope of the line showing media travel versus total dust received per foot of media width, in appropriate units. Table 2 gives the values of S, T, and B derived from the data plotted in Figure 2 and from the elapsed-time records of the tests, for the "steady-state" operating condition for both aerosol dirt concentrations. It is seen that the value of the burden B is very nearly the same for the tests at the two concentrations.

It would be expected on general grounds that for the same filtering media, face velocity, and aerosol, the burden B would be affected chiefly by the pressure drop at which the unit was operated. However, the fact that almost identical burdens resulted for two dirt concentrations gives support for the use of a relation like equation (b) for making estimates of media usage for various possible values of the dirt concentration C or for units of various heights of exposed filtering blanket. It should be recognized however that B (here about 106 grams/sq. ft.) may have a quite different value for some other operating pressure drop or face velocity, or for some other aerosol.

The results show plainly that for a unit equipped with a differential pressure switch controlling the media shifting mechanism, the use of media is proportional to the concentration or amount of dirt being received. For a unit equipped with a timer-clock, the rate of use of media would be constant and unresponsive to dirt loading rates, and the pressure drop would rise and fall in magnitude with increase or decrease in dirt concentration. It should be noted that excessive slippage of the shift mechanism friction clutch is more serious, as regards proper shifting of the media, with a timer-clock control than with a differential pressure control, since the latter will keep the shift mechanism drive motor energized until the required movement of media results.

The efficiency of the unit appeared to be unaffected by movement of the media during an efficiency measurement. After the unit had been removed from the test duct, the section of the duct five feet long downstream of the flanges, and upstream of a 3/4 inch thick wood strip fastened flat across the bottom of the test duct, was carefully swept out with a fine brush. No observable amount of material was obtained from the duct by this sweeping.

Cellophane tapes, stretched across the test duct with the adhesive side facing upstream, indicated upon visual and microscopic examination after exposure to the air stream that some particles of sizes up to approximately 125 microns had passed through the filter during the dirt-loading tests. Particles smaller than five microns were observed in quantity by microscopic examination of the downstream filter papers obtained in tests with both aerosols. No lint was observed on the tapes during these tests.

The intermittent shifting action of the media occurred without significant noise.



TABLE 1

Initial and Final Performance of Air Filter

<u>Face Velocity</u>	<u>Air Flow</u>	<u>Pressure Drop (1)</u>	<u>Average Efficiency</u>	
			<u>Atmospheric Air</u>	<u>Cottrell Precipitate</u>
fpm	cfm	inch W.G.	percent	percent
200	1000	0.075		
375	1500	.121		
500	2000	.188	11	75
625	2500	.273		
500	2000	.45 ± .04 ²⁾	13 ²⁾	79 ²⁾




1) Resistance of the clean filter.

2) Values for the filter at "steady-state" condition when dirt-loaded with a mixture of 96% Cottrell precipitate and 4% lint by weight.

TABLE 2

Summary of Performance with Cottrell Precipitate at 500 fpm

<u>Condition</u>	<u>Initial</u>	<u>"Steady State"</u>	<u>"Steady State"</u>
Duration, hours	3.2	6.9	9.3
Aerosol conc. (c) gram/1000 cf	1.0	1.0	0.5
Avg. efficiency, percent	74.6	79.2	79.4
Avg. pressure drop, inch W.G.	0.188	0.445	0.452
Pressure drop, avg. max/ avg. min., inch W.G.	-	.485/.407	.489/.416
Rate of dirt ldg. (S), grams/hr. per ft of media width	-	60	30
Rate of travel of media (T), ft/hr	-	0.555	0.285
"Steady-state" burden on media (B) grams/ft ²	-	107.5	105.3

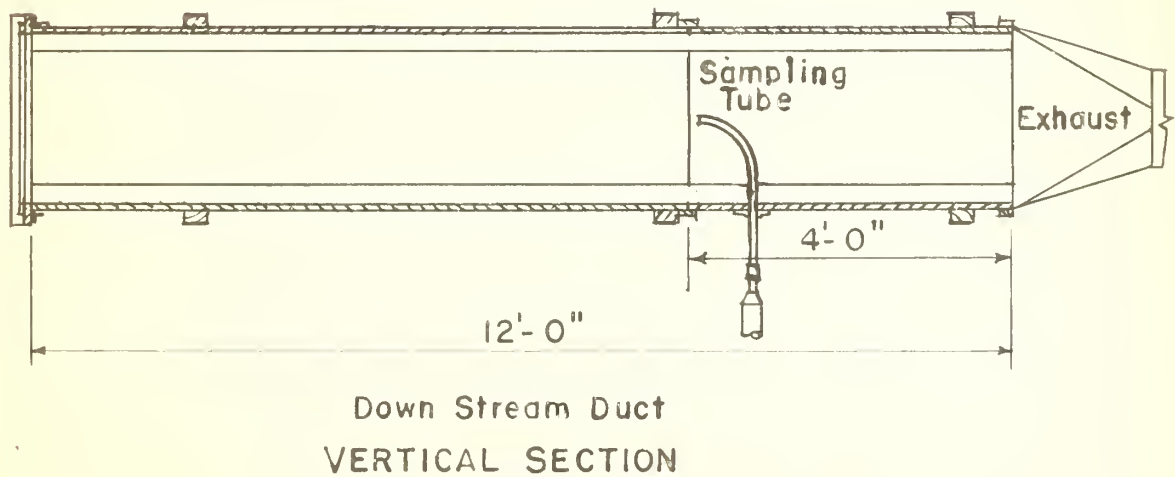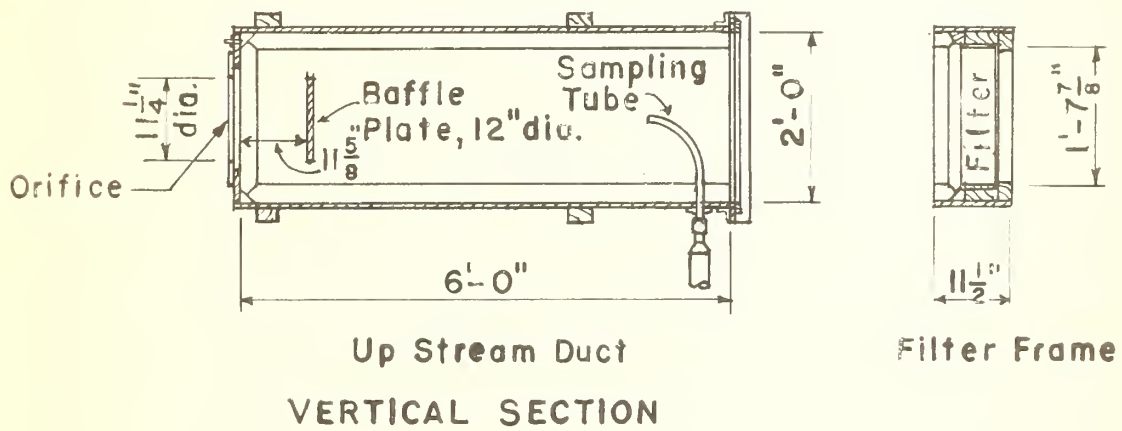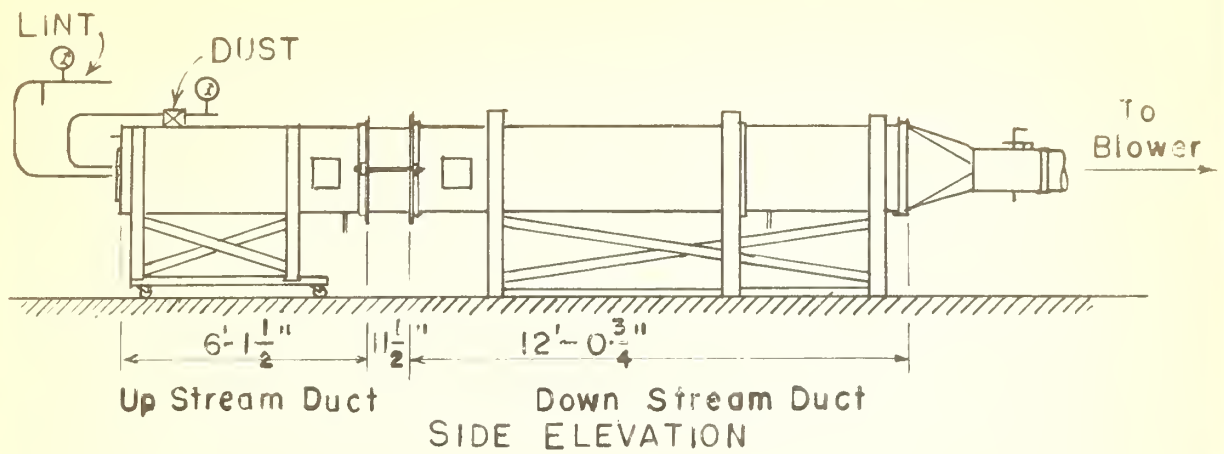

Air Filter Test Apparatus



Figure 1

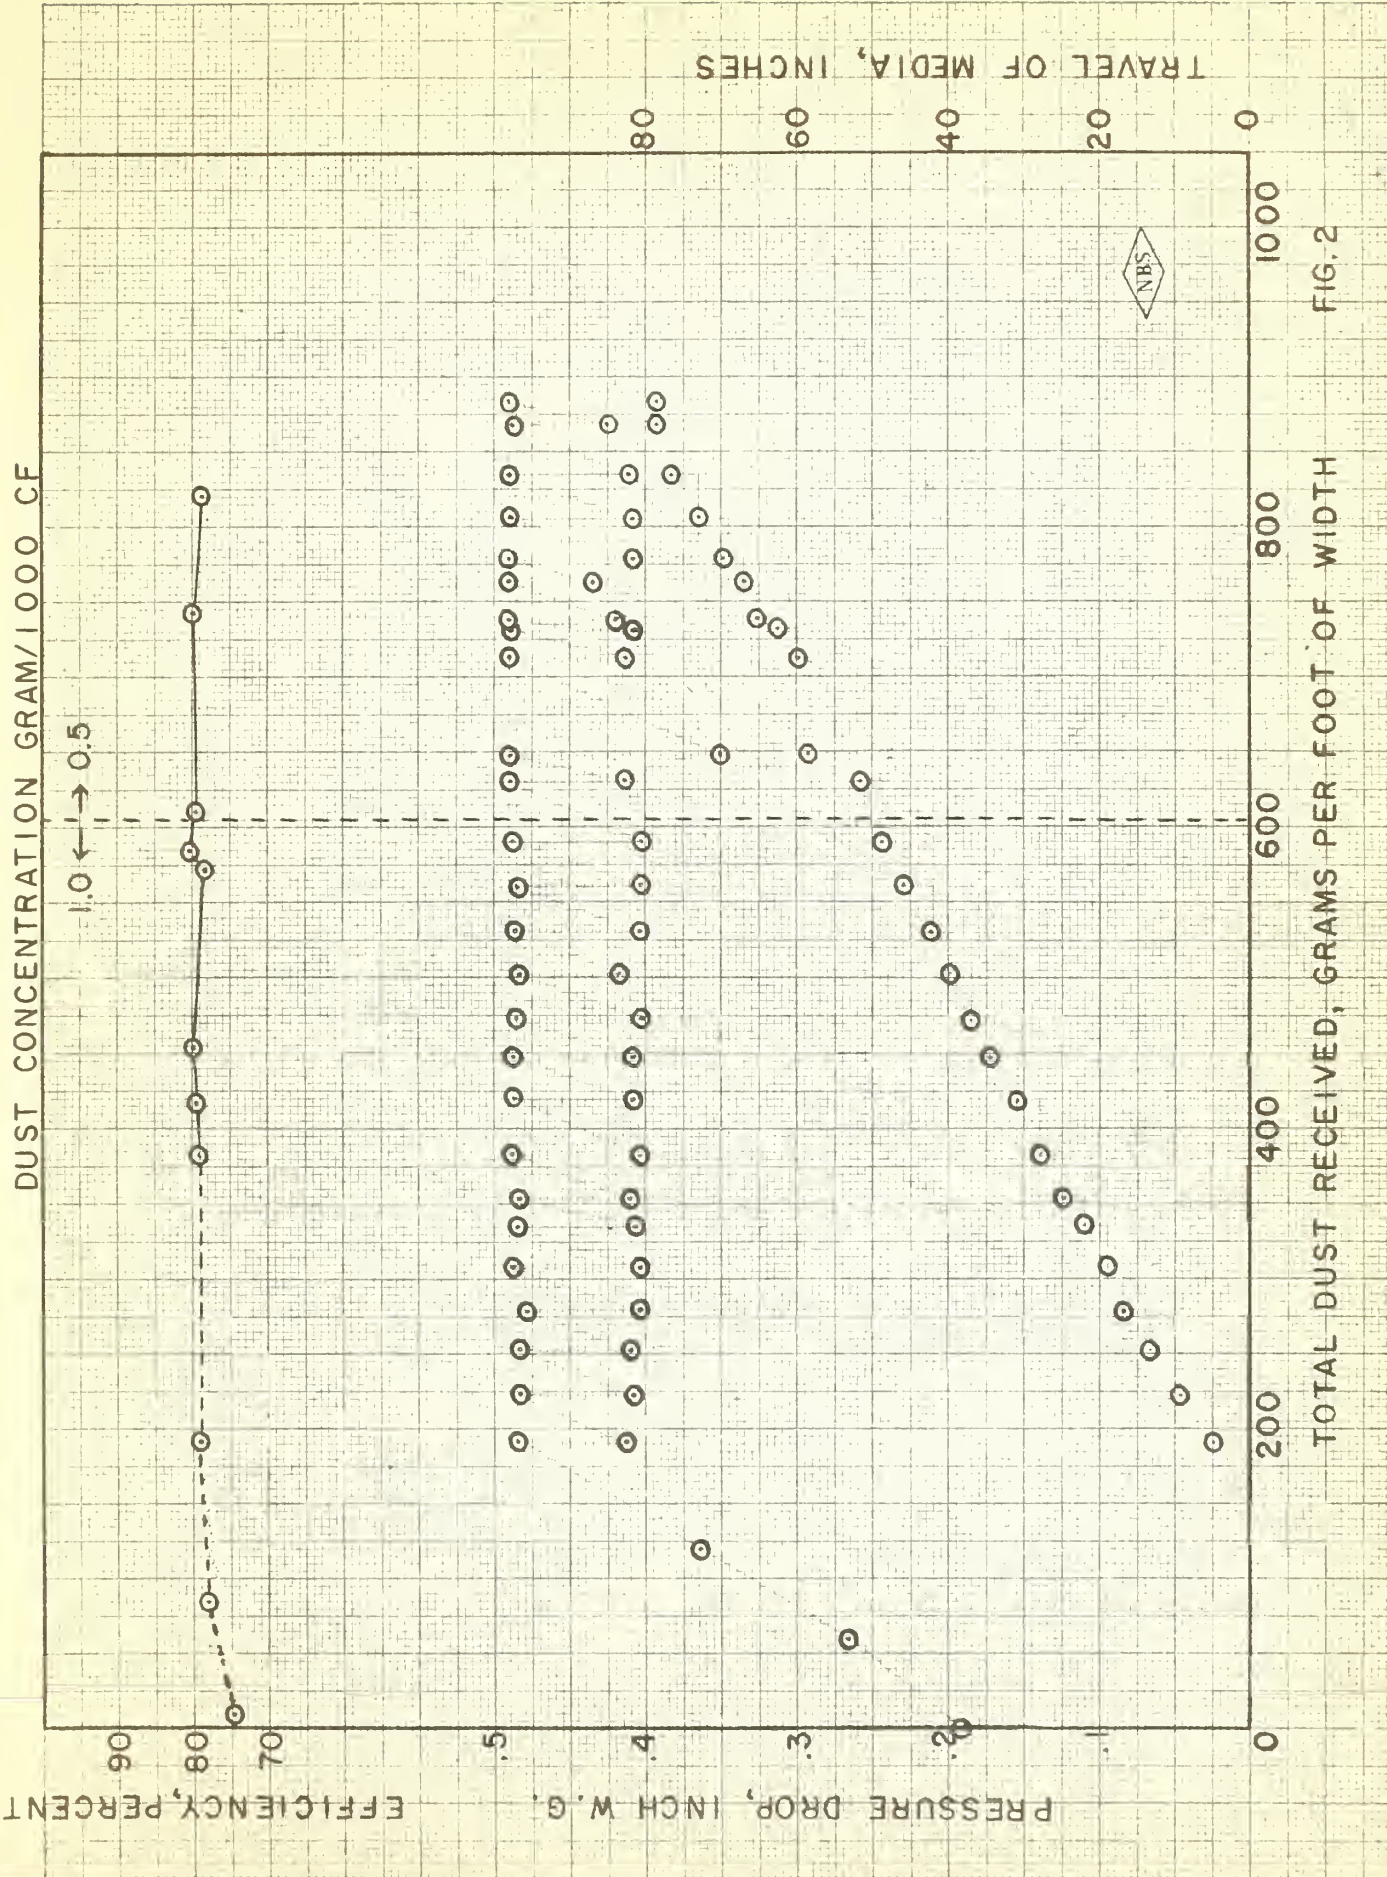


FIG. 2

THE NATIONAL BUREAU OF STANDARDS

Functions and Activities

The functions of the National Bureau of Standards are set forth in the Act of Congress, March 3, 1901, as amended by Congress in Public Law 619, 1950. These include the development and maintenance of the national standards of measurement and the provision of means and methods for making measurements consistent with these standards; the determination of physical constants and properties of materials; the development of methods and instruments for testing materials, devices, and structures; advisory services to Government Agencies on scientific and technical problems; invention and development of devices to serve special needs of the Government; and the development of standard practices, codes, and specifications. The work includes basic and applied research, development, engineering, instrumentation, testing, evaluation, calibration services, and various consultation and information services. A major portion of the Bureau's work is performed for other Government Agencies, particularly the Department of Defense and the Atomic Energy Commission. The scope of activities is suggested by the listing of divisions and sections on the inside of the front cover.

Reports and Publications

The results of the Bureau's work take the form of either actual equipment and devices or published papers and reports. Reports are issued to the sponsoring agency of a particular project or program. Published papers appear either in the Bureau's own series of publications or in the journals of professional and scientific societies. The Bureau itself publishes three monthly periodicals, available from the Government Printing Office: The Journal of Research, which presents complete papers reporting technical investigations; the Technical News Bulletin, which presents summary and preliminary reports on work in progress; and Basic Radio Propagation Predictions, which provides data for determining the best frequencies to use for radio communications throughout the world. There are also five series of nonperiodical publications: The Applied Mathematics Series, Circulars, Handbooks, Building Materials and Structures Reports, and Miscellaneous Publications.

Information on the Bureau's publications can be found in NBS Circular 460, Publications of the National Bureau of Standards (\$1.25) and its Supplement (\$0.75), available from the Superintendent of Documents, Government Printing Office. Inquiries regarding the Bureau's reports and publications should be addressed to the Office of Scientific Publications, National Bureau of Standards, Washington 25, D. C.

