

~~667~~
-73

NATIONAL BUREAU OF STANDARDS REPORT

6938

PERFORMANCE TEST OF A "DUST-GARD"
THROW-AWAY TYPE AIR FILTER

by

Carl W. Coblentz and Paul R. Achenbach

Report to
Public Buildings Service
General Services Administration
Washington 25, D. C.



**U. S. DEPARTMENT OF COMMERCE
NATIONAL BUREAU OF STANDARDS**

FOR OFFICIAL USE ONLY

THE NATIONAL BUREAU OF STANDARDS

Functions and Activities

The functions of the National Bureau of Standards are set forth in the Act of Congress, March 3, 1901, as amended by Congress in Public Law 619, 1950. These include the development and maintenance of the national standards of measurement and the provision of means and methods for making measurements consistent with these standards; the determination of physical constants and properties of materials; the development of methods and instruments for testing materials, devices, and structures; advisory services to government agencies on scientific and technical problems; invention and development of devices to serve special needs of the Government; and the development of standard practices, codes, and specifications. The work includes basic and applied research, development, engineering, instrumentation, testing, evaluation, calibration services, and various consultation and information services. Research projects are also performed for other government agencies when the work relates to and supplements the basic program of the Bureau or when the Bureau's unique competence is required. The scope of activities is suggested by the listing of divisions and sections on the inside of the back cover.

Publications

The results of the Bureau's work take the form of either actual equipment and devices or published papers. These papers appear either in the Bureau's own series of publications or in the journals of professional and scientific societies. The Bureau itself publishes three periodicals available from the Government Printing Office: The Journal of Research, published in four separate sections, presents complete scientific and technical papers; the Technical News Bulletin presents summary and preliminary reports on work in progress; and Basic Radio Propagation Predictions provides data for determining the best frequencies to use for radio communications throughout the world. There are also five series of nonperiodical publications: Monographs, Applied Mathematics Series, Handbooks, Miscellaneous Publications, and Technical Notes.

Information on the Bureau's publications can be found in NBS Circular 460, Publications of the National Bureau of Standards (\$1.25) and its Supplement (\$1.50), available from the Superintendent of Documents, Government Printing Office, Washington 25, D.C.

NATIONAL BUREAU OF STANDARDS REPORT

NBS PROJECT

NBS REPORT

1003-30-10630

August 17, 1960

6938

PERFORMANCE TEST OF A "DUST-GARD" THROW-AWAY TYPE AIR FILTER

by

Carl W. Coblentz and Paul R. Achenbach
Air Conditioning, Heating, and Refrigeration Section
Building Technology Division

to
Public Buildings Service
General Services Administration
Washington 25, D. C.

IMPORTANT NOTICE

NATIONAL BUREAU OF ST/
Intended for use within the
to additional evaluation and r
listing of this Report, either
the office of the Director, Na
however, by the Government
to reproduce additional copie

Approved for public release by the
Director of the National Institute of
Standards and Technology (NIST)
on October 9, 2015.

regress accounting documents
mally published it is subjected
reproduction, or open-literature
ion is obtained in writing from
Such permission is not needed,
prepared if that agency wishes



U. S. DEPARTMENT OF COMMERCE
NATIONAL BUREAU OF STANDARDS
FOR OFFICIAL USE ONLY

PERFORMANCE TEST OF A "DUST-GARD"
THROW-AWAY TYPE AIR FILTER

by

C. W. Coblentz and P. R. Achenbach

1. Introduction

At the request of the Public Buildings Service, General Services Administration, the performance characteristics of a throw-away type air filter, identified by the trade name "Dust-Gard," were determined. The scope of this examination included determination of the arrestance of Cottrell precipitate, pressure drop, and dust-holding capacity at 370 ft/min face velocity of specimens with nominal thicknesses of 1 and 2 inches. As part of an investigation made by the National Bureau of Standards for the Department of Defense, the same performance examinations were also made at a face velocity of 540 ft/min.

2. Description of Test Specimens

The test specimens were supplied by the U. S. Gypsum Company, of Wabash, Indiana. The nominal size of these filters was 20 x 20 inches and 2 in. and 1 in. thick, respectively. The filter medium was made of glass fibers and held in a cardboard frame with channel-shaped cross section. The face of the filters was 17 5/8 in. square, offering a net face area of 2.16 square feet. The weight of the clean 2-in. filter was 482 grams and that of the 1-in. filter was 380 grams (17 oz and 13 1/2 oz, respectively). The filters were sprayed at the factory with an adhesive.

3. Test Method and Procedure

Arrestance determinations were made with the NBS "Dust Spot Test Method" using Cottrell precipitate as the aerosol. The test method is described in a paper entitled, "A Test Method for Air Filters," by R. S. Dill (ASHVE Transactions, Vol. 44, p. 379, 1938).

The filters were placed in a frame, sealed to prevent any by-pass of air, and then installed in the test apparatus. During the test, samples of air were drawn from the center points of the test duct 1 ft upstream and 8 ft downstream of the test specimen at equal rates and passed through known areas of Whatman No. 41 filter paper. The ratios of the upstream and downstream filter paper areas were selected to

obtain a similar increase of opacity. The change of opacity of these areas was determined with a sensitive photometer which measured the light transmission of the same spot on each sampling paper before and after the test. The two sampling papers used for each test were selected to have the same light transmission readings when clean. Air was drawn through both samplers while measured amounts of Cottrell precipitate were introduced into the test apparatus. The arrestance, A (in percent), was then computed by the following formula:

$$A = 100 - \frac{S_D}{S_U} \times \frac{\Delta D}{\Delta U} \times 100$$

where S_D and S_U are the respective downstream and upstream filter sampling paper areas and ΔD and ΔU the respective changes in opacity of the sampling papers. The aerosol used for the arrestance determination was Cottrell precipitate, which had been previously sifted through a 100-mesh wire screen. In order to simulate actual operating conditions when loading the filter, 4 percent by weight of No. 7 cotton linters, previously ground in a Wiley mill with a 4-millimeter screen, were introduced simultaneously with the Cottrell precipitate. Whereas the arrestance measurements were made with Cottrell precipitate only, the cotton linters were added during the loading process and a sufficient amount was included to obtain an overall weight ratio of 96 to 4 parts by weight, including that portion of Cottrell precipitate which was used for arrestance determinations.

Arrestance determinations were made at the beginning and at the end of the loading period for each filter at each face velocity. Also, additional arrestance determinations were made at selected intervals while the filter was being loaded.

The pressure drop across the filter under test was recorded at the beginning of the test and after each increment of 20 grams of Cottrell precipitate were introduced into the test apparatus. The filters were loaded with a dust concentration of approximately 1 gram per 1000 cu ft of air until the pressure drop reached 0.5 in. W.G. for the test conducted at 370 ft/min face velocity, and 0.8 in. W.G. for the test conducted at 540 ft/min face velocity.

4. Test Results

Tables 1 to 4 show the observed pressure drop, arrestance, and dust loads of the filters. The dust load per square foot net face area at the reported intervals is the weight of dust and lint introduced into the test apparatus, diminished by the fallout in the upstream portion of the test duct during that interval, divided by the net face area of the filter. The total fallout was determined at the end of each test by weighing the dust swept out of the upstream portion of the test duct. For computing the dust load per square foot net face area, the amount of dust and lint introduced into the test apparatus was multiplied by 1 minus the ratio of fallout to the total dust introduced, and divided by the net face area of the filter, according to the following formula:

$$L = \frac{D \times (1 - F)}{A}$$

where L = dust load, grams per square foot
D = dust and lint introduced, grams
A = net filter area, square feet
F = $\frac{\text{total fallout}}{\text{total dust and lint introduced}}$

The values shown in Tables 1 to 4 are graphically presented in Fig. 1 and 2, and smooth curves that approximate the curves of the least mean square distances of the individual points of observation have been fitted to the data. It will be noted that the dust-holding capacity, i.e., the dust load at final pressure drop, of the 1-in. filter was considerably lower than that of the 2-in. filter, at both air velocities, whereas the arrestances of both filters were similar. Table 5 summarizes the test results for both filter thicknesses and face velocities. The dust-holding capacity shown in this table is that dust load which, according to the graph or test results, was reached at the final pressure drop of 0.5 to 0.8 in. W.G., respectively. Also shown in this table are the mean arrestances for each filter under the various test conditions, during the period in which the capacity dust load was accumulated. These values were obtained by drawing horizontal lines through the arrestance curves in Fig. 1 and 2, which would give the same areas between the curves and the lines above and below.

The initial pressure drop increased from 0.086 in. W.G. across the 1-in. thick filter and 0.107 in. W.G. across the 2-in. thick filter to 0.156 in. W.G. and 0.196 in. W.G., respectively, with an increase in face velocity from 370 ft/min

to 540 ft/min, an increase of approximately 90 percent in each case. The dust-holding capacity of the 1-in. thick filter decreased from 190 g/sq ft to 173 g/sq ft when the air velocity was raised from 370 ft/min to 540 ft/min, whereas the dust-holding capacity of the 2-in. thick filter slightly increased, from 254 to 264 g/sq ft, with the increase of the face velocity.

The arrestance values determined for the clean filters ranged from 58 percent to 63 percent and increased from 77 to 79 percent when the filters were loaded to their final pressure drop. The average arrestance for all four test conditions was between 72 and 73 percent. Except for the increase of the arrestance value due to the dust load, which is to be expected with this type of filter, there was no significant difference of the arrestance in either of the test conditions.

Table 1

Performance of
U.S. Gypsum Co. "Dust-Gard" 1-in. Thick Air Filter
(Face Velocity, 370 ft/min. Aerosol, Cottrell Precipitate)

<u>Dust Load</u> g/sq ft	<u>Pressure Drop</u> in. W. G.	<u>Arrestance</u> %
0	0.086	-
4	0.091	58
57	0.194	72
110	0.304	75
154	0.411	77
190	0.505	78

Table 2

Performance of
U.S. Gypsum Co. "Dust-Gard" 1-in. Thick Air Filter
(Face Velocity, 540 ft/min. Aerosol, Cottrell Precipitate)

<u>Dust Load</u> g/sq ft	<u>Pressure Drop</u> in. W. G.	<u>Arrestance</u> %
0	0.156	-
4	0.164	63
60	0.357	70
117	0.535	77
173	0.800	79

Table 3

Performance of
U.S. Gypsum Co. "Dust-Gard" 2-in. Thick Air Filter
(Face Velocity, 370 ft/min. Aerosol, Cottrell Precipitate)

<u>Dust Load</u> g/sq ft	<u>Pressure Drop</u> in. W. G.	<u>Arrestance</u> %
0	0.107	-
4	0.110	61
48	0.186	72
92	0.245	75
136	0.296	75
180	0.357	76
251	0.492	78

Table 4

Performance of
U.S. Gypsum Co. "Dust-Gard" 2-in. Thick Air Filter
(Face Velocity 540 ft/min. Aerosol, Cottrell Precipitate)

<u>Dust Load</u> g/sq ft	<u>Pressure Drop</u> in. W. G.	<u>Arrestance</u> %
0	0.196	-
4	0.203	59
60	0.357	71
117	0.469	71
175	0.594	74
228	0.699	76
264	0.801	77

Table 5

Summary of Test Results on
"Dust-Gard" Throw-away Air Filters

Thickness of Filter, inch	1		2	
	370	540	370	540
Final Pressure Drop, in. W.G.	0.5	0.8	0.5	0.8
Initial Pressure Drop, in. W.G.	0.086	0.156	0.107	0.196
Dust-Holding Capacity, g/sq ft	190	173	254	264
Initial Arrestance, %	58	63	61	59
Average Arrestance, %	72	73	73	72
Final Arrestance, %	78	79	78	77

U. S. GYPSUM COMPANY, "DUST-GARD"

1-in. thick

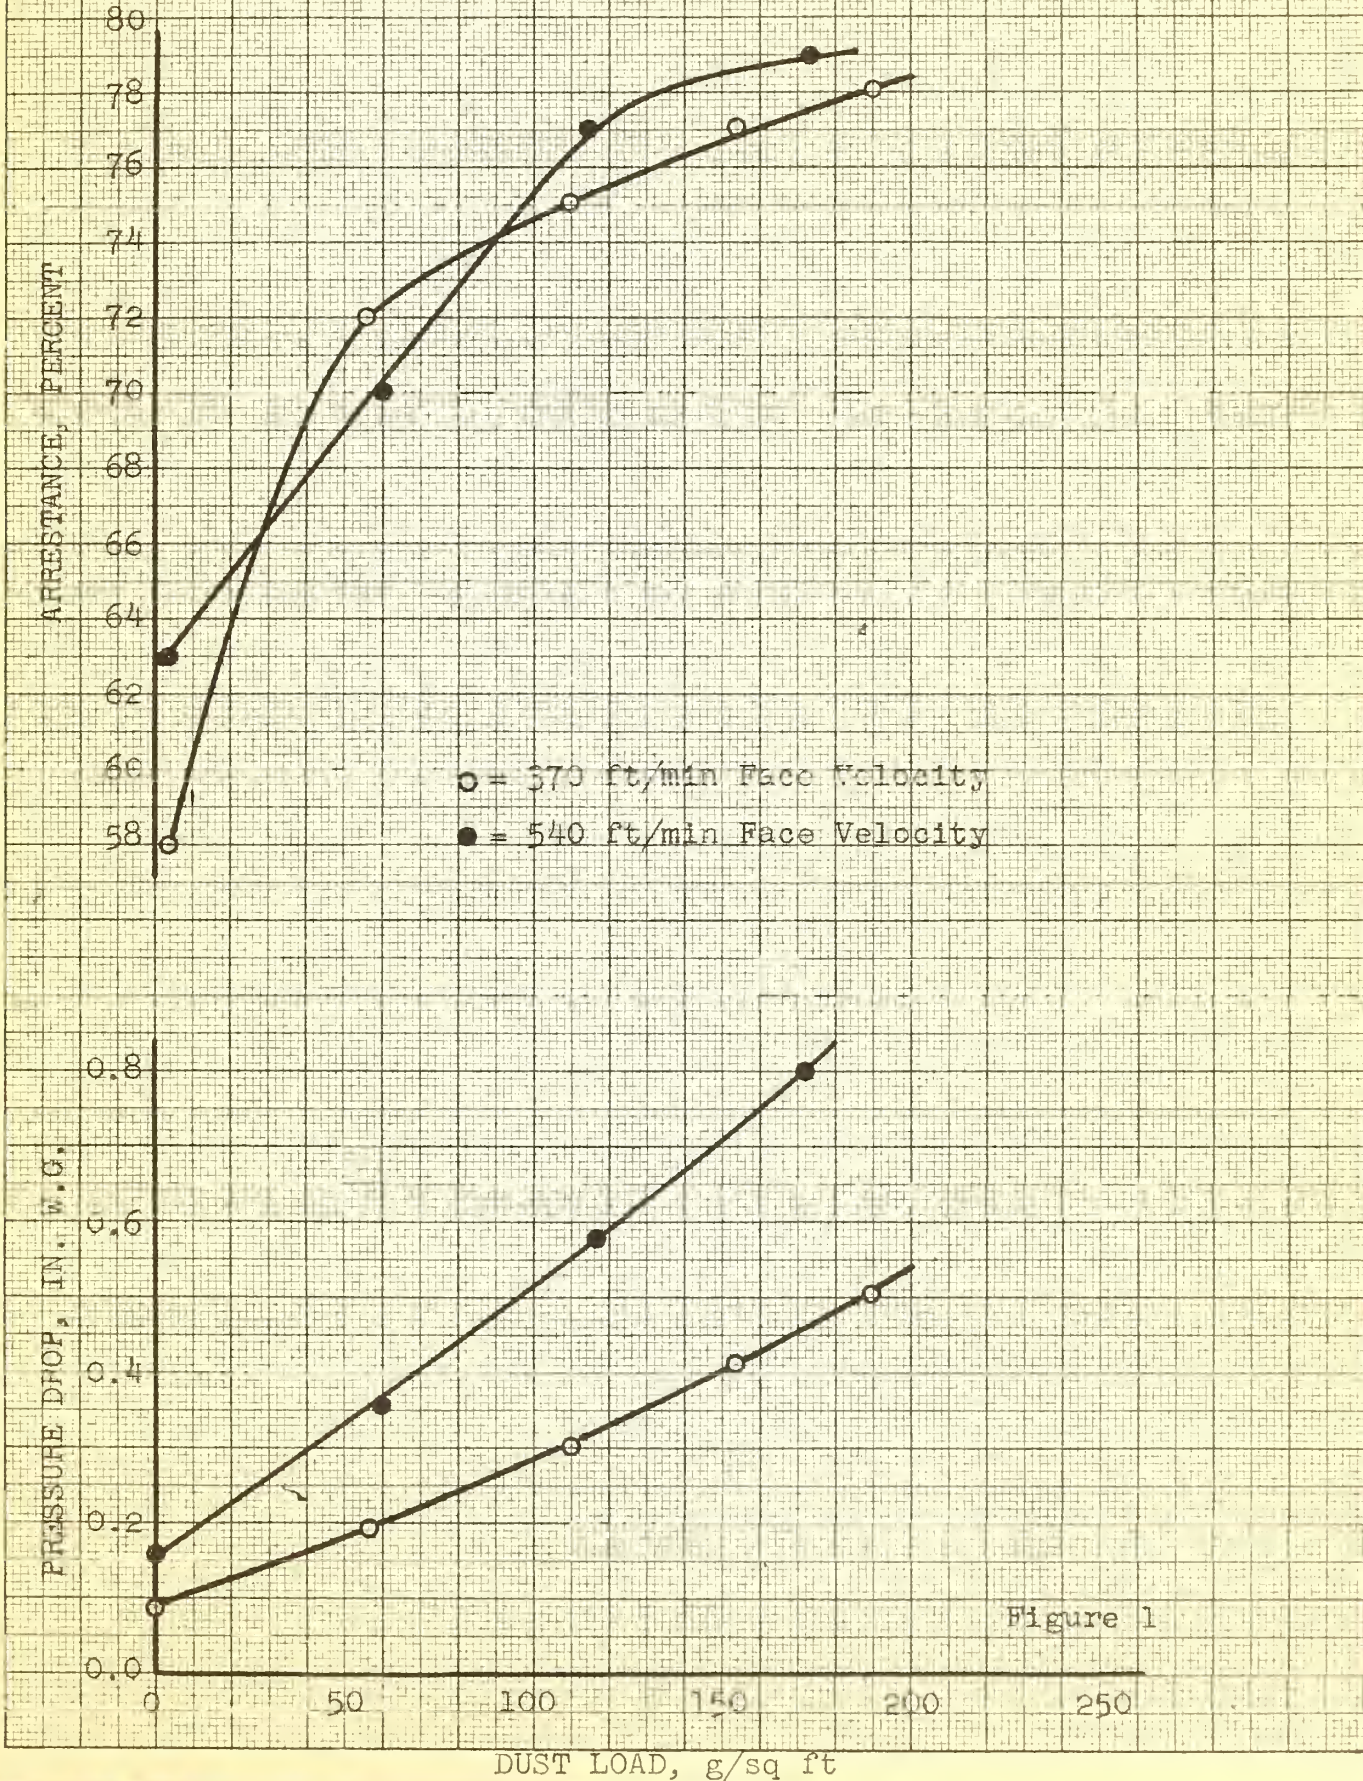



Figure 1

K&ECCO., N.Y. 65216



U. S. GYPSUM COMPANY, "DUST-GARD"

2-in. thick

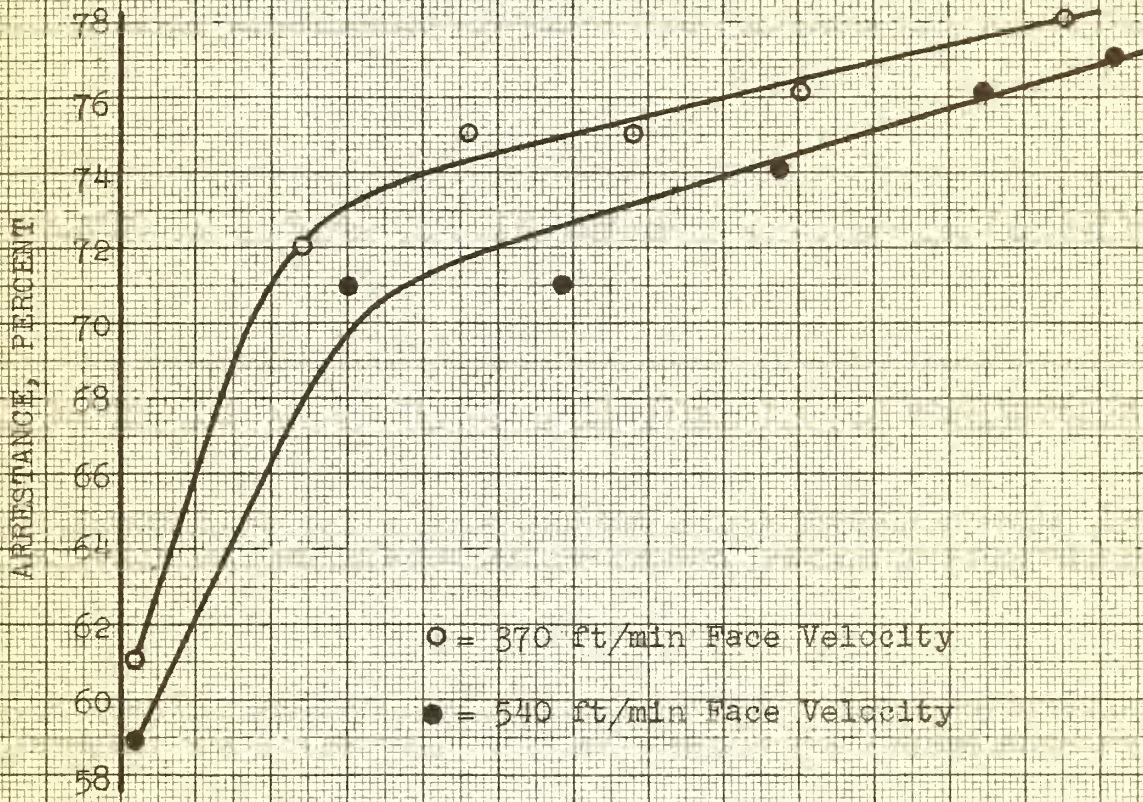

○ = 370 ft/min Face Velocity
● = 540 ft/min Face Velocity

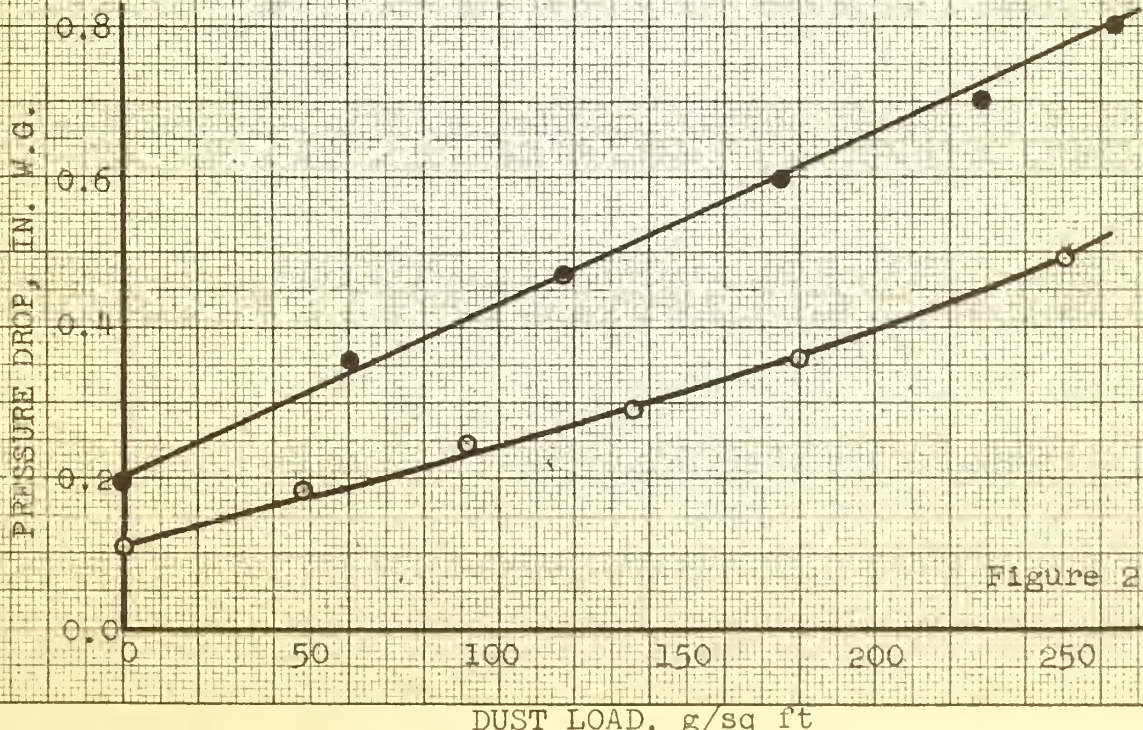


Figure 2

BS-G 48 C
K RECO. N.Y. 65216

U.S. DEPARTMENT OF COMMERCE

Frederick H. Mueller, *Secretary*

NATIONAL BUREAU OF STANDARDS

A. V. Astin, *Director*



THE NATIONAL BUREAU OF STANDARDS

The scope of activities of the National Bureau of Standards at its major laboratories in Washington, D.C., and Boulder, Colorado, is suggested in the following listing of the divisions and sections engaged in technical work. In general, each section carries out specialized research, development, and engineering in the field indicated by its title. A brief description of the activities, and of the resultant publications, appears on the inside of the front cover.

WASHINGTON, D.C.

Electricity and Electronics. Resistance and Reactance. Electron Devices. Electrical Instruments. Magnetic Measurements. Dielectrics. Engineering Electronics. Electronic Instrumentation. Electrochemistry.

Optics and Metrology. Photometry and Colorimetry. Photographic Technology. Length. Engineering Metrology.

Heat. Temperature Physics. Thermodynamics. Cryogenic Physics. Rheology. Molecular Kinetics. Free Radicals Research.

Atomic and Radiation Physics. Spectroscopy. Radiometry. Mass Spectrometry. Solid State Physics. Electron Physics. Atomic Physics. Neutron Physics. Radiation Theory. Radioactivity. X-rays. High Energy Radiation. Nucleonic Instrumentation. Radiological Equipment.

Chemistry. Organic Coatings. Surface Chemistry. Organic Chemistry. Analytical Chemistry. Inorganic Chemistry. Electrodeposition. Molecular Structure and Properties of Gases. Physical Chemistry. Thermochemistry. Spectrochemistry. Pure Substances.

Mechanics. Sound. Mechanical Instruments. Fluid Mechanics. Engineering Mechanics. Mass and Scale. Capacity, Density, and Fluid Meters. Combustion Controls.

Organic and Fibrous Materials. Rubber. Textiles. Paper. Leather. Testing and Specifications. Polymer Structure. Plastics. Dental Research.

Metallurgy. Thermal Metallurgy. Chemical Metallurgy. Mechanical Metallurgy. Corrosion. Metal Physics.

Mineral Products. Engineering Ceramics. Glass. Refractories. Enameled Metals. Constitution and Microstructure.

Building Technology. Structural Engineering. Fire Protection. Air Conditioning, Heating, and Refrigeration. Floor, Roof, and Wall Coverings. Codes and Safety Standards. Heat Transfer. Concrete Materials.

Applied Mathematics. Numerical Analysis. Computation. Statistical Engineering. Mathematical Physics.

Data Processing Systems. SEAC Engineering Group. Components and Techniques. Digital Circuitry. Digital Systems. Analog Systems. Application Engineering.

• Office of Basic Instrumentation.

• Office of Weights and Measures.

BOULDER, COLORADO

Cryogenic Engineering. Cryogenic Equipment. Cryogenic Processes. Properties of Materials. Gas Liquefaction.

Radio Propagation Physics. Upper Atmosphere Research. Ionospheric Research. Regular Propagation Services. Sun-Earth Relationships. VLF Research. Radio Warning Services. Airglow and Aurora. Radio Astronomy and Arctic Propagation.

Radio Propagation Engineering. Data Reduction Instrumentation. Modulation Research. Radio Noise. Tropospheric Measurements. Tropospheric Analysis. Propagation Obstacles Engineering. Radio-Meteorology. Lower Atmosphere Physics.

Radio Standards. High Frequency Electrical Standards. Radio Broadcast Service. High Frequency Impedance Standards. Electronic Calibration Center. Microwave Physics. Microwave Circuit Standards.

Radio Communication and Systems. Low Frequency and Very Low Frequency Research. High Frequency and Very High Frequency Research. Ultra High Frequency and Super High Frequency Research. Modulation Research. Antenna Research. Navigation Systems. Systems Analysis. Field Operations.

